



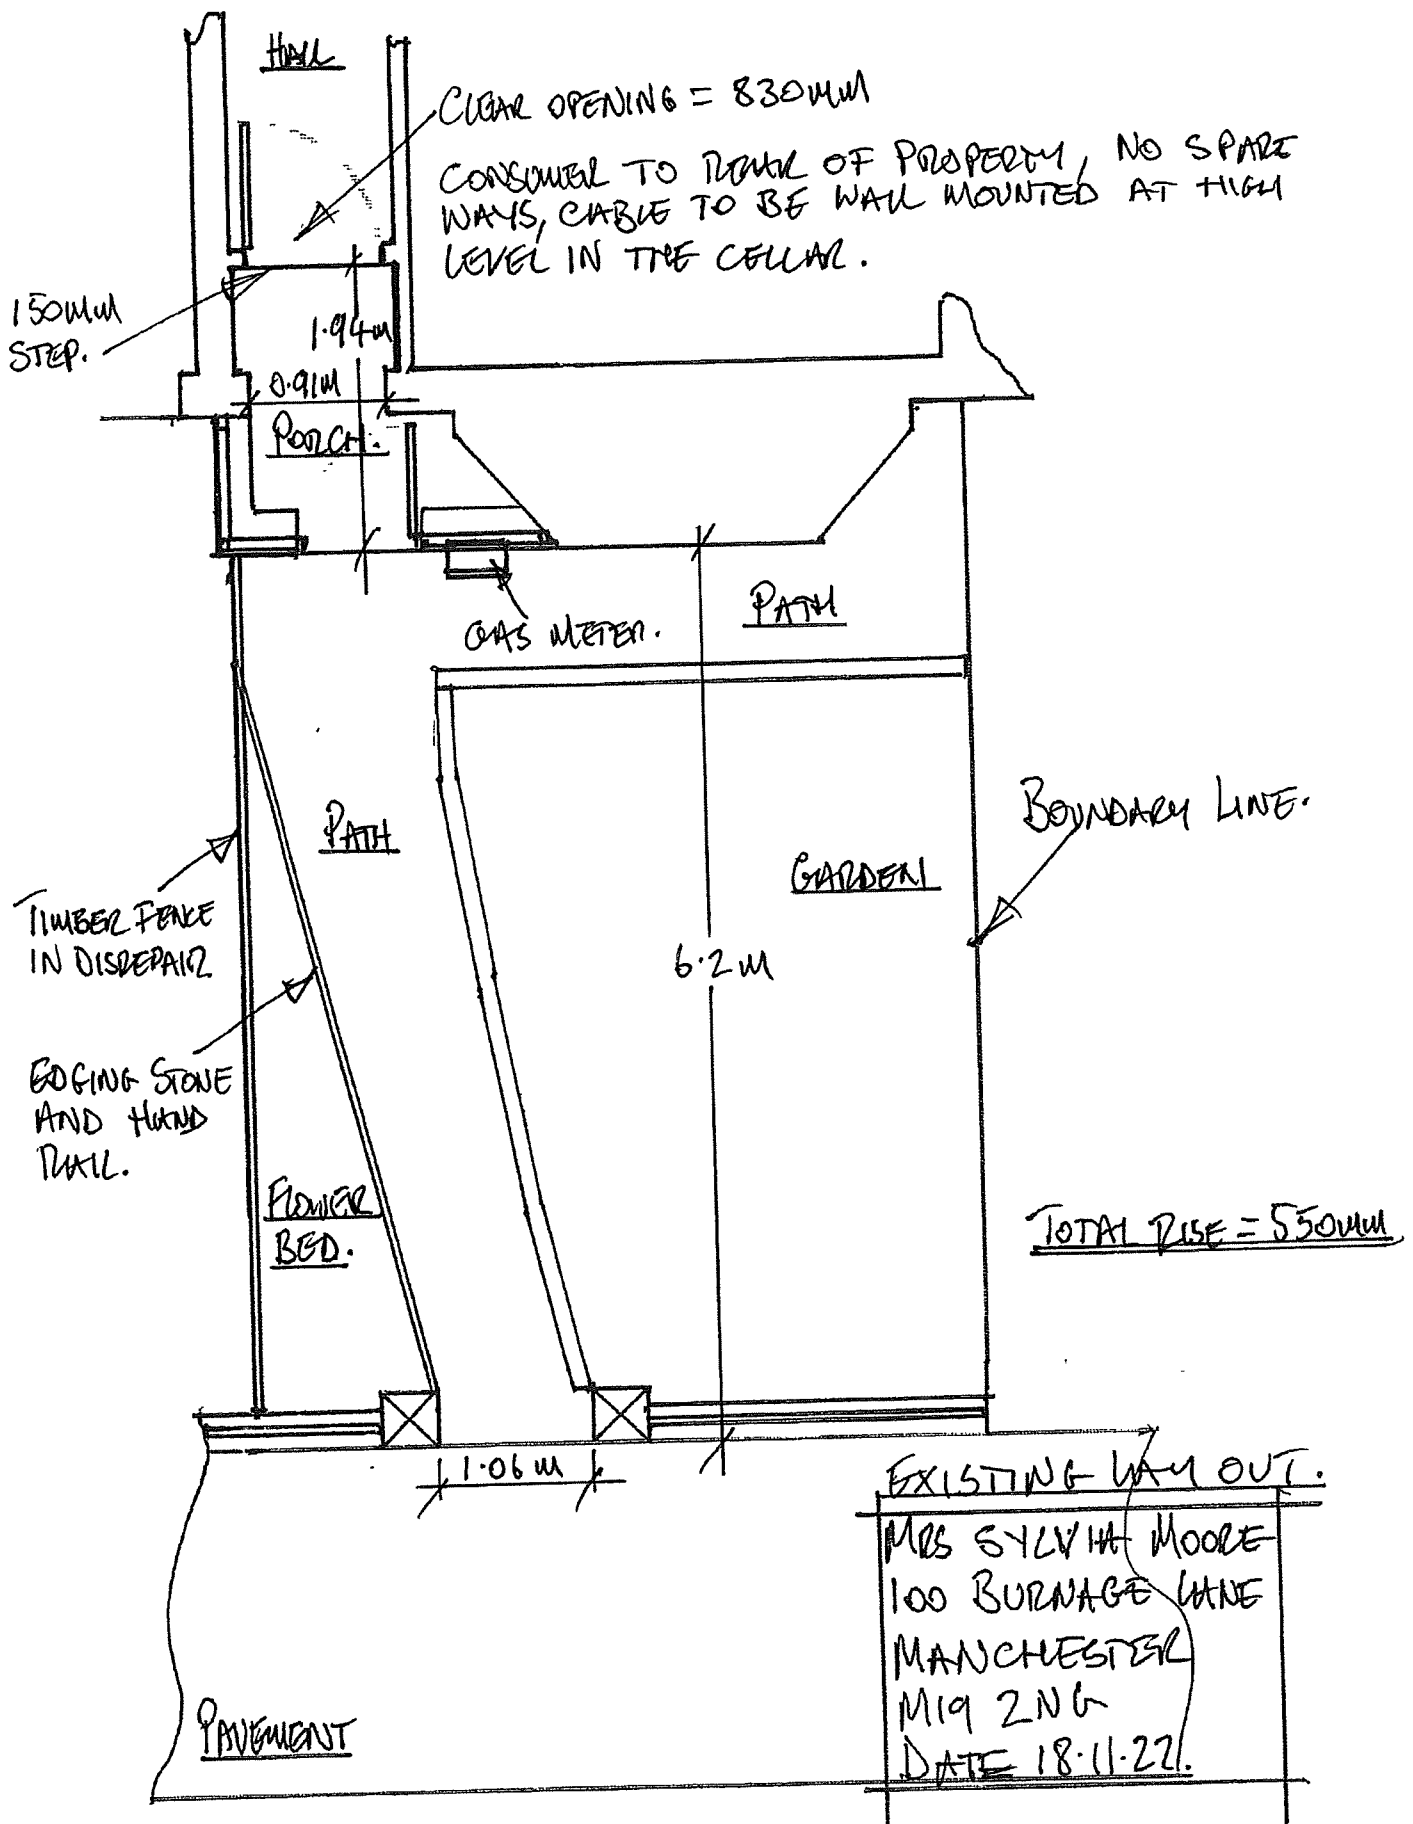

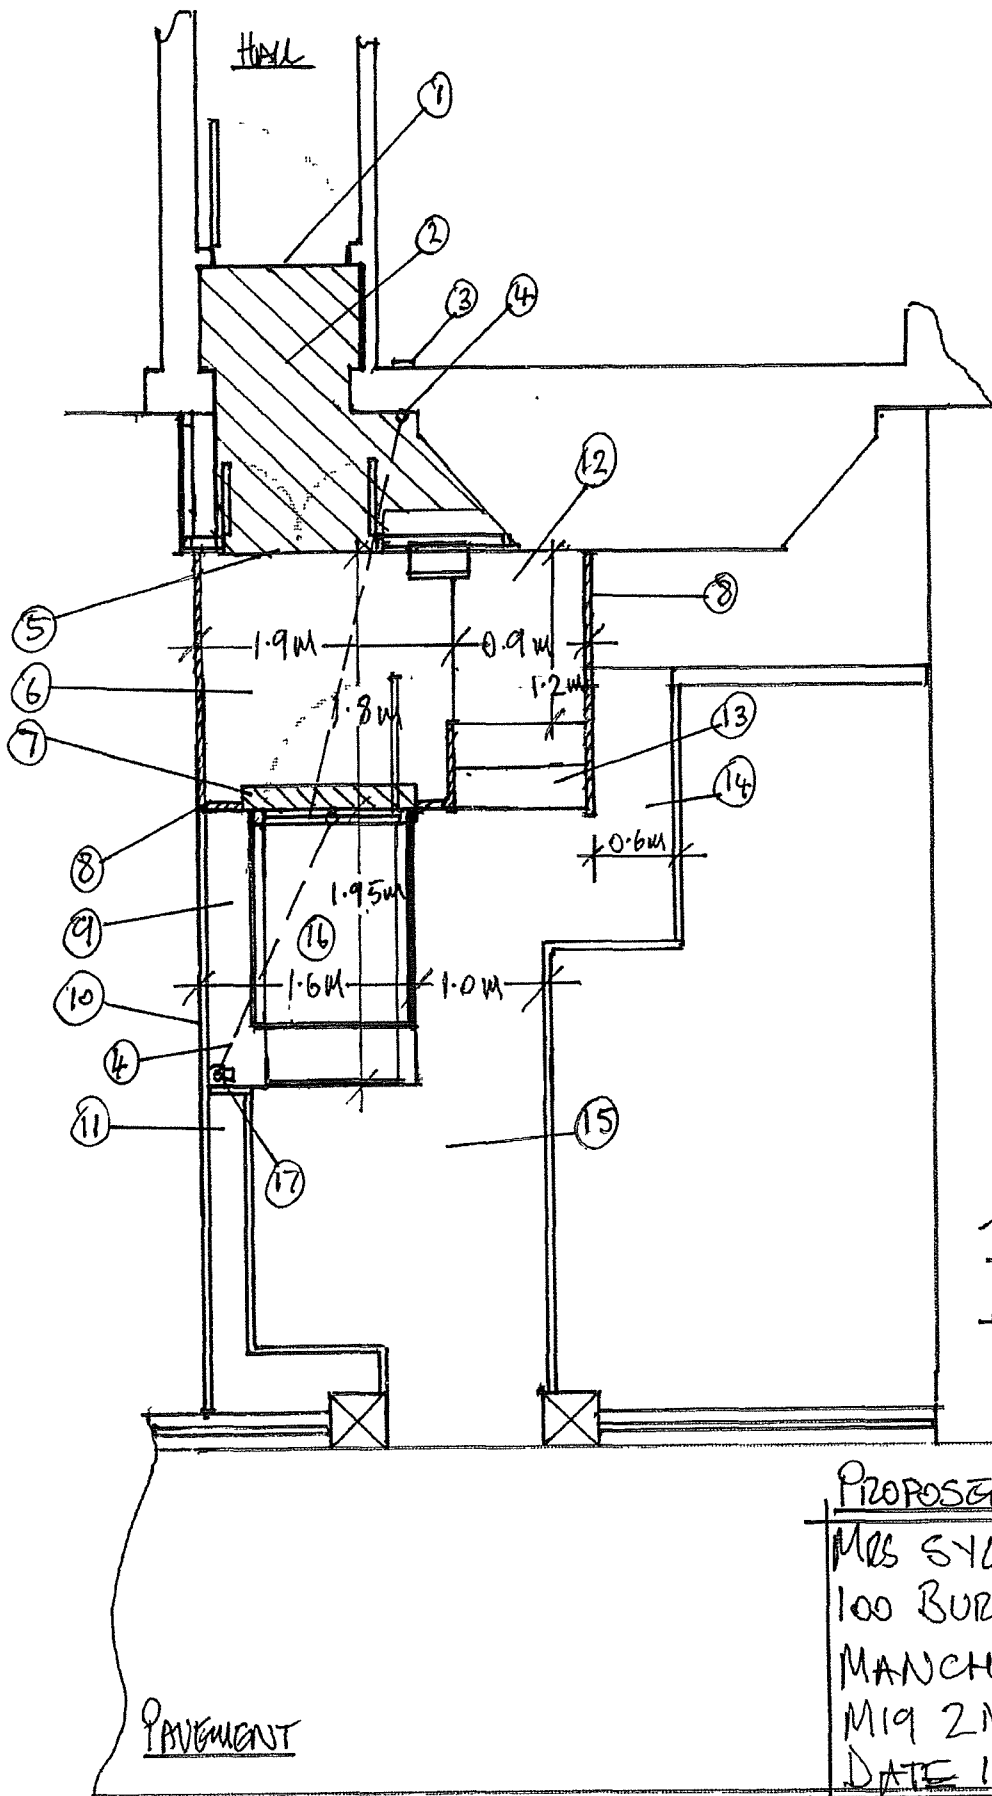




TOTAL RISE = 550mm
 LIFT RISE = 500mm

PROPOSED LAYOUT

MRS SYLVIA MOORE
 100 BURNAGE LANE
 MANCHESTER
 M19 2NG
 DATE 18.11.22.

ADJACENT SURFACE DISTANCE BS6440:2011			
GAP BETWEEN THE WALLS OF THE LIFT	MINIMUM GAP	MAXIMUM GAP	ADJACENT SURFACE DISTANCE
<10	✓	✓	✓
>10 - <100	✓	✓	✓
>100 - <300	✓	✓	✓
>300	✓	✓	✓

Table A

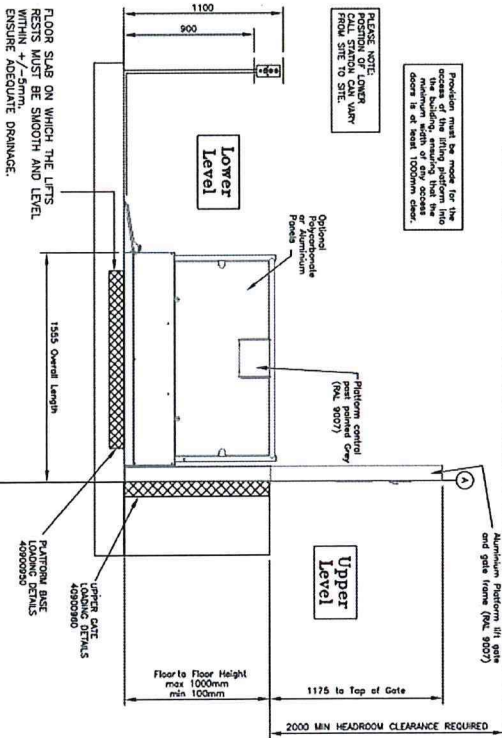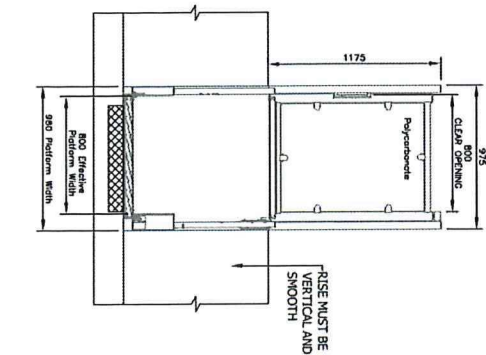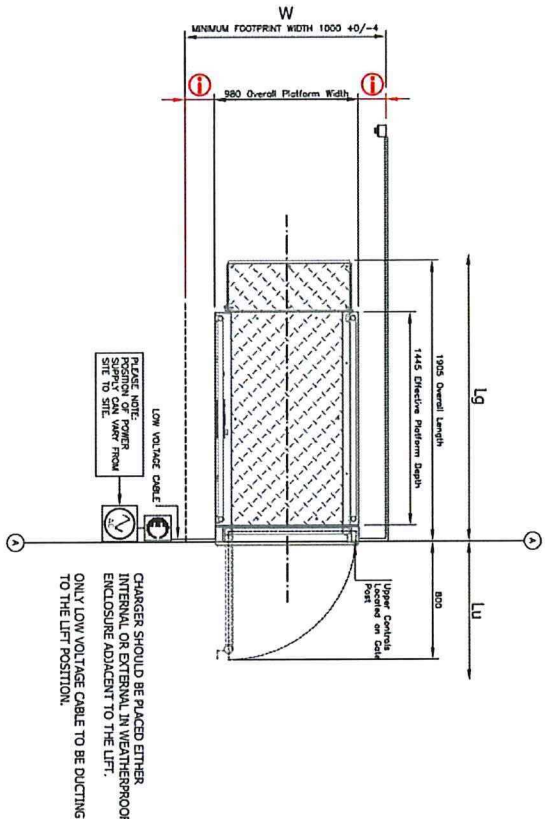

NOTE: TO ensure that the lift is safe to use, the customer should ensure that the lift is installed in a suitable location and that the lift is used in accordance with the instructions.

SITE DIMENSIONS

Minimum Footprint Width (W)	1000mm
Minimum Ground Footprint Length (Lg)*	3405mm
Minimum Upper Footprint Length (Lu)*	1500mm

*Including 1500mm TURNING CYCLE

FOR EXTERNAL LIFT POWER SUPPLY NEED TO BE LOCATED INSIDE BUILDING AND DUCTED TO LIFT POSITION

BUILDERS WORK AND GENERAL NOTES - STEP LIFT

- The customer is responsible for carrying out the work below. These are required for the lift to comply with the Supply of Machinery (Safety) Regulations 1992. If any points are not clear, please contact Pollocklifts without delay.
- GENERAL
 - Clear access into and through the building for the passage of the lift equipment and personnel must be maintained.
 - Building materials and store in a suitable dry and secure location within 5m of intended lift site. Parts should be handled with care and slung correctly to avoid damaging components and decorative finishes. Parts may become damaged by storage outside or in damp conditions.
- DIMENSIONS AND TOLERANCES
 - Do not scale from the drawings. All dimensions are in millimetres except where otherwise stated. All dimensions are to be measured from datum line AA.
 - LIFT AREA
 - Floor and side walls in the area where the platform lift is to be located must be firm, smooth level, suitably drained and have no projections or recesses across their face. Any walls surrounding the lift should be positioned as per Table A away from the lift edges in order to eliminate tripping hazards.
 - Make good where necessary around the platform lift and its associated equipment after they are finally positioned and fixed.
 - ELECTRICAL WORKS
 - Provide a 230V, phase, 50 hertz, 3 wire permanent supply terminating in a fused spur, 13A within 1.5m of the lift (which is to be marked with a 20A warning label) and a 5A changeover switch (type 'T' or equivalent) to BS58 Part 2.
 - For external installation it is recommended that lighting is provided controlled by PIR's.
 - The electrical work must comply with the latest revision of the IEE Wiring Regulations.
 - It is recommended that the supply is protected by a suitable RCD.
 - Where flush / surface mounted coil stations are required, walls should be chased out prior to lift installation to allow for mounting of cable conduit and coil ponds. Client to make good after lift commissioning.

BUILDING WORK REQUIRED

- 1-.....
- 2-.....
- 3-.....
- 4-.....
- 5-.....
- 6-.....

APPROVED WORKING DRAWING

BY:..... COMP:.....

SIGNED:..... DATE:.....

NOTE: THE ABOVE BUILDING WORK MUST BE CARRIED OUT PRIOR TO THE LIFT INSTALLATION

LIFT DATA

PLATFORM SIZE	800W	THROUGH ACCESS	COLOUR 9007	FLOOR MOUNTED
UPPER GATE HANDED	LH	ALUMINIUM GLAZED	COLOUR 9007	
LOWER GATE HANDED	N/A	-----		
LOWER LEVEL RAMP	ON BOARD RAMP			
TRAVEL	(MIN 250mm MAX 1000mm)			mm TBC



UNIT 1 SLOEFIELD DRIVE
CARRICKFERGUS
COUNTY ANTRIM
NORTHERN IRELAND
BT38 8GX
TEL: 00 44 (0) 28 93368167
WEB: WWW.POLLOCKLIFTS.CO.UK

UNIT: STEEP LIFT


NAME: CLASSIC 800W LH Upper Gate - On Board Ramp

40900255


Change History Record

Issue	CHANGE No.	DATE	INITIALS
A	-----	27/01/14	TL
B	-----	01/07/14	TL
C	-----	24/02/20	TL

1m Steplift 800W
1m Steplift 900W

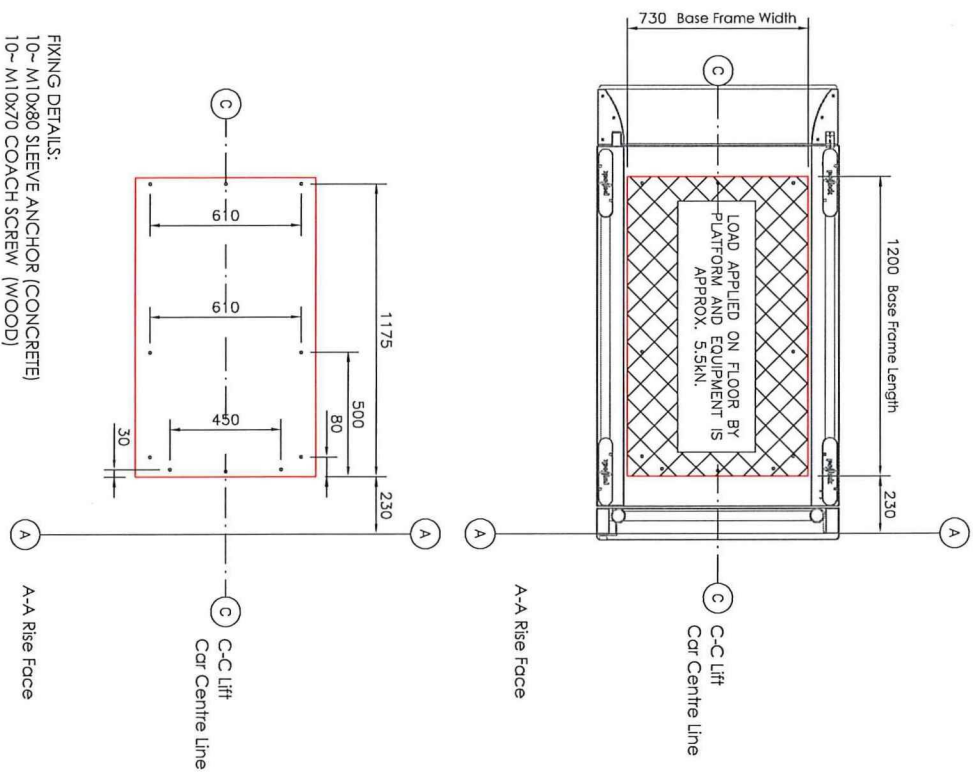



Im Steplift 1100W

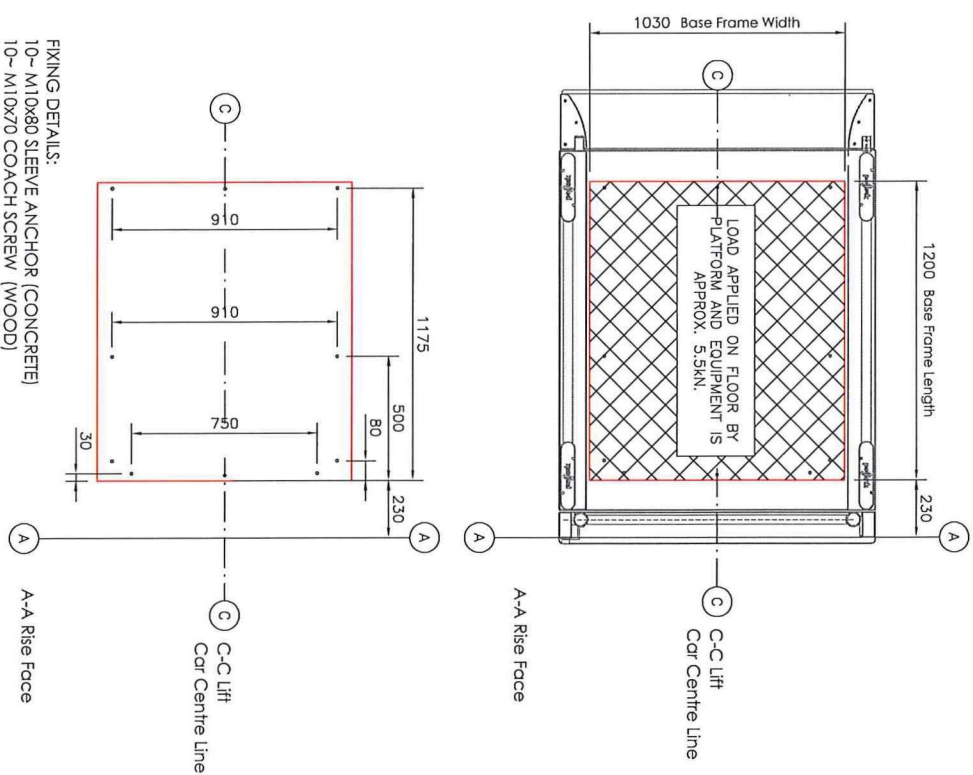

Change History Record			
Issue	CHANGE No.	DATE	INITIALS
A	-----	27/01/14	TL
B	-----	10/04/14	TL
C	C80742	01/07/14	TL

APPROVED WORKING DRAWING		COPYRIGHT  UNIT 1 SLOEFIELD DRIVE CARRIGFERCUS COUNTY ANTRIM NORTHERN IRELAND BT38 8GX TEL: 00 44 (0) 28 93368167 WEB: WWW.POLLOCKLIFTS.CO.UK
BY:.....	COMP:.....	
SIGNED:.....	DATE:.....	
APPROVAL		
PLATFORM SIZE	800W / 900W / 1100W	UNIT: S T E P L I F T
TRAVEL	(MIN 100mm MAX 1000mm)mm T8C	
NAME: CLASSIC and EXECUTIVE – THRU ACCESS – BASE DRAWING		
40900950		

Im Steplift Upper Gate Fixing / Loading Details.

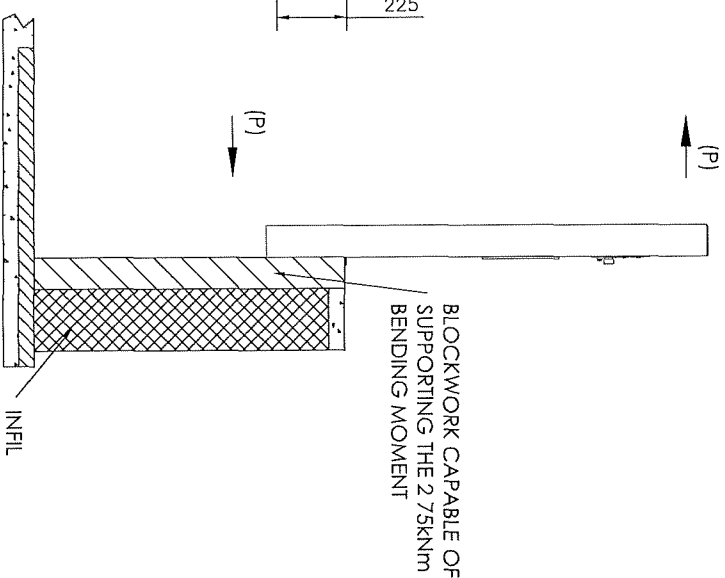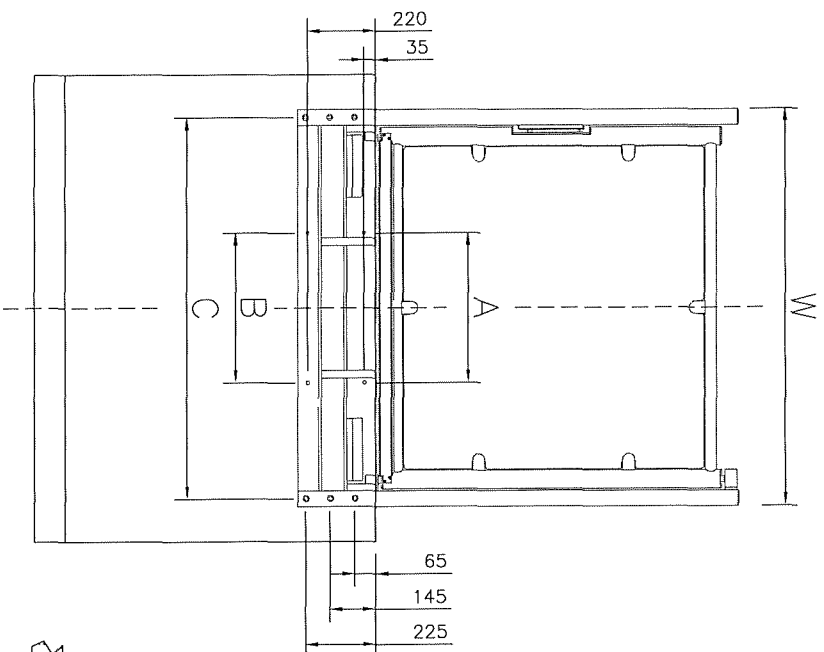

UPPER GATE FIXING

GATE VARIABLES				
THROUGH ACCESS				Gate Width
LIFT WIDTH	"A"	"B"	"C"	"W"
800W	380mm	380mm	925mm	975mm
900W	380mm	480mm	1025mm	1075mm
1100W	480mm	480mm	1225mm	1275mm
SIDE ACCESS				
1400W	480mm	480mm	1370mm	1422mm

NOTE:
THESE LOADINGS ARE ONLY GENERATED UNDER FORESEEABLE MISUSE.

TOTAL STRUCTURAL LOAD (FOS 1.6) = 240kg

PULL OUT LOAD PER FIXING = 2kN

BENDING MOMENT ON LIFT FACE WALL = 2.75kNm

FIXING DETAILS
10~ M10X80 SLEEVE ANCHOR (CONCRETE)
10~ M10X70 COACH SCREW (WOOD)

Change History Record

Issue	CHANGE No	DATE	INITIALS
A	---	27/01/14	TL
B	---	10/04/14	TL
C	CRO742	01/07/14	TL

APPROVED WORKING DRAWING

BY
SIGNED

COMP

DATE

PLATFORM SIZE

800W / 900W / 1100W

TRAVEL

(MIN 100mm MAX 1000mm)

mm TBC

COPYRIGHT

pollock
Lifts

UNIT 1, SLOEFIELD DRIVE
GARRICKTERRUS
NORTHERN ANTRIM
NORTHERN IRELAND
BT38 8GX (O) 28 93368167
WEB WWW.POLLOCKLIFTS.CO.UK

UNIT STEPLIFT

NAME CLASSIC and EXECUTIVE - UPPER GATE LOADING

40900960