

TM59 Thermal Comfort Summary Report

LAYSTALL STREET, MANCHESTER, M1 2JZ

OUR REF: 220805b

DATE: 29/11/2022



PREPARED BY:

HURSTWOOD ENVIRONMENTAL CONSULTING
ATRIA
SPA ROAD
BOLTON
BL1 4AG



The present document, its content, its appendices and/or amendments ("the Document") have been created by Hurstwood Environmental Consulting ("Hurstwood") for informative purposes. They contain private information referring to Hurstwood and/or its subsidiaries (the "Company"), and are addressed exclusively to its recipients. Consequently, they shall not be, totally or partially, disclosed, published and/or distributed without the previous and written consent of Hurstwood, unless it is made an explicit reference to the ownership of Hurstwood in the intellectual property rights. The whole content of this Document, whether text, images, brands, logotypes, colour combinations or any other element, its structure or design, selection and presentation model of the materials included therein are protected by both industrial and intellectual property rights – Hurstwood's ownership – and shall be respected by both recipient and addressee of the present Document. In particular, but without restricting the generality of confidentiality obligation, any reproduction (except for private use), transformation, distribution, public communication – at any third party's disposal – and generally, any other way of exploitation – through any procedure – of the whole or part of the Document, as well as its design, selection and presentation of materials included therein is strictly forbidden.



CONTENTS

1.0	INTRODUCTION	PAGE 2
2.0	DECLARATION OF COMPLIANCE WITH CIBSE AM11	PAGE 3
3.0	SOFTWARE USED FOR DYNAMIC THERMAL SIMULATION	PAGE 4
4.0	RELEVANT THERMAL COMFORT CRITERIA	PAGE 6
5.0	RELEVANT SIMULATION DATA	PAGE 7
6.0	RESULTS FROM DYNAMIC THERMAL SIMULATION [CURRENT DSY]	PAGE 12
7.0	RESULTS FROM DYNAMIC THERMAL SIMULATION [FUTURE DSY]	PAGE 20

1.0 INTRODUCTION

Hurstwood has been appointed to provide a TM59 Summary Report for the proposed block of apartment dwellings at Laystall Street, Manchester, M1 2JZ.

The purpose of this report is to clearly confirm that:

1. Thermal modelling has been carried out using software in accordance with CIBSE AM11 Building Energy and Environmental Modelling.

The modelling demonstrates that the building design and services strategy can deliver thermal comfort levels in occupied spaces in accordance with the criteria set out in CIBSE Guide A Environmental Design; or other appropriate industry standard (where this sets a higher or more appropriate requirement/level for the building type) to a **warmer than average climate** as per guidance in *CIBSE TM48: Use of climate change data in building simulation*.

2. The software used to carry out the simulation at the detailed design stage provides full dynamic thermal analysis.
3. The results of the dynamic thermal analysis show the building cooling load required to ensure:
 - a. The occupied areas of the building comply with any requirement, in terms of “time out of range” (TOR) metric, from the appropriate industry standard (as above) OR where there is no appropriate industry standard available or TOR recommendation made, the building services engineer confirms that the TOR is acceptable for the purpose and function of the building.
 - b. The occupied areas of the building comply with any requirement, in terms of “Predicted Mean Vote” (PMV) metric, from the appropriate industry standard (as above).
 - c. The occupied areas of the building comply with any requirement, in terms of “Percentage of People Dissatisfied” (PPD) metric, from the appropriate industry standard (as above).

2.0 DECLARATION OF COMPLIANCE WITH CIBSE AM11

CIBSE Applications Manual AM11: 1998, Building Energy and Environmental Modelling has been written to help in the selection and application of BEEM software in practice.

The manual covers:

- a) *Applicability*: BEEM software is normally a complex package of various calculation procedures; it should only be used when it is appropriate to do so.
- b) *Selection*: a large number of BEEM software tools exist; choosing the right tool for the job is the first important task in modelling.
- c) *Quality*: there is always the possibility of errors within software, mistakes in implementation and/ or the misapplication of software. Consideration should be given to validation of software and procedures for their use.
- d) *User skills*: the effect of user errors and assumptions on the results obtained can far outweigh the accuracy of BEEM software. Appropriate training, together with the establishment and use of quality assurance procedures, is an important part of developing a modelling capability.
- e) *Input data*: access to guidance and sources of information for deriving appropriate input data is pertinent to good modelling.

The guidance given in AM11: 1998 has been followed in the production of this report.

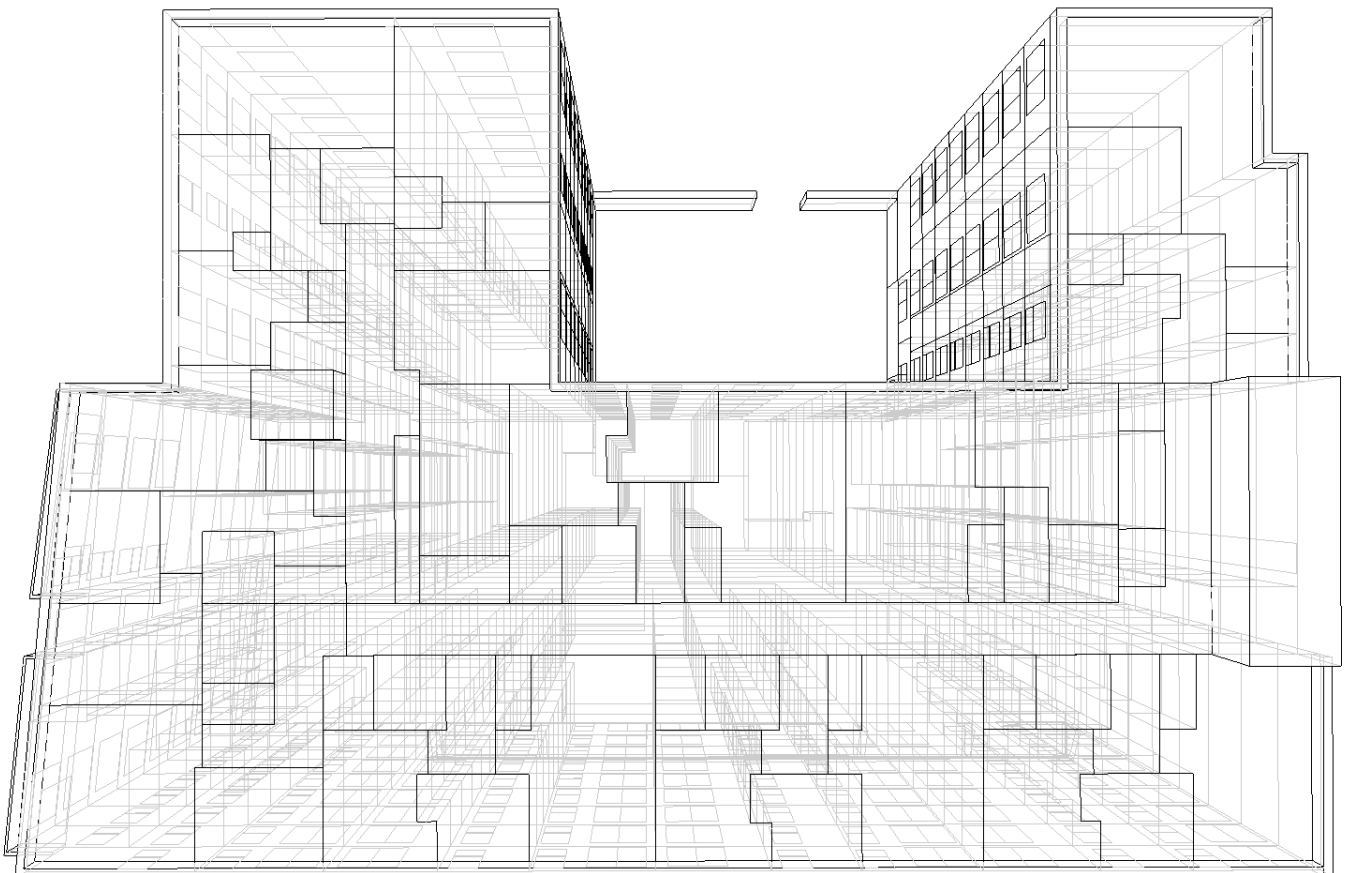


Figure 1. Top view of the proposed dwellings from IES Thermal Model

3.0 SOFTWARE USED FOR DYNAMIC THERMAL SIMULATION

The simulation tool used for this investigation is IES Virtual Environment, Version 2022.1.0.0.

The calculation methodology adopted was full Dynamic Thermal Simulation over a period of 365 days with a 20 day pre-conditioning period.

The ApacheSim calculation engine was used and a full SunCast solar shading analysis was performed to ensure the local shading devices and overhangs were accurately reflected in the simulation.

ApacheSim is comprised of the following tools:

- Apache
- ApacheEngine
- Vista & VistaPro
- ApacheView
- ApachePro
- ApacheLocate
- Constructions Database



Calculations are based on first-principles models of heat transfer process and are driven by real weather data.

Data Entry Options

- Extensive database of global weather
- Data detailing layer-by-layer thermo-physical properties of building elements
- Comprehensive data on glazing systems including angle-dependent transmissivity and absorptivity
- Sensible and latent gains from lights, equipment and occupants
- Natural ventilation, mechanical ventilation and infiltration
- Plant operation profiles
- Plant efficiency and fuel characteristics
- Powerful facilities for assigning and editing time-varying room data such as plant, casual gains and air exchanges
- Database of constructions
- Time-series profiles
- Tabular Edit feature for Building Template Manager & NCM (for UK Part L)
- Tabular Edit interface for entering properties of thermal templates, room thermal properties, HVAC systems and constructions. Gives ability to quickly enter data, review inputs and includes option to export and import *.csv files (e.g. Excel)
- Faster project setup using Master Template and Design Options features. The Master Templates feature delivers bulk data copying & rapid automatic seeding of data in to a project while the Design Option feature provides a means to make specific and targeted changes to specified data in a project

Analysis options

- User-controlled time steps down to 1 minute
- Idealised or detailed HVAC plant modeling
- Options for natural and mechanical ventilation; specify flows in advance or calculate using MacroFlo and ApacheHVAC

- Choice of models for internal and external convection

RadianceIES – Day Lighting and Electric Lighting Simulation

RADIANCE is a computer software package developed by the Lighting Systems Research Group at Lawrence Berkley Laboratory in California, USA. It was developed as a research tool to accurately calculate and predict the visible radiation within a space. Radiance is internationally recognised as one of the leading lighting simulation tools available. Using a 3-dimensional geometrical model of the physical environment Radiance produces a map of spectral radiance values in a photo-realistic image.

Radiance can be categorised as a “ray-tracing” algorithm, which tracks rays of light backwards from the “eye” to the “focus” of the scene. This contrasts with the “radiosity” technique where the exchange of energy between surface matches is matched.

SunCast – Solar Shading Analysis

SunCast is used to perform shading and solar insolation studies. It can be used to investigate:

- External obstruction and self-shading of a building.
- Solar mapping through windows and openings.
- The effects of changing orientation of building.

SunCast generates shadows and internal solar insolation from any sun position defined by date, time, orientation, site latitude and longitude. This shadow information can be stored for subsequent analysis by:

- Viewing shadows from any eye position.
- Animating the solar analyses by generating a sequence of images and creating an *.avi movie.
- Making opaque surfaces “transparent” to permit the user to better view the solar insolation on internal surfaces e.g. “removing” roofs or surfaces to identify internal solar insolation paths.
- Displaying solar surface shading/insolation statistics.
- Output data for thermal simulation.

SunCast can be used in a variety of studies including passive solar design and is essential at the planning stage to visualize the effect of the building on surrounding buildings. SunCast has also been used to study problems such as grass growth in sports stadia and ‘right of light’ issues.

MacroFlo – Multi Zone Air Movement

MacroFlo uses a multi-zone thermo-fluid solver to simulate bulk air flow driven by wind pressure and buoyancy forces. It allows analysis of problems involving infiltration, natural ventilation and mechanical ventilation. Typical applications include:

- Evaluation of natural ventilation solutions (including Advanced Natural Ventilation and Mixed-mode systems).
- Evaluation of ventilation control strategies.
- An understanding of the performance of double-skin façades.
- Analysis of room temperature statistics in naturally ventilated buildings (simulation of overheating risk).
- Predictions of air velocities through openings.
- Analysis of HVAC systems where the building is used as a return air pathway.

4.0 RELEVANT THERMAL COMFORT CRITERIA

An appropriate industry standard for the proposed development is given in CIBSE Guide A.

Table 1.5 of CIBSE Guide A recommends summer and winter comfort criteria for building spaces which can be used to determine and report the percentage time out of range (TOR) metric (criterion 5).

Building/room type	Winter operative temp. range for stated activity and clothing levels			Summer operative temp. range (air conditioned buildings†) for stated activity and clothing levels		
	Temp. /°C	Activity /met	Clothing /clo	Temp. /°C	Activity /met	Clothing /clo
<i>Dwellings:</i>						
— <i>bathrooms</i>	20-22	-	-	23-25	-	-
— <i>bedrooms</i>	17-19	0.9	2.5	23-25	0.9	1.2
— <i>halls/stairs/landings</i>	19-24	-	-	21-25	-	-
— <i>kitchens</i>	17-19	1.6	1.0	21-25	1.5	0.5
— <i>living rooms</i>	22-23	1.1	1.0	21-25	1.1	0.6
— <i>toilets</i>	19-21	-	-	21-25	1.1	0.6

The temperature ranges given in Table 1.5 of CIBSE Guide A (shown above) can be adjusted to account for the circumstance that the clothing and activity differ from those assumed in Table 1.5. The temperature ranges may be widened by approximately 1°C at each end if a predicted mean vote of ± 0.5 of the operative temperature (i.e. percentage of people dissatisfied of 10%) is acceptable.

† The summer comfort temperatures given in Table 1.5 apply to air-conditioned buildings. Higher temperatures may be acceptable if full air conditioning is not present, and guidance on this can be found in section 1.4.2 of CIBSE Guide A, with a detailed discussion of the adaptive approach in section 1.6 of the same.

The Adaptive Thermal Comfort assessment method outlined in CIBSE TM 59 has been used to assess the overheating propensity. The development will be considered 'at risk' if any of the following criteria are exceeded.

TM59, 4.2(a) Criterion 1 - Hours of Exceedence (H_e): For living rooms, kitchens and bedrooms: The number of hours the ΔT is greater than or equal to one degree (K) during the period May to September inclusive must not exceed 3% of total annual occupied hours.

TM59, 4.2(b) Criterion 2 - Hours of Exceedence (H_e): For bedrooms only: The number of hours the predicted operative temperature exceeds 26°C (θ_{max}) by 1K or more between 10pm and 7am, should not exceed 1% of total annual occupied hours during the period May to September inclusive (32 hours).

TM59, 4.3 Criteria for homes predominantly mechanically ventilated - Hours of Exceedence (H_e): The number of hours the predicted operative temperature in each room exceeds 26°C (θ_{max}) by 1K, or more, should not exceed 3% of total annual occupied hours.

Passivhaus Classic Performance Requirement - Hours of Exceedence (H_e): The number of hours the predicted operative temperature in each room exceeds 25°C (θ_{max}) by 1K, or more, should not exceed 10% of total annual hours.

5.0 RELEVANT SIMULATION DATA

Weather Data

To demonstrate adaptability to a current climate scenario the Manchester_DSY01 has been applied as per guidance in *CIBSE TM48: Use of climate change data in building simulation*. This represents a predicted warmer than average summer based in historic measured data for the region.

General Performance Criteria

<i>External Wall Area Weighted U-Value</i>	0.17	W/m ² .K
<i>Insulated Internal Partition Area Weighted U-Value</i>	0.35	W/m ² .K
<i>Roof Area Weighted U-Value</i>	0.14	W/m ² .K
<i>Ground Floor Area Weighted U-Value</i>	0.14	W/m ² .K
<i>Internal Floor/Ceiling Area Weighted U-Value</i>	0.18	W/m ² .K
<i>Windows Area Weighted U-Value</i>	1.40	W/m ² .K
<i>Windows Total Solar Transmission (G-Value)</i>	40	%
<i>Windows Visible Light Transmission (VLT)</i>	70	%
<i>Windows Frame Factor</i>	10	%

Thermal Mass Analysis

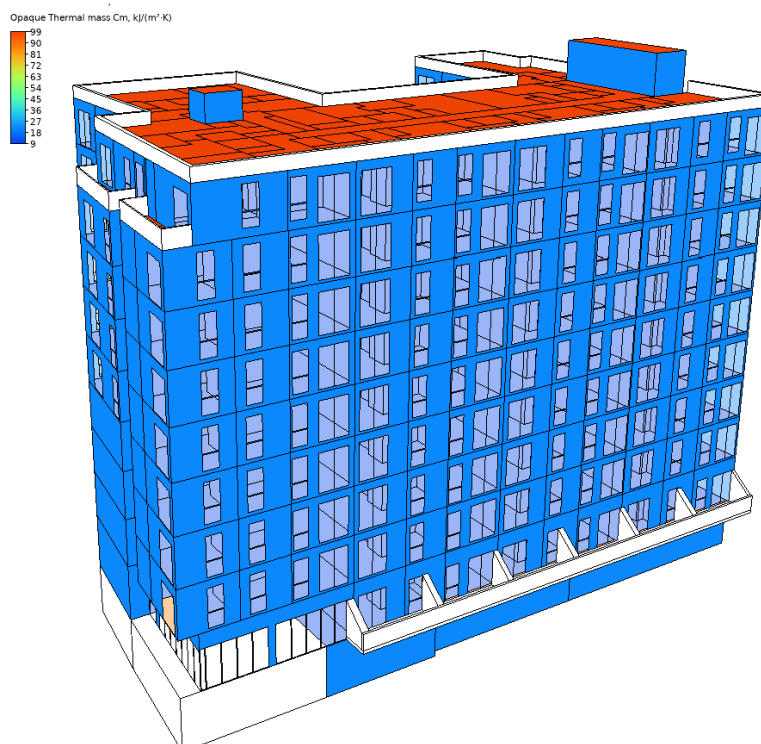


Figure 2. Thermal Mass Cm for Opaque Building Fabric

	Thermal Mass Cm		Thermal Mass Class
External Wall	21.95	KJ/(m ² .K)	Very Lightweight
Internal Partition	8.75	KJ/(m ² .K)	Very Lightweight
Roof	98.75	KJ/(m ² .K)	Lightweight
Ground Floor	85.0	KJ/(m ² .K)	Very Lightweight
Internal Floor/Ceiling	8.75	KJ/(m ² .K)	Very Lightweight

General Infiltration

This ventilation profile is considered to run continuously as it is governed by the air permeability of the building fabric which at this stage is assumed to be 3.0 m³/(h.m²)@50Pa. The assumed ventilation rate is 0.15 air changes per hour. The condition of the supply air is External.

Natural Ventilation

Each dwelling benefits from manual openable external windows and doors and trickle vents which provide makeup air for continuous mechanical extract system.

Opening Type

- XTRN0000 (External window CLOSED)
- XTRN0002 (External window OPENING)
- XTRN0003 (External Glazed Door OPENING)
- XTRN0004 (External Glazed Door CLOSED)

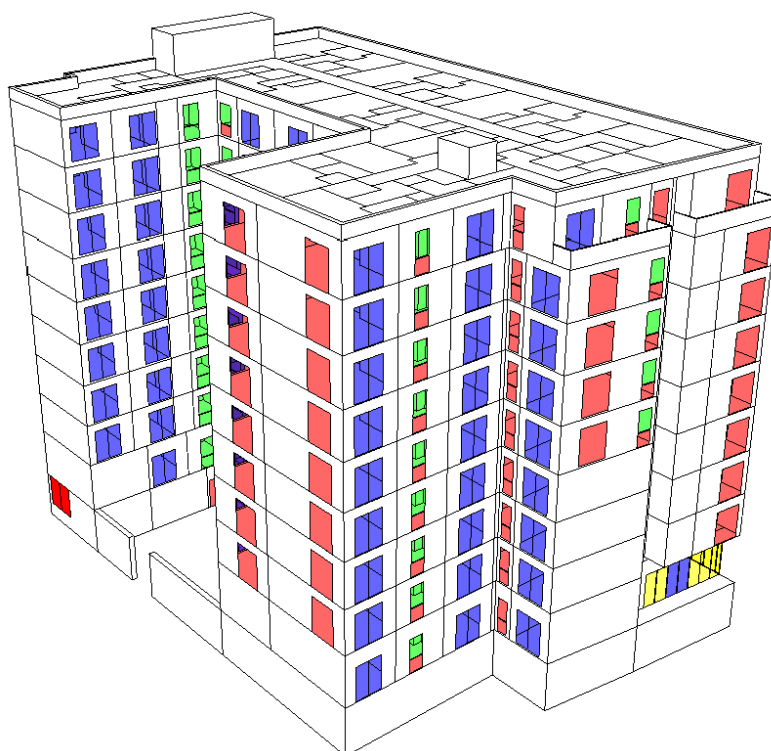


Figure 3. Showing opening types from North

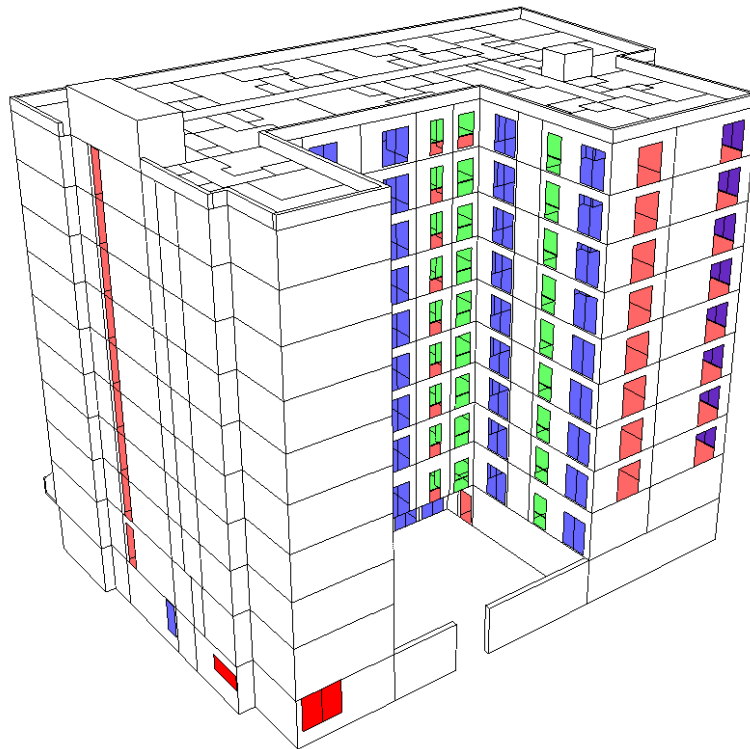


Figure 4. Showing opening types from East

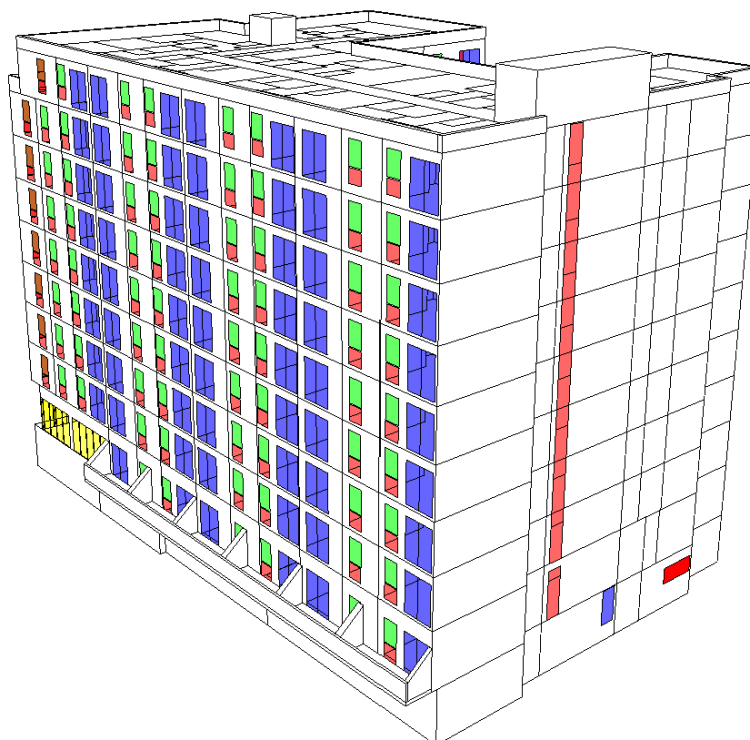


Figure 5. Showing opening types from South

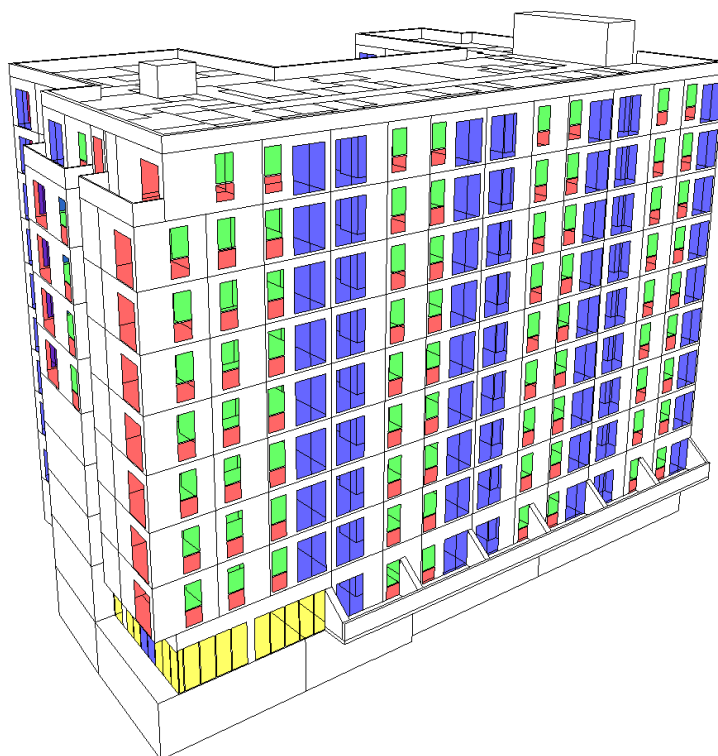


Figure 6. Showing opening types from West

Mechanical ventilation

Each dwelling benefits from a Continuous Mechanical Extract Ventilation. Heat Recovery on the extract air is used for the generation of Low Carbon DHW (via KERS units).

The following flow rates are applied to the relevant zones:

Zone	K/L/Dining	Bedroom	Bathroom	Ensuite
Flow Rate	13 l/s	-	15 l/s	15 l/s

Internal Shading Devices

Internal shading devices have been included in the simulation. The simulated operation of the internal shading is: shading present when $i > 400$ at a shading coefficient of 0.6.

Internal Gains

Figure 1 of CIBSE TM59 provides guidance on the typical peak equipment gains which can be expected in modern dwellings.

Zone	Watts
Double bedroom	80

All internal gains are controlled by specific modulating profiles which are used to better represent the equipment heat gain into the space as it varies throughout the day. These profiles are taken directly from Figure 1 of CIBSE TM59.

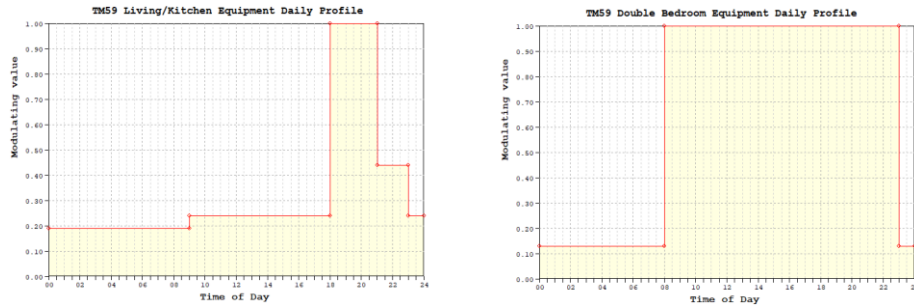


Figure 7. Kitchen/Living/Dining and Double Bedroom Modulating Profile for Equipment Gains

The internal lighting gain is based on figures provided and is as follows:

Zone	W/m ²
All Zones	2.0

The occupancy gain is based on the CIBSE figures above with the following occupancy density in each space:

Zone	K/L/D	Bedroom	Bathroom	Ensuite
No. of occupants	4	2	0	0



Figure 8. Kitchen/Living/Dining and Double Bedroom Modulating Profile for Occupant Gains

6.0 RESULTS FROM DYNAMIC THERMAL SIMULATION [CURRENT CLIMATIC CONDITION]

The following table shows the predicted percentage of occupied hours the internal temperature exceeds 25°C and 26°C in all occupied areas based on the mechanical purge ventilation rate of 13l/s in Kitchen/Living/Dining Areas, 8l/s to ensuite and bathroom areas (with makeup air via trickle vents in windows).

Note: the Passivhaus threshold is ≤10% of the total annual hours at TOP-25°C≥1K, and the TM59 threshold is ≤3% of the occupied hours at TOP-26°C≥1K.

ROOM NAME	WITHOUT BLINDS		WITH BLINDS		PASS/FAIL
	PASSIVHAUS CRITERIA 4.3 % Hrs TOP- 25°C≥1K	TM59 CRITERIA % Hrs TOP- 26°C≥1K	PASSIVHAUS CRITERIA 4.3 % Hrs TOP- 25°C≥1K	TM59 CRITERIA % Hrs TOP- 26°C≥1K	
00_APT01_BEDROOM 1	4.1	1.6	4.2	1.7	PASS
00_APT01_BEDROOM 2	1	0.2	0.9	0.1	PASS
00_APT01_KITCHEN/LIVING/DINER	2.4	1.2	2.4	1.3	PASS
00_APT02_BEDROOM 1	2.4	0.8	2.5	0.8	PASS
00_APT02_KITCHEN/LIVING/DINER	2.7	1.3	3	1.5	PASS
00_APT03_BEDROOM 1	0.3	0	0.3	0	PASS
00_APT03_BEDROOM 2	0.7	0.1	0.7	0.1	PASS
00_APT03_KITCHEN/LIVING/DINER	1.9	1	1.9	1	PASS
00_APT04_BEDROOM	0.2	0	0.3	0	PASS
00_APT04_KITCHEN/LIVING/DINER	1.8	1	1.9	1	PASS
00_APT05_BEDROOM 1	0.4	0	0.5	0	PASS
00_APT05_KITCHEN/LIVING/DINER	2	1.1	2.2	1.2	PASS
00_APT06_BEDROOM 1	4.9	1.7	4.9	1.6	PASS
00_APT06_BEDROOM 2	1.7	0.7	1.4	0.4	PASS
00_APT06_KITCHEN/LIVING/DINER	2.9	1.6	2.8	1.4	PASS
00_APT07_BEDROOM 1	5.1	1.9	5.1	1.8	PASS
00_APT07_BEDROOM 2	1.7	0.7	1.4	0.4	PASS
00_APT07_KITCHEN/LIVING/DINER	3.2	1.8	3.2	1.5	PASS
00_APT08_BEDROOM 1	5.2	1.8	5	1.8	PASS
00_APT08_BEDROOM 2	1.7	0.7	1.4	0.4	PASS
00_APT08_KITCHEN/LIVING/DINER	3	1.7	3	1.5	PASS
00_APT09_BEDROOM 1	0.4	0	0.6	0	PASS
00_APT09_KITCHEN/LIVING/DINER	1.6	0.8	1.5	0.8	PASS
01_APT01_BEDROOM 1	5.9	2.2	7	2.5	PASS
01_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
01_APT01_KITCHEN/LIVING/DINER	3.4	1.7	3.4	1.7	PASS
01_APT02_BEDROOM 1	3.4	1.1	3.9	1.3	PASS



01_APT02_KITCHEN/LIVING/DINER	3.6	2	3.9	2.2	PASS
01_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
01_APT03_BEDROOM 2	0.8	0.1	0.9	0.1	PASS
01_APT03_KITCHEN/LIVING/DINER	2.7	1.3	2.8	1.3	PASS
01_APT04_BEDROOM	0.3	0	0.3	0	PASS
01_APT04_KITCHEN/LIVING/DINER	2.5	1.3	2.6	1.3	PASS
01_APT05_BEDROOM 1	6.3	2.5	6.9	2.6	PASS
01_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
01_APT05_KITCHEN/LIVING/DINER	1.4	0.7	1.5	0.7	PASS
01_APT06_BEDROOM 1	12.5	3.9	7.7	2.6	PASS
01_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
01_APT06_KITCHEN/LIVING/DINER	5.1	2.4	3.7	1.9	PASS
01_APT07_BEDROOM 1	13.5	4.1	8.3	2.8	PASS
01_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
01_APT07_KITCHEN/LIVING/DINER	6.2	2.9	4.1	2.2	PASS
01_APT08_BEDROOM 1	14	4.3	8.6	2.8	PASS
01_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
01_APT08_KITCHEN/LIVING/DINER	5.9	2.6	3.9	2	PASS
01_APT09_BEDROOM 1	2.7	1.1	2	0.6	PASS
01_APT09_BEDROOM 2	2.3	1	1.8	0.6	PASS
01_APT09_KITCHEN/LIVING/DINER	7.2	3.8	4.8	2.7	PASS
01_APT10_BEDROOM 1	0.4	0	0.9	0	PASS
01_APT10_KITCHEN/LIVING/DINER	1.8	0.9	1.8	0.9	PASS
02_APT01_BEDROOM 1	5.9	2.2	7	2.5	PASS
02_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
02_APT01_KITCHEN/LIVING/DINER	3.4	1.8	3.4	1.7	PASS
02_APT02_BEDROOM 1	3.4	1.1	4	1.3	PASS
02_APT02_KITCHEN/LIVING/DINER	3.6	2	3.9	2.2	PASS
02_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
02_APT03_BEDROOM 2	0.8	0.1	0.9	0.1	PASS
02_APT03_KITCHEN/LIVING/DINER	2.7	1.3	2.8	1.3	PASS
02_APT04_BEDROOM	0.3	0	0.3	0	PASS
02_APT04_KITCHEN/LIVING/DINER	2.5	1.3	2.6	1.3	PASS
02_APT05_BEDROOM 1	6.4	2.5	6.9	2.6	PASS
02_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
02_APT05_KITCHEN/LIVING/DINER	1.4	0.7	1.5	0.7	PASS
02_APT06_BEDROOM 1	12.7	4	7.8	2.6	PASS
02_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS



02_APT06_KITCHEN/LIVING/DINER	5.1	2.4	3.7	1.9	PASS
02_APT07_BEDROOM 1	13.7	4.2	8.4	2.8	PASS
02_APT07_BEDROOM 2	2.1	0.9	1.6	0.5	PASS
02_APT07_KITCHEN/LIVING/DINER	6.2	2.9	4.1	2.2	PASS
02_APT08_BEDROOM 1	14.1	4.3	8.6	2.9	PASS
02_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
02_APT08_KITCHEN/LIVING/DINER	5.9	2.6	3.9	2	PASS
02_APT09_BEDROOM 1	2.7	1.2	2.1	0.6	PASS
02_APT09_BEDROOM 2	2.3	1	1.8	0.6	PASS
02_APT09_KITCHEN/LIVING/DINER	7.2	3.8	4.8	2.7	PASS
02_APT10_BEDROOM 1	0.4	0	0.9	0	PASS
02_APT10_KITCHEN/LIVING/DINER	1.8	0.9	1.8	0.9	PASS
03_APT01_BEDROOM 1	5.9	2.2	7.1	2.5	PASS
03_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
03_APT01_KITCHEN/LIVING/DINER	3.4	1.8	3.4	1.7	PASS
03_APT02_BEDROOM 1	3.4	1.1	4	1.3	PASS
03_APT02_KITCHEN/LIVING/DINER	3.7	2	3.9	2.2	PASS
03_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
03_APT03_BEDROOM 2	0.8	0.1	0.9	0.1	PASS
03_APT03_KITCHEN/LIVING/DINER	2.7	1.3	2.8	1.3	PASS
03_APT04_BEDROOM	0.3	0	0.3	0	PASS
03_APT04_KITCHEN/LIVING/DINER	2.5	1.3	2.6	1.3	PASS
03_APT05_BEDROOM 1	6.4	2.5	6.9	2.6	PASS
03_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
03_APT05_KITCHEN/LIVING/DINER	1.4	0.7	1.5	0.7	PASS
03_APT06_BEDROOM 1	12.7	4	7.8	2.6	PASS
03_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
03_APT06_KITCHEN/LIVING/DINER	5.2	2.4	3.7	2	PASS
03_APT07_BEDROOM 1	13.6	4.2	8.3	2.8	PASS
03_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
03_APT07_KITCHEN/LIVING/DINER	6.3	2.9	4.2	2.3	PASS
03_APT08_BEDROOM 1	14	4.3	8.5	2.8	PASS
03_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
03_APT08_KITCHEN/LIVING/DINER	5.9	2.6	3.9	2.1	PASS
03_APT09_BEDROOM 1	2.8	1.2	2.1	0.6	PASS
03_APT09_BEDROOM 2	2.3	1	1.8	0.6	PASS
03_APT09_KITCHEN/LIVING/DINER	7.2	3.8	4.8	2.7	PASS
03_APT10_BEDROOM 1	0.4	0	0.9	0	PASS



03_APT10_KITCHEN/LIVING/DINER	1.8	0.9	1.8	0.9	PASS
04_APT01_BEDROOM 1	6	2.2	7.1	2.5	PASS
04_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
04_APT01_KITCHEN/LIVING/DINER	3.4	1.8	3.4	1.7	PASS
04_APT02_BEDROOM 1	3.4	1.2	4	1.3	PASS
04_APT02_KITCHEN/LIVING/DINER	3.8	2.1	3.9	2.2	PASS
04_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
04_APT03_BEDROOM 2	0.8	0.1	0.9	0.1	PASS
04_APT03_KITCHEN/LIVING/DINER	2.7	1.3	2.8	1.3	PASS
04_APT04_BEDROOM	0.3	0	0.3	0	PASS
04_APT04_KITCHEN/LIVING/DINER	2.5	1.3	2.7	1.3	PASS
04_APT05_BEDROOM 1	6.7	2.5	7	2.6	PASS
04_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
04_APT05_KITCHEN/LIVING/DINER	1.4	0.7	1.5	0.8	PASS
04_APT06_BEDROOM 1	12.8	4	7.8	2.6	PASS
04_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
04_APT06_KITCHEN/LIVING/DINER	5.1	2.4	3.7	2	PASS
04_APT07_BEDROOM 1	13.8	4.2	8.4	2.8	PASS
04_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
04_APT07_KITCHEN/LIVING/DINER	6.3	3	4.2	2.3	PASS
04_APT08_BEDROOM 1	14.1	4.3	8.6	2.8	PASS
04_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
04_APT08_KITCHEN/LIVING/DINER	5.9	2.7	3.9	2.1	PASS
04_APT09_BEDROOM 1	2.7	1.2	2.1	0.6	PASS
04_APT09_BEDROOM 2	2.3	1	1.8	0.6	PASS
04_APT09_KITCHEN/LIVING/DINER	7.3	3.8	4.8	2.7	PASS
04_APT10_BEDROOM 1	0.6	0	1.3	0.1	PASS
04_APT10_KITCHEN/LIVING/DINER	2.4	1.4	2.4	1.4	PASS
05_APT01_BEDROOM 1	6.1	2.2	7.4	2.6	PASS
05_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
05_APT01_KITCHEN/LIVING/DINER	3.5	1.8	3.4	1.8	PASS
05_APT02_BEDROOM 1	3.4	1.2	4	1.3	PASS
05_APT02_KITCHEN/LIVING/DINER	3.8	2.1	3.9	2.2	PASS
05_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
05_APT03_BEDROOM 2	0.8	0.1	0.9	0.1	PASS
05_APT03_KITCHEN/LIVING/DINER	2.7	1.4	2.9	1.4	PASS
05_APT04_BEDROOM	0.3	0	0.4	0	PASS
05_APT04_KITCHEN/LIVING/DINER	2.6	1.3	2.7	1.3	PASS



05_APT05_BEDROOM 1	6.9	2.6	7.1	2.7	PASS
05_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
05_APT05_KITCHEN/LIVING/DINER	1.5	0.8	1.6	0.8	PASS
05_APT06_BEDROOM 1	13.3	4.1	8	2.6	PASS
05_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
05_APT06_KITCHEN/LIVING/DINER	5.3	2.5	3.8	2	PASS
05_APT07_BEDROOM 1	14.2	4.3	8.6	2.8	PASS
05_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
05_APT07_KITCHEN/LIVING/DINER	6.4	3.1	4.2	2.2	PASS
05_APT08_BEDROOM 1	14.9	4.5	9	2.9	PASS
05_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
05_APT08_KITCHEN/LIVING/DINER	6.1	2.8	3.9	2.1	PASS
05_APT09_BEDROOM 1	2.7	1.1	2	0.6	PASS
05_APT09_BEDROOM 2	2.3	0.9	1.8	0.6	PASS
05_APT09_KITCHEN/LIVING/DINER	7.6	4	4.9	2.8	PASS
05_APT10_BEDROOM 1	0.6	0	1.4	0.2	PASS
05_APT10_KITCHEN/LIVING/DINER	2.4	1.5	2.4	1.4	PASS
06_APT01_BEDROOM 1	6.3	2.2	7.5	2.6	PASS
06_APT01_BEDROOM 2	1.2	0.2	1.1	0.2	PASS
06_APT01_KITCHEN/LIVING/DINER	3.5	1.9	3.4	1.8	PASS
06_APT02_BEDROOM 1	3.5	1.2	4.1	1.4	PASS
06_APT02_KITCHEN/LIVING/DINER	4	2.1	4	2.2	PASS
06_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
06_APT03_BEDROOM 2	0.9	0.1	0.9	0.1	PASS
06_APT03_KITCHEN/LIVING/DINER	2.7	1.4	2.9	1.4	PASS
06_APT04_BEDROOM	0.3	0	0.3	0	PASS
06_APT04_KITCHEN/LIVING/DINER	2.6	1.3	2.8	1.4	PASS
06_APT05_BEDROOM 1	7.1	2.6	7.3	2.8	PASS
06_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
06_APT05_KITCHEN/LIVING/DINER	1.5	0.8	1.6	0.9	PASS
06_APT06_BEDROOM 1	14	4.3	8.3	2.7	PASS
06_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
06_APT06_KITCHEN/LIVING/DINER	5.5	2.7	3.8	2	PASS
06_APT07_BEDROOM 1	14.7	4.5	8.9	2.9	PASS
06_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
06_APT07_KITCHEN/LIVING/DINER	6.7	3.2	4.2	2.3	PASS
06_APT08_BEDROOM 1	15.3	4.7	9.2	2.9	PASS
06_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS



06_APT08_KITCHEN/LIVING/DINER	6.2	3	4	2.1	PASS
06_APT09_BEDROOM 1	2.7	1.1	2	0.6	PASS
06_APT09_BEDROOM 2	2.3	0.9	1.8	0.6	PASS
06_APT09_KITCHEN/LIVING/DINER	7.8	4.1	4.9	2.8	PASS
06_APT10_BEDROOM 1	0.6	0	1.4	0.2	PASS
06_APT10_KITCHEN/LIVING/DINER	2.4	1.5	2.5	1.5	PASS
07_APT01_BEDROOM 1	6.5	2.3	7.8	2.7	PASS
07_APT01_BEDROOM 2	1.2	0.3	1.1	0.2	PASS
07_APT01_KITCHEN/LIVING/DINER	3.6	1.9	3.5	1.8	PASS
07_APT02_BEDROOM 1	3.8	1.3	4.1	1.4	PASS
07_APT02_KITCHEN/LIVING/DINER	4.1	2.2	4	2.3	PASS
07_APT03_BEDROOM 1	0.4	0	0.4	0	PASS
07_APT03_BEDROOM 2	0.9	0.1	0.8	0.1	PASS
07_APT03_KITCHEN/LIVING/DINER	2.7	1.4	2.9	1.5	PASS
07_APT04_BEDROOM 1	0.4	0	0.3	0	PASS
07_APT04_KITCHEN/LIVING/DINER	2.6	1.4	2.8	1.4	PASS
07_APT05_BEDROOM 1	7.4	2.6	7.5	2.8	PASS
07_APT05_BEDROOM 2	0.4	0	0.5	0	PASS
07_APT05_KITCHEN/LIVING/DINER	1.6	0.9	1.7	0.9	PASS
07_APT06_BEDROOM 1	14.4	4.5	8.6	2.7	PASS
07_APT06_BEDROOM 2	2	0.9	1.6	0.5	PASS
07_APT06_KITCHEN/LIVING/DINER	5.6	2.8	3.8	2	PASS
07_APT07_BEDROOM 1	15.1	4.7	9.1	2.9	PASS
07_APT07_BEDROOM 2	2	0.9	1.6	0.5	PASS
07_APT07_KITCHEN/LIVING/DINER	6.8	3.4	4.3	2.4	PASS
07_APT08_BEDROOM 1	15.5	4.8	9.3	2.9	PASS
07_APT08_BEDROOM 2	2	0.9	1.6	0.5	PASS
07_APT08_KITCHEN/LIVING/DINER	6.4	3	4	2.2	PASS
07_APT09_BEDROOM 1	2.4	0.9	1.8	0.4	PASS
07_APT09_BEDROOM 2	2.3	0.9	1.8	0.6	PASS
07_APT09_KITCHEN/LIVING/DINER	8	4.2	5	2.8	PASS
07_APT10_BEDROOM 1	0.6	0	1.3	0.3	PASS
07_APT10_KITCHEN/LIVING/DINER	2.3	1.4	2.4	1.4	PASS
08_APT01_BEDROOM 1	7.5	2.5	7.5	2.7	PASS
08_APT01_BEDROOM 2	0.9	0.1	0.7	0	PASS
08_APT01_KITCHEN/LIVING/DINER	3	1.6	3	1.6	PASS
08_APT02_BEDROOM 1	3.3	1.1	3.3	1.1	PASS
08_APT02_KITCHEN/LIVING/DINER	3.6	1.8	3.4	1.8	PASS

08_APT03_BEDROOM 1	0.2	0	0.1	0	PASS
08_APT03_BEDROOM 2	0.6	0	0.6	0	PASS
08_APT03_KITCHEN/LIVING/DINER	1.7	0.9	1.7	0.9	PASS
08_APT04_BEDROOM 1	0.1	0	0.1	0	PASS
08_APT04_KITCHEN/LIVING/DINER	1.7	0.9	1.7	0.9	PASS
08_APT05_BEDROOM 1	4.9	1.9	5	1.9	PASS
08_APT05_BEDROOM 2	0.2	0	0.3	0	PASS
08_APT05_KITCHEN/LIVING/DINER	1.2	0.5	1.2	0.5	PASS
08_APT06_BEDROOM 1	7.3	2.5	6.4	2.3	PASS
08_APT06_BEDROOM 2	1.6	0.5	1.1	0.2	PASS
08_APT06_KITCHEN/LIVING/DINER	3.5	1.9	3.3	1.7	PASS
08_APT07_BEDROOM 1	7.9	2.6	7.5	2.5	PASS
08_APT07_BEDROOM 2	1.6	0.5	1.1	0.2	PASS
08_APT07_KITCHEN/LIVING/DINER	3.8	2.1	3.5	1.9	PASS
08_APT08_BEDROOM 1	8.9	2.8	8.4	2.6	PASS
08_APT08_BEDROOM 2	1.6	0.5	1.1	0.2	PASS
08_APT08_KITCHEN/LIVING/DINER	3.6	1.9	3.3	1.7	PASS
08_APT09_BEDROOM 2	17.5	6.4	9.5	3	PASS
08_APT09_KITCHEN/LIVING/DINER	4.4	2.8	3.8	2	PASS
08_APT10_BEDROOM 1	1.3	0.1	1.5	0	PASS
08_APT10_BEDROOM 2	0.9	0.1	0.9	0	PASS

The following table shows the predicted percentage of occupied hours the internal temperature exceeds 28°C in all corridor areas. Whilst there is no mandatory target for corridor temperatures, if an Operative Temperature of 28 °C is exceeded for more than 3% of total annual hours, for the purpose of this report, this is considered a significant overheating risk:

ROOM NAME	TM59 CRITERIA % Hrs TOP- 28°C>=1K	PASS/FAIL
00_CORRIDOR	0	PASS
00_STAIRS 1	0	PASS
00_STAIRS 2	0	PASS
01_CORRIDOR	0	PASS
01_STAIRS 1	0	PASS
01_STAIRS 2	0	PASS
02_CORRIDOR	0	PASS
02_STAIRS 1	0	PASS
02_STAIRS 2	0	PASS
03_CORRIDOR	0	PASS
03_STAIRS 1	0	PASS
03_STAIRS 2	0	PASS
04_CORRIDOR	0	PASS
04_STAIRS 1	0	PASS
04_STAIRS 2	0	PASS
05_CORRIDOR	0	PASS
05_STAIRS 1	0	PASS
05_STAIRS 2	0	PASS
06_CORRIDOR	0	PASS
06_STAIRS 1	0	PASS
06_STAIRS 2	0	PASS
07_CORRIDOR	0	PASS
07_STAIRS 1	0	PASS
07_STAIRS 2	0	PASS
08_CORRIDOR	0	PASS
08_STAIRS 1	0	PASS
08_STAIRS 2	0	PASS
LG_STAIRS 1	0.1	PASS
LG_STAIRS 2	0	PASS
RF_STAIRS 2	0	PASS

7.0 RESULTS FROM DYNAMIC THERMAL SIMULATION [FUTURE CLIMATIC CONDITION]

Weather Data

To demonstrate adaptability to a current climate scenario the Manchester DSY1_2020_High_90_Percentile_DSY has been applied as per guidance in *CIBSE TM48: Use of climate change data in building simulation*. This represents a predicted warmer than average summer based in historic measured data for the region.

All other simulation inputs are consistent with those detailed in Section 5 of this report.

ROOM NAME	WITHOUT BLINDS		WITH BLINDS		PASS/FAIL
	PASSIVHAUS CRITERIA 4.3 % Hrs TOP- 25°C>=1K	TM59 CRITERIA % Hrs TOP- 26°C>=1K	PASSIVHAUS CRITERIA 4.3 % Hrs TOP- 25°C>=1K	TM59 CRITERIA % Hrs TOP- 26°C>=1K	
00_APT01_BEDROOM 1	5.4	3.2	5.4	2.6	PASS
00_APT01_BEDROOM 2	3.2	2.1	2.8	1.2	PASS
00_APT01_KITCHEN/LIVING/DINER	3.0	1.8	2.8	1.2	PASS
00_APT02_BEDROOM 1	3.6	2.1	3.5	1.5	PASS
00_APT02_KITCHEN/LIVING/DINER	2.9	1.7	2.7	1.2	PASS
00_APT03_BEDROOM 1	1.8	0.9	1.5	0.5	PASS
00_APT03_BEDROOM 2	3.0	1.8	2.7	1.1	PASS
00_APT03_KITCHEN/LIVING/DINER	2.5	1.4	2.4	1.0	PASS
00_APT04_BEDROOM	1.7	0.8	1.4	0.5	PASS
00_APT04_KITCHEN/LIVING/DINER	2.4	1.3	2.3	0.9	PASS
00_APT05_BEDROOM 1	2.1	1.2	1.9	0.6	PASS
00_APT05_KITCHEN/LIVING/DINER	2.5	1.4	2.4	1.0	PASS
00_APT06_BEDROOM 1	6.4	3.9	5.8	2.8	PASS
00_APT06_BEDROOM 2	3.9	2.8	3.2	1.7	PASS
00_APT06_KITCHEN/LIVING/DINER	3.3	2.1	3.0	1.4	PASS
00_APT07_BEDROOM 1	6.7	4.0	6.0	3.0	PASS
00_APT07_BEDROOM 2	3.9	2.8	3.1	1.7	PASS
00_APT07_KITCHEN/LIVING/DINER	3.3	2.1	3.0	1.4	PASS
00_APT08_BEDROOM 1	6.6	4.0	6.0	3.0	PASS
00_APT08_BEDROOM 2	3.9	2.8	3.1	1.7	PASS
00_APT08_KITCHEN/LIVING/DINER	3.2	2.1	3.0	1.4	PASS
00_APT09_BEDROOM 1	2.4	1.1	1.9	0.5	PASS
00_APT09_KITCHEN/LIVING/DINER	2.4	1.3	2.2	0.8	PASS
01_APT01_BEDROOM 1	7.1	4.2	7.2	3.0	PASS
01_APT01_BEDROOM 2	3.6	2.4	3.0	1.4	PASS
01_APT01_KITCHEN/LIVING/DINER	3.6	2.2	3.4	1.5	PASS



01_APT02_BEDROOM 1	4.5	2.7	4.5	2.1	PASS
01_APT02_KITCHEN/LIVING/DINER	3.7	2.2	3.7	1.5	PASS
01_APT03_BEDROOM 1	2.1	1.0	1.7	0.5	PASS
01_APT03_BEDROOM 2	3.3	2.1	2.9	1.3	PASS
01_APT03_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
01_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS
01_APT04_KITCHEN/LIVING/DINER	2.7	1.6	2.6	1.1	PASS
01_APT05_BEDROOM 1	7.5	4.5	7.6	3.6	FAIL
01_APT05_BEDROOM 2	2.0	1.0	1.7	0.5	PASS
01_APT05_KITCHEN/LIVING/DINER	2.1	1.1	2.0	0.8	PASS
01_APT06_BEDROOM 1	13.9	7.4	8.3	3.7	FAIL
01_APT06_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
01_APT06_KITCHEN/LIVING/DINER	4.3	2.5	3.6	1.7	PASS
01_APT07_BEDROOM 1	16.7	9.3	8.9	3.9	FAIL
01_APT07_BEDROOM 2	4.6	3.3	3.5	2.0	PASS
01_APT07_KITCHEN/LIVING/DINER	6.6	3.1	3.8	1.8	PASS
01_APT08_BEDROOM 1	17.2	9.6	9.5	4.1	FAIL
01_APT08_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
01_APT08_KITCHEN/LIVING/DINER	6.1	2.9	3.6	1.7	PASS
01_APT09_BEDROOM 1	6.0	4.1	4.3	2.2	PASS
01_APT09_BEDROOM 2	5.3	3.7	3.9	2.2	PASS
01_APT09_KITCHEN/LIVING/DINER	8.0	3.9	4.3	2.0	PASS
01_APT10_BEDROOM 1	2.5	1.2	2.1	0.6	PASS
01_APT10_KITCHEN/LIVING/DINER	2.3	1.2	2.2	0.8	PASS
02_APT01_BEDROOM 1	7.1	4.2	7.2	3.0	PASS
02_APT01_BEDROOM 2	3.7	2.4	3.0	1.4	PASS
02_APT01_KITCHEN/LIVING/DINER	3.6	2.2	3.4	1.5	PASS
02_APT02_BEDROOM 1	4.5	2.7	4.5	2.1	PASS
02_APT02_KITCHEN/LIVING/DINER	3.8	2.3	3.7	1.5	PASS
02_APT03_BEDROOM 1	2.1	1.0	1.7	0.5	PASS
02_APT03_BEDROOM 2	3.3	2.1	2.9	1.3	PASS
02_APT03_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
02_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS
02_APT04_KITCHEN/LIVING/DINER	2.7	1.6	2.6	1.1	PASS
02_APT05_BEDROOM 1	7.6	4.6	7.8	3.6	PASS
02_APT05_BEDROOM 2	2.0	1.0	1.7	0.5	PASS
02_APT05_KITCHEN/LIVING/DINER	2.1	1.2	2.0	0.8	PASS
02_APT06_BEDROOM 1	14.2	7.6	8.5	3.7	FAIL



02_APT06_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
02_APT06_KITCHEN/LIVING/DINER	4.3	2.5	3.6	1.7	PASS
02_APT07_BEDROOM 1	16.9	9.4	9.3	4.0	FAIL
02_APT07_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
02_APT07_KITCHEN/LIVING/DINER	6.7	3.1	3.8	1.8	PASS
02_APT08_BEDROOM 1	17.3	9.7	9.5	4.1	FAIL
02_APT08_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
02_APT08_KITCHEN/LIVING/DINER	6.2	2.9	3.6	1.7	PASS
02_APT09_BEDROOM 1	6.1	4.2	4.3	2.2	PASS
02_APT09_BEDROOM 2	5.3	3.7	3.9	2.2	PASS
02_APT09_KITCHEN/LIVING/DINER	8.0	3.9	4.3	2.0	PASS
02_APT10_BEDROOM 1	2.5	1.2	2.1	0.6	PASS
02_APT10_KITCHEN/LIVING/DINER	2.3	1.2	2.2	0.8	PASS
03_APT01_BEDROOM 1	7.1	4.2	7.2	3.0	PASS
03_APT01_BEDROOM 2	3.7	2.4	3.0	1.4	PASS
03_APT01_KITCHEN/LIVING/DINER	3.6	2.2	3.4	1.5	PASS
03_APT02_BEDROOM 1	4.5	2.7	4.5	2.1	PASS
03_APT02_KITCHEN/LIVING/DINER	3.8	2.3	3.7	1.5	PASS
03_APT03_BEDROOM 1	2.1	1.0	1.7	0.5	PASS
03_APT03_BEDROOM 2	3.3	2.1	2.9	1.3	PASS
03_APT03_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
03_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS
03_APT04_KITCHEN/LIVING/DINER	2.7	1.6	2.6	1.1	PASS
03_APT05_BEDROOM 1	7.6	4.6	7.8	3.6	FAIL
03_APT05_BEDROOM 2	2.0	1.0	1.7	0.5	PASS
03_APT05_KITCHEN/LIVING/DINER	2.1	1.2	2.0	0.8	PASS
03_APT06_BEDROOM 1	14.2	7.6	8.5	3.7	FAIL
03_APT06_BEDROOM 2	4.6	3.3	3.6	2.1	PASS
03_APT06_KITCHEN/LIVING/DINER	4.3	2.5	3.6	1.7	PASS
03_APT07_BEDROOM 1	16.8	9.3	9.2	4.0	FAIL
03_APT07_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
03_APT07_KITCHEN/LIVING/DINER	6.8	3.2	3.9	1.8	PASS
03_APT08_BEDROOM 1	17.1	9.6	9.4	4.1	FAIL
03_APT08_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
03_APT08_KITCHEN/LIVING/DINER	6.2	2.9	3.6	1.7	PASS
03_APT09_BEDROOM 1	6.1	4.2	4.3	2.2	PASS
03_APT09_BEDROOM 2	5.3	3.7	3.9	2.2	PASS
03_APT09_KITCHEN/LIVING/DINER	8.0	3.9	4.3	2.0	PASS



03_APT10_BEDROOM 1	2.6	1.2	2.1	0.6	PASS
03_APT10_KITCHEN/LIVING/DINER	2.3	1.2	2.2	0.8	PASS
04_APT01_BEDROOM 1	7.2	4.2	7.3	3.0	PASS
04_APT01_BEDROOM 2	3.7	2.4	3.0	1.4	PASS
04_APT01_KITCHEN/LIVING/DINER	3.6	2.2	3.4	1.5	PASS
04_APT02_BEDROOM 1	4.6	2.8	4.5	2.1	PASS
04_APT02_KITCHEN/LIVING/DINER	3.9	2.4	3.8	1.6	PASS
04_APT03_BEDROOM 1	2.1	1.1	1.7	0.5	PASS
04_APT03_BEDROOM 2	3.3	2.1	2.9	1.3	PASS
04_APT03_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
04_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS
04_APT04_KITCHEN/LIVING/DINER	2.8	1.6	2.6	1.1	PASS
04_APT05_BEDROOM 1	7.6	4.6	7.8	3.6	FAIL
04_APT05_BEDROOM 2	2.0	1.0	1.7	0.5	PASS
04_APT05_KITCHEN/LIVING/DINER	2.1	1.2	2.1	0.8	PASS
04_APT06_BEDROOM 1	14.1	7.6	8.4	3.7	FAIL
04_APT06_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
04_APT06_KITCHEN/LIVING/DINER	4.3	2.5	3.6	1.7	PASS
04_APT07_BEDROOM 1	16.9	9.4	9.3	4.0	FAIL
04_APT07_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
04_APT07_KITCHEN/LIVING/DINER	6.9	3.2	3.9	1.8	PASS
04_APT08_BEDROOM 1	17.3	9.6	9.5	4.1	FAIL
04_APT08_BEDROOM 2	4.6	3.3	3.6	2.0	PASS
04_APT08_KITCHEN/LIVING/DINER	6.3	2.9	3.6	1.7	PASS
04_APT09_BEDROOM 1	6.1	4.2	4.3	2.2	PASS
04_APT09_BEDROOM 2	5.3	3.7	3.9	2.2	PASS
04_APT09_KITCHEN/LIVING/DINER	8.1	4.0	4.3	2.0	PASS
04_APT10_BEDROOM 1	3.0	1.5	2.4	0.7	PASS
04_APT10_KITCHEN/LIVING/DINER	3.1	1.9	2.9	1.2	PASS
05_APT01_BEDROOM 1	7.3	4.2	7.4	3.0	PASS
05_APT01_BEDROOM 2	3.6	2.4	3.0	1.4	PASS
05_APT01_KITCHEN/LIVING/DINER	3.7	2.2	3.4	1.6	PASS
05_APT02_BEDROOM 1	4.7	2.8	4.6	2.1	PASS
05_APT02_KITCHEN/LIVING/DINER	3.9	2.5	3.8	1.6	PASS
05_APT03_BEDROOM 1	2.1	1.1	1.7	0.5	PASS
05_APT03_BEDROOM 2	3.3	2.1	2.9	1.3	PASS
05_APT03_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
05_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS



05_APT04_KITCHEN/LIVING/DINER	2.8	1.6	2.7	1.2	PASS
05_APT05_BEDROOM 1	7.8	4.7	8.0	3.6	FAIL
05_APT05_BEDROOM 2	2.0	1.0	1.8	0.5	PASS
05_APT05_KITCHEN/LIVING/DINER	2.2	1.2	2.1	0.8	PASS
05_APT06_BEDROOM 1	14.7	7.9	8.7	3.7	FAIL
05_APT06_BEDROOM 2	4.5	3.3	3.6	2.0	PASS
05_APT06_KITCHEN/LIVING/DINER	4.5	2.5	3.7	1.7	PASS
05_APT07_BEDROOM 1	17.5	9.7	9.5	4.0	FAIL
05_APT07_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
05_APT07_KITCHEN/LIVING/DINER	7.0	3.3	3.8	1.8	PASS
05_APT08_BEDROOM 1	18.2	10.3	9.9	4.2	FAIL
05_APT08_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
05_APT08_KITCHEN/LIVING/DINER	6.5	3.0	3.6	1.7	PASS
05_APT09_BEDROOM 1	6.0	4.2	4.3	2.2	PASS
05_APT09_BEDROOM 2	5.2	3.7	3.9	2.2	PASS
05_APT09_KITCHEN/LIVING/DINER	8.3	4.1	4.4	2.0	PASS
05_APT10_BEDROOM 1	3.1	1.5	2.4	0.7	PASS
05_APT10_KITCHEN/LIVING/DINER	3.1	2.0	2.9	1.3	PASS
06_APT01_BEDROOM 1	7.4	4.3	7.5	3.0	PASS
06_APT01_BEDROOM 2	3.6	2.4	3.0	1.4	PASS
06_APT01_KITCHEN/LIVING/DINER	3.7	2.3	3.5	1.6	PASS
06_APT02_BEDROOM 1	5.0	3.1	4.7	2.1	PASS
06_APT02_KITCHEN/LIVING/DINER	4.0	2.5	3.9	1.6	PASS
06_APT03_BEDROOM 1	2.2	1.1	1.8	0.5	PASS
06_APT03_BEDROOM 2	3.4	2.1	2.9	1.3	PASS
06_APT03_KITCHEN/LIVING/DINER	3.0	1.8	2.9	1.3	PASS
06_APT04_BEDROOM	1.8	0.9	1.6	0.5	PASS
06_APT04_KITCHEN/LIVING/DINER	2.9	1.6	2.7	1.2	PASS
06_APT05_BEDROOM 1	8.0	4.7	8.2	3.7	FAIL
06_APT05_BEDROOM 2	2.0	1.0	1.8	0.5	PASS
06_APT05_KITCHEN/LIVING/DINER	2.2	1.2	2.1	0.8	PASS
06_APT06_BEDROOM 1	15.5	8.3	8.9	3.8	FAIL
06_APT06_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
06_APT06_KITCHEN/LIVING/DINER	4.6	2.6	3.6	1.8	PASS
06_APT07_BEDROOM 1	17.8	10.1	9.7	4.0	FAIL
06_APT07_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
06_APT07_KITCHEN/LIVING/DINER	7.1	3.4	3.9	1.8	PASS
06_APT08_BEDROOM 1	18.4	10.6	10.0	4.2	FAIL



06_APT08_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
06_APT08_KITCHEN/LIVING/DINER	6.6	3.1	3.6	1.7	PASS
06_APT09_BEDROOM 1	6.0	4.1	4.3	2.2	PASS
06_APT09_BEDROOM 2	5.2	3.7	3.9	2.2	PASS
06_APT09_KITCHEN/LIVING/DINER	8.4	4.2	4.4	2.0	PASS
06_APT10_BEDROOM 1	3.1	1.5	2.5	0.7	PASS
06_APT10_KITCHEN/LIVING/DINER	3.1	2.0	2.9	1.3	PASS
07_APT01_BEDROOM 1	7.6	4.3	7.6	3.0	PASS
07_APT01_BEDROOM 2	3.6	2.4	3.0	1.5	PASS
07_APT01_KITCHEN/LIVING/DINER	3.7	2.3	3.5	1.6	PASS
07_APT02_BEDROOM 1	5.1	3.1	4.7	2.2	PASS
07_APT02_KITCHEN/LIVING/DINER	4.0	2.6	3.9	1.7	PASS
07_APT03_BEDROOM 1	2.2	1.1	1.8	0.5	PASS
07_APT03_BEDROOM 2	3.4	2.2	3.0	1.3	PASS
07_APT03_KITCHEN/LIVING/DINER	3.1	1.8	2.9	1.3	PASS
07_APT04_BEDROOM 1	1.8	0.9	1.6	0.5	PASS
07_APT04_KITCHEN/LIVING/DINER	2.9	1.7	2.8	1.2	PASS
07_APT05_BEDROOM 1	8.2	4.9	8.5	3.8	FAIL
07_APT05_BEDROOM 2	2.1	1.1	1.8	0.5	PASS
07_APT05_KITCHEN/LIVING/DINER	2.3	1.3	2.2	0.9	PASS
07_APT06_BEDROOM 1	15.8	8.7	9.1	3.8	FAIL
07_APT06_BEDROOM 2	4.5	3.3	3.5	2.0	PASS
07_APT06_KITCHEN/LIVING/DINER	4.7	2.6	3.6	1.8	PASS
07_APT07_BEDROOM 1	18.2	10.3	9.9	4.0	FAIL
07_APT07_BEDROOM 2	4.5	3.2	3.5	2.0	PASS
07_APT07_KITCHEN/LIVING/DINER	7.3	3.4	3.9	1.8	PASS
07_APT08_BEDROOM 1	18.7	10.8	10.1	4.2	FAIL
07_APT08_BEDROOM 2	4.5	3.2	3.5	2.0	PASS
07_APT08_KITCHEN/LIVING/DINER	6.8	3.2	3.6	1.7	PASS
07_APT09_BEDROOM 1	5.7	3.9	4.0	2.0	PASS
07_APT09_BEDROOM 2	5.1	3.6	3.8	2.1	PASS
07_APT09_KITCHEN/LIVING/DINER	8.5	4.3	4.3	2.0	PASS
07_APT10_BEDROOM 1	3.0	1.5	2.5	0.7	PASS
07_APT10_KITCHEN/LIVING/DINER	3.1	1.8	2.8	1.3	PASS
08_APT01_BEDROOM 1	8.4	4.7	8.4	3.6	FAIL
08_APT01_BEDROOM 2	3.3	2.0	2.7	1.1	PASS
08_APT01_KITCHEN/LIVING/DINER	3.3	2.0	3.1	1.3	PASS
08_APT02_BEDROOM 1	4.4	2.7	4.3	1.8	PASS

08_APT02_KITCHEN/LIVING/DINER	3.7	2.2	3.4	1.4	PASS
08_APT03_BEDROOM 1	2.1	0.9	1.5	0.3	PASS
08_APT03_BEDROOM 2	3.3	1.8	2.6	1.0	PASS
08_APT03_KITCHEN/LIVING/DINER	2.3	1.3	2.2	0.8	PASS
08_APT04_BEDROOM 1	1.5	0.6	1.3	0.2	PASS
08_APT04_KITCHEN/LIVING/DINER	2.2	1.2	2.2	0.8	PASS
08_APT05_BEDROOM 1	6.1	3.4	5.9	2.8	PASS
08_APT05_BEDROOM 2	1.8	0.8	1.4	0.4	PASS
08_APT05_KITCHEN/LIVING/DINER	1.9	1.1	1.7	0.6	PASS
08_APT06_BEDROOM 1	9.1	4.9	7.4	3.0	PASS
08_APT06_BEDROOM 2	3.9	2.7	3.1	1.5	PASS
08_APT06_KITCHEN/LIVING/DINER	3.5	2.3	3.2	1.5	PASS
08_APT07_BEDROOM 1	9.6	5.2	7.9	3.0	PASS
08_APT07_BEDROOM 2	3.9	2.7	3.1	1.5	PASS
08_APT07_KITCHEN/LIVING/DINER	4.3	2.4	3.4	1.6	PASS
08_APT08_BEDROOM 1	14.1	8.2	8.3	3.6	FAIL
08_APT08_BEDROOM 2	3.9	2.7	3.1	1.5	PASS
08_APT08_KITCHEN/LIVING/DINER	4.0	2.2	3.3	1.5	PASS
08_APT09_BEDROOM 2	16.7	7.6	11.2	7.0	FAIL
08_APT09_KITCHEN/LIVING/DINER	7.3	4.9	5.7	2.7	PASS
08_APT10_BEDROOM 1	5.7	3.3	4.3	1.3	PASS
08_APT10_BEDROOM 2	3.7	2.2	3.2	1.2	PASS

The following table shows the predicted percentage of occupied hours the internal temperature exceeds 28°C in all corridor areas. Whilst there is no mandatory target for corridor temperatures, if an Operative Temperature of 28 °C is exceeded for more than 3% of total annual hours, for the purpose of this report, this is considered a significant overheating risk:

ROOM NAME	TM59 CRITERIA % Hrs TOP- 28°C>=1K	PASS/FAIL
00_CORRIDOR	0	PASS
00_STAIRS 1	0	PASS
00_STAIRS 2	0	PASS
01_CORRIDOR	0	PASS
01_STAIRS 1	0	PASS
01_STAIRS 2	0.1	PASS
02_CORRIDOR	0	PASS
02_STAIRS 1	0	PASS

02_STAIRS 2	0.1	PASS
03_CORRIDOR	0	PASS
03_STAIRS 1	0	PASS
03_STAIRS 2	0.1	PASS
04_CORRIDOR	0	PASS
04_STAIRS 1	0	PASS
04_STAIRS 2	0.1	PASS
05_CORRIDOR	0	PASS
05_STAIRS 1	0	PASS
05_STAIRS 2	0.1	PASS
06_CORRIDOR	0	PASS
06_STAIRS 1	0	PASS
06_STAIRS 2	0.1	PASS
07_CORRIDOR	0	PASS
07_STAIRS 1	0	PASS
07_STAIRS 2	0.1	PASS
08_CORRIDOR	0	PASS
08_STAIRS 1	0	PASS
08_STAIRS 2	0.1	PASS
LG_STAIRS 1	0.6	PASS
LG_STAIRS 2	0.3	PASS
RF_STAIRS 2	0	PASS

-END