
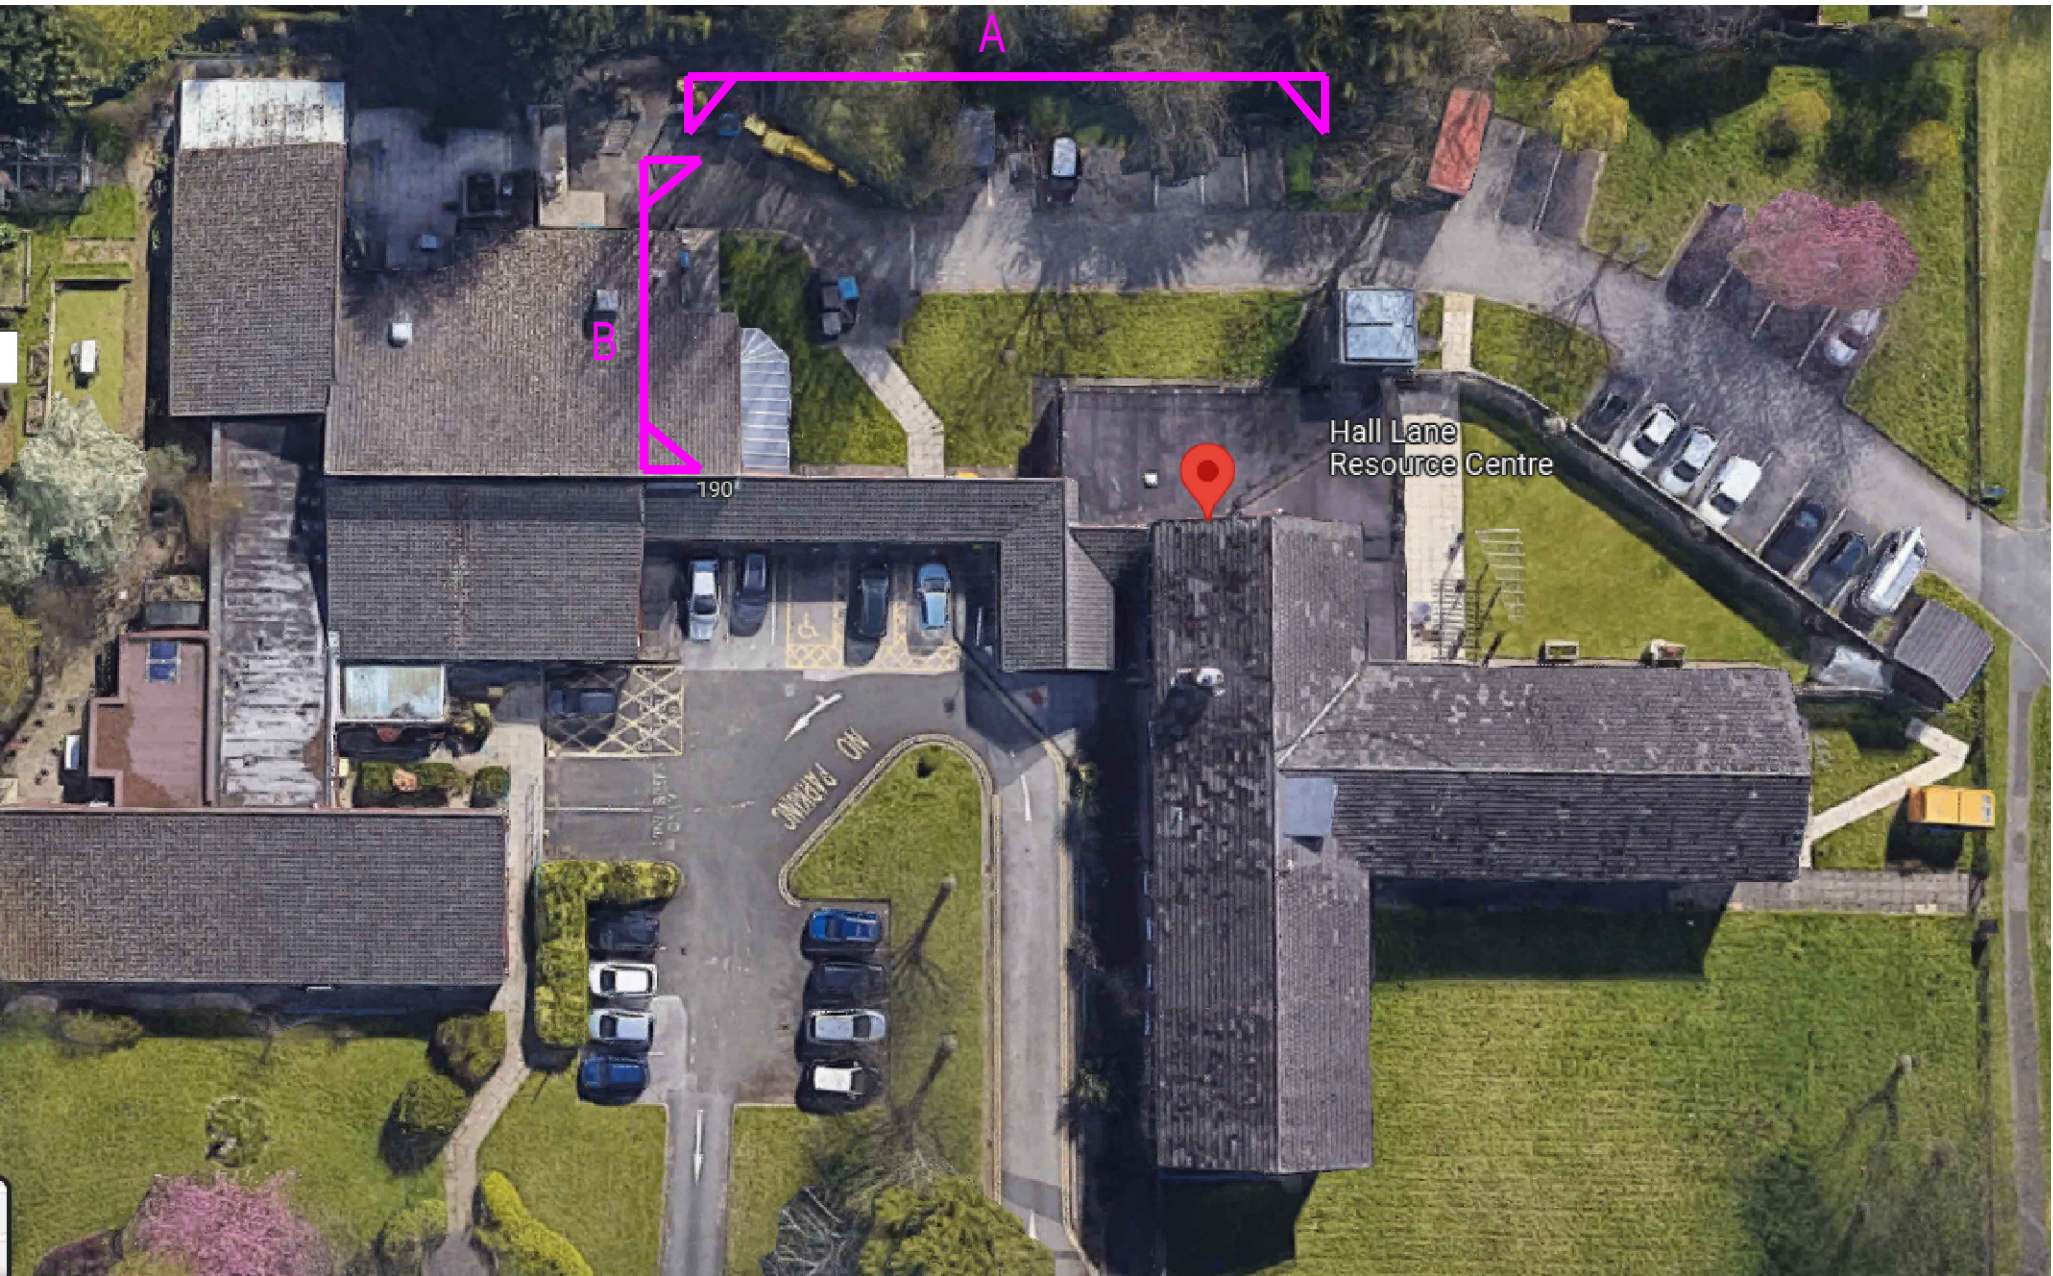
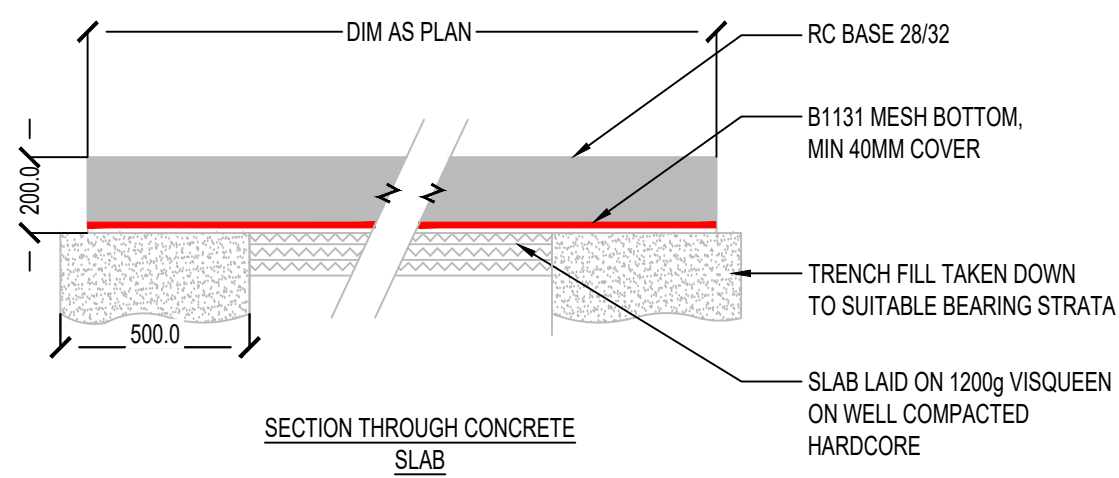


150mm CONCRETE BASE FOR HEAT PUMP AND ENCLOSURE TO SIT ON. CONCRETE SPECIFICATION SHOWN BELOW IN A SEPARATE DETAIL

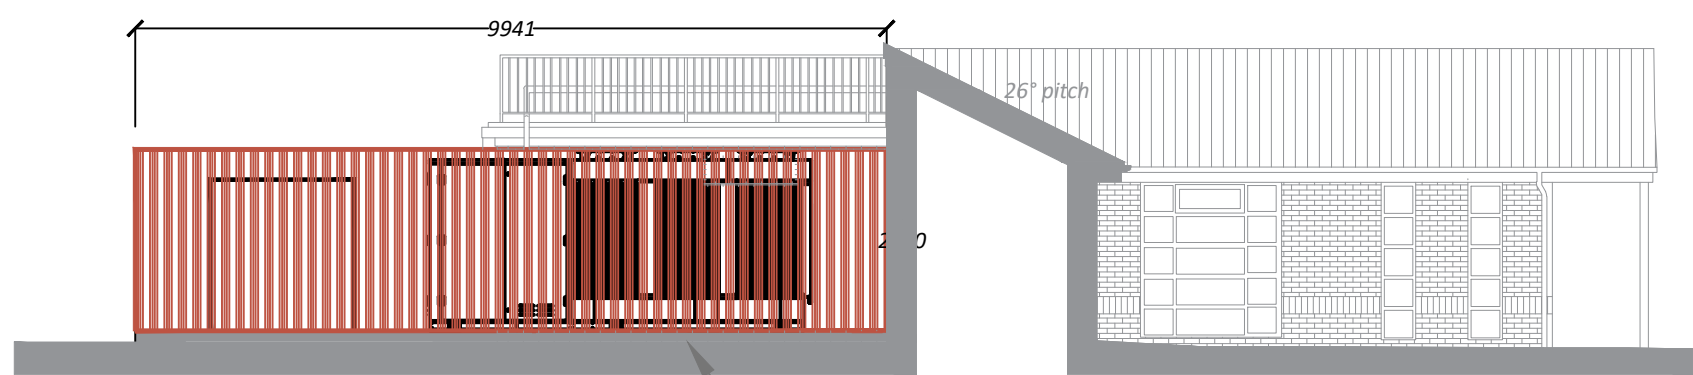

SITE LAYOUT - SCALE 1:100 @A1

- NOTES
- WHERE LTHW SERVICES PASS THROUGH WALLS (STRUCTURAL OR STUDWORK) FORMING FIRE COMPARTMENTATION OR THROUGH FLOORS FORMING VERTICAL FIRE COMPARTMENTATION THE CONTRACTOR SHALL SLEEVE/SEAL THE OPENING FORMED FOR THE SERVICES WITH A PROPRIETY FIRE SEALANT AND ACOUSTIC SEALANT TO THE ARCHITECT'S SPECIFICATION.
 - THE CONTRACTOR SHALL REFER TO THE ARCHITECT'S DRAWINGS FOR LOCATIONS OF ALL FIRE COMPARTMENTS AND THE REQUIRED PERFORMANCES OF ALL SEALS.
 - ALL HIGH POINTS ON MAIN PIPEWORK SHALL BE INSTALLED WITH MANUAL AIR VENTS, UNLESS NOTED OTHERWISE.
 - ALL LOW POINTS ON PIPEWORK SHALL BE INSTALLED WITH DRAIN OFF COCKS.
 - ALL VALVES AND CONTROL EQUIPMENT SHALL BE FULLY ACCESSIBLE TO ENABLE SERVICE, MAINTENANCE AND REPLACEMENT.
 - MEANS FOR EXPANSION SHALL BE PROVIDED WHERE STRUCTURAL MOVEMENT JOINTS ARE PRESENT.
 - FINAL NUMBER, SIZE AND LOCATION OF ALL EXPANSION BELLOWS, GUIDES AND ANCHOR POINTS SHALL BE DESIGNED BY CONTRACTOR PRIOR TO INSTALLATION.
 - FOR PIPEWORK MATERIAL AND INSULATION REFER TO SPECIFICATION.
 - ANY VALVE ARRANGEMENTS SHOWN ARE INDICATIVE ONLY. THE CONTRACTOR SHALL REFER TO THE MECHANICAL AND PUBLIC HEALTH SCHEMATICS TO CONFIRM ALL VALVE ARRANGEMENTS, SCHEMATIC ARRANGEMENT AND PIPE SIZES.

A	15.11.22	ISSUED FOR COMMENT
Rev	Date	Details
Drawing Title: HALL LANE RESOURCE CENTRE ELEVATIONS		
Drawing No. 6776-M-DR-02		01
Site Address: Hall Lane Resource Centre		
Client Drawing Ref: -		
Project Manager: DT	Designed By: JA	Date: 24.10.22
Scale @ A1: 1:100	Drawn By: GS	Revision: A