


Contractor to obtain all necessary information and carry out all necessary investigations regarding position of underground services in vicinity of works prior to excavations


locate & connect into existing drains first !

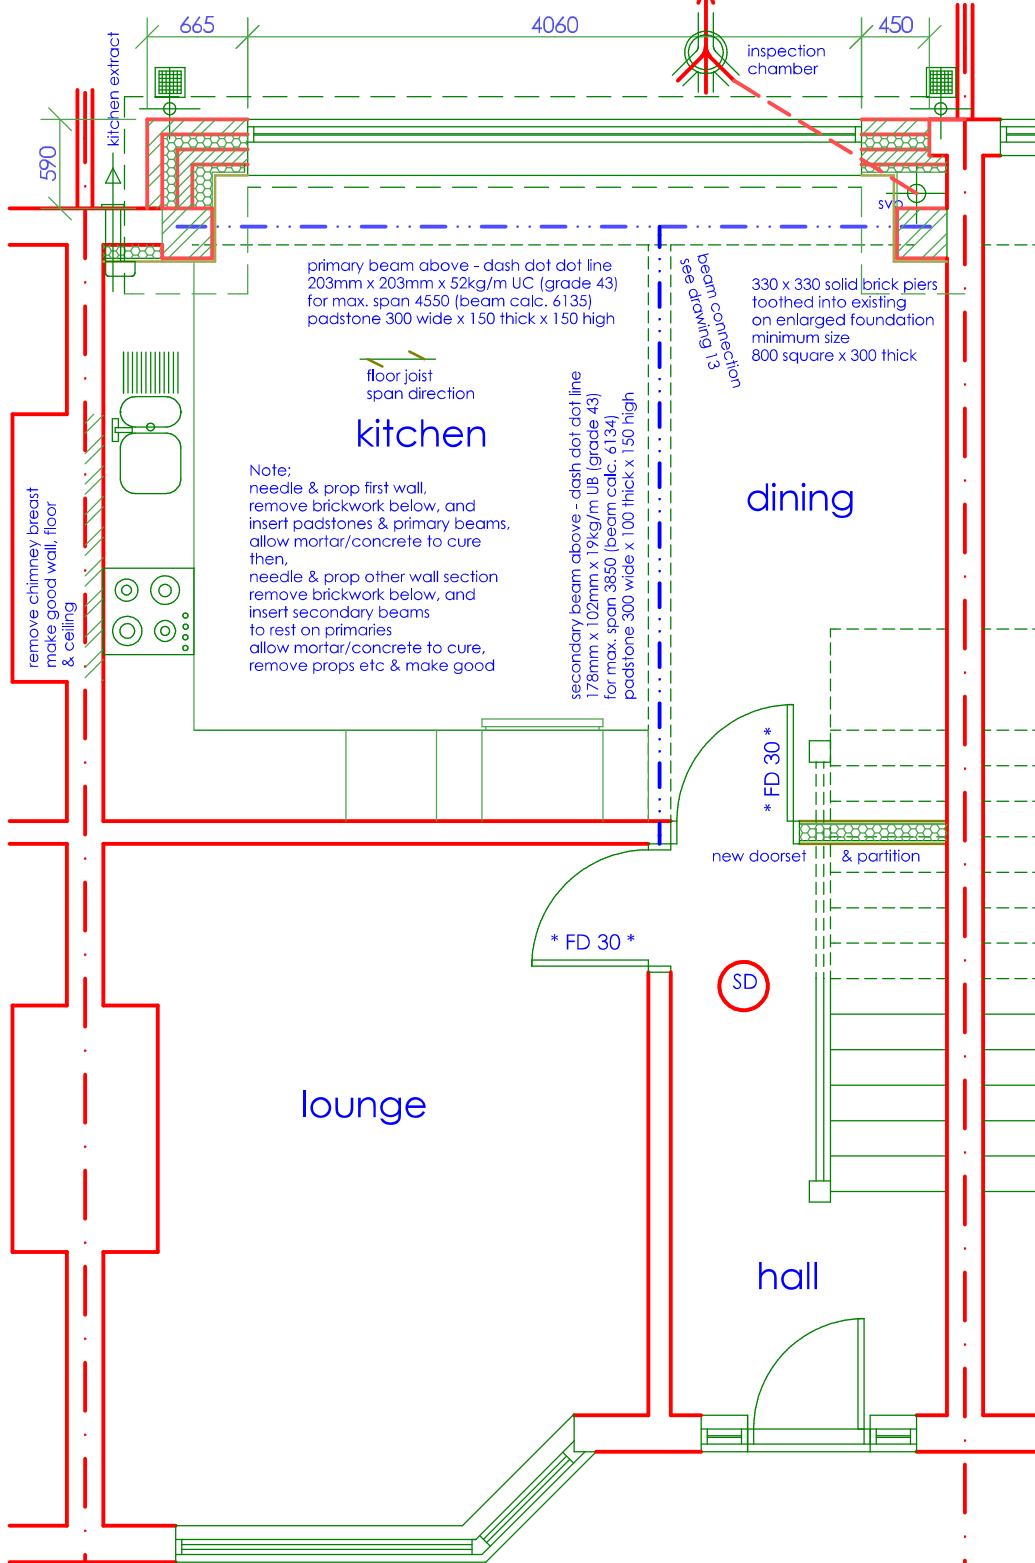

GROUND

The Electrical & Mechanical works shown in this drawing package is an initial indication of client requirements and it is the responsibility of specialist(s) employed by the client/builder to design, supply, install the works and provide operating & maintenance instructions/manuals/files/records & installation certificates for the works. All works to be in accord with Building Regulations.

All electrical work will be designed, installed, inspected & tested by a person competent to do so. Prior to completion of the works the Local Authority will require be satisfied that: An electrical installation certificate issued under a "Competent Person" scheme has been issued. Appropriate certificates & forms to BS7671 to be provided.

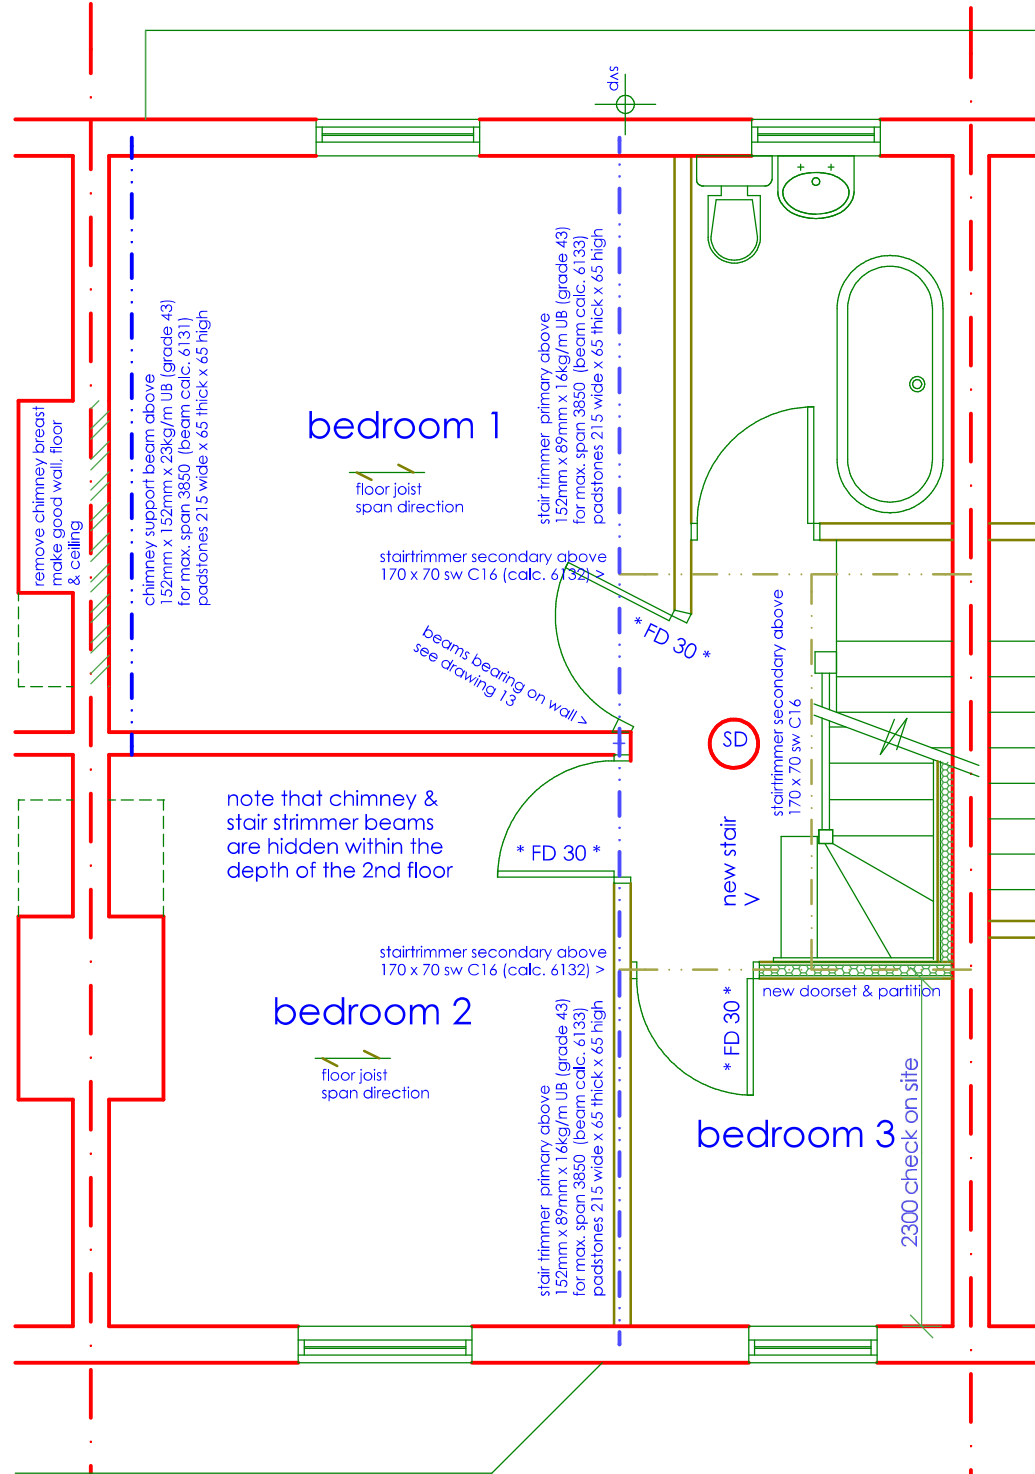

FIRST


All works in connection with gas shall only be undertaken by a GAS SAFE registered installer. Any new and replacement natural gas & LPG boilers to have a minimum SEDBUK rating of 90%. Radiators to be fitted with thermostatic valves.

SD denotes self contained smoke alarm to BS 5446 : Part 1 mains operated and permanently wired to a separately fused circuit at the distribution board; alarm also to have battery back up; alarm to be interconnect with any other alarms in the same dwellinghouse; wiring to be standard IEE regulations but need not be 'pyrotechnic'.

The contractor(s) are responsible for checking all dimensions and existing features on site prior to fabrication, manufacture or construction of the works






Scale: all dimension in mm unless otherwise stated

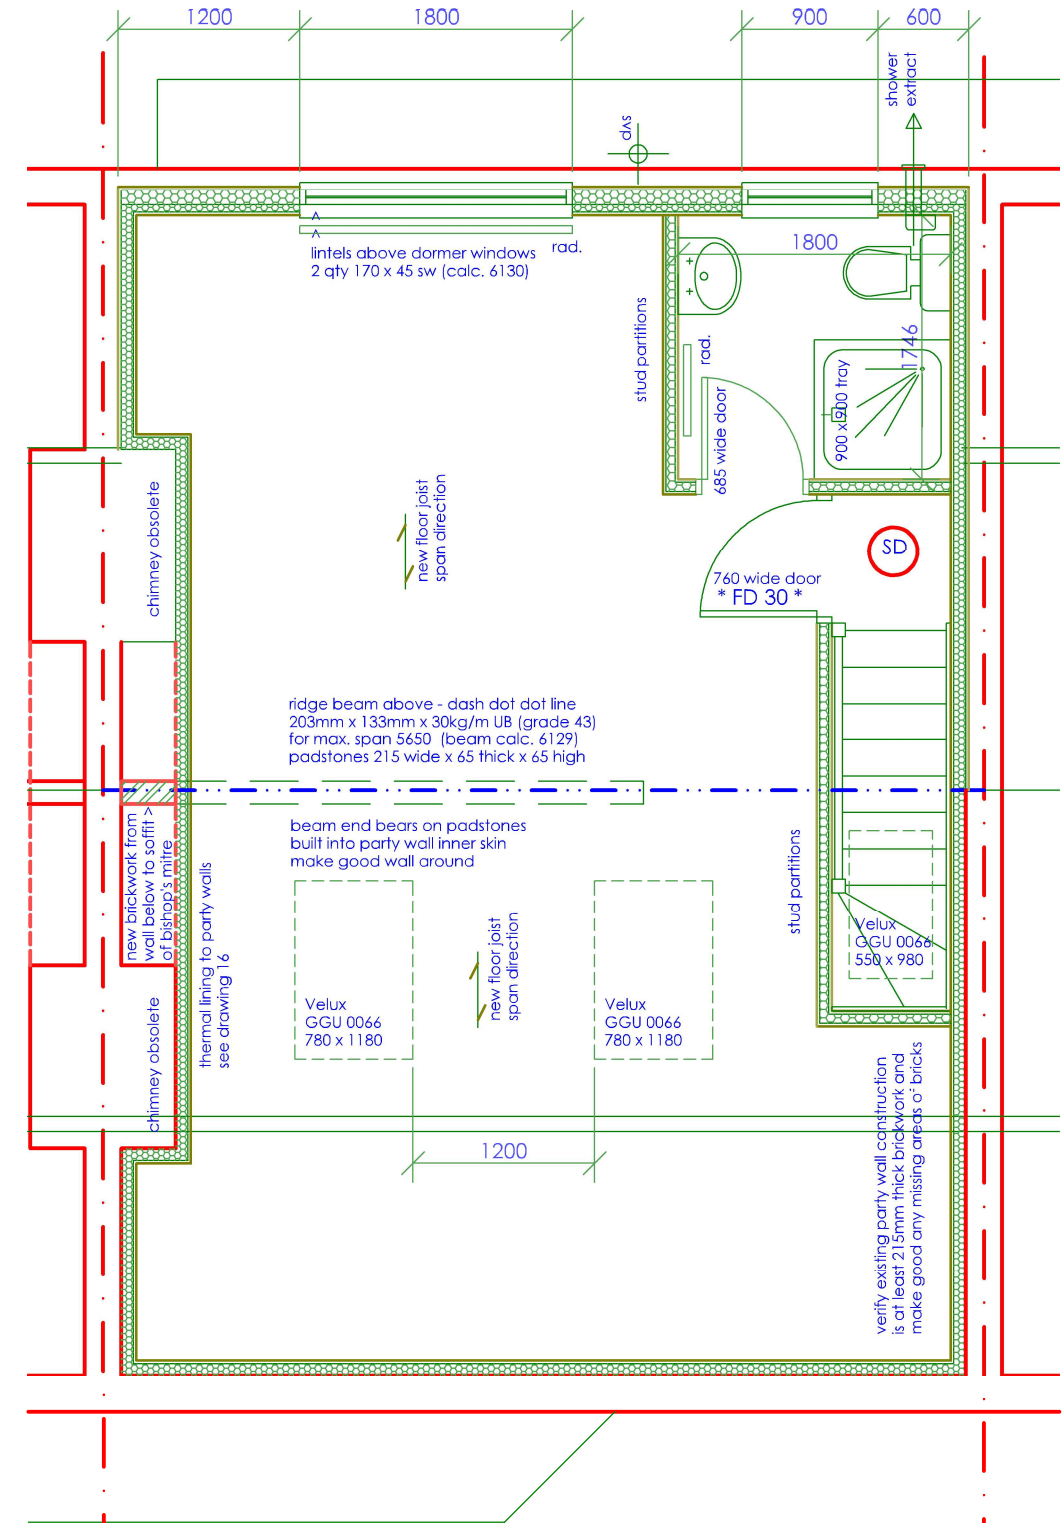


LOFT


A proportion of new light fittings to be low energy/ eg: fluorescent or compact fluorescent or any fitting with efficacy > 45lmwp lumens per cuicuit watt and a total output of greater than 400 lamp lumens; minimum 3 fittings per 4 fittings. Fittings in stores, cupboards, wardrobes excluded from count. Garage fittings to have high frequency electronic ballast.



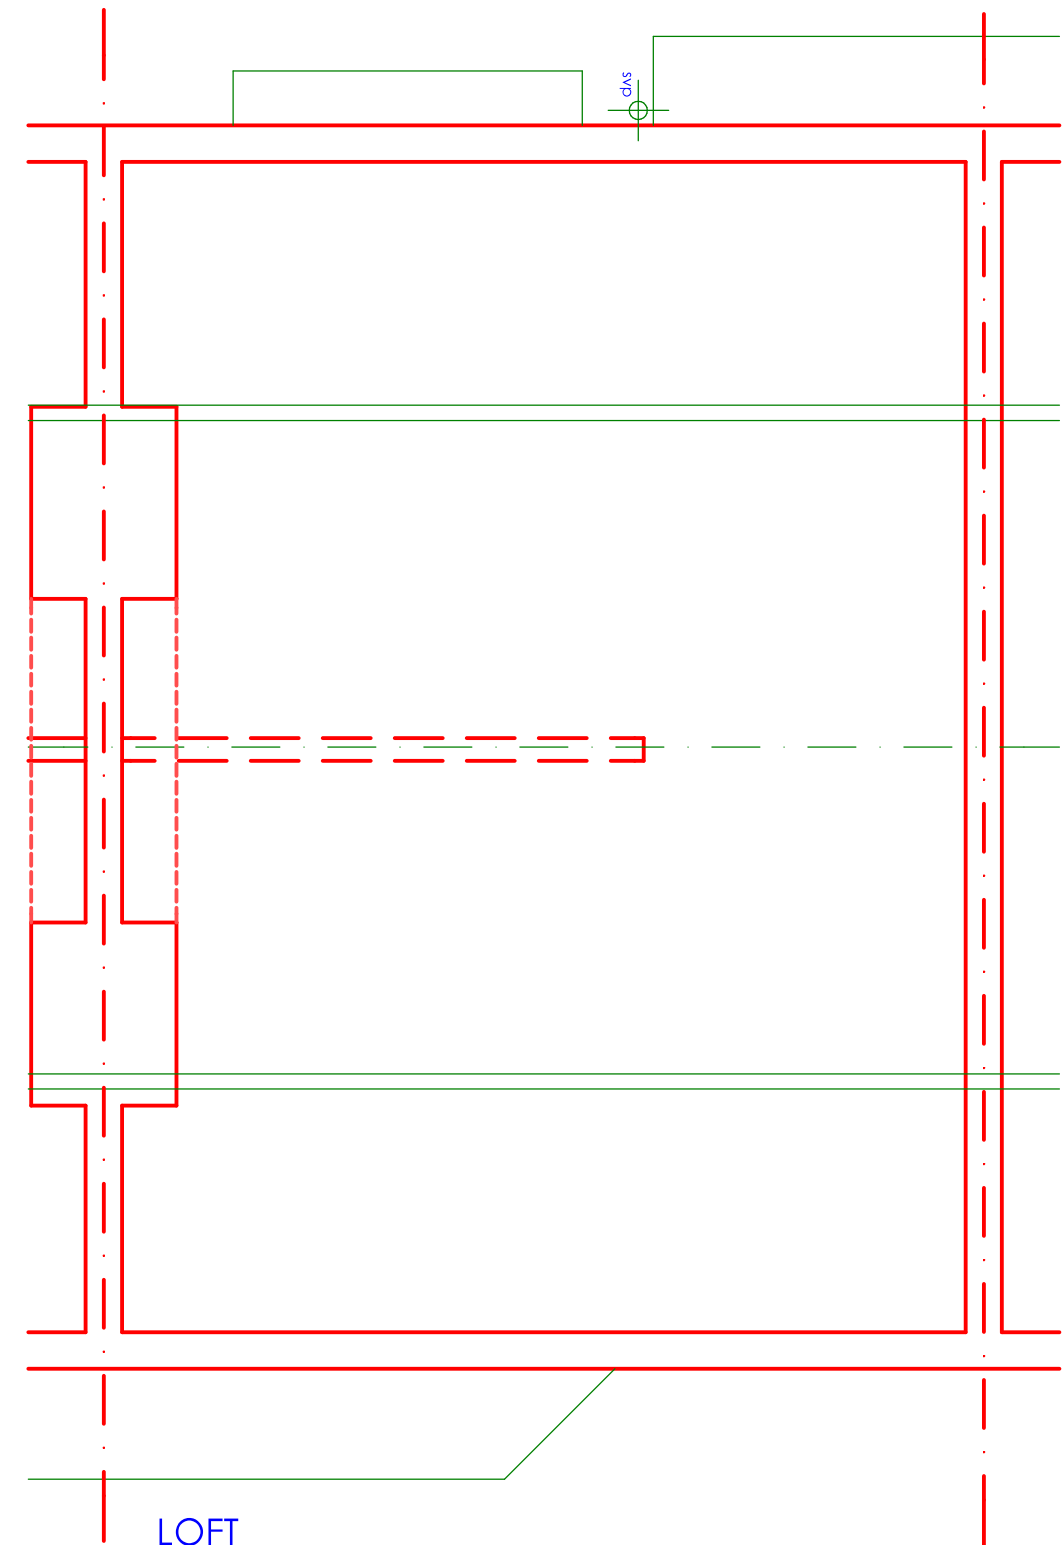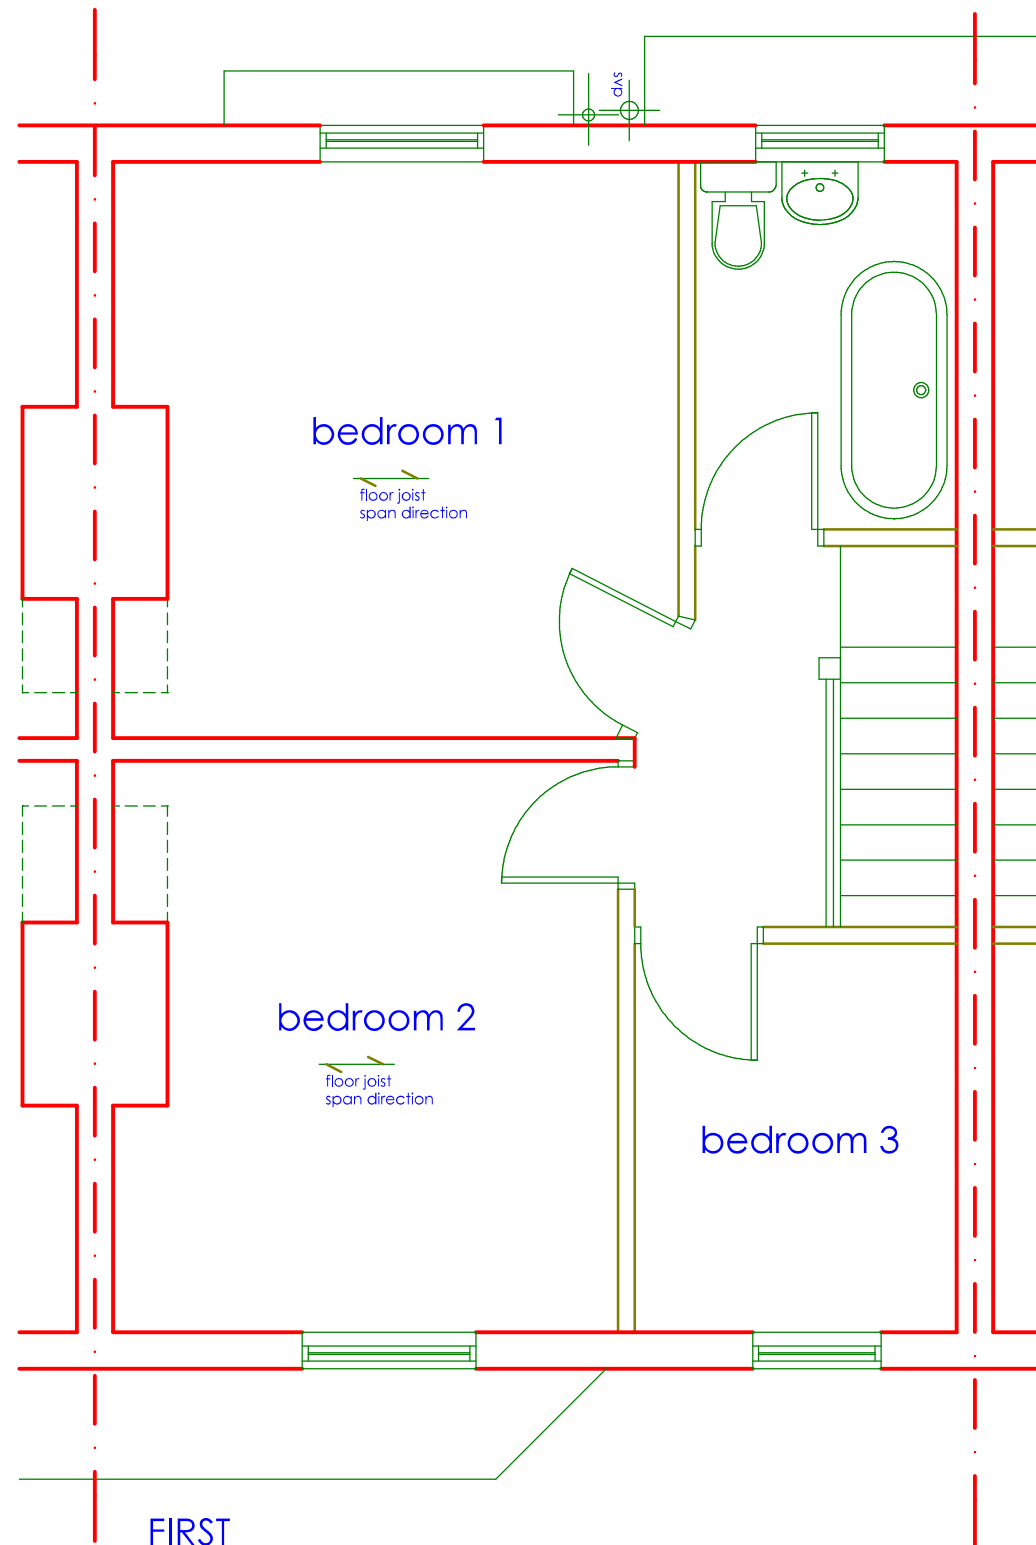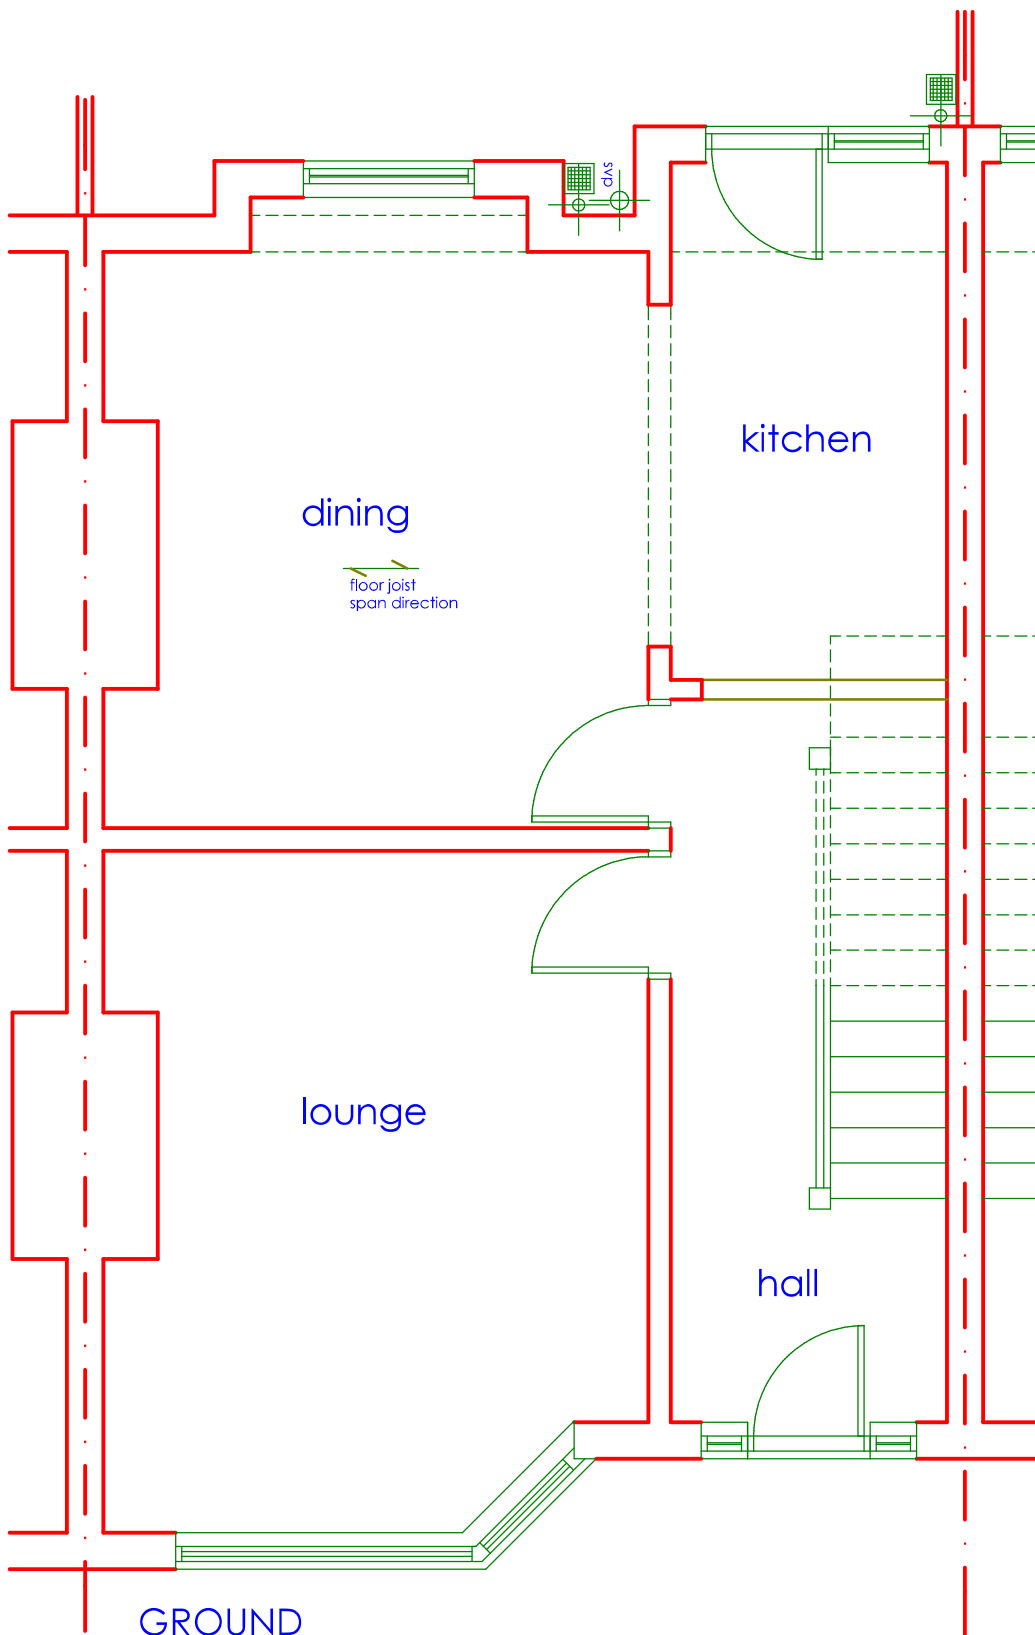


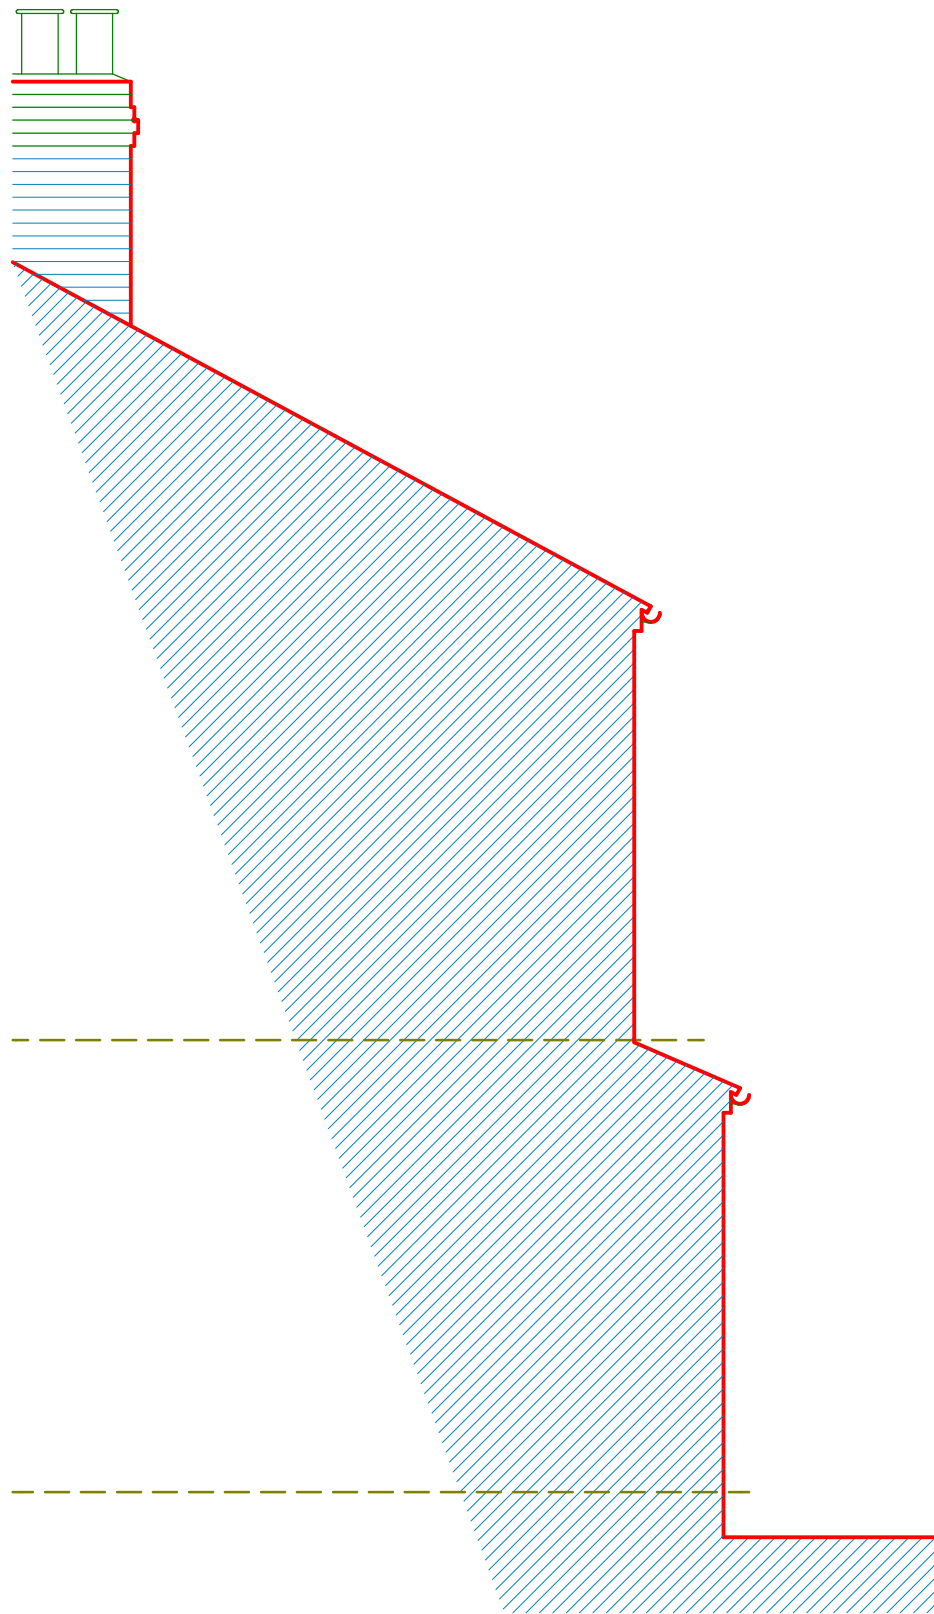

SIDE

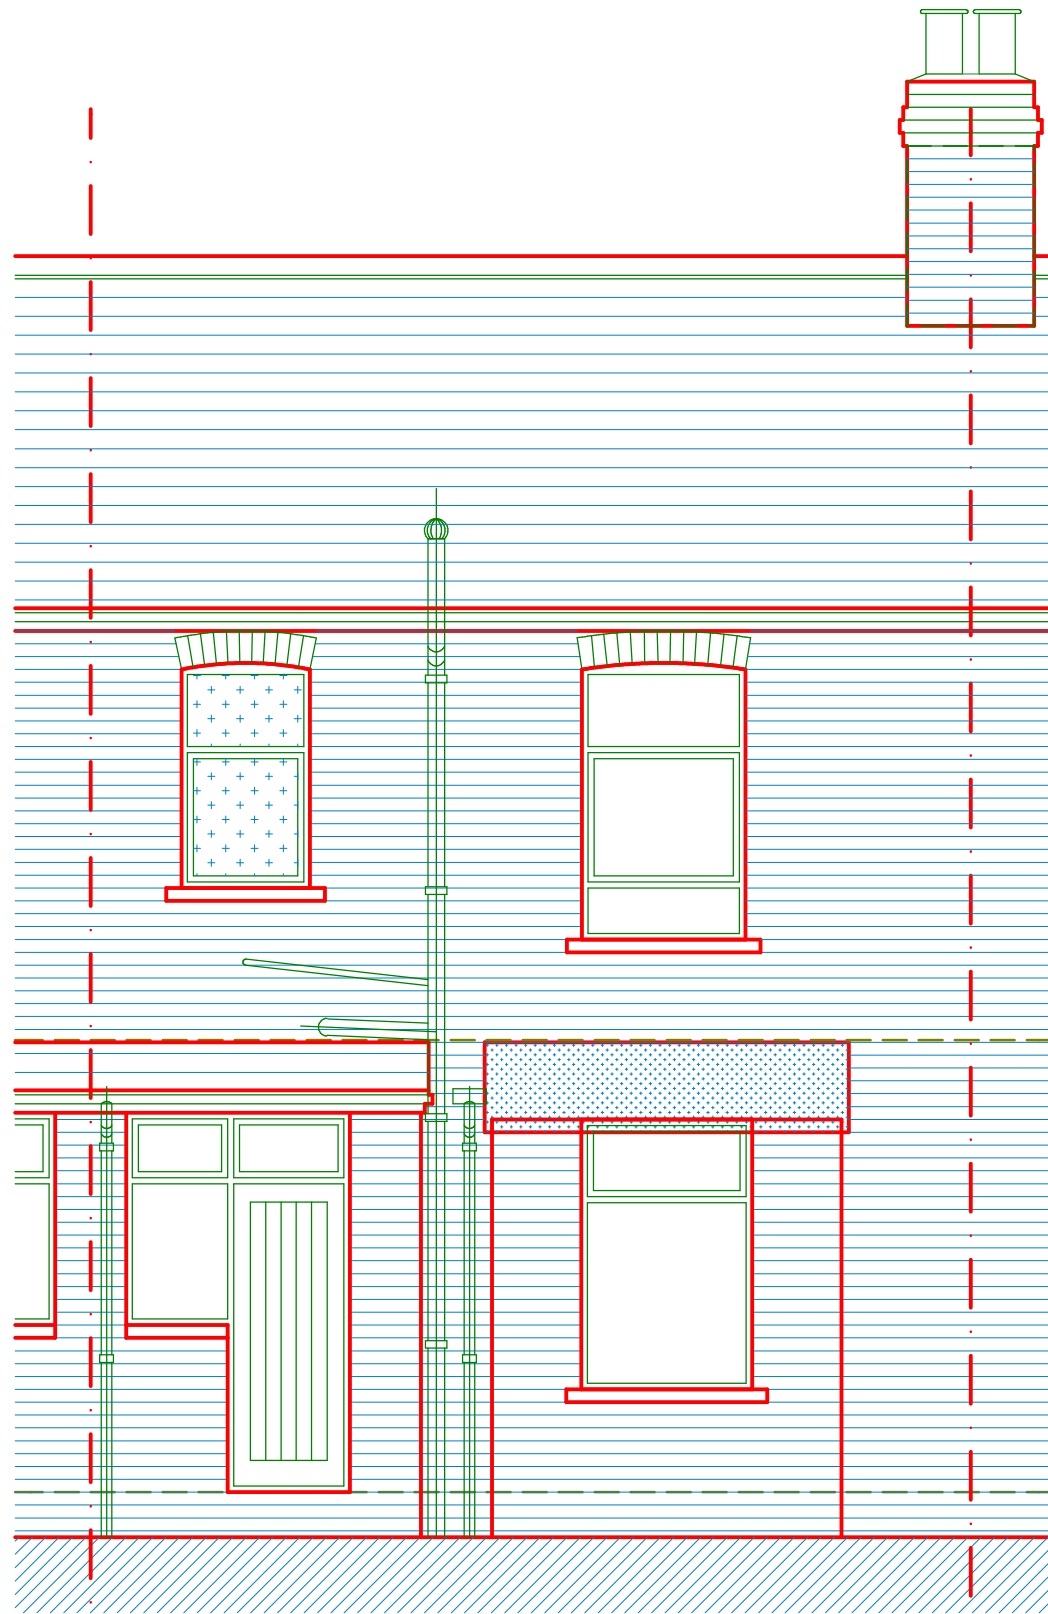

REAR

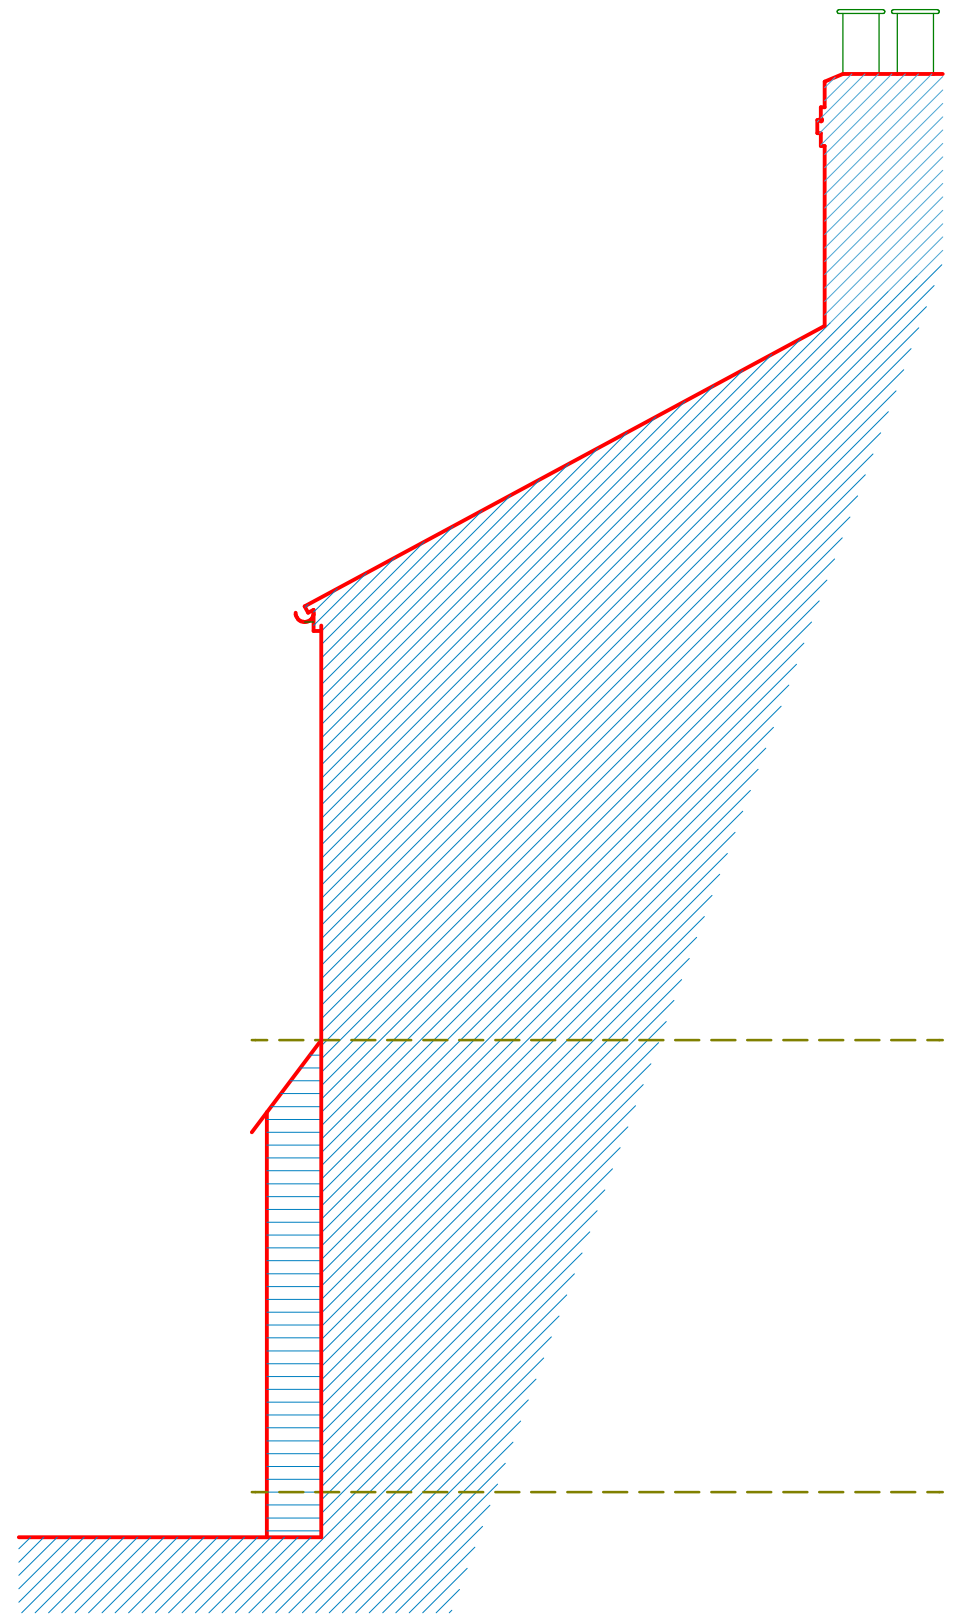

SIDE

