


NEW CARPARK LIGHTING COLUMNS TO BE INSTALLED AS SHOWN.

NEW CABLES TO RUN ALONG THE EDGE OF THE NEW CARPARK, BETWEEN EACH COLUMN VIA 10mm² SWA CABLES BURIED IN THE GROUND.

NEW LIGHTING SUPPLIED FROM ID OFFICES (BUILDING 47) DISTRIBUTION BOARDS, CONTROLLED VIA A TIMELOCK AND PHOTOCELL MOUNTED ON BUILDING 47.

LUX LEVELS AND ISOLINES FOR PROPOSED LAYOUT SHOWN.

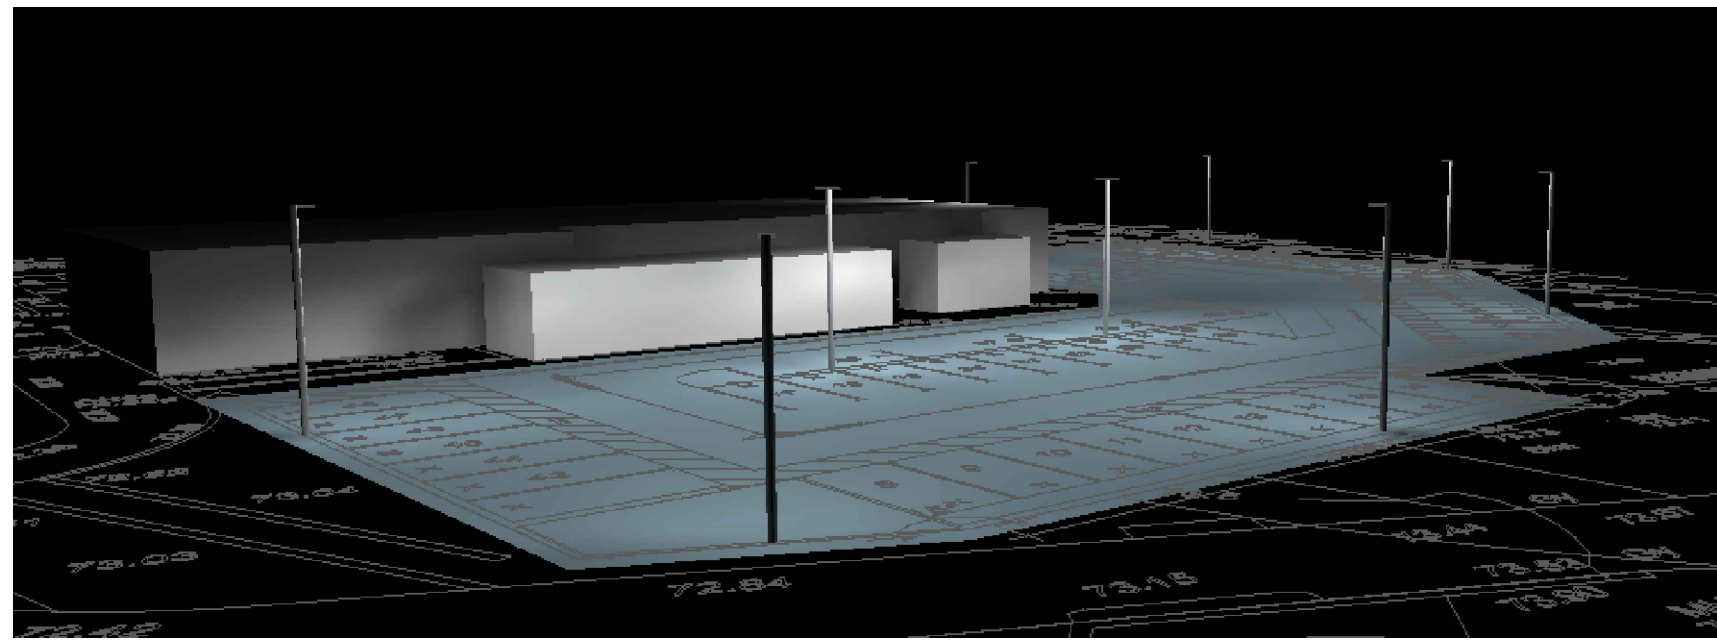

No	DESCRIPTION
00	PERMITS TO WORK REQUIRED THROUGHOUT
01	ASBESTOS MAY BE PRESENT. REQUEST REGISTER FROM ESTATES BEFORE WORK COMMENCES
02	BEWARE OF EXISTING UNDERGROUND SERVICES. CHECK GPR SURVEY DRAWINGS
03	EXISTING LIVE SERVICES

P03	THIRD ISSUE - LUMINAIRE LAYOUT AND TYPE UPDATED	24/10/2022	JR	DS	
P02	SECOND ISSUE - LUMINAIRE LAYOUT AND WATTAGE UPDATED	24/10/22	JR	WHG	
P01	FIRST ISSUE	11/10/22	AF	DP	
REV	DESCRIPTION	DATE	DRW.	CHK.	