
NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Ref.	Date	Revisions	By
P01	28.07.21	PRELIMINARY ISSUE	BA
P02	05.10.21	CIRCUITING ADDED	RJ
C01	08.11.21	CONSTRUCTION ISSUE	MI
C02	01.12.21	LUMINAIRE UPDATE	MI
C03	26.01.22	SUBSTATION LIGHTING ADDED	MI

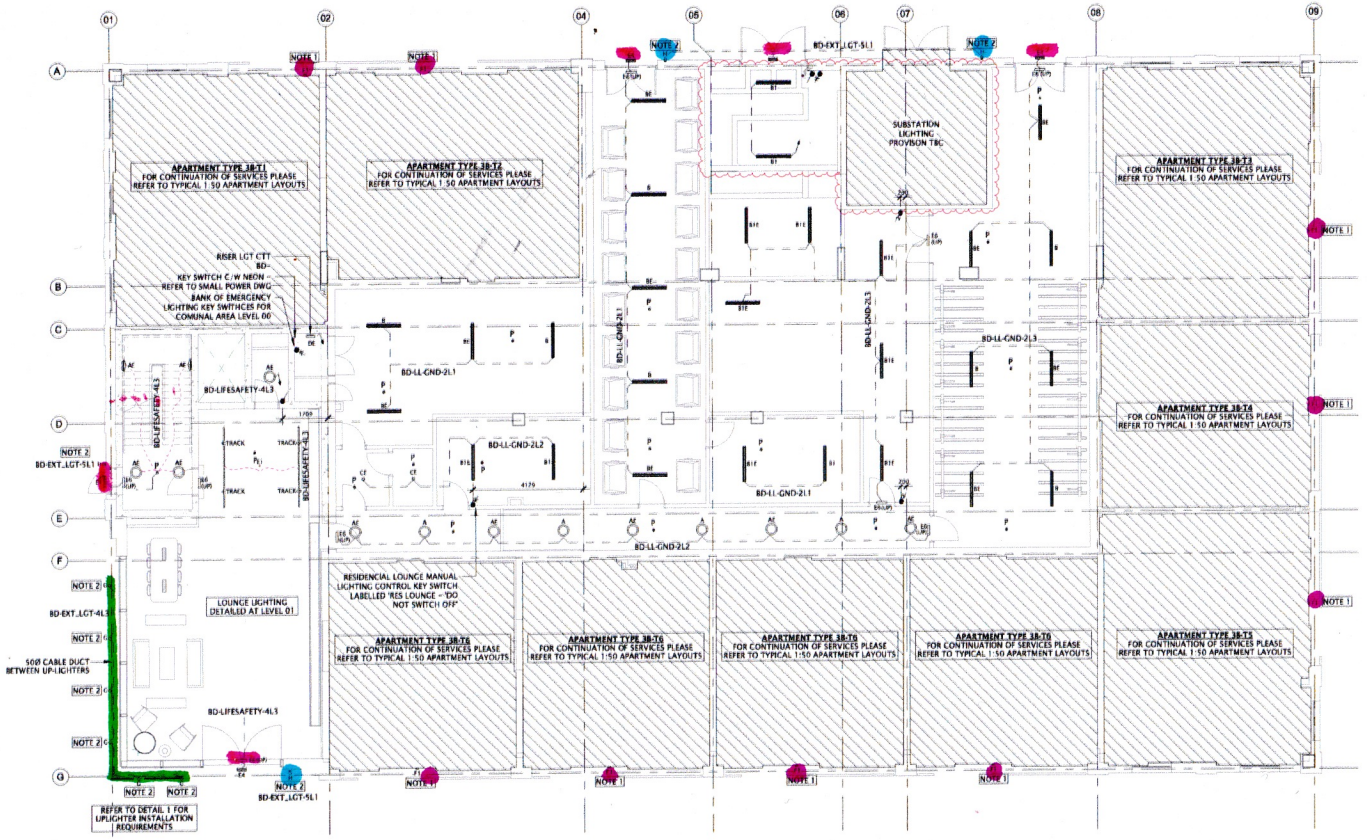

Level 00 - Lighting Layout
1 : 100

NOTES

1. TYPE F1 AND F2 WALL MOUNTED LUMINAIRE CONTROLLED VIA MANUAL SWITCH LOCATED IN THE ASSOCIATED APARTMENT.
2. EXTERNAL LIGHTING CONTROLLED BY TIMECLOCK / PHOTOCELL WITH MANUAL OVERRIDE. REFER TO EXTERNAL LIGHTING CONTROLS WIRING SCHEMATIC AS01-AME-61-XX-OR-E-0012 FOR DETAILS OF TIMECLOCK, PHOTOCELL AND PRESENCE DETECTION REQUIREMENTS.
3. POSITIONS OF ACCESSORIES SHOWN ARE APPROXIMATE UNLESS SPECIFIC DIMENSIONS ARE INDICATED AND / OR ARCHITECTAL SETTING OUT INFORMATION HAS BEEN MADE AVAILABLE.


LIGHTING LEGEND

A	ZMP - CIRCULAR BULKHEAD
B	WZP - IP65 SURFACE LINEAR - WPZ/4/3580/4
B1	WZP - IP65 SURFACE LINEAR - WPZ/4/6220/4
C	ASTORIA LED - RECESSED SPOT
D	LDB - IP65 CIRULAR BULKHEAD
F	TR2 SURFACE -
F2	TARA S -
F3	TRAXON - IP65 LONG RANGE EXIT SIGN
F4	AX - EMERGENCY BULKHEAD
F5	LUNA - EMERGENCY FLOOD LIGHT
G	EXIT - WALL MOUTED EXIT SIGN
G2	LD51 - EXIT SIGN
G3	HYDRO EXIT - IP65 EXIT SIGN
H	LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT (BLACK)
H2	LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT
S	ATLANTA S - IP67 IN GROUND UP LIGHT
W	TBC - IP67 ELV 'SPIKE' UP LIGHT
N	TUBE UP-DOWN - IP65 UP/DOWN WALL LIGHT
J	BOL/LED/2 - IP65 BOLLARD
L	LED TAPE - IP67 LED TAPE IN EXTRUSION
TRACK	GRACE - TRACK MOUNTED SPOTLIGHTS
E	DENOTES EMERGENCY FITTING

LIGHTING CONTROLS LEGEND

PIR1	LONG RANGE WALL MOUNTED MICROWAVE PRESENCE DETECTOR
P	SURFACE MOUNTED PIR
	1 GANG 1 WAY LIGHT SWITCH
	1 GANG 2 WAY LIGHT SWITCH
	EMERGNCY LIGHTING KEY SWITCH
	SURFACE MOUNTED IP67 ADAPTABLE BOX (100X100X50mm)

UPLIGHTER IN PAVEMENT TO ENTRANCE.

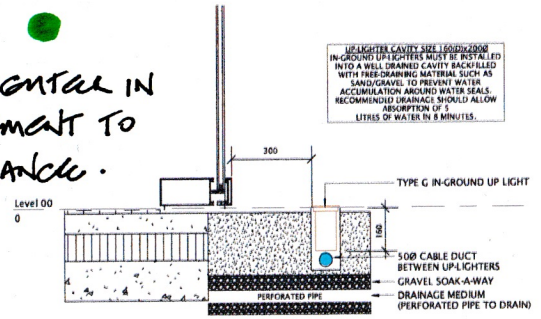

Detail 1 - External In-Ground Up-Lighter Installation
N.T.S.

GROUND FLOOR

- TOWNHOUSE LANTERNS STREET LEVEL
- UP + DOWN LIGHT LANTERN TO PLANT ROOM. + MAIN ENTRANCE.
- EMERGENCY BULKHEAD LIGHTS TO EVACUATION ROUTE

0m 2m 4m 6m 8m 10m
VISUAL SCALE 1:100 @ A1

CONSTRUCTION

ameon
Building Services Engineering
Unit 9-10 Olympic Court, Boardmans Way, Whitehills Business Park, Blackpool, FY4 5GU
Tel: 01253 760160
E-mail: info@ameon.co.uk

Client	Job Title	Drawing Title	Date
DEX Construction	Addington Street	Ground Floor - Lighting, Emergency Lighting & Controls Layout	JUNE 2021


Scale @ A1	Drawn by	Check by
As indicated	BW	RL

Drawing Number	Revision
AS01-AME-63-GF-DR-E-0001	C03

Vit File: C:\Users\mcameron\Documents\AS01-AME-00-XX-M3-U-0001 (P11.2) 04.01.22_mcameron6A4XA.rvt

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Ref.	Date	Revisions	By
P01	28.07.21	PRELIMINARY ISSUE	BW
P02	05.10.21	CIRCUITING ADDED, CONTROLS UPDATED	RL
C01	08.11.21	CONSTRUCTION ISSUE	MH
C02	01.12.21	LUMINAIRE UPDATE	MH
C03	12.01.22	APARTMENT REFERENCES UPDATED	MH

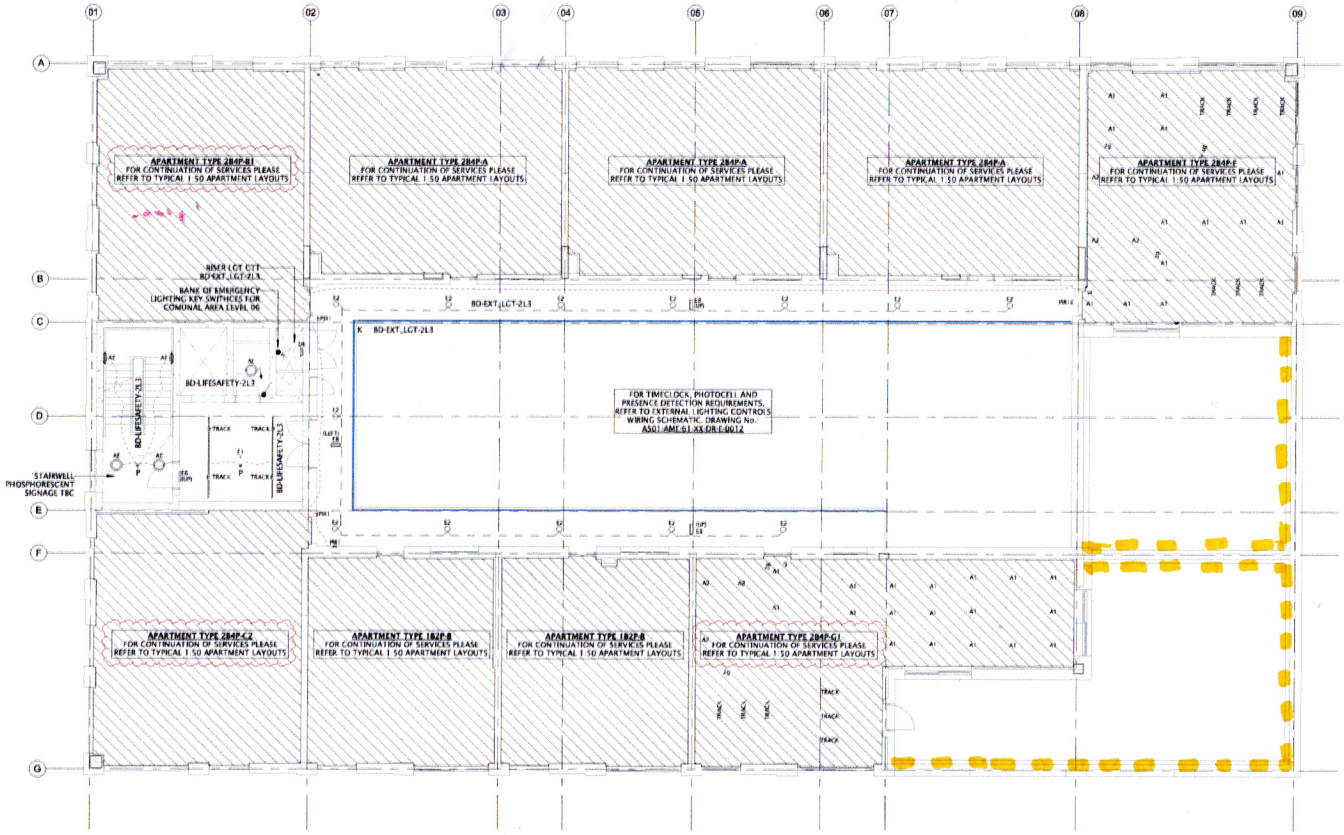

Level 06 - Lighting Layout
1 : 100

NOTES

1. TYPE F1 AND F2 WALL MOUNTED LUMINAIRE CONTROLLED VIA MANUAL SWITCH LOCATED IN THE ASSOCIATED APARTMENT.
2. EXTERNAL LIGHTING CONTROLLED BY TIMECLOCK / PHOTOCELL WITH MANUAL OVERRIDE. REFER TO EXTERNAL LIGHTING CONTROLS WIRING SCHEMATIC AS01-AME-61-XX-DR-E-0012 FOR DETAILS OF TIMECLOCK, PHOTOCELL AND PRESENCE DETECTION REQUIREMENTS.
3. POSITIONS OF ACCESSORIES SHOWN ARE APROXIMATE UNLESS SPECIFIC DIMENSIONS ARE INDICATED AND / OR ARCHITECTAL SETTING OUT INFORMATION HAS BEEN MADE AVAILABLE.

LIGHTING LEGEND

- A — ZMP - CIRCULAR BULKHEAD
- WZP - IP65 SURFACE LINEAR - WPZ/4/3580/4
- WZP - IP65 SURFACE LINEAR - WPZ/4/6220/4
- ASTORIA LED - RECESSED SPOT
- LDB - IP65 CIRULAR BULKHEAD
- TR2 SURFACE -
- TARA S -
- TRAXON - IP65 LONG RANGE EXIT SIGN
- AX - EMERGENCY BULKHEAD
- LUNA - EMERGENCY FLOOD LIGHT
- EXIT - WALL MOUTED EXIT SIGN
- LD51 - EXIT SIGN
- HYDRO EXIT - IP65 EXIT SIGN
- LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT (BLACK)
- LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT
- ATLANTA S - IP67 IN GROUND UP LIGHT
- TBC - IP67 ELV 'SPIKE' UP LIGHT
- TUBE UP/DOWN - IP65 UP/DOWN WALL LIGHT
- BOL/LED/2 - IP65 BOLLARD
- LED TAPE - IP67 LED TAPE IN EXTRUSION
- TRACK — GRACE - TRACK MOUNTED SPOTLIGHTS
- E — DENOTES EMERGENCY FITTING

LIGHTING CONTROLS LEGEND

- PIR1 — LONG RANGE WALL MOUNTED MICROWAVE PRESENCE DETECTOR
- P — SURFACE MOUNTED PIR
- 1 GANG 1 WAY LIGHT SWITCH
- 1 GANG 2 WAY LIGHT SWITCH
- EMERGNCY LIGHTING KEY SWITCH
- SURFACE MOUNTED IP67 ADAPTABLE BOX (100X100X50mm)

SCENIC LIGHTING
TERRACE LOW LEVEL LIGHTING
LIGHT LED LIGHTS THRU WALL

ameon
Building Services Engineering
Unit 9-10 Olympic Court, Boardmans Way,
Whitehills Business Park, Blackpool, FY4 5GU
Tel: 01253 760160
E-mail: info@ameon.co.uk

CONSTRUCTION

0m 2m 4m 6m 8m 10m
VISUAL SCALE 1:100 @ A1

Client	Job Title	Drawing Title	Date
DEX Construction	Addington Street	Sixth Floor - Lighting, Emergency Lighting & Controls Layout	JUNE 2021


Scale @ A1	Drawn by	Check by
1 : 100	BW	RL

Drawing Number: AS01-AME-63-06-DR-E-0001
Revision: C03

Revit File: C:\Users\mcameron\Documents\AS01-AME-00-XX-M3-U-0001 (P11.2) 04.01.22_mcameron6A4XA.rvt

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Ref.	Date	Revisions	By
P01	28.07.21	PRELIMINARY ISSUE	RJ
P02	05.10.21	CIRCUITING ADDED, CONTROLS UPDATED	RJ
C01	08.11.21	CONSTRUCTION ISSUE	MC
C02	01.12.21	LUMINAIRE UPDATE	MC
C03	12.01.22	APARTMENT REFERENCES UPDATED	MC

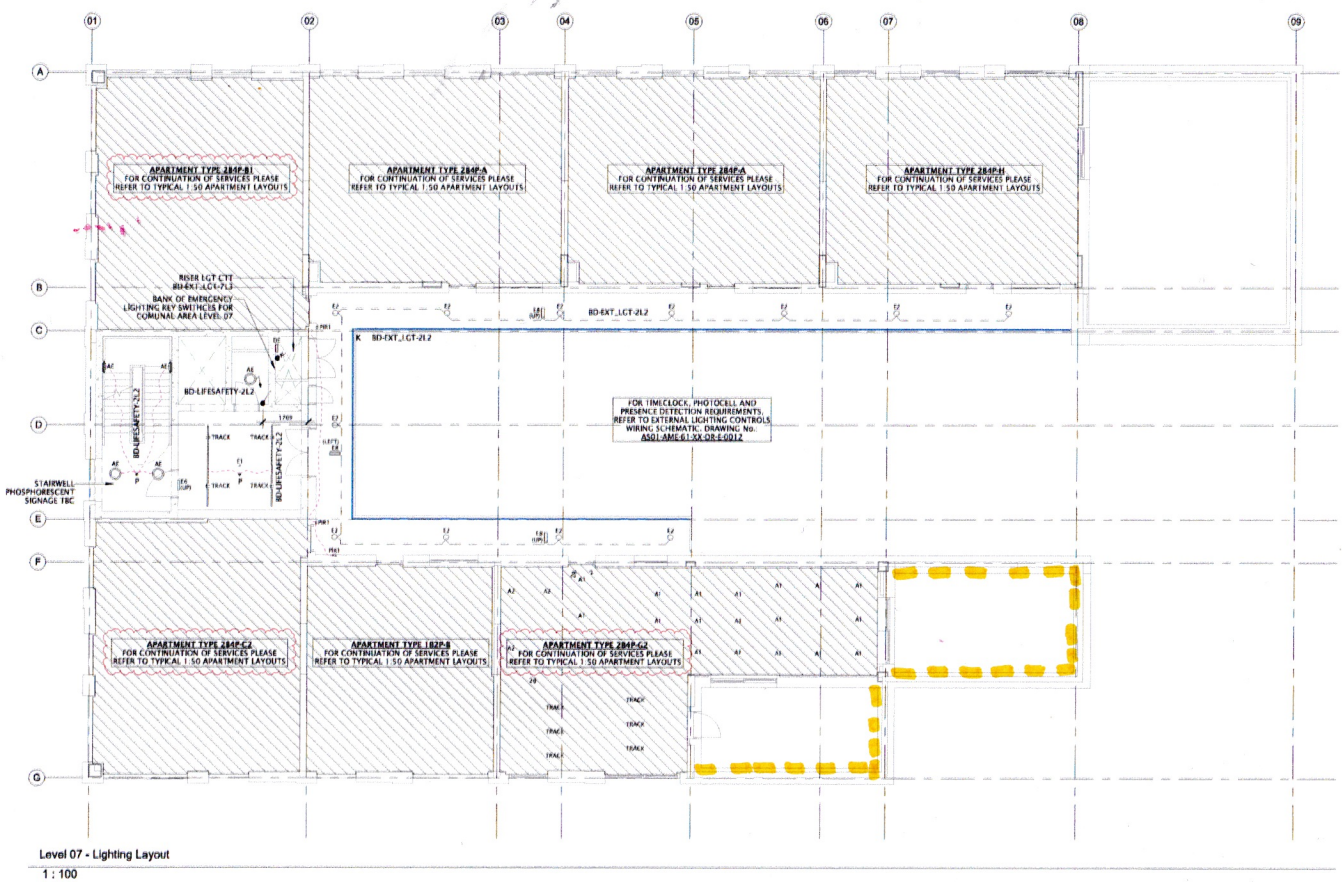

Level 07 - Lighting Layout
1 : 100

NOTES

1. TYPE F1 AND F2 WALL MOUNTED LUMINAIRE CONTROLLED VIA MANUAL SWITCH LOCATED IN THE ASSOCIATED APARTMENT.
2. EXTERNAL LIGHTING CONTROLLED BY TIMECLOCK / PHOTOCELL WITH MANUAL OVERRIDE. REFER TO EXTERNAL LIGHTING CONTROLS WIRING SCHEMATIC AS01-AME-61-XX-DR-E-0012 FOR DETAILS OF TIMECLOCK, PHOTOCELL AND PRESENCE DETECTION REQUIREMENTS.
3. POSITIONS OF ACCESSORIES SHOWN ARE APPROXIMATE UNLESS SPECIFIC DIMENSIONS ARE INDICATED AND / OR ARCHITECTAL SETTING OUT INFORMATION HAS BEEN MADE AVAILABLE.

LIGHTING LEGEND

- A — ZMP - CIRCULAR BULKHEAD
- A — WZP - IP65 SURFACE LINEAR - WPZ/4/3580/4
- B1 — WZP - IP65 SURFACE LINEAR - WPZ/4/6220/4
- C — ASTORIA LED - RECESSED SPOT
- D — LDB - IP65 CIRULAR BULKHEAD
- E1 — TR2 SURFACE -
- E2 — TARA S -
- E3 — TRAXON - IP65 LONG RANGE EXIT SIGN
- E4 — AX - EMERGENCY BULKHEAD
- E5 — LUNA - EMERGENCY FLOOD LIGHT
- E6 — EXIT - WALL MOUTED EXIT SIGN
- E7 — LDS1 - EXIT SIGN
- E8 — HYDRO EXIT - IP65 EXIT SIGN
- F1 — LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT (BLACK)
- F2 — LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT
- G — ATLANTA S - IP67 IN GROUND UP LIGHT
- TBC — TBC - IP67 ELV SPIKE UP LIGHT
- H — TUBE UP/DOWN - IP65 UP/DOWN WALL LIGHT
- J — BOI/LED/2 - IP65 BOLLARD
- K — LED TAPE - IP67 LED TAPE IN EXTRUSION
- TRACK — GRACE - TRACK MOUNTED SPOTLIGHTS
- E — DENOTES EMERGENCY FITTING

LIGHTING CONTROLS LEGEND

- PIR1 — LONG RANGE WALL MOUNTED MICROWAVE PRESENCE DETECTOR
- P — SURFACE MOUNTED PIR
- 1 GANG 1 WAY LIGHT SWITCH
- 1 GANG 2 WAY LIGHT SWITCH
- EMERGNCY LIGHTING KEY SWITCH
- SURFACE MOUNTED IP67 ADAPTABLE BOX (100X100X50mm)

TERRACE SCENIC LIGHTING
LOW LEVEL LED - LIGHTS PACAPET WALL

0m 2m 4m 6m 8m 10m
VISUAL SCALE 1:100 @ A1

CONSTRUCTION

ameon
Building Services Engineering
Unit 9-10 Olympic Court, Boardmans Way,
Whitehills Business Park, Blackpool, FY4 5GU
Tel: 01253 760160
E-mail: info@ameon.co.uk

Client	Job Title	Drawing Title	Date
DEX Construction	Addington Street	Seventh Floor - Lighting, Emergency Lighting & Controls Layout	JUNE 2021


Scale @ A1	Drawn by	Check by
1 : 100	BW	RL

Drawing Number: AS01-AME-63-07-DR-E-0001
Revision: C03

vit File: C:\Users\mcameron\Documents\AS01-AME-00-XX-M3-U-0001 (P11.2) 04.01.22_mcameron6A4KA.rvt

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Ref.	Date	Revisions	
P01	28.07.21	PRELIMINARY ISSUE	BW
P02	05.10.21	CIRCUITING ADDED, CONTROLS UPDATED	RJ
C01	08.11.21	CONSTRUCTION ISSUE	MH
C02	01.12.21	LUMINAIRE UPDATE	MH
C03	12.01.22	APARTMENT REFERENCES UPDATED	MH

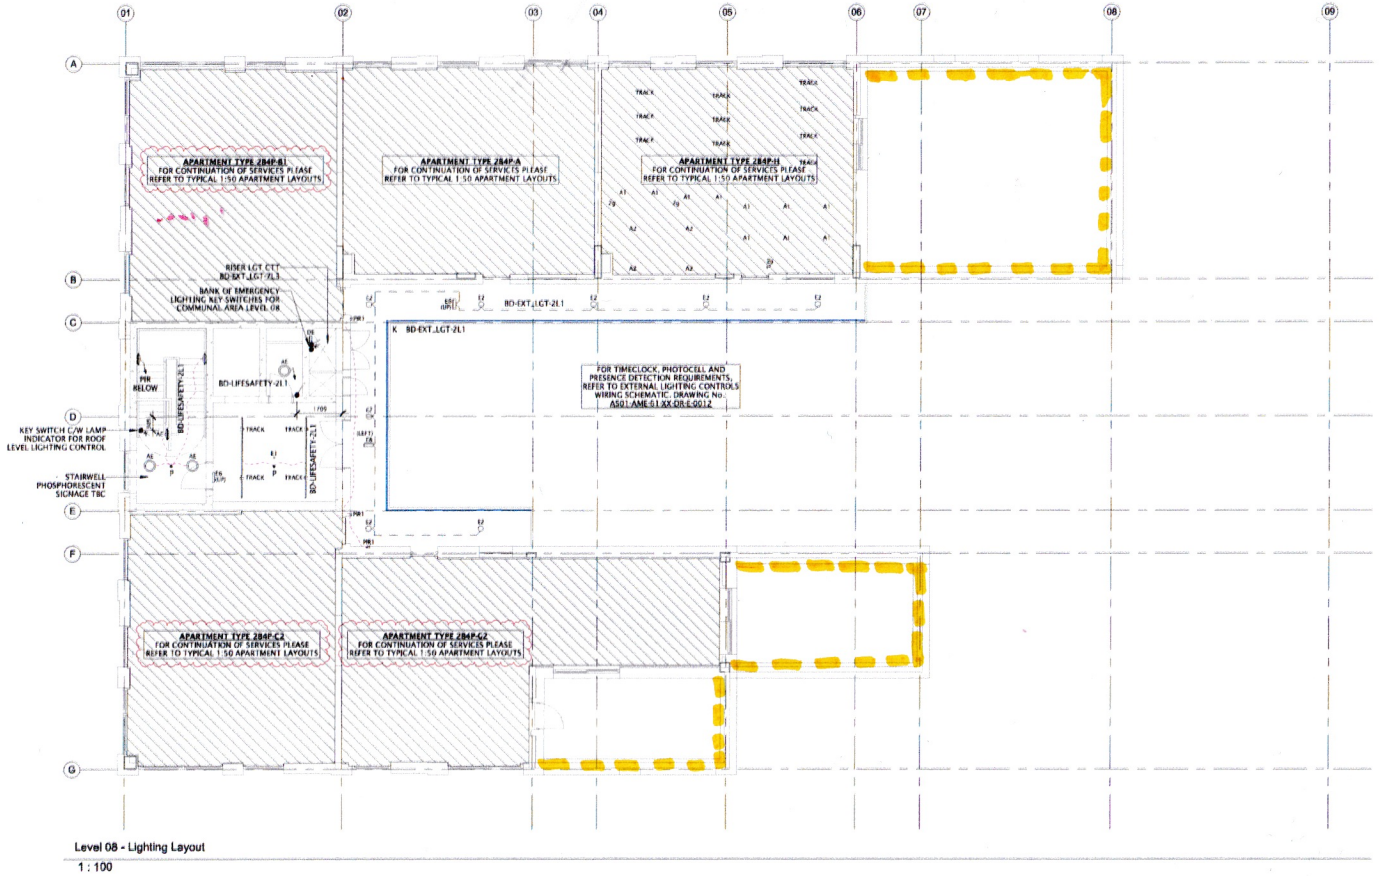

Level 08 - Lighting Layout
1 : 100

NOTES

1. TYPE F1 AND F2 WALL MOUNTED LUMINARIE CONTROLLED VIA MANUAL SWITCH LOCATED IN THE ASSOCIATED APARTMENT.
2. EXTERNAL LIGHTING CONTROLLED BY TIMECLOCK / PHOTOCELL WITH MANUAL OVERRIDE. REFER TO EXTERNAL LIGHTING CONTROLS WIRING SCHEMATIC AS01-AME-61-XX-DR-E-0012 FOR DETAILS OF TIMECLOCK, PHOTOCELL AND PRESENCE DETECTION REQUIREMENTS.
3. POSITIONS OF ACCESSORIES SHOWN ARE APPROXIMATE UNLESS SPECIFIC DIMENSIONS ARE INDICATED AND / OR ARCHITECTAL SETTING OUT INFORMATION HAS BEEN MADE AVAILABLE.

LIGHTING LEGEND

- A — ZMP - CIRCULAR BULKHEAD
- B — WZP - IP65 SURFACE LINEAR - WPZ/4/3580/4
- B1 — WZP - IP65 SURFACE LINEAR - WPZ/4/6220/4
- C, S — ASTORIA LED - RECESSED SPOT
- D — LDB - IP65 CIRULAR BULKHEAD
- F1 — TR2 SURFACE -
- F2 — TARA S -
- E1 — TRAXON - IP65 LONG RANGE EXIT SIGN
- E4 — AX - EMERGENCY BULKHEAD
- E6 — LUNA - EMERGENCY FLOOD LIGHT
- E10 — EXIT - WALL MOUTED EXIT SIGN
- E7 — LDS1 - EXIT SIGN
- E8 — HYDRO EXIT - IP65 EXIT SIGN
- F1 — LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT (BLACK)
- F2 — LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT
- C — ATLANTA S - IP67 IN GROUND UP LIGHT
- W — TBC - IP67 ELV 'SPIKE' UP LIGHT
- H, S — TUBE UP-DOWN - IP65 UP/DOWN WALL LIGHT
- J — BOL/LED/2 - IP65 BOLLARD
- L — LED TAPE - IP67 LED TAPE IN EXTRUSION
- TRACK — GRACE - TRACK MOUNTED SPOTLIGHTS
- E — DENOTES EMERGENCY FITTING

LIGHTING CONTROLS LEGEND

- PIR1 — LONG RANGE WALL MOUNTED MICROWAVE PRESENCE DETECTOR
- P — SURFACE MOUNTED PIR
- 1 GANG 1 WAY LIGHT SWITCH
- 1 GANG 2 WAY LIGHT SWITCH
- EMERGENCY LIGHTING KEY SWITCH
- SURFACE MOUNTED IP67 ADAPTABLE BOX (100X100X50mm)

TERRACE SCENIC LIGHTING
LOW LEVEL LED - LIGHTS PARAPET WALL.

CONSTRUCTION

ameon
Building Services Engineering
Unit 9-10 Olympic Court, Boardmans Way, Whitehills Business Park, Blackpool, FY4 5GU
Tel: 01253 760160
E-mail: info@ameon.co.uk

0m 2m 4m 6m 8m 10m
VISUAL SCALE 1:100 @ A1

Client	Job Title	Drawing Title	Date
DEX Construction	Addington Street	Eighth Floor - Lighting, Emergency Lighting & Controls Layout	JUNE 2021


Scale @ A1	Drawn by	Check by
1 : 100	BW	RL

Drawing Number: AS01-AME-63-08-DR-E-0001
Revision: C03

vil File: C:\Users\mcameron\Documents\AS01-AME-00-XX-M3-U-0001 (P17.2) 04.01.22_mcameron6A4XA.rvt

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Ref.	Date	Revisions	By
P01	28.07.21	PRELIMINARY ISSUE	BW
P02	05.10.21	CIRCUITING ADDED, CONTROLS UPDATED	RJ
C01	08.11.21	CONSTRUCTION ISSUE	MH
C02	01.12.21	LUMINAIRE UPDATE	MH

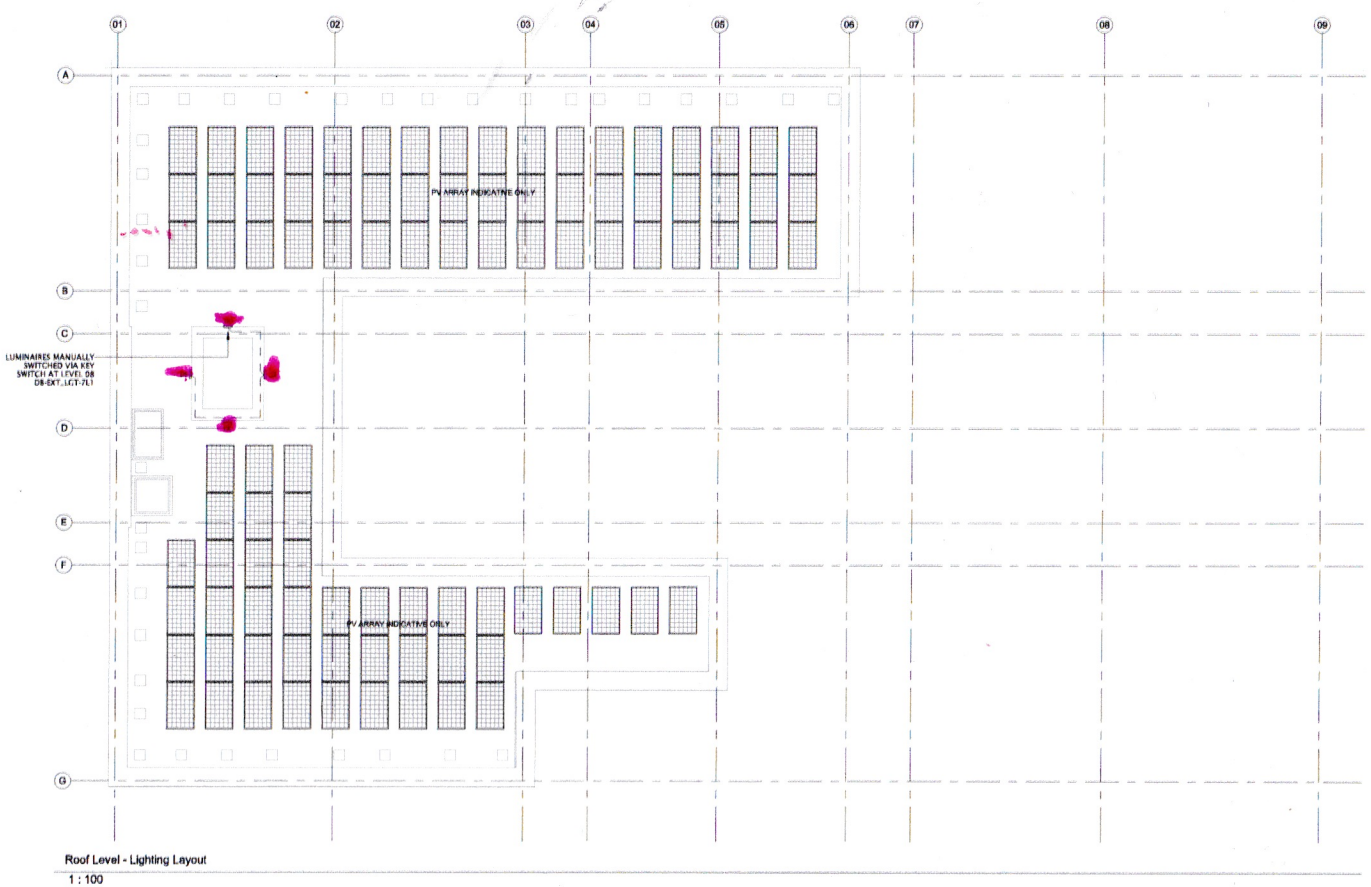

Roof Level - Lighting Layout
1 : 100

NOTES

1. TYPE F1 AND F2 WALL MOUNTED LUMINARIE CONTROLLED VIA MANUAL SWITCH LOCATED IN THE ASSOCIATED APARTMENT.
2. EXTERNAL LIGHTING CONTROLLED BY TIMECLOCK / PHOTOCELL WITH MANUAL OVERRIDE. REFER TO EXTERNAL LIGHTING CONTROLS WIRING SCHEMATIC AS01-AME-61-XX-DR-E-0012 FOR DETAILS OF TIMECLOCK, PHOTOCELL AND PRESENCE DETECTION REQUIREMENTS.
3. POSITIONS OF ACCESSORIES SHOWN ARE APPROXIMATE UNLESS SPECIFIC DIMENSIONS ARE INDICATED AND / OR ARCHITECTAL SETTING OUT INFORMATION HAS BEEN MADE AVAILABLE.

LIGHTING LEGEND

- ZMP - CIRCULAR BULKHEAD
- WZP - IP65 SURFACE LINEAR - WPZ/4/3580/4
- WZP - IP65 SURFACE LINEAR - WPZ/4/6220/4
- ASTORIA LED - RECESSED SPOT
- LD8 - IP65 CIRULAR BULKHEAD
- TR2 SURFACE -
- TARA S -
- TRAXON - IP65 LONG RANGE EXIT SIGN
- AX - EMERGENCY BULKHEAD
- LUNA - EMERGENCY FLOOD LIGHT
- EXIT - WALL MOUTED EXIT SIGN
- LDS1 - EXIT SIGN
- HYDRO EXIT - IP65 EXIT SIGN
- LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT (BLACK)
- LDL 1037 - IP54 SQUARE UP/DOWN WALL LIGHT
- ATLANTA 5 - IP67 IN GROUND UP LIGHT
- TUBE UP-DOWN - IP65 UP/DOWN WALL LIGHT
- BOL/LED/2 - IP65 BOLLARD
- LED TAPE - IP67 LED TAPE IN EXTRUSION
- GRACE - TRACK MOUNTED SPOTLIGHTS
- DENOTES EMERGENCY FITTING

LIGHTING CONTROLS LEGEND

- LONG RANGE WALL MOUNTED MICROWAVE PRESENCE DETECTOR
- SURFACE MOUNTED PIR
- 1 GANG 1 WAY LIGHT SWITCH
- 1 GANG 2 WAY LIGHT SWITCH
- EMERGNCY LIGHTING KEY SWITCH
- SURFACE MOUNTED IP67 ADAPTABLE BOX (100X100X50mm)

EMERGENCY BULKHEAD LIGHTS FIXED TO THE LIFT OVER RUN

Roof Level

CONSTRUCTION

ameon
Building Services Engineering
Unit 9-10 Olympic Court, Boardmans Way, Whitehills Business Park, Blackpool, FY4 5GU
Tel: 01253 760160
E-mail: info@ameon.co.uk

0m 2m 4m 6m 8m 10m
VISUAL SCALE 1:100 @ A1

Client	Job Title	Drawing Title	Date
DEX Construction	Addington Street	Roof Level - Lighting, Emergency Lighting & Controls Layout	JULY 2021

Scale @ A1	Drawn by	Check by
1 : 100	BW	RL

Drawing Number: AS01-AME-63-RF-DR-E-0001
Revision: C02

vit File: C:\Users\mcameron\Documents\AS01-AME-00-XX-M3-U-0001 (P11.1) 01.10.21_mcameron6A4XA.rvt