
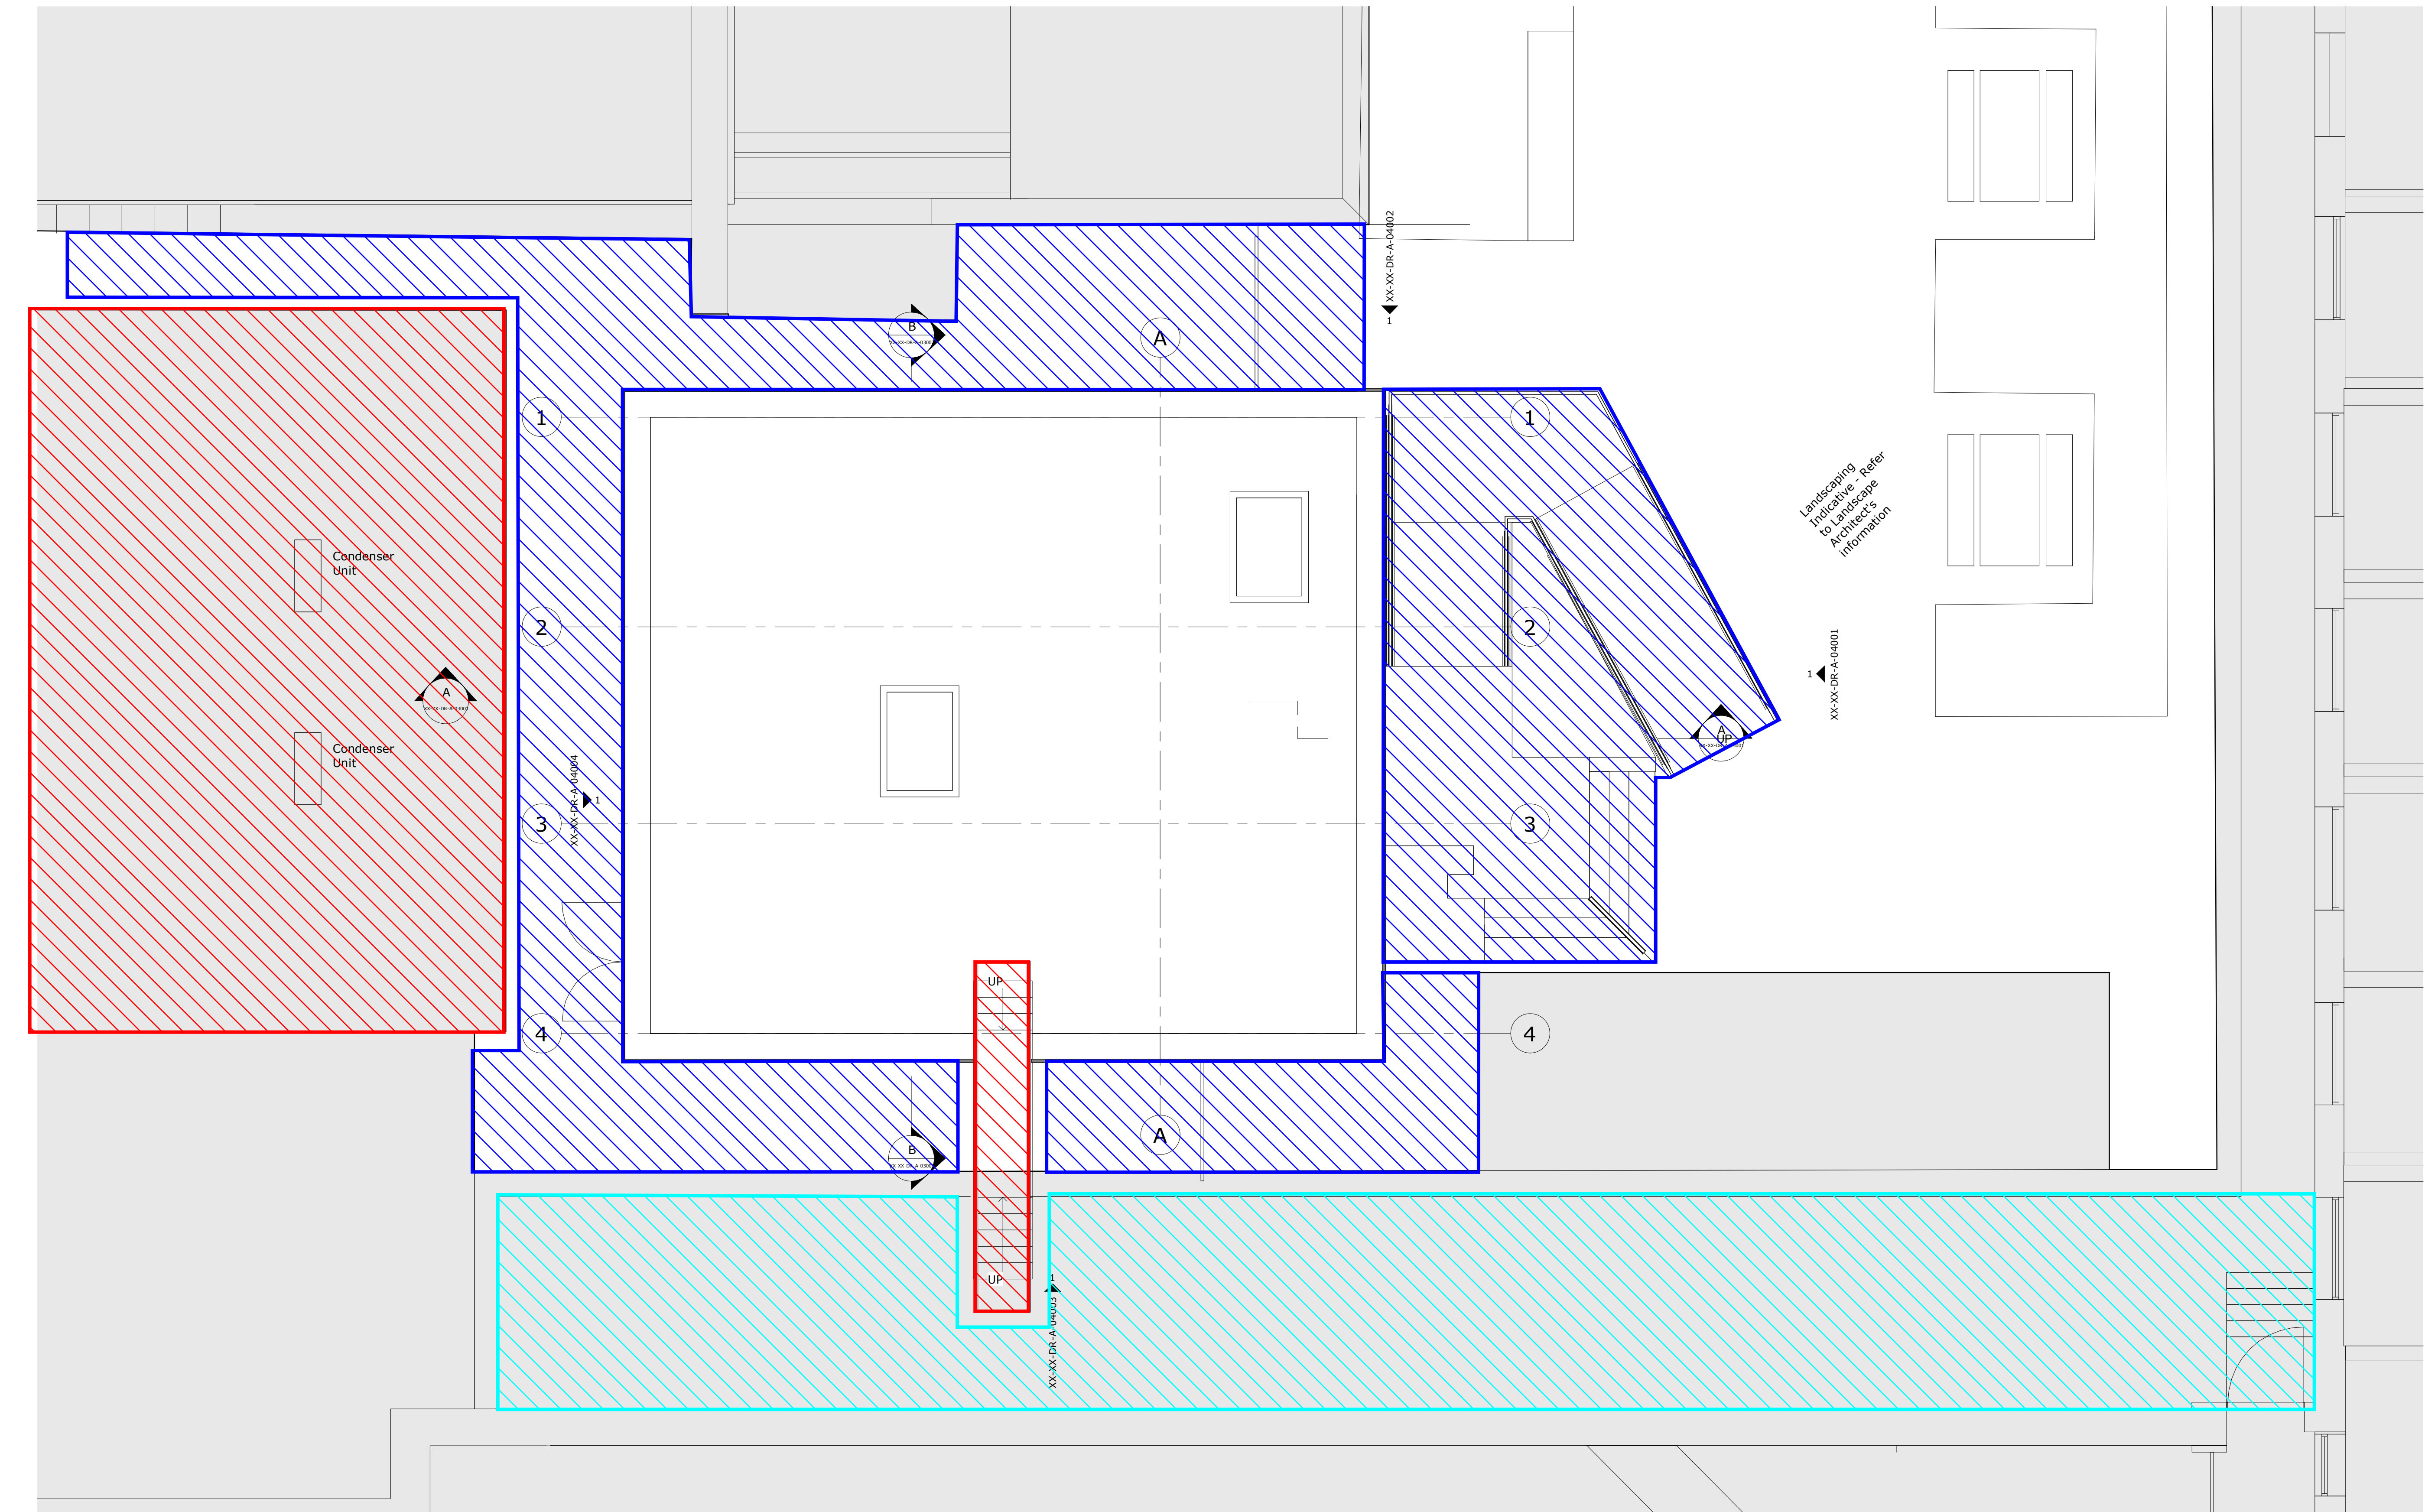






- 

General Roof lighting. LED fittings complete with integral emergency lighting to be mounted onto gantry handrails.
- 

General roof walkway lighting. LED fittings complete with integral emergency lighting to be mounted along existing building facade leading up to the proposed roof access gantry walkway.
- 

General External building perimeter lighting. To be wall mounted LED fittings covering building exits where possible, coordinated with building elevations. Emergency lighting to be integral within the fittings. Lighting levels to be 5-10 Lux. Any existing fittings to be replaced with new.