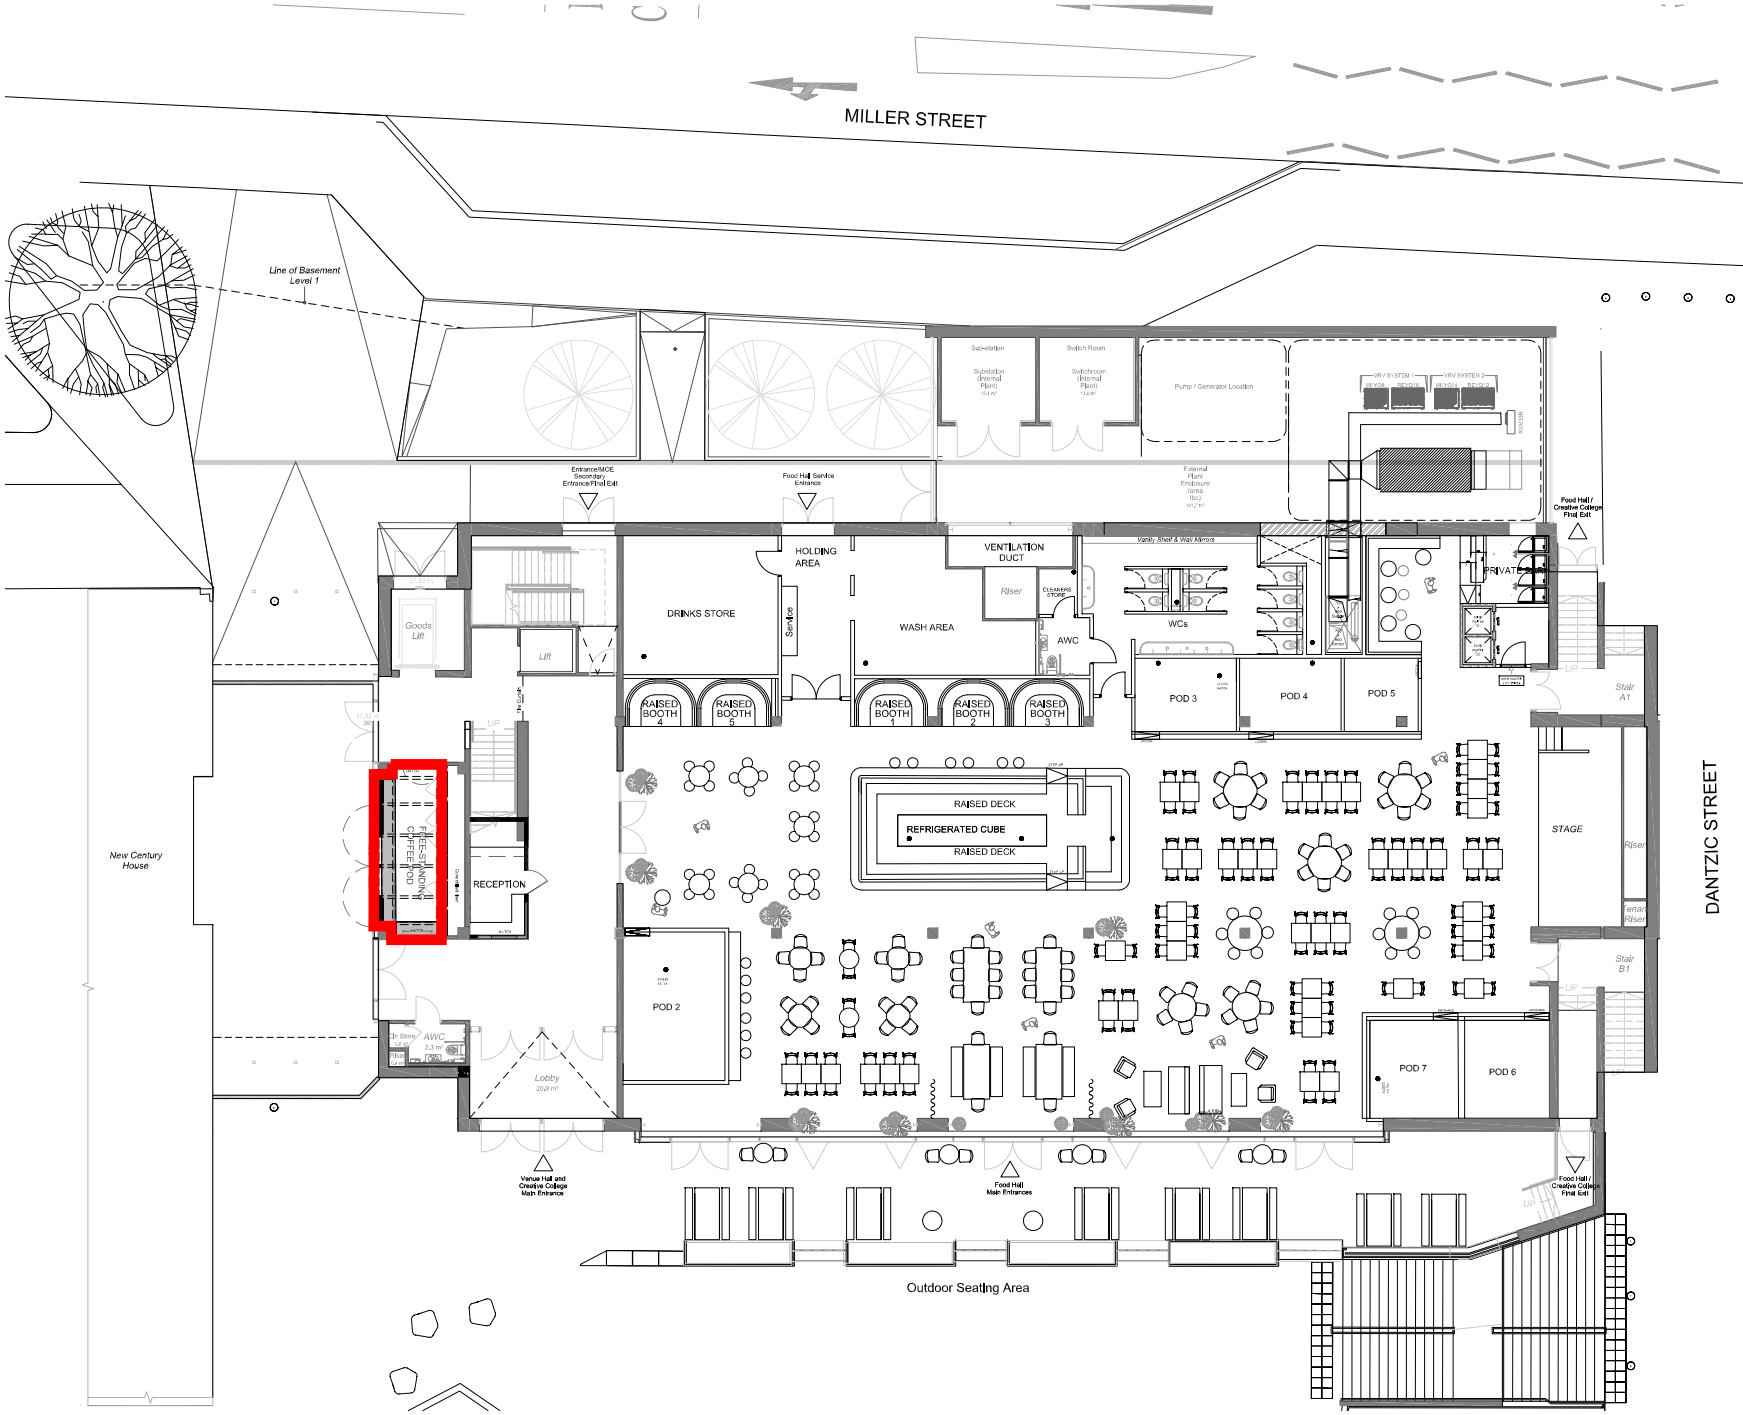


This drawing is the property of Sheila Bird Studios. Copyright is reserved by them and the drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person either wholly or in part without the consent in writing from Sheila Bird Studios.

Dimensions to be checked on site. Figured dimensions to be taken in preference to those scaled.

Building Regulations Notes

- Any new fire alarm and detection system will be installed to BS 5839: November 2002.
- All new doors will be readily available at all times to all occupants and visitors without the use of a detachable device or prior knowledge of the door's operation. Any electro-magnetic locking devices will be set upon activation of the fire alarm and power loss and a green call point manual override will be provided.
- Emergency lighting will be installed to BS5266; Part 1: 2005.
- The fire exit signage will comply and be installed to BS5499: Part 4: 2000.
- All new essential electrical circuits required in the event of a fire will be installed to BS6387: 1994 to a CWZ standard.
- Any modifications to the air handling ductwork will be carried out in accordance with BS 5588: Part 9: 1989.
- The ventilation system will shut down upon activation of the fire alarm.
- The surface spread of flame rating of all new wall linings in the accommodation areas will achieve a minimum of class 1 in accordance with BS 476-7:1987
- The surface spread of flame rating of all new wall linings in the circulation areas will achieve a minimum of class 0 in accordance with BS 476-7:1987 and BS 476-6:1989
- Any service penetrations through the resistant construction will be suitably fire stopped.
- All new doors have a minimum clear opening of 850mm.
- Any new corridor will have a minimum door width of 1200mm.
- All doors will have a leading edge of at least 300mm. The glazing will be safety glass to BS 6262: 1981, class C generally and class B where a panel adjacent to a door is over 900mm wide.
- The blinds in any new glazed partitions are not retractable.
- A fresh air supply rate of ten litres per second per person will be achieved in each enclosed habitable space.
- Any new toilet areas will have a ventilation rate of six litres per second per WC with a fifteen minute overrun.
- Any new Tea Point or domestic style Kitchen will have a ventilation rate of fifteen litres per second with a 15 minute overrun.
- Any new kitchen sink waste will have a minimum diameter of 40mm and will discharge into an existing SVP connection via a 75mm deep seal trap.
- Any new washbasin waste will have a minimum diameter of 32mm and will discharge into an existing SVP connection via a 75mm deep seal trap.
- Any new shower area will have a ventilation rate of fifteen litres per second per shower with a fifteen minute overrun.
- The method of heating the hot water supply is by an unvented system.
- Any new shower waste will have a minimum diameter of 40mm and will discharge into an existing SVP connection via a 75mm deep seal trap.
- At least one door leaf in any new ducted door set has at least a leaf with a minimum clear opening of 850mm.
- Vision panels are provided in all new circulation doors by a continuous panel between 500mm and 1500mm above finished floor level.

Approved Document Mg2004

- An access statement should be created to establish disabled access.
- New reception desks should be dropside (or sloped) from the entrance doors and one section needs to be a maximum of 760mm high with 700mm knee recess, 500mm width.
- New doors to have a maximum opening force of 20N at the leading edge of the door.
- Latched doors need to be opened using one hand with a closed fist.
- Door furniture to contrast visually with the surface of the door.
- Door frames to contrast visually with the surface of the surrounding wall.
- The leading edge of any new open or non-self closing door to contrast visually with the surroundings.
- Vision panels in doors to extend down to 500mm above finished floor level but may have a break between 800 and 1150mm above finished floor level. Manifestation of glazing above finished floor level now required at 2 levels - level 1 between 850 and 1000mm above finished floor level, level 2 between 1400 and 1600mm above finished floor level. Manifestation to contrast with the background.
- Bree room worktop to be 850mm above finished floor level with clear space below. 700mm above finished floor level. Give to have taps either automatic control or capable of being operated with a closed fist.
- Terminal fittings to comply with Guidance Note G18.3 - Schedule 2: of S1 1976/1148.
- Switches and outlets between 400 and 1000mm above finished floor level with a preference for the lower range.
- Permanently wired appliances 400 to 1200mm above finished floor level.
- Switches requiring precise hand movement 750 to 1200mm.
- Close vision needed 1200 to 1400mm.
- Consistent positioning of switches, outlets, controls at least 350mm from corners.
- Light switches 900 to 1100mm aligned with door handles.
- Switches operated by one hand.
- Switches to be plate on position.
- Mains and circuit isolator to indicate on and off position.
- Front plates to contrast visually with the background.
- Artificial lighting to be compatible with other electronic and radio requency installations.
- Only doors required to be fire doors to have closers fitted.
- All fire doors to be held open using devices that comply with BS EN 1154
- Corridors and lobbies to be free from obstructions.
- Corridor floor finishes not to give appearance of being steps.
- Corridor and lobby floors to be slip resistant.

SHEILA BIRD STUDIOS

Mazel House
15 Stanley Street
Manchester
M8 8SH
(0161) 833 0832
cad@sheilabird.co.uk
www.sheilabird.com

Client	: ONE PLUS FOUR
Location	: NEW CENTURY HALL
Description	: BOUNDARY PLAN - GF COFFEE POD
Date	: 14. 06. 22
Scale	: 1:100 @ A1
Drawing No.	: 3936-F01-012