
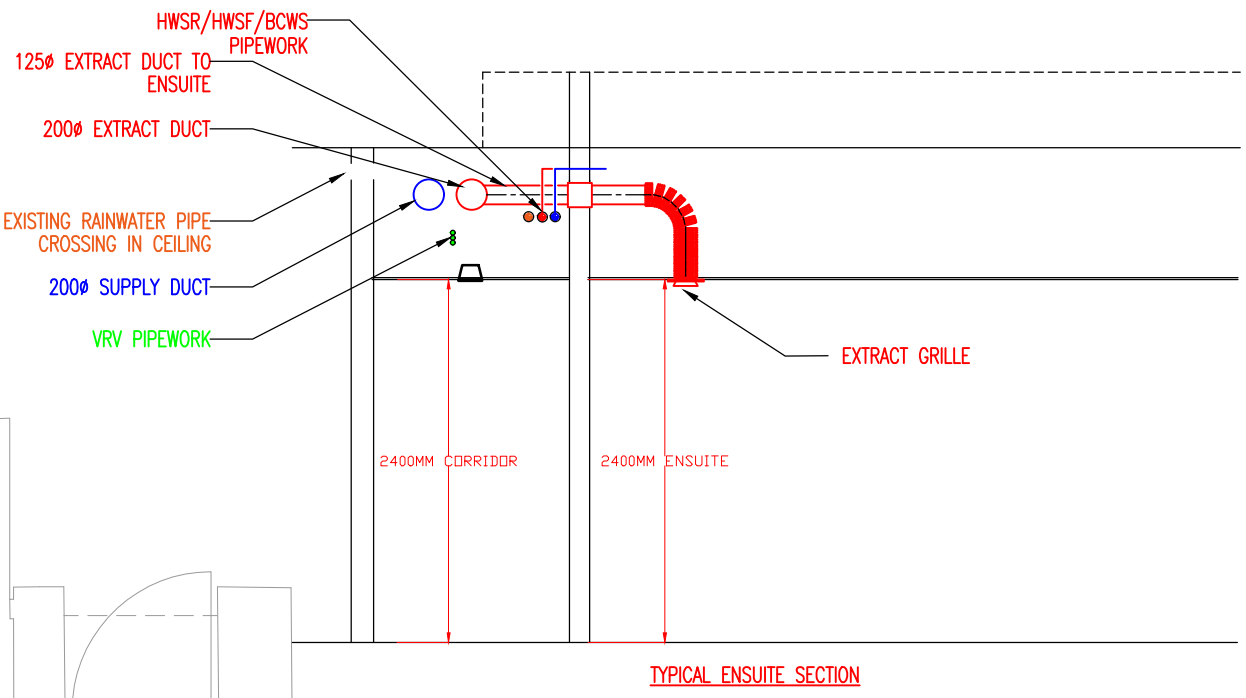


NOTES

1. ALL DUCTWORK TO BE INSTALLED AND ACCESS POINTS PROVIDED FOR CLEANING FULLY IN ACCORDANCE WITH THE REQUIREMENTS OF DW144 & DW172 WHERE APPLICABLE.

LEGEND

- IFD INTEGRAL INTUMESCENT FIRE BLOCK DAMPER (SUITABLE FOR HIGH HUMIDITY AREAS) (LORIENT SELF CLEANING)
FD FIRE DAMPER
MSFD MOTORISED SMOKE FIRE DAMPER
VCD VOLUME CONTROL DAMPER
AP ACCESS PANEL
FA FROM ABOVE
TA TO ABOVE
FB FROM BELOW
TB TO BELOW

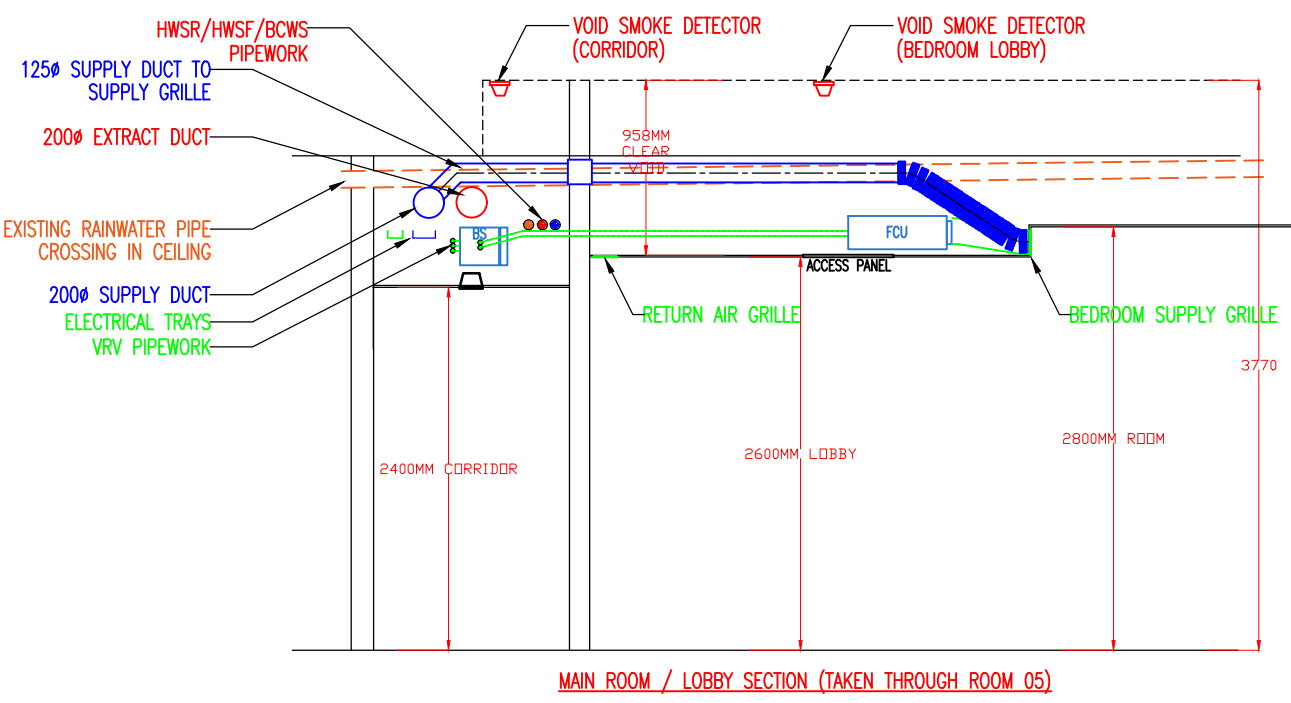

Rev.	Detail of Revision	Date	Drawn
01	Preliminary Issue	Aug 22	MM
A	Tender Issue	Sep 22	MM

M&E Consultants

DMS

Design & Management Services
Building Services Consulting Engineers
Hurlers Road Church Road Bradwell Branning Essex CM17 7EP
E mail info@dms.co.uk

Client

Accor Invest

Project

Ibis Hotel
Princess Street
Manchester

Drawing Title

Ground Floor
Ventilation
Layout

Scale 1:50 A1

Date Aug 22 Drawn by DMS

Drawing Status

Tender Issue

Drawing Number Revision

C220801/M/300

A

