


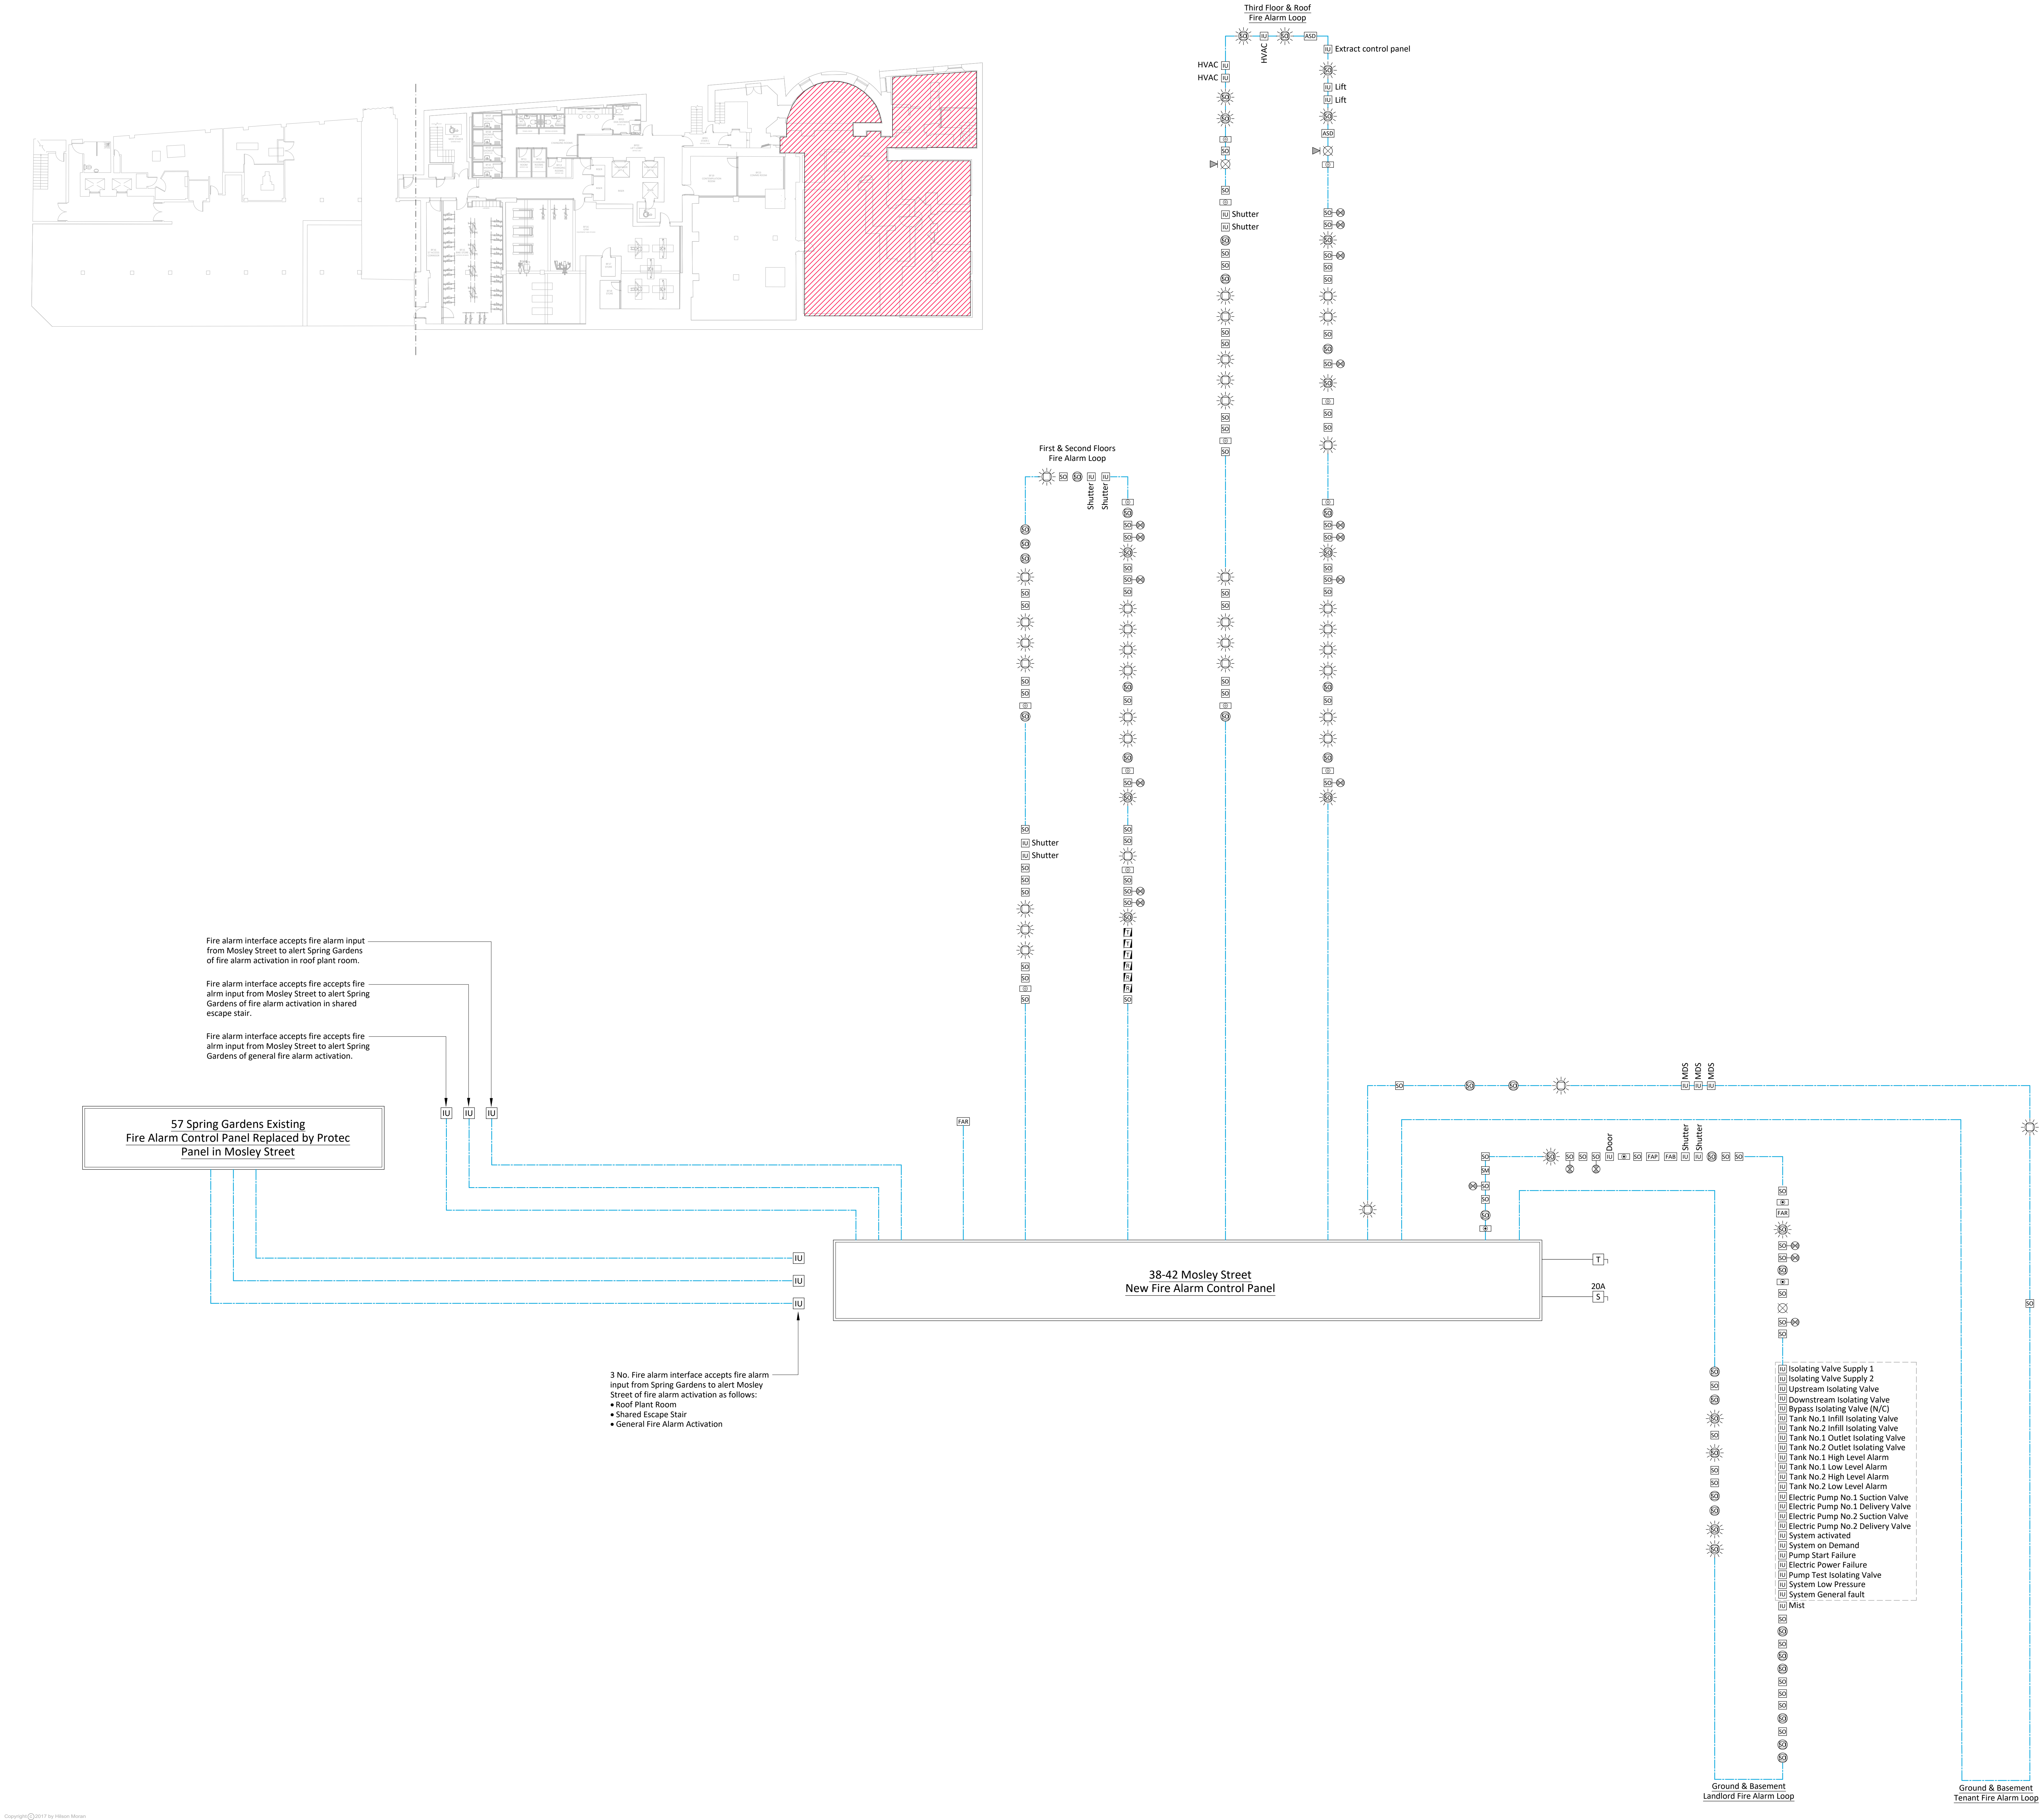

Do not scale from this drawing.
Verify dimensions by site measurement.
Read this drawing in conjunction with the latest architectural and structural drawings.
This drawing is based on the following information:-

Notes

- This drawing to be read in conjunction with all mechanical, electrical & public health drawings for this contract.
- All services work to be carried out in accordance with the relevant Engineering Specification for this contract.

LEGEND:

FAP	Main Fire alarm control panel.
FAR	Fire alarm repeater panel.
FAB	Fire alarm battery cubicle (if required).
ASD	Aspirated fire control panel.
EC	Manual call point - flush mounted.
SC	Manual call point - surface mounted.
SD	Optical smoke detector.
HT	Fixed temperature heat detector.
SM	Multi criteria detector (optical, heat & CO ₂).
SDS	Optical smoke detector with sounder base.
HTS	Fixed temperature heat detector with sounder base.
SDS	Multi criteria detector with sounder base.
SDS	Optical smoke detector with sounder & visual alarm base.
HTS	Fixed temperature heat detector with sounder & visual alarm base.
SDS	Multi criteria detector with sounder & visual alarm base.
SDS	Sounder & visual alarm device only.
VS	Electronic sounder.
FI	Flashing alarm indicator lamp.
ADRI	Automatic detector remote indicator lamp.
MDO	Magnetic door holder.
IU	Interface unit.
FT	Beam transmitter & receiver unit.
RF	Reflector.

04	09/09/22	CAT A / B Contractor Issue.	RMF	RMF
03	12/08/22	Updated to suit Cat B layout	RMF	RMF
02	29/04/22	Stage 4 Issue	RMF	RMF
01	01/04/22	Stage 3 Issue	RMF	RMF

Revision	Date	Description	Drawn	Checked
----------	------	-------------	-------	---------

HIM

hilsonmoran.cominfo@hilsonmoran.com

Client
Bruntwood

Project
38 - 42 Mosley Street
Grade 2*
Listed Building Refurbishment

Drawing Title
Electrical Services
Fire Alarm Schematic

Scale	Sheet Size	Checked	Approved
NTS	A0	RMF	SR
Status			HM Project No.
FOR INFORMATION			27618
Drawing No.			Rev
27618-HM-ZZ-ZZ-DR-ES-6100			04