


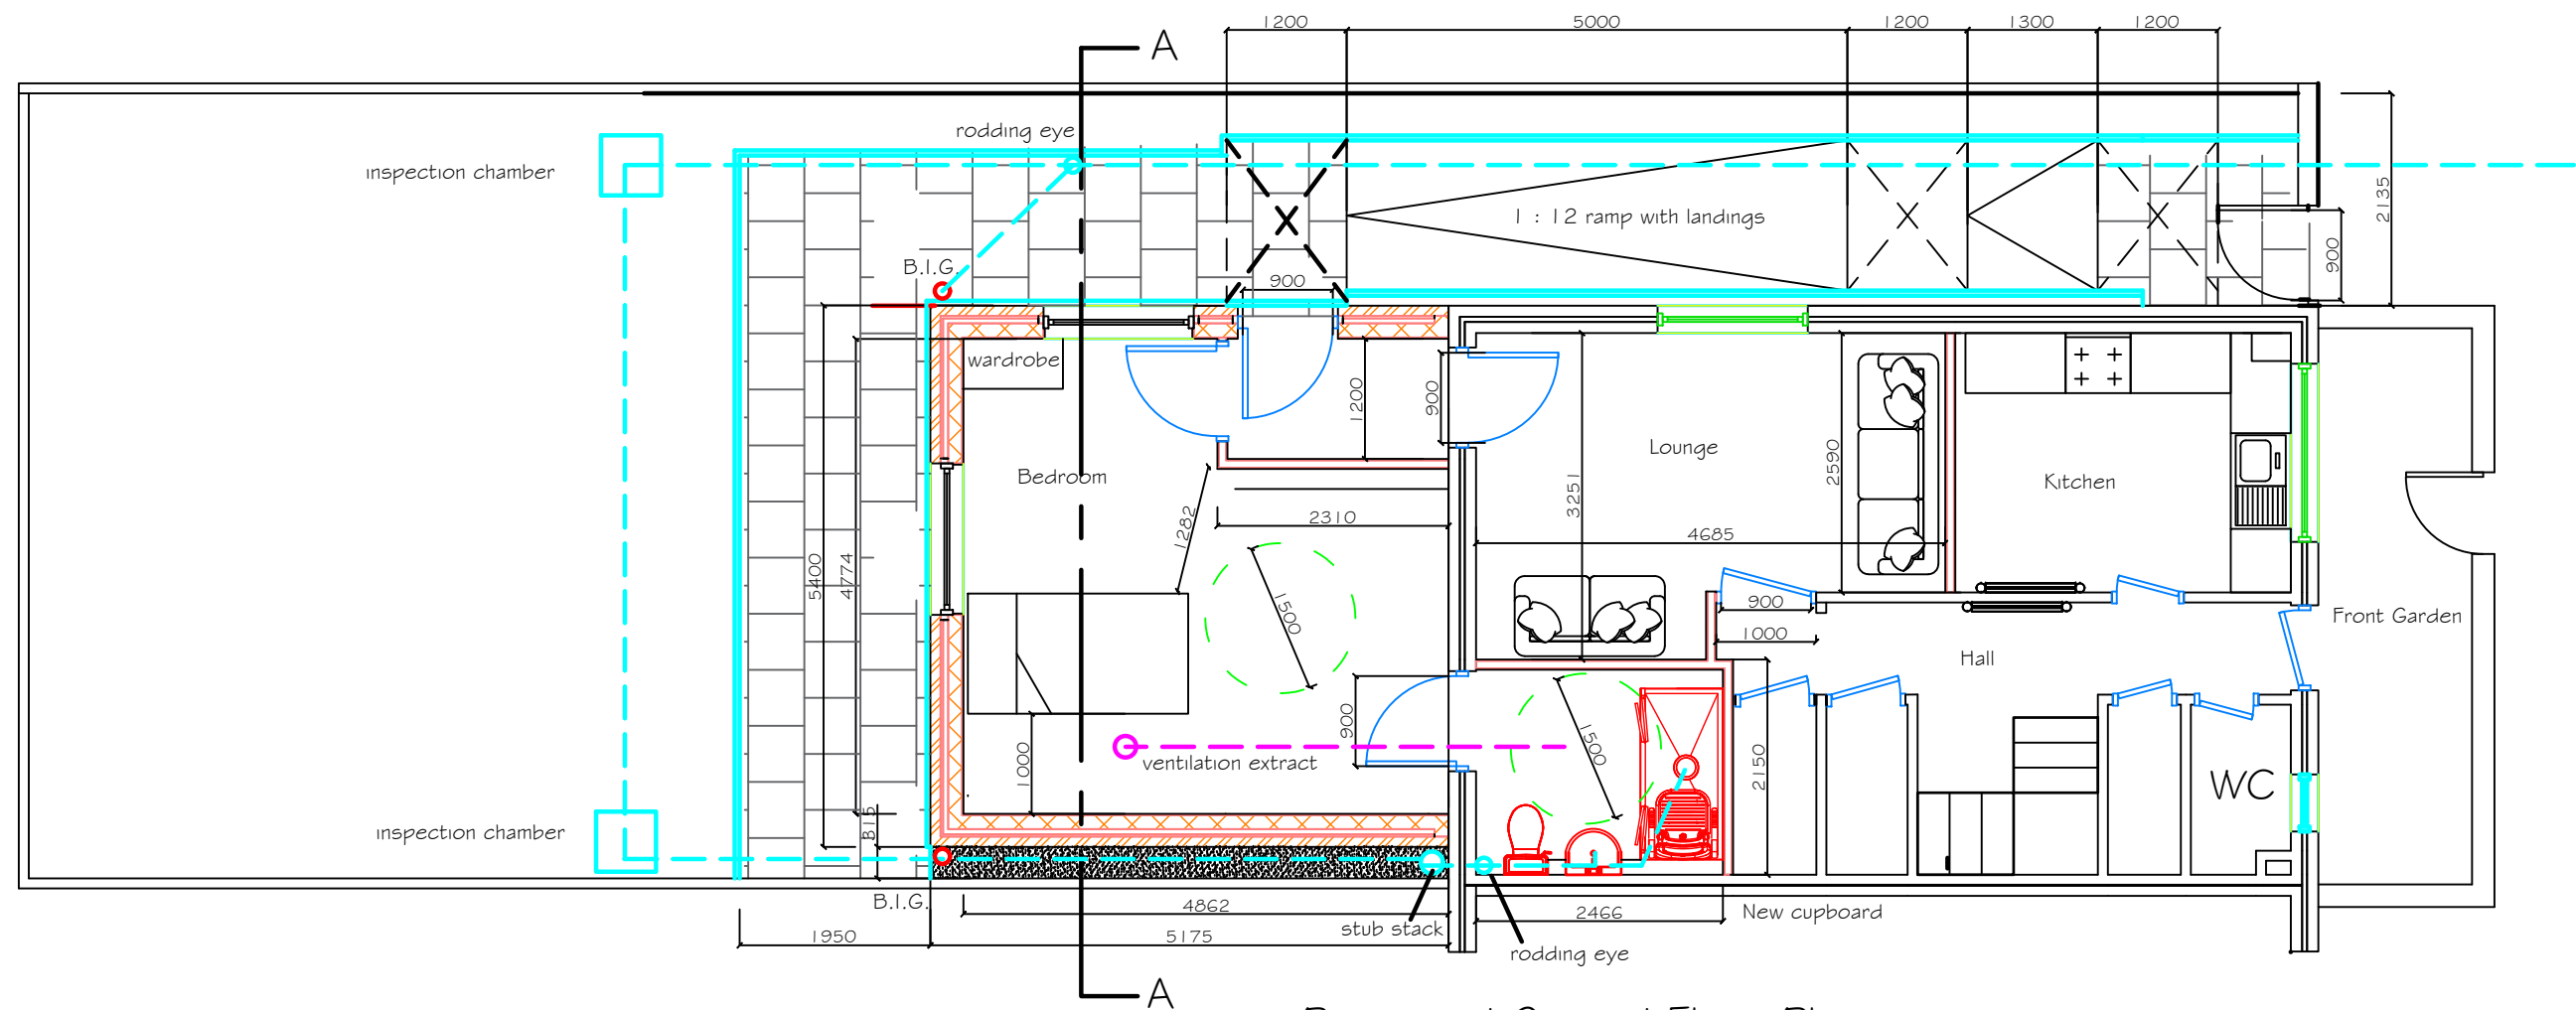

Proposed Ground Floor Plan

New external door opening & new openings to Lounge & Wet room to have a Catnic TS90/100 thermally broken cavity lintel or similar approved bearing 150mm minimum to each side

New internal door opening Lounge from Hall to have a Catnic BSD 100 lintel or similar approved to have a 150mm minimum bearing to each side

New windows to have Catnic TS90/100 thermally broken cavity lintels or similar approved bearing 150mm minimum each side

Ventilation to new wet room to be ducted through ceiling if possible and through extension ceiling and through roof surface