REV	DATE	DESCRIPTION	DRW	Eng
P01	27.10.2021	INITIAL ISSUE	AL	AL
P02	3.11.2021	COLOUR ISSUE	AL	AL
P03	12.11.2021	LEGEND ADDED	AL	AL
P04	01.12.2021	AMENDED TO SUIT COORDINATION MEETING	AL	AL
P05	25.07.2022	SUITABILITY CHANGED TO S3	AL	AL

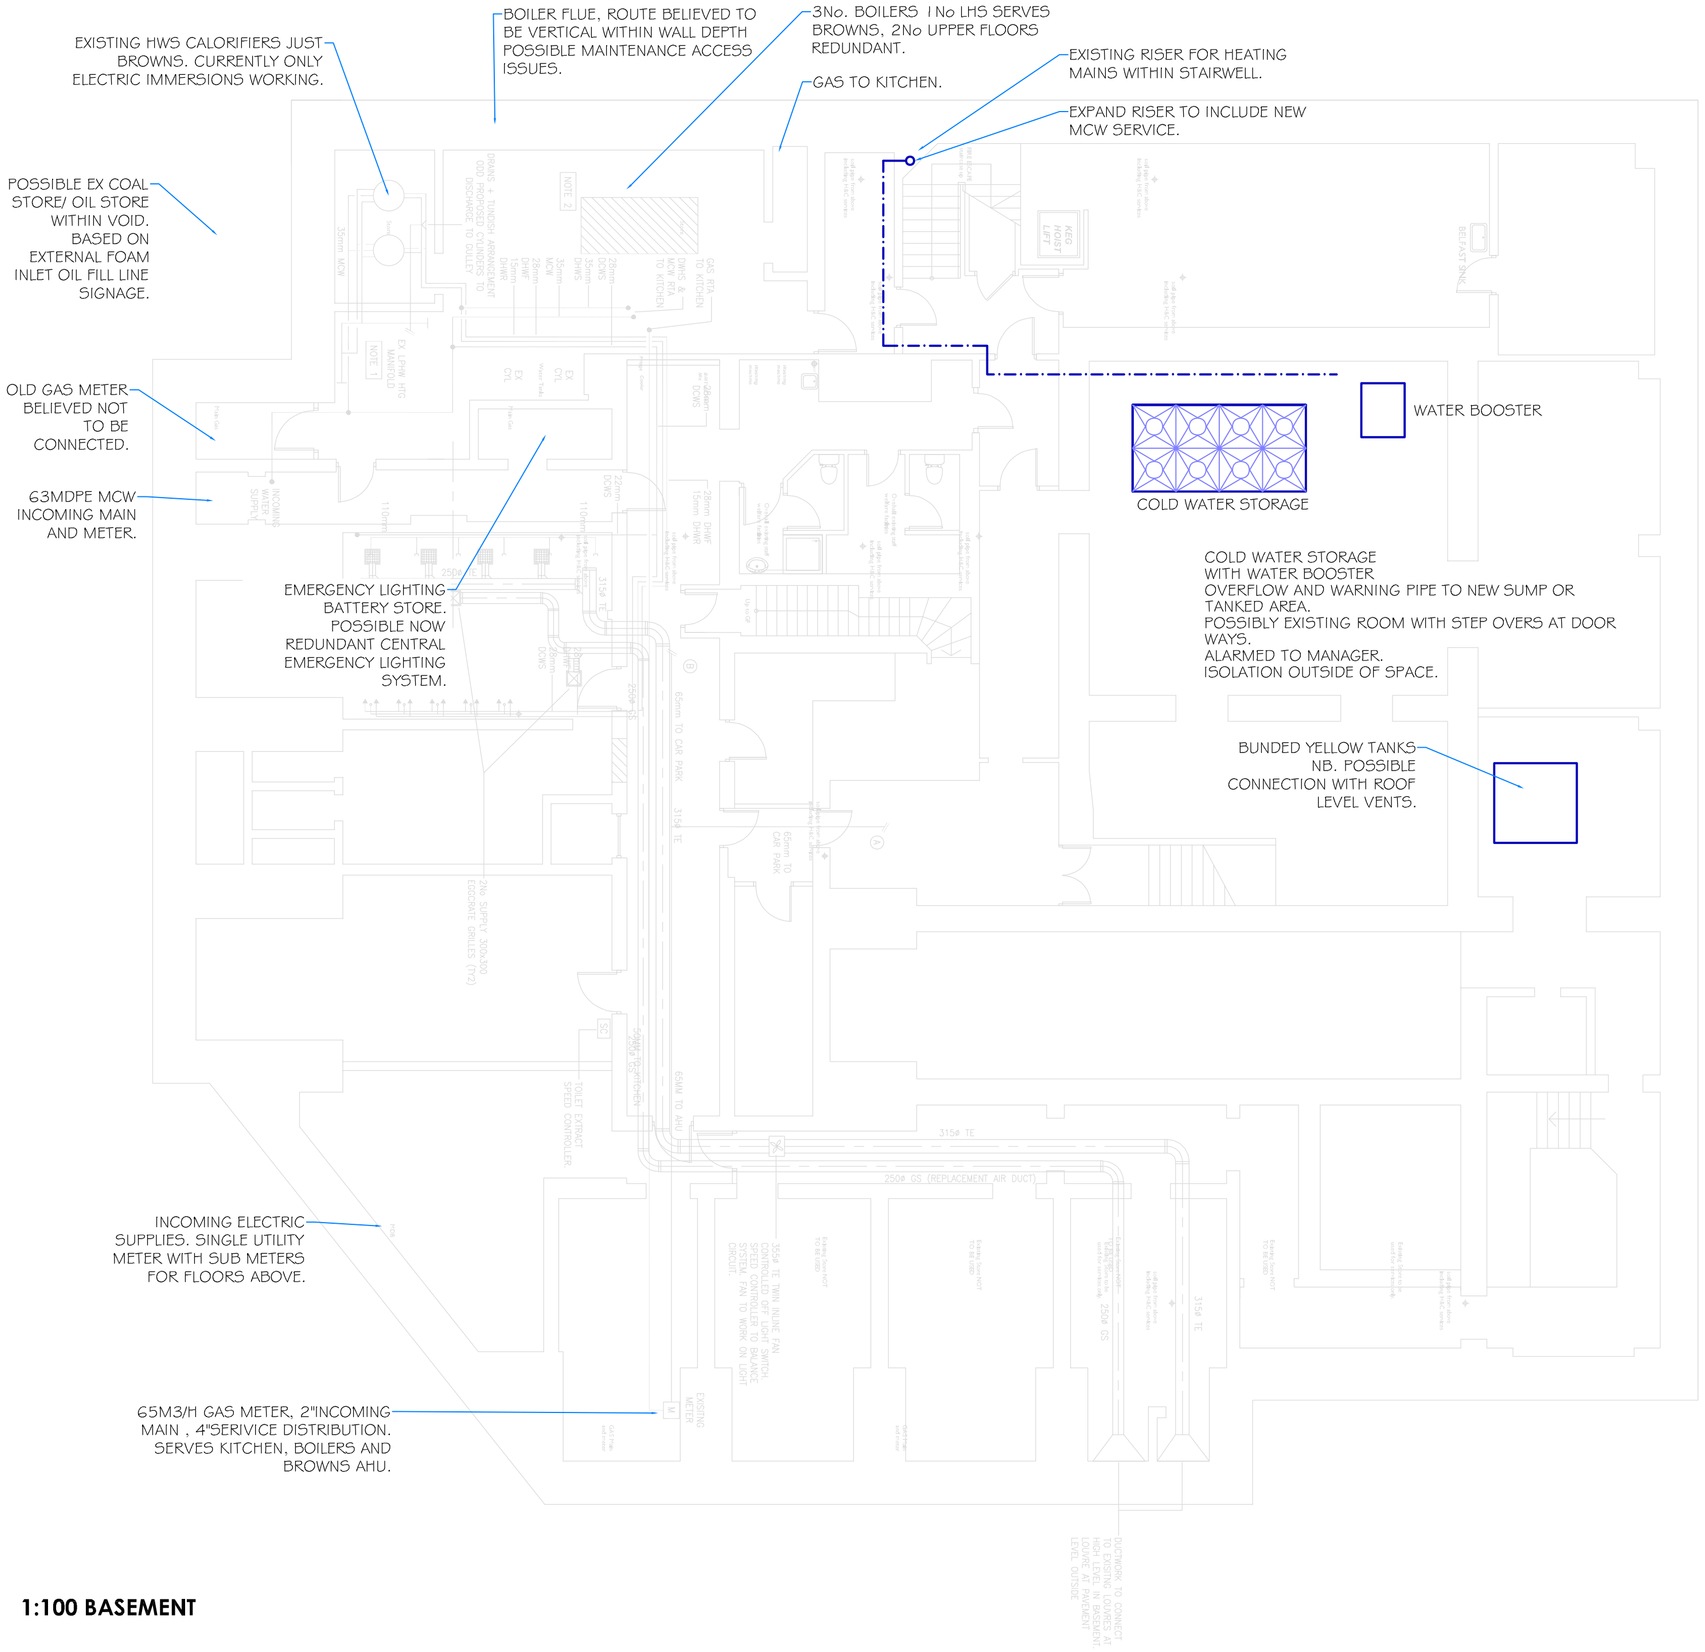

1:100 BASEMENT

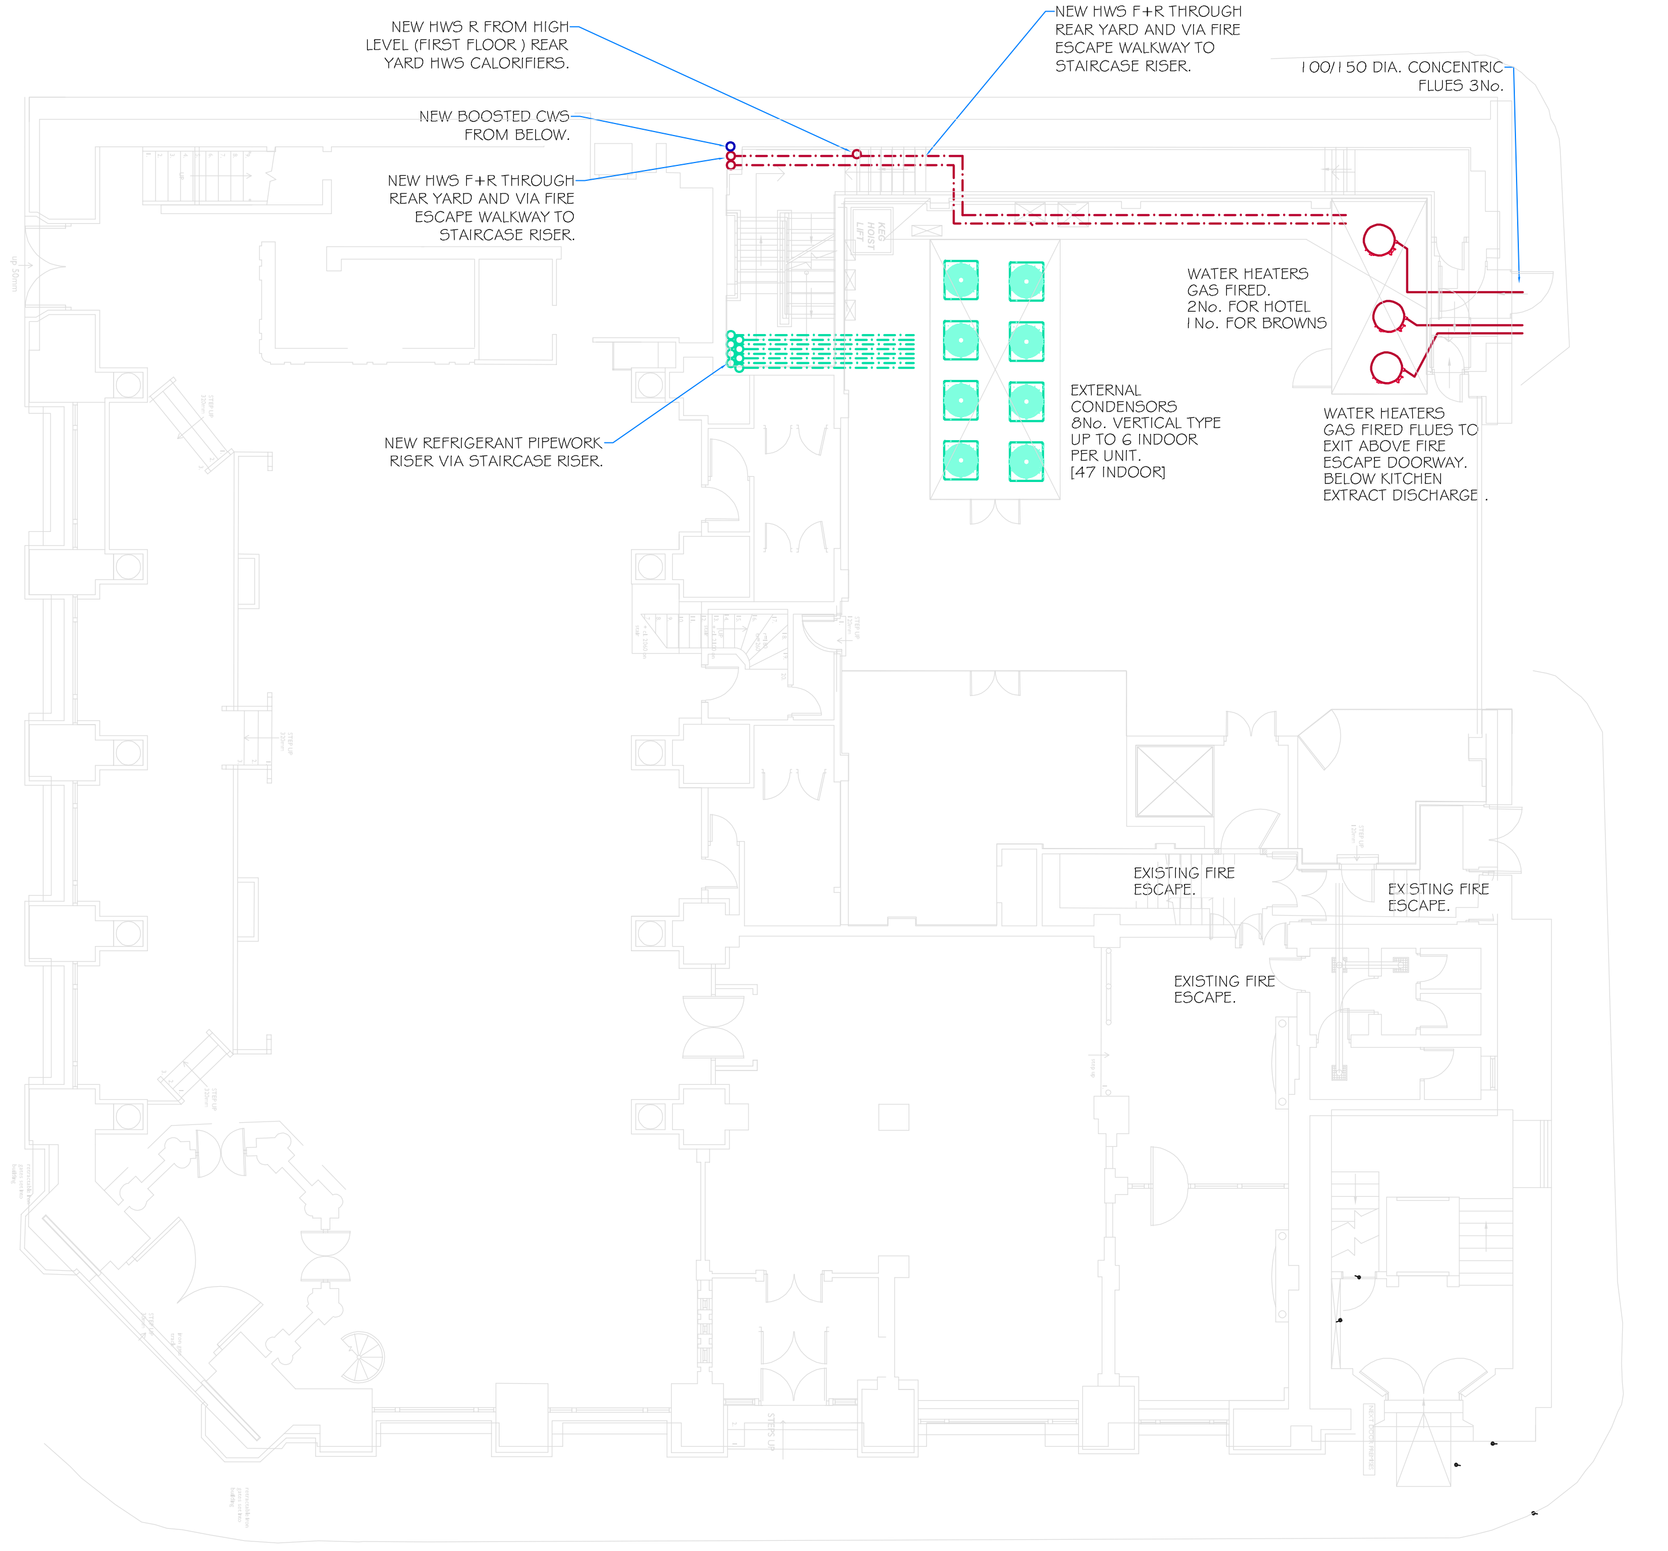

1:100 GROUND FLOOR

1.4 AIR CONDITIONING INTERNAL UNIT RECESSED/ SURFACE TBC, 1 =CONDENSER REF . 1 -G=MCU GROUP REF

350x350 BWIC EXTRACT VENTILATION

350x350 BWIC SUPPLY VENTILATION

150 DIA BWIC REFRIGERANT PIPEWORK

150 DIA BWIC COLD WATER PIPEWORK

150 DIA BWIC HOT WATER PIPEWORK

150 DIA BWIC ELECTRICAL RISER

COLD WATER SERVICE (CWS) PIPE

HOT WATER SERVICE (HWS) PIPE

REFRIGERANT PIPEWORK (2 PIPES) (AC)

EXRACT DUCT

SUPPLY DUCT

ELECTRICAL TRUNKING / CABLE TRAY / BASKET

FB FROM BELOW BWIC IN FLOOR

FA FROM ABOVE BWIC IN CEILING

TA TO ABOVE BWIC IN CEILING

TB TO BELOW BWIC IN CEILING

Scale Metres 1 2 3 4 5

Client
MITCHELLS & BUTLERS Plc

Mitchells & Butlers

BMT Project No. / Project Title
B3322 / IKC MANCHESTER

Project Address
INN KEEPERS COLLECTION
1-3 YORK STREET
MANCHESTER

Drawing Title
M&E SERVICES INSTALLATION
SERVICE ALLOCATION FEASABILITY

Job No.	Originator	Zone	Level	Type	Role
B3322	BMT	ZZ	B-01	DR	ME

System Classification	Drawing No.	Suitability	Revision
PM_10_20_30-1001		S3	P05

Drawn	Engineer	Date	Scale	Size
AL	AL	27/10/2021	1:100	A1

BUILDING MANAGEMENT TECHNOLOGY
9208 MELTON ROAD
THURMASTON
LEICESTER
LE4 8GR
TEL: (0116)244 0331
E-MAIL: <firstname.surname>@bmt-ltd.co.uk>