REV	DATE	DESCRIPTION	DRW	Eng
P01	11.11.2021	INITIAL ISSUE	AL	AL
P02	01.12.2021	AMENDED TO IN LINE WITH COORDINATION MEETING	AL	AL
P03	25.07.2022	SUITABILITY CHANGED TO S3	AL	AL

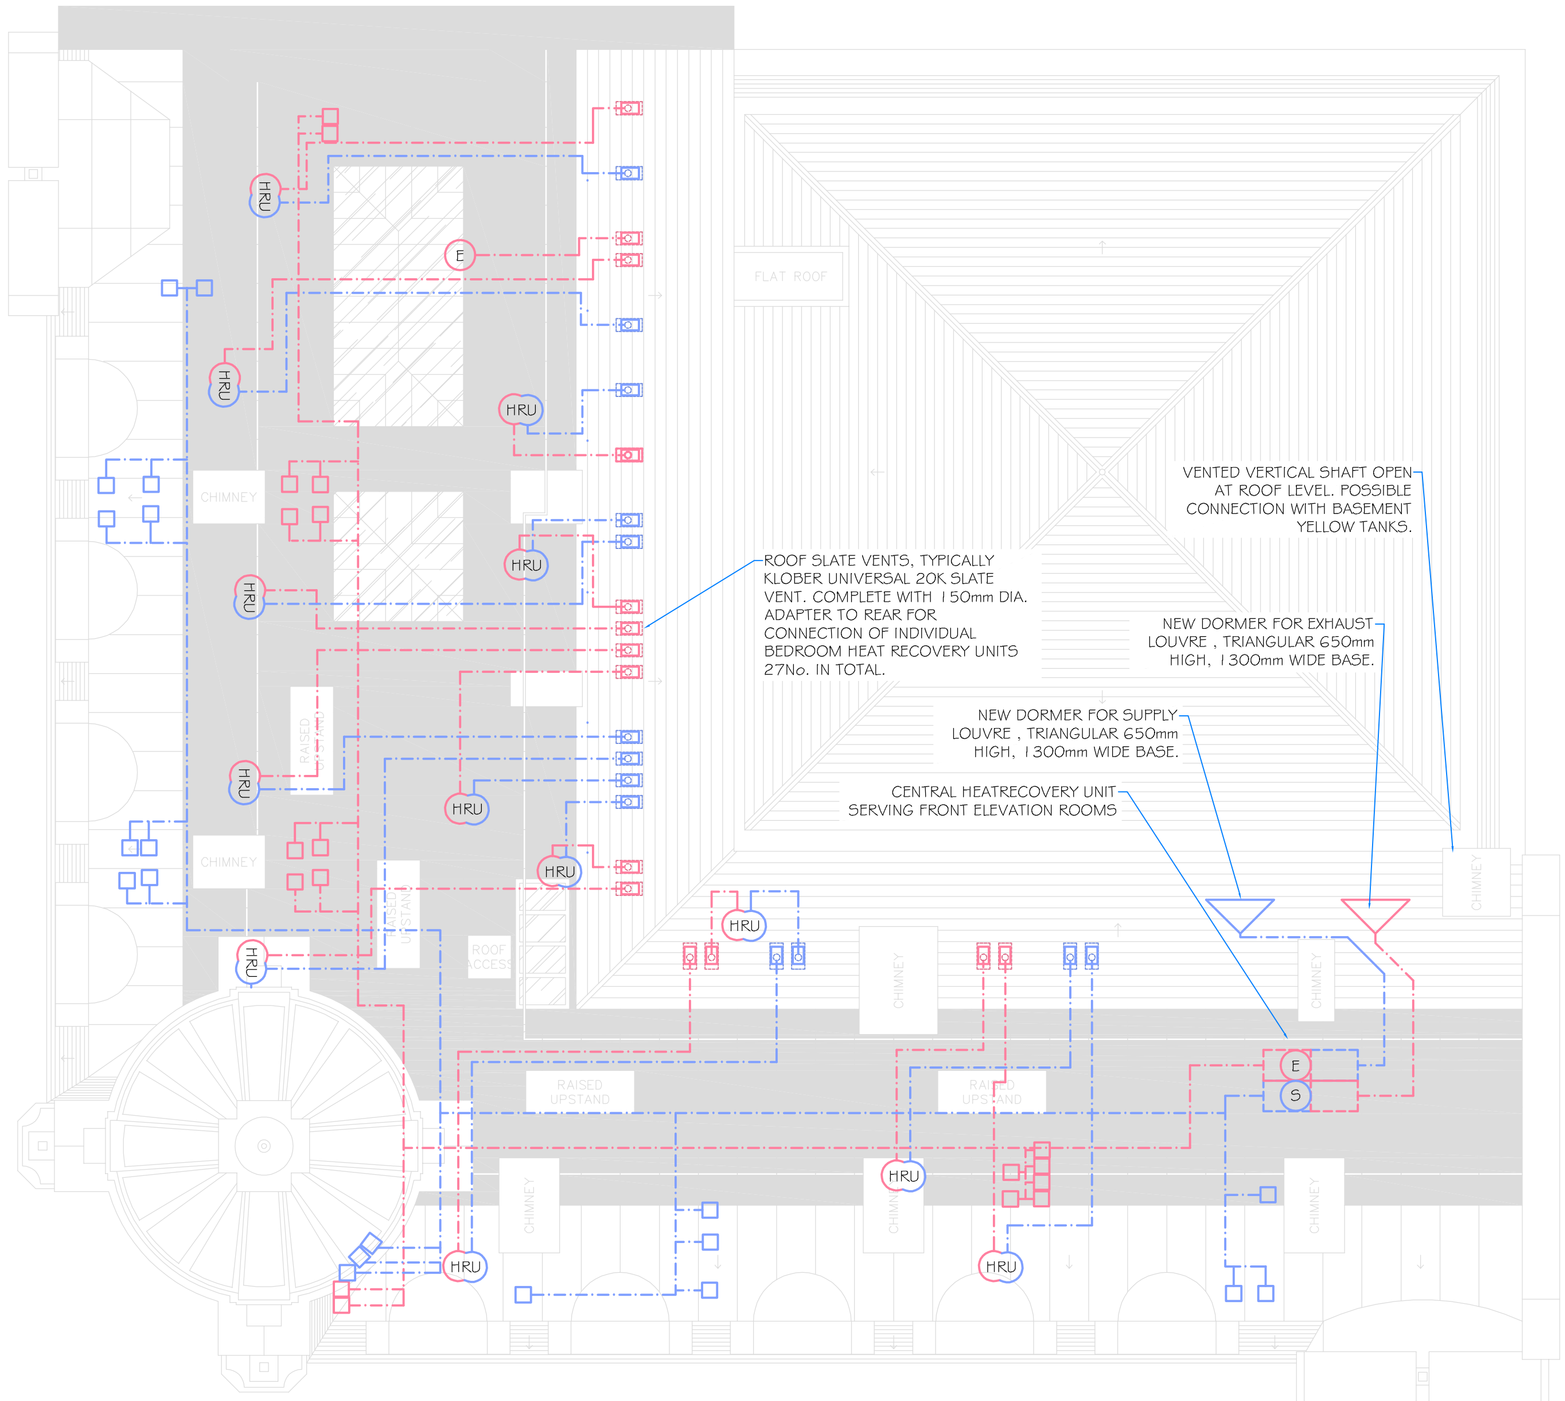

1:100 ROOF

1.4 AIR CONDITIONING INTERNAL UNIT RECESSED/ SURFACE TBC, 1=CONDENSER REF . 1-G=MCU GROUP REF

- 350x350 BWIC EXTRACT VENTILATION
- 350x350 BWIC SUPPLY VENTILATION
- 150 DIA BWIC REFRIGERANT PIPEWORK
- 150 DIA BWIC COLD WATER PIPEWORK
- 150 DIA BWIC HOT WATER PIPEWORK
- 150 DIA BWIC ELECTRICAL RISER
- COLD WATER SERVICE (CWS) PIPE
- HOT WATER SERVICE (HWS) PIPE
- REFRIGERANT PIPEWORK (2 PIPES) (AC)
- EXRACT DUCT
- SUPPLY DUCT
- ELECTRICAL TRUNKING / CABLE TRAY / BASKET
- FB FROM BELOW BWIC IN FLOOR
- FA FROM ABOVE BWIC IN CEILING
- TA TO ABOVE BWIC IN CEILING
- TB TO BELOW BWIC IN CEILING

Scale Metres 1 2 3 4 5

Client
MITCHELLS & BUTLERS Plc

Mitchells & Butlers

BMT Project No. / Project Title
B3322 / IKC MANCHESTER

Project Address
INN KEEPERS COLLECTION
1-3 YORK STREET
MANCHESTER

Drawing Title
M&E SERVICES INSTALLATION
SERVICE ALLOCATION FEASABILITY

Job No.	Originator	Zone	Level	Type	Role
B3322	BMT	ZZ	05	DR	ME

System Classification	Drawing No.	Suitability	Revision
PM_10_20_30-1004		S3	P03

Drawn	Engineer	Date	Scale	Size
AL	AL	11/11/2021	1:100	A1

BUILDING MANAGEMENT TECHNOLOGY
9208 MELTON ROAD
THURMASTON
LEICESTER
LE4 8GR
TEL: (0116)244 0331
E-MAIL: <firstname.surname>@bmt-ltd.co.uk>