

SUSPENDED CEILING SYSTEM TYPICAL DETAILS

CasoLine MF - Perimeter details to proposed walls

- 1

2 layers Gyproc plasterboard fixed with British Gypsum Drywall Screws at 230mm centres in field of board & 150mm centres at board ends
- 2

Gyproc MF5 Ceiling Sections at max. 450mm centres fixed to each MF7 with 2 no. British Gypsum Wafer Head Jack-Point Screws or MF9 Connecting Channels
- 3

Gyproc MF8 Perimeter Channel suitably fixed to wall at 600mm centres
- 4


Gyproc MF7 Primary Support Channels at 1200mm centres
- 5

Gyproc MF8 Strap Hanger or FEA1 Steel Angle hangers at 1200mm centres fixed to MF7 with 2 no. British Gypsum Wafer Head Jack-Point Screws
- 6


Gyproc MF12 Soffit Cleat fixed to hanger with MF11 Nut & Bolt & suitably fixed to soffit
- 7

Isover insulation where required
- 8

Gyproc Sealant for optimum sound insulation

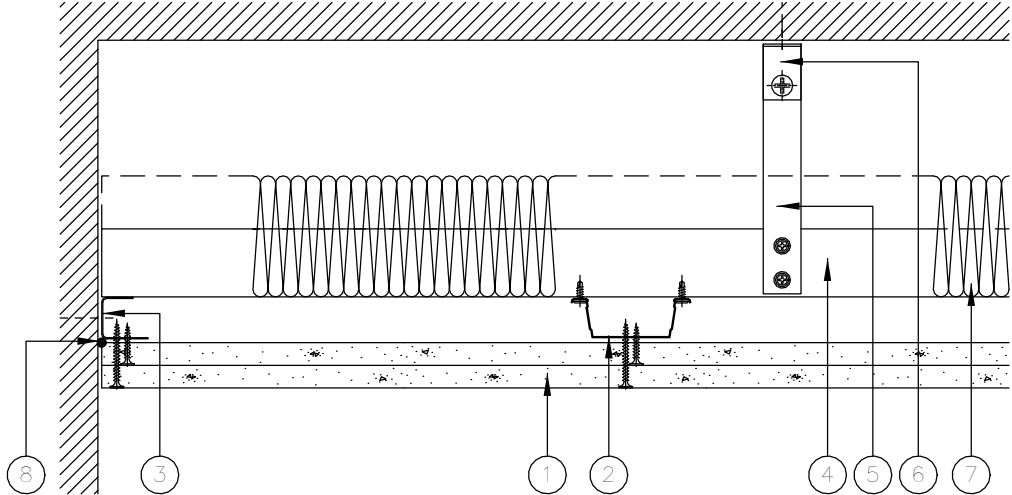

Perimeter 1

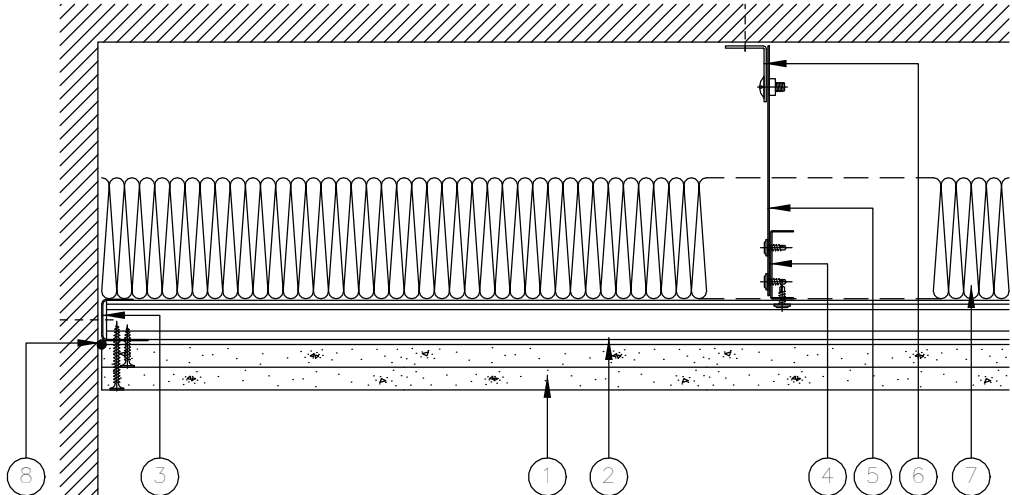

Perimeter 2

CasoLine MF - Perimeter details to existing walls

- 1

2 layers Gyproc plasterboard fixed with British Gypsum Drywall Screws at 230mm centres in field of board & 150mm centres at board ends
- 2

Gyproc MF5 Ceiling Sections at max. 450mm centres fixed to each MF7 with 2 no. British Gypsum Wafer Head Jack-Point Screws or MF9 Connecting Channels
- 3

Gyproc MF8 Perimeter Channel suitably fixed to wall at 600mm centres
- 4

Gyproc MF7 Primary Support Channels at 1200mm centres
- 5


Gyproc MF8 Strap Hanger or FEA1 Steel Angle hangers at 1200mm centres fixed to MF7 with 2 no. British Gypsum Wafer Head Jack-Point Screws
- 6

Gyproc MF12 Soffit Cleat fixed to hanger with MF11 Nut & Bolt & suitably fixed to soffit
- 7


Isover insulation where required
- 8

Gyproc Sealant for optimum sound insulation
- 9

Gyproc BGM105 Edge Reveal

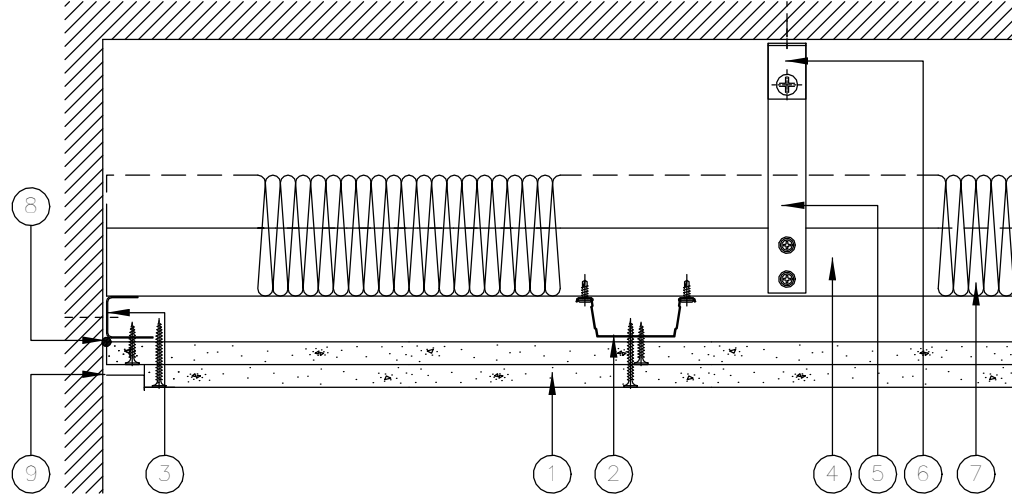

Perimeter 1

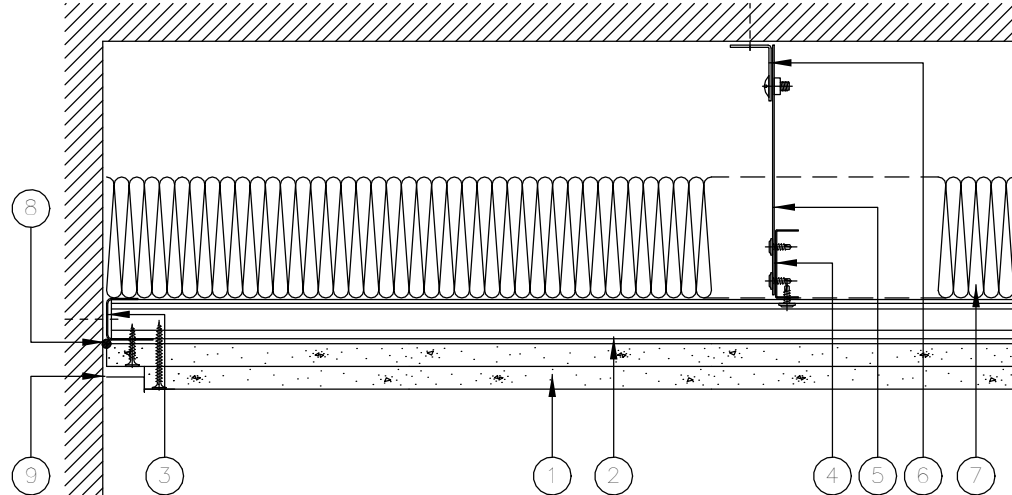

Perimeter 2

PARTITION SYSTEM TYPICAL DETAILS

GypWall CLASSIC - Abutments from existing slab to soffit

- 1

2 layers Gyproc plasterboard fixed with British Gypsum Drywall Screws at 300mm centres
- 2

Gyproc 70 AS 50 AcouStuds at 600mm centres
- 3

Isover insulation where required
- 4

Gyproc 72 FEC 50 Channel suitably fixed to floor/soffit at 600mm centres (72 DC 60 for height over 4200mm)
- 5

Gyproc Sealant for optimum sound insulation
- 6

Gyproc jointing material bulk fill where gap exceeds 5mm
- 7

Indicative skirting
- 8

Gyproc GFS1 Fixing Strap to support outer layer horizontal board joints
- 9


Gyproc Steel Angle or timber batten suitably fixed to soffit
- 10

Gyproc 70 S 50 'C' stud suitably fixed to wall at 600mm centres
- 11

Gyproc BGM105 Edge Reveal
- 12

CAT A Raised access floor system
- 13

Ceiling perimeter detail to CAT A ceiling

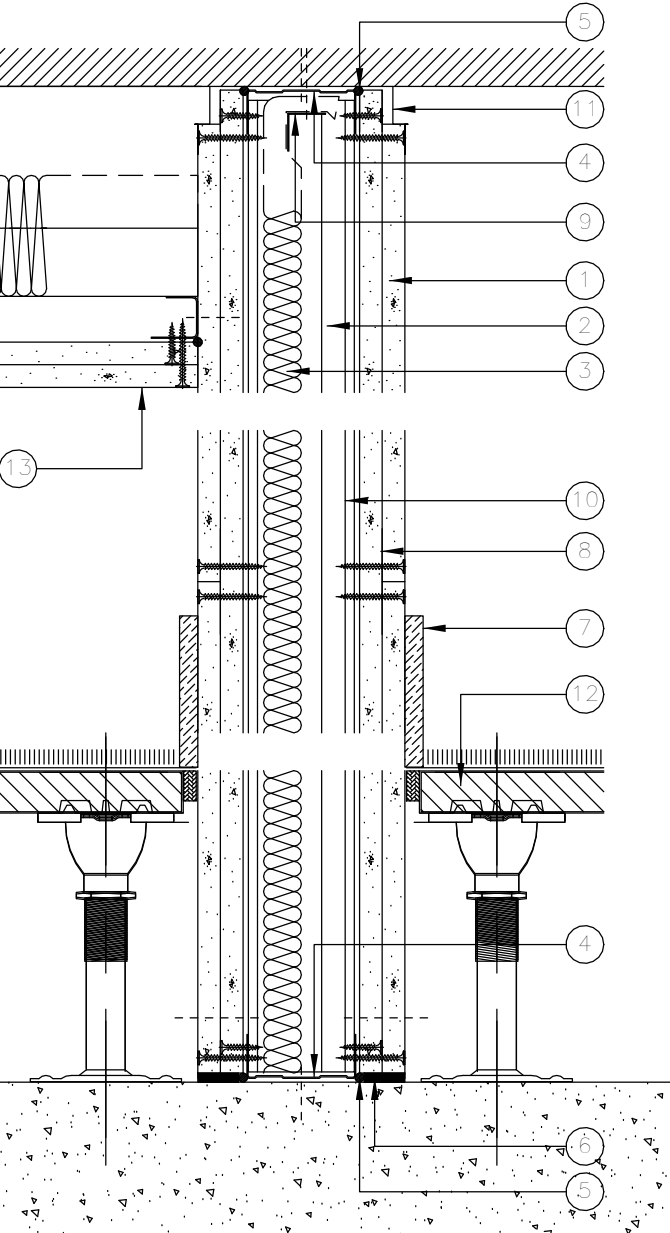

RAISED ACCESS FLOOR SYSTEM AT PERIMETER

GypWall CLASSIC - Abutments to existing walls & ceiling

- 1

2 layers Gyproc plasterboard fixed with British Gypsum Drywall Screws at 300mm centres
- 2

Gyproc 70 AS 50 AcouStuds at 600mm centres
- 3

Isover insulation where required
- 4

Gyproc 72 FEC 50 Channel suitably fixed to floor/soffit at 600mm centres (72 DC 60 for height over 4200mm)
- 5

Gyproc Sealant for optimum sound insulation
- 6

Gyproc jointing material bulk fill where gap exceeds 5mm
- 7


Indicative skirting
- 8

Gyproc GFS1 Fixing Strap to support outer layer horizontal board joints
- 9

Gyproc Steel Angle or timber batten suitably fixed to soffit
- 10

Gyproc 70 S 50 'C' stud suitably fixed to wall at 600mm centres
- 11

Gyproc BGM105 Edge Reveal

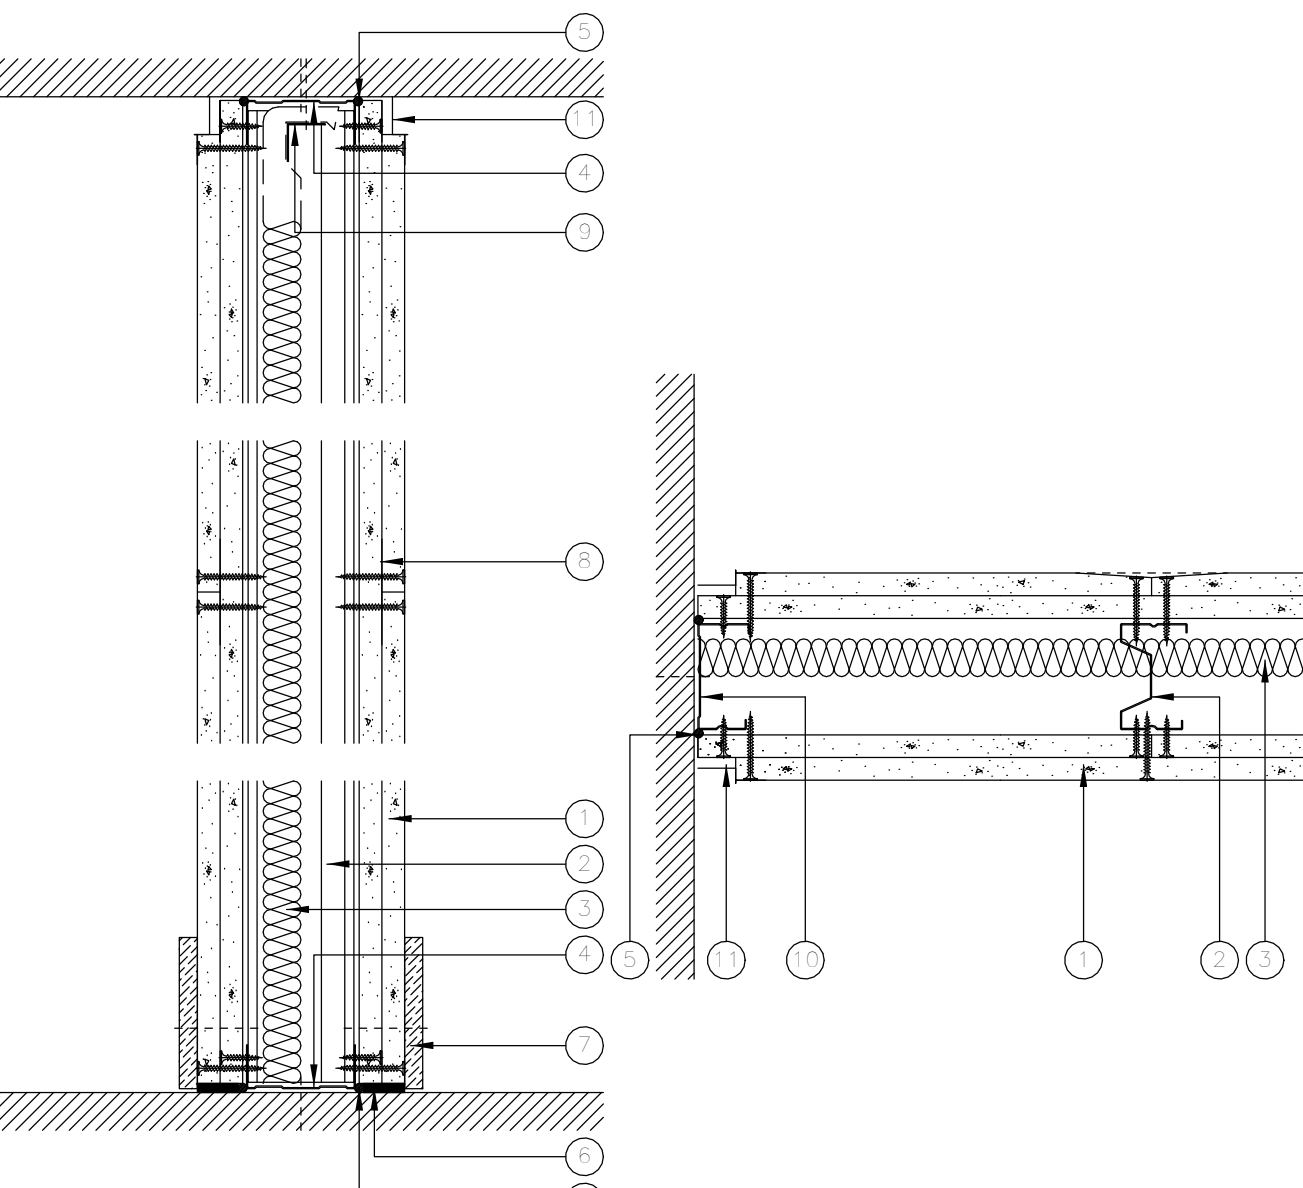

Base & Head

Wall Abutment

© COPYRIGHT
The copyright in this drawing is vested in OBI Property Ltd and no licence or assignment of any kind has been, or is, granted to any third party whether by provision of copies or originals of the drawings or otherwise unless otherwise agreed in writing.

DO NOT SCALE FROM THIS DRAWING
The contractor shall check and verify all dimensions on site and report any discrepancies in writing to OBI Property Ltd before proceeding with work.

FOR ELECTRONIC DATA ISSUE
Electronic data / drawings are issued as "read only" and should not be interrogated for measurement. All dimensions and levels should be read, only from those values stated in text, on the drawing.

AREA MEASUREMENT
The areas are approximate and can only be verified by a detailed dimensional survey of the completed building. Any decisions to be made on the basis of these predictions, whether as to project viability, pre-letting, lease agreements or the like, should include due allowance for the increases and decreases inherent in the design development and building processes. Figures relate to the likely areas of the building at the current state of the design and using the Gross External Area (GEA) / Gross Internal Area (GIA) / Nett Internal Area (NIA) method of measurement from the Code of Measuring Practice, 6th Edition (RICS Code of Practice). All areas are subject to Town Planning and Conservation Area Consent, and detailed Rights to Light analysis.

Rev	Comments	Date	Rev by
Client			
Project			
Drawing			
Drawing Number			
Date			
Drawn by			
Status			
Scale			
Checked by			
Information			
OBI			
80 Mosley Street, Manchester, M2 3FX. T: 0161 237 1717 www.obiproperty.co.uk			