


Outlet
Ref
Once
Outlet_Type
Outlet_Size_(mm_dia)
Outlet_Ref_(KO)
Rainwater_Pipe_Size_(mm_dia)
Catchment_Area_Ref
Effective_Area_to_drain_(sqm)
Achieved_Outlet_Flow_Rate_(litres_sec)
Gutter_size_(mm)
Status
Outlet_Type
Outlet_Ref_(KO)
Roof_Area_Ref
Area_to_drain_(sqm)
NUMBER

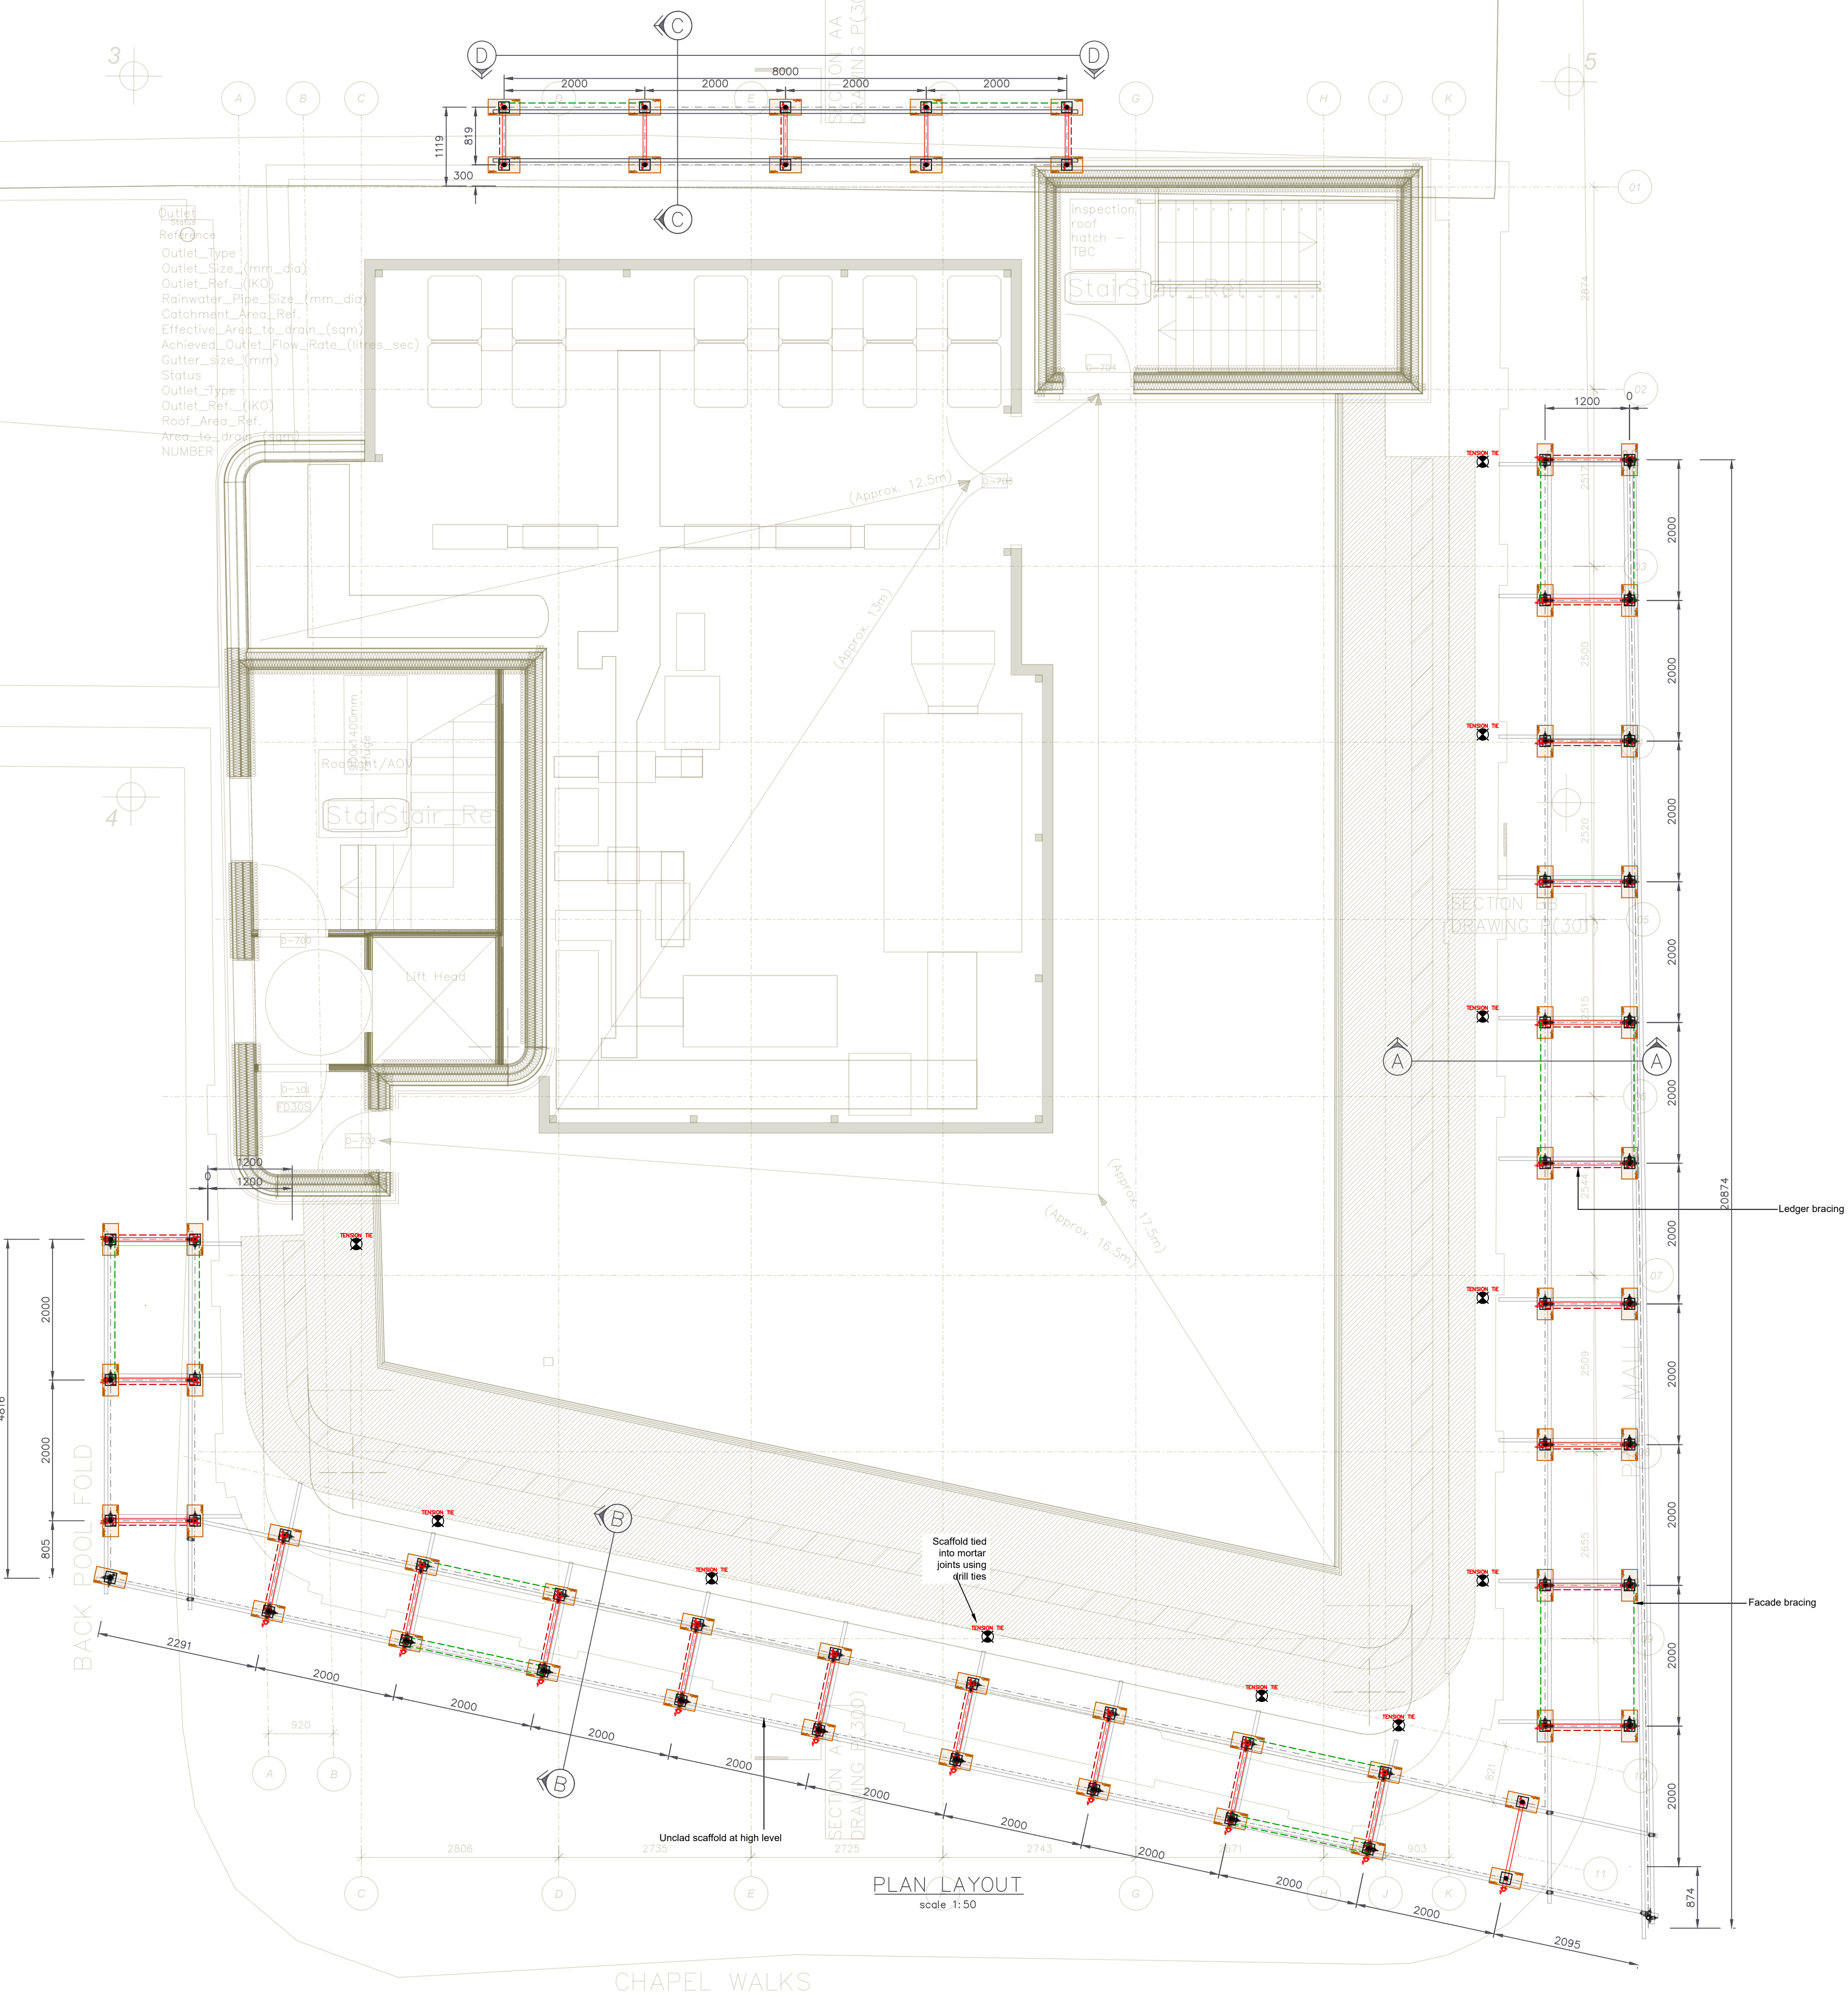

PLAN LAYOUT
scale 1:50

RISK - ACCURACIES IN BUILDING LINE CAUSING SCAFFOLD TO BE DIMENSIONALLY INACCURATE
Control Measure: Prior to erection the scaffold contractor and/or principal contractor should check the existing structure to ensure the scaffold can be based out and erected as detailed and inform Creator Ltd of any discrepancies.


RISK - EXCESSIVE BAY SIZES INSTALLED DURING ERECTION
Control Measure: The scaffold contractor must ensure that the maximum bay size installed are as indicated and should not be exceeded. It is the responsibility of the scaffold contractor to remedy any defects.

RISK - OVERLOADING OF SCAFFOLD STRUCTURE
Control Measure: The design service loads indicated should be closely site managed to ensure that only 2 number of working levels are present at one time. The load conditions of the scaffold should be clearly identified on the scaffag.


RISK - OVERLOADING OF EXISTING STRUCTURE
Control Measure: Principal contractor to employ a structural engineer to ensure the applied loads from the scaffold do not overload the existing structure. Creator Ltd to be contacted where structure is deemed unsafe to support scaffold structure.

RISK - EXCESSIVE LIFT HEIGHTS CAUSING BUCKLING
Control Measure: Maximum lift heights to be installed as detailed by the scaffold contractor and have a maximum tolerance of ±100mm

RISK - OVERLOADING OF EXISTING STRATA
Control Measure: Principal contractor to employ a structural engineer to ensure the applied loads from the scaffold do not overload the existing strata. Creator Ltd to be contacted where strata is deemed unsafe to support scaffold structure.

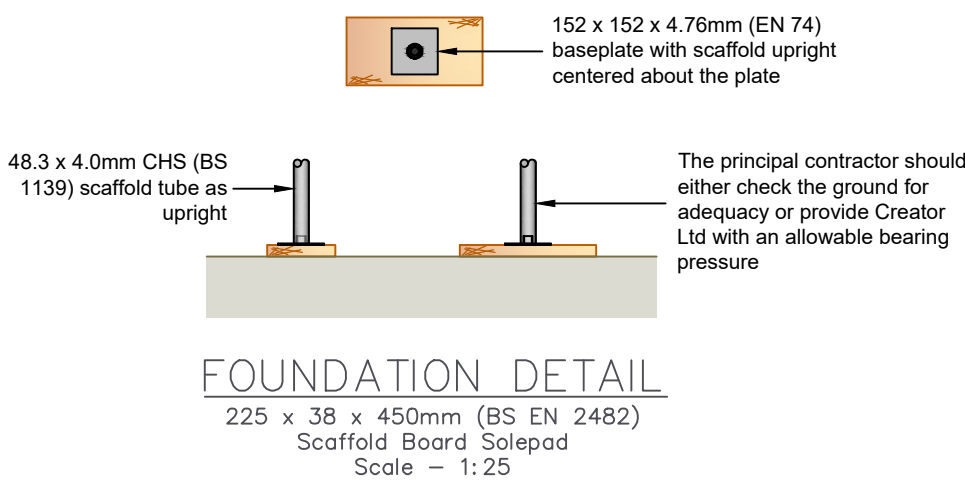

FOUNDATION DETAIL
225 x 38 x 450mm (BS EN 2482)
Scaffold Board Solepad
Scale - 1:25

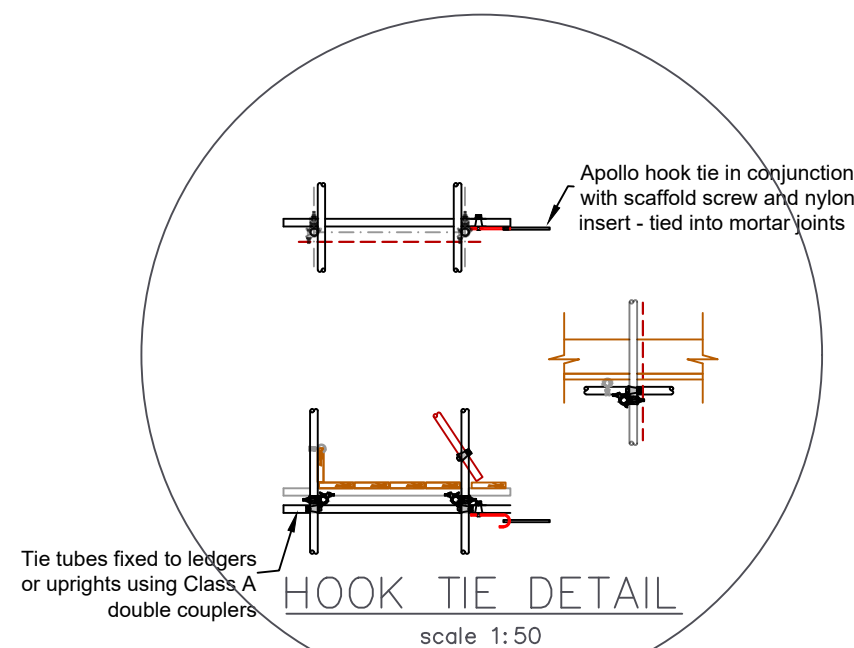

HOOK TIE DETAIL
scale 1:50

DOCUMENT REFERENCES
This design is to be read in conjunction with the following design drawings and/or documents:
CRE-IBN-082-001E_REPORT
APPENDIX A - CRE-IBN-082-001E_1,2,3,4.dwg

AMENDMENTS / REVISIONS							
REV	BY	DATE	CHECK	DATE	APPD	DATE	
E	AW	22.04.22	KRB	22.04.22			
D	APS	23.08.21	KRB	23.08.21			
C	SLS	17.08.21	KRB	17.08.21			
B	KRB	22.06.21					
A	CH	15.06.21	KRB	15.06.21			
-	EAS	02.06.21	MDR	03.06.21	KRB	03.06.21	



FOR CONSTRUCTION
CRE-IBN-082-001E_recovery
1
1:50,25
A1
ACCESS SCAFFOLD
CAVENDISH HOUSE
MANCHESTER
M1 5EE
SEE QUOTE

CREATOR
SCAFFOLD DESIGNS
& TEMPORARY WORKS CONSULTANTS LTD
CREATOR ADDRESS
Cavendish House, 501 DPM
Cavendish House
100-102, Cavendish Road
M1 5EE
www.creator-scaffolddesigns.co.uk