


1 : 100

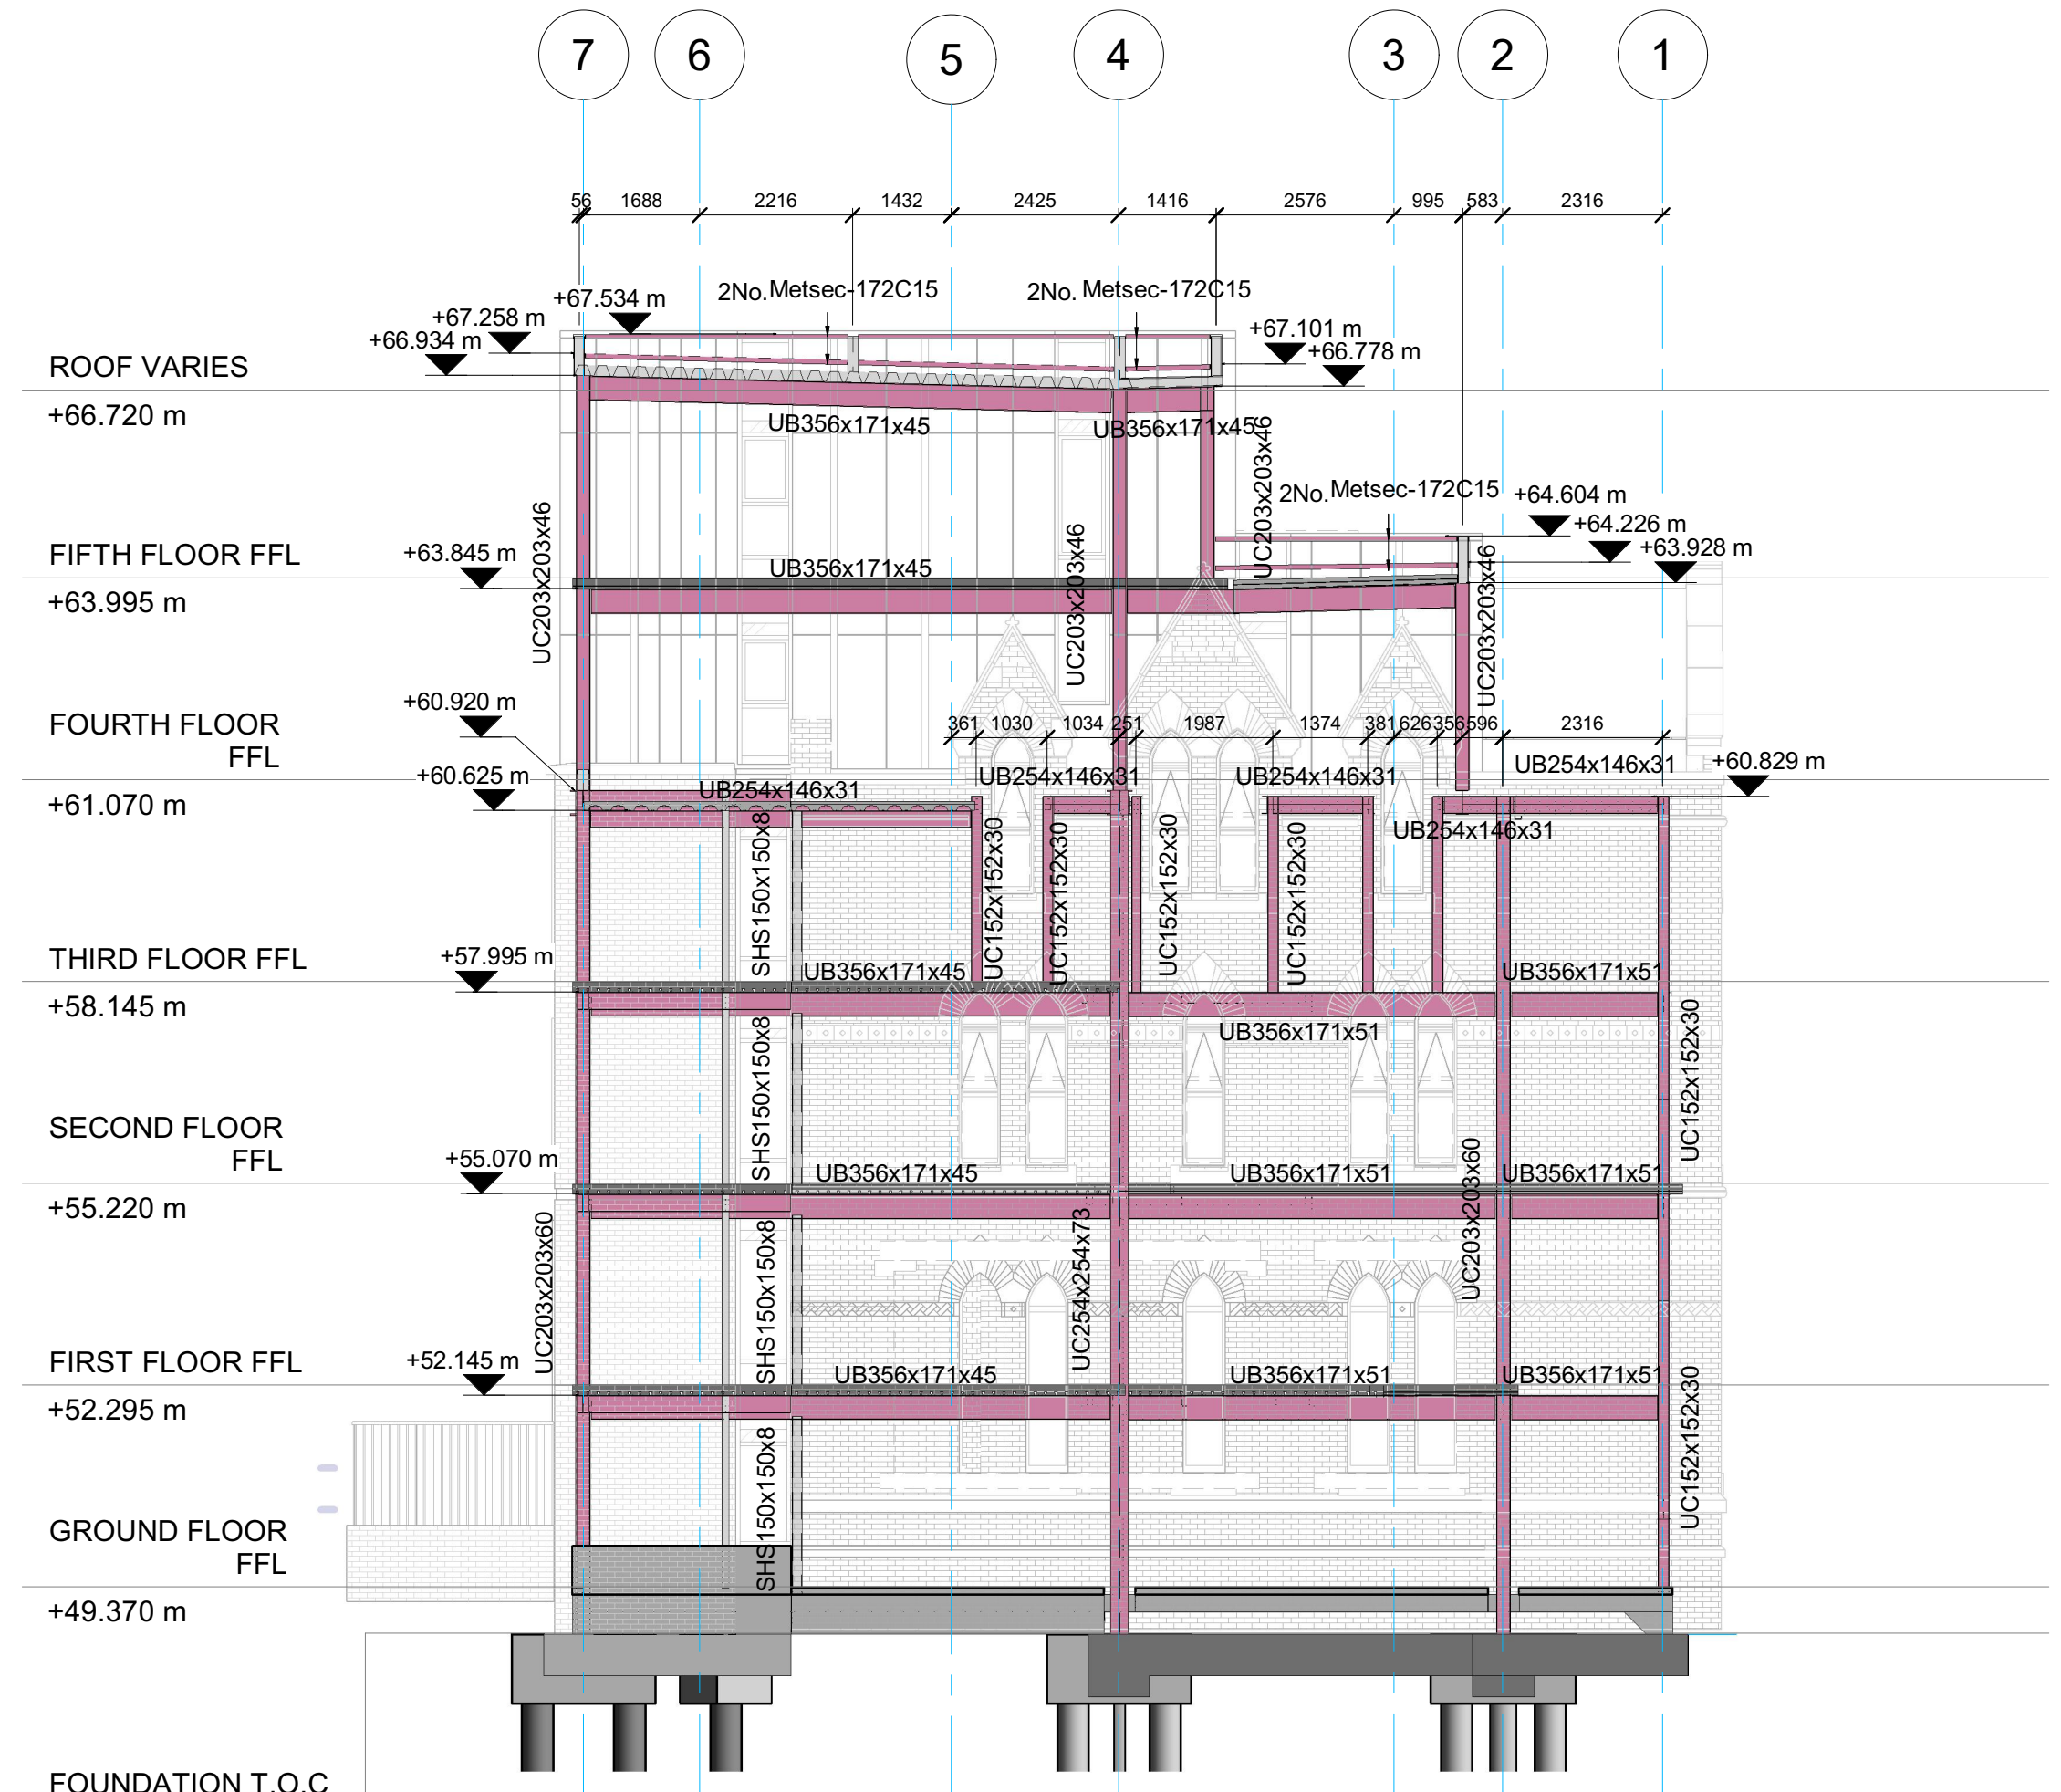

1 : 100

C3	20.06.22	AK	BM	FINAL CONSTRUCTION ISSUE
C2	23.05.22	AK	BM	CONSTRUCTION ISSUE. REVISED AS INDICATED
C1	27.04.22	AK	BM	CONSTRUCTION ISSUE. REVISED AS INDICATED
P3	01.03.22	AK	BM	UPDATED STAGE 4
P2	11.02.22	AK	BM	STAGE 4 ISSUE
P1	30.04.21	AK	BM	GRID UPDATES STAGE 3 ISSUE
	DATE	DRAWN	REV'D BY	AMENDMENT

STATUS	PURPOSE OF ISSUE
A	CONSTRUCTION

COPYRIGHT:
The concepts and the information contained in this document are the copyright of Ridge LLP.
Use or copying of the document in whole or in part without written permission of Ridge LLP,
constitutes an infringement of copyright.



CLIENT		ERIC WRIGHT CONSTRUCTION	
PROJECT		ANCOATS DISPENSARY	
DRAFTER		ENGINEER	
AK		BM	

STRUCTURAL ELEVATIONS
SHEET 2

SCALE As indicated	SHEET A1	DRAWING No 210005-RDG-XX-ZZ-DR-S-0051	AMDT C3
-----------------------	-------------	--	------------

STEEL NOTES

- ALL STEELWORK TO BE HOT ROLLED GRADE S355 TO BS EN 10025:2004 & BS EN 10210.
- ALL STEEL BEAMS SUPPORTING CONCRETE METAL DECK FLOORS AND SLABS ARE DESIGNED COMPOSITELY. ALLOW FOR 19mm DIAMETER x 105mm LONG SHAPES AND 300mm CENTRES ON PRIMARY BEAMS AND 150mm CENTRES ON SECONDARY BEAMS, THROUGH DECK WELDED ON SITE.
- ALLOW FOR TRANSVERSE SHEAR REINFORCEMENT WITHIN ALL CONCRETE METAL DECK FLOORS AND SLABS: H16 2000mm LONG AT 200mm CENTRES ON PRIMARY BEAMS AND 1000mm H16 U BARS TO PERIMETER BEAMS.
- ADDITIONAL STEEL PLATES/ANGLES 100x100x8 RSA OR 100mm WIDE x 8mm THICK STEEL PLATE WILL BE REQUIRED AT THE BASE OF ALL COLUMNS MARKED ** ON PLAN , TO PROVIDE ADEQUATE BEARING SUPPORT FOR THE FLOOR AND ROOF DECKING.
- FLOOR TO FLOOR HEIGHT IS RESTRICTED AND THEREFORE M&E SERVICES ARE PROPOSED TO BE LOCATED WITHIN THE DEPTH OF THE STEELWORK. REFER RIDGE DRAWINGS 210005-RDG-XX-ZZ-DR-S-0100 ONWARDS (I.E. 0100 SERIES DRAWING NUMBERS) FOR DETAILS.
- STEEL BEAMS DEPTH HAS BEEN LIMITED TO 356UB/356UC TO RESTRICT DEPTH TO 375mm.
- FIRE DESIGN: REFER TO FIRE ENGINEER AND ARCHITECT'S REQUIREMENTS

CORROSION PROTECTION:

- ALL INTERNAL STEELWORK CONSIDERED TO BE ENVIRONMENT CATEGORY C2 LOW RISK. SURFACE PREPARATION: BLAST CLEAN TO Sa 2 1/2. COATING: 80 MICRON ZINC PHOSPHATE EPOXY PRIMER.

CONNECTIONS:

- REFER TO RIDGE CONNECTION FORCES MARKUP FOR SPECIFIC CONNECTION FORCES

NOTES

1. DRAWINGS ARE TO BE READ IN CONJUNCTION WITH ALL RELEVANT SPECIFICATIONS, ENGINEERS, ARCHITECTS' AND SERVICES DRAWINGS, INCLUDING APPROVED BUILDERS' WORK DRAWINGS. CONTRACTOR TO NOTIFY ENGINEER OF DISCREPANCIES BETWEEN STRUCTURAL DRAWINGS AND SPECIFICATIONS / OTHER DRAWINGS.
2. DO NOT SCALE FROM THE DRAWING. WORK TO DIMENSIONS AND COORDINATES PROVIDED. ALL LEVELS ARE IN METRES AND ALL DIMENSIONS ARE IN MILLIMETRES.
3. FOR GENERAL NOTES REFER TO RDG DRAWING 5014349-RDG-XX-XX-DR-S-0001.
4. ARCHITECT TO CONFIRM ALL SETTING OUT AND DIMENSIONS.
5. U.N.O. ALL COLUMNS CENTRED ON GRID.
6. ALL SERVICES ARE RISERS/ PENETRATIONS T.B.C. BY M&E ENGINEER.