




ABBREVIATIONS KEY

FD = FIRE DAMPER
VCD = VOLUME CONTROL DAMPER
CTA = CROSS TALK ATTENUATOR
FIA = FIRE ALARM INTERFACE

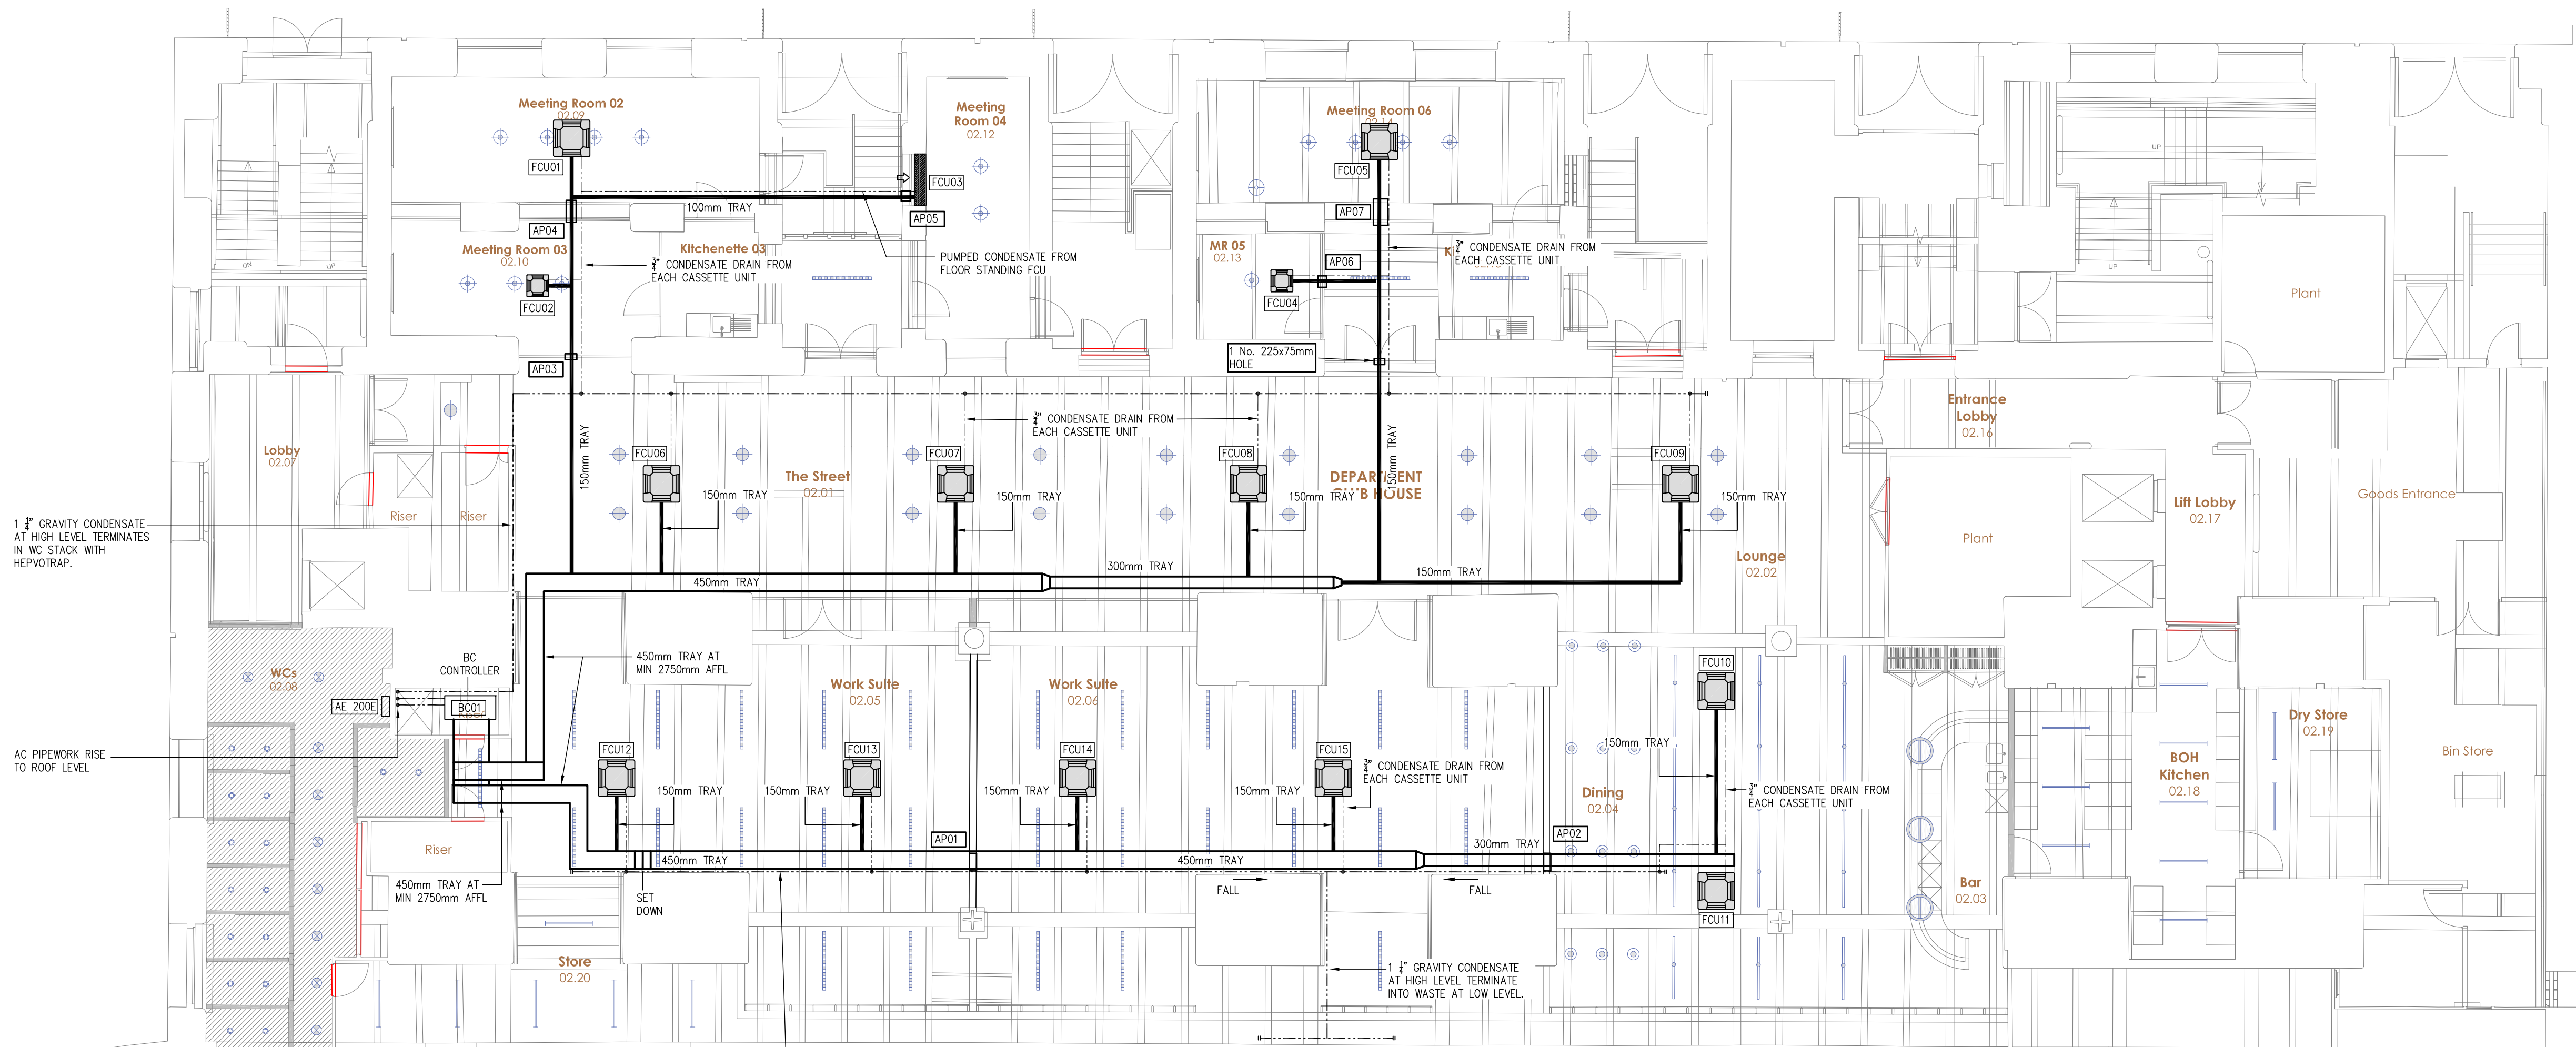

NOTES
VRF/DX:
ABLE TRAY TO BE INSTALLED AT HEIGHT TO PREVENT CLASHES WITH FCU'S & DUCTWORK AS INDICATED.
FCU'S HUNG AT 2500mm TO GRILLE.
CONDENSATE TO FOLLOW DX PIPE ROUTE TO TERMINATION POINTS AS INDICATED.
REFRIGERANT CONTAINMENT TO BE INSTALLED ON CABLE TRAY.

L2 - AIR CONDITIONING LAYOUT

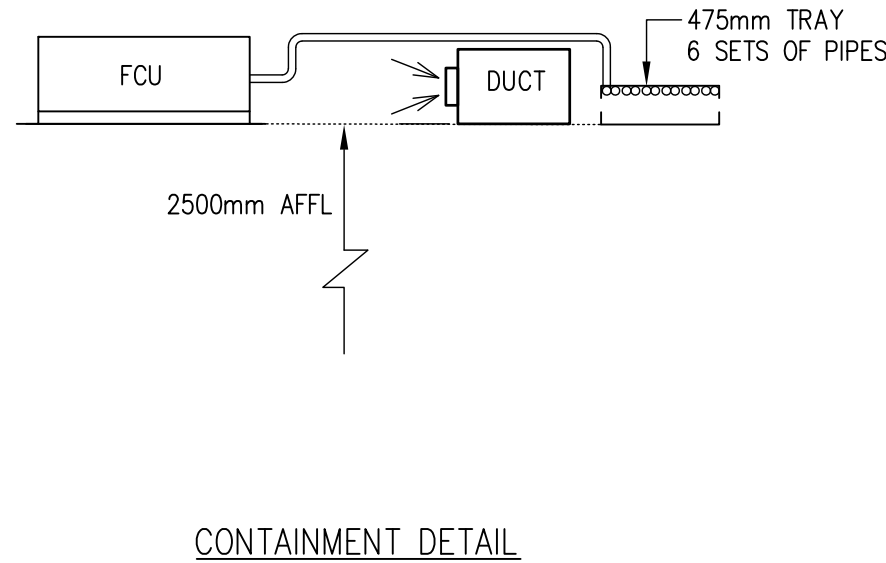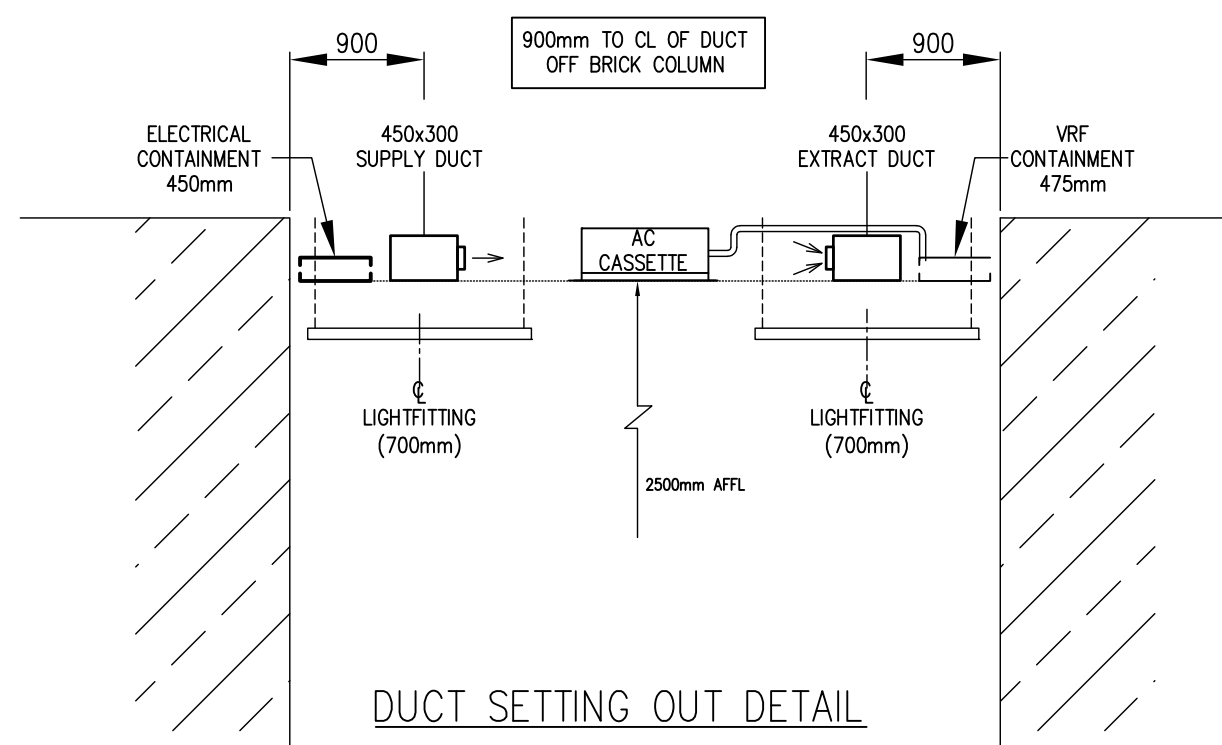

AS FITTED

AF	AS FITTED	20.05.20	RJ	PM	PM
C3	CONSTRUCTION ISSUE COMMENTS INCORPORATED	12.02.20	RJ	PM	PM
C2	CONSTRUCTION ISSUE HOPE REQUIREMENTS INDICATED	5.02.20	RJ	PM	PM
C1	CONSTRUCTION ISSUE COMMENTS INCORPORATED	23.01.20	RJ	PM	PM
P2	COMMENTS INCORPORATED	16.01.20	RJ	PM	PM
P1	ISSUED FOR COMMENTS	14.01.20	RJ	PM	PM
Rev	Revision note	Date	CAD Rev	Eng Sgn'd	Eng Chk'd

DRAWING TITLE

SECOND FLOOR
AIR CONDITIONING LAYOT

PROJECT

BONDED WAREHOUSE

CLIENT

Temperature Control



Walker House, Chester Road
Old Trafford, Manchester, M16 9HN
Phone: 0161 872 5722
Email: autocad.mano@temperaturecontrol.co.uk
www.temperaturecontrol.co.uk

ENVIRONMENTAL
ECE
CONSULTING ENGINEERS

Environmental Consulting Engineers
The Plaza
100 Old Hall Street
Liverpool L3 5QJ
T: 0151 600 5445
F: 0151 600 5446
enquiries@ecengineers.co.uk
www.ecengineers.co.uk

Mechanical & Electrical Building Services Consulting Engineers,
Sustainability Consultants, Project Management, Cost Consultants

SCALE: 1:100 (A1)	DATE: 19.09.19	DRAWING NUMBER: ECE-0170-M100	REV: AF
DRAWN: RJ	DESIGN: PM		