

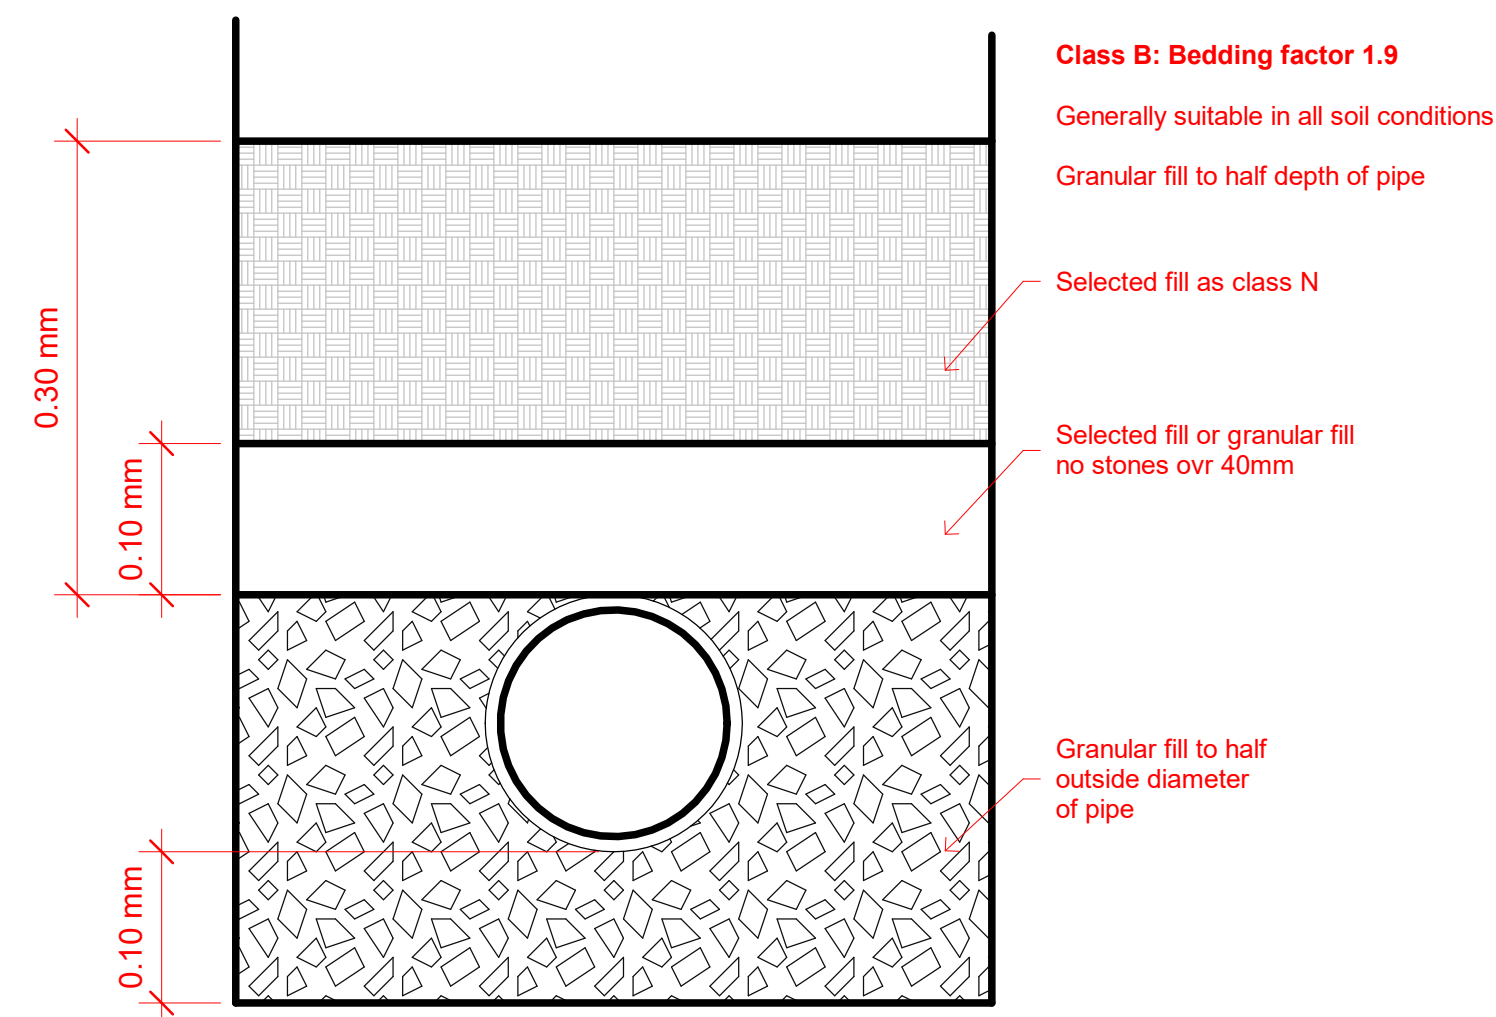


Diagram 10: Bedding for pipes Class N

2 Drainage - Diagram 10 Class N2
1 : 5


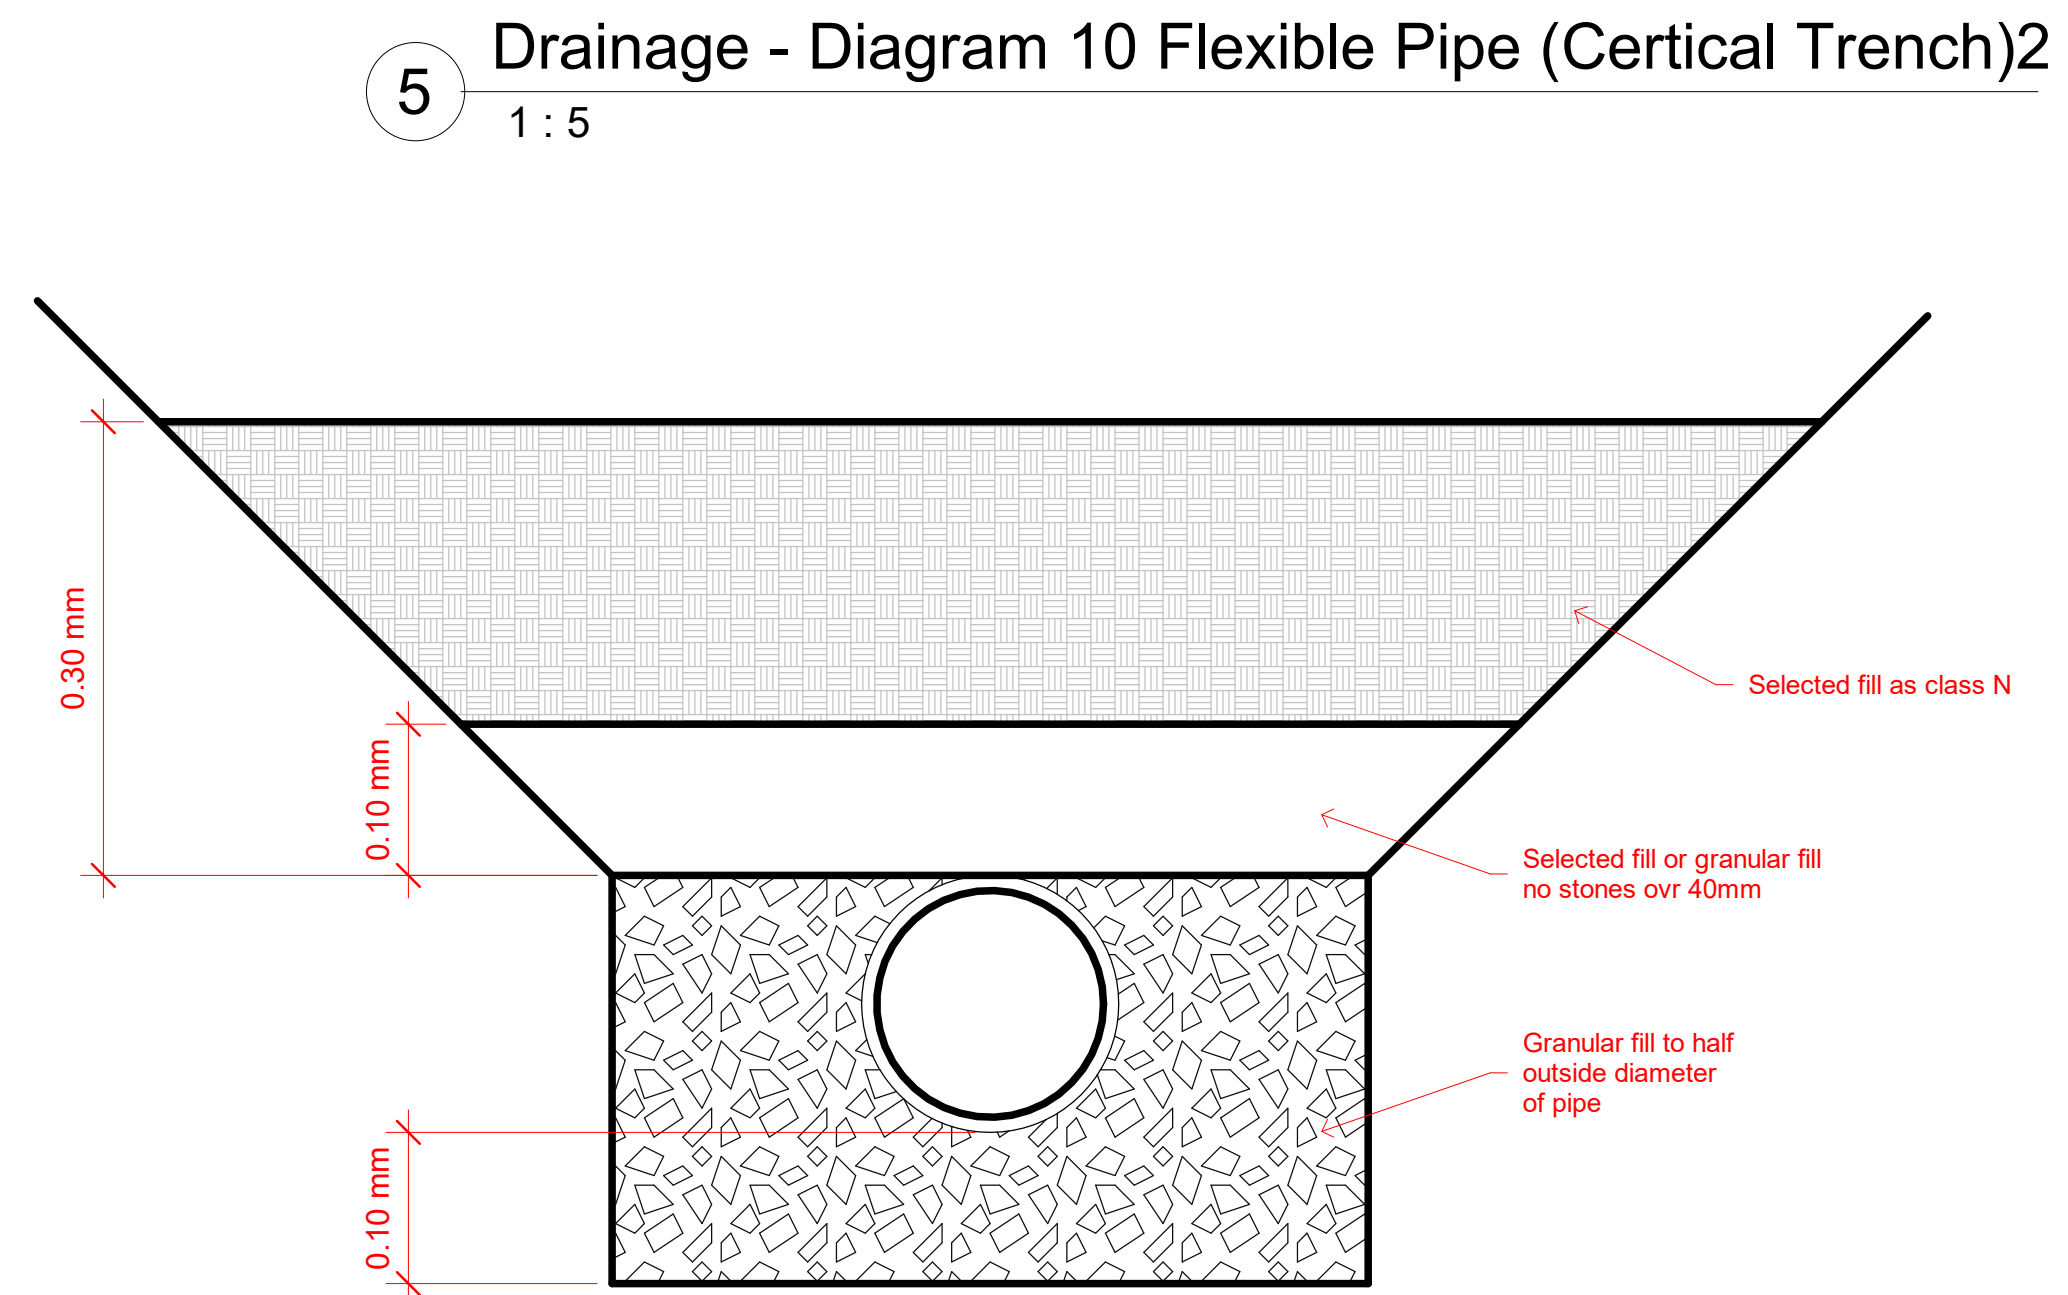


Diagram 10: Bedding for pipes Class B

4 Drainage - Diagram 10 Class B2
1 : 5

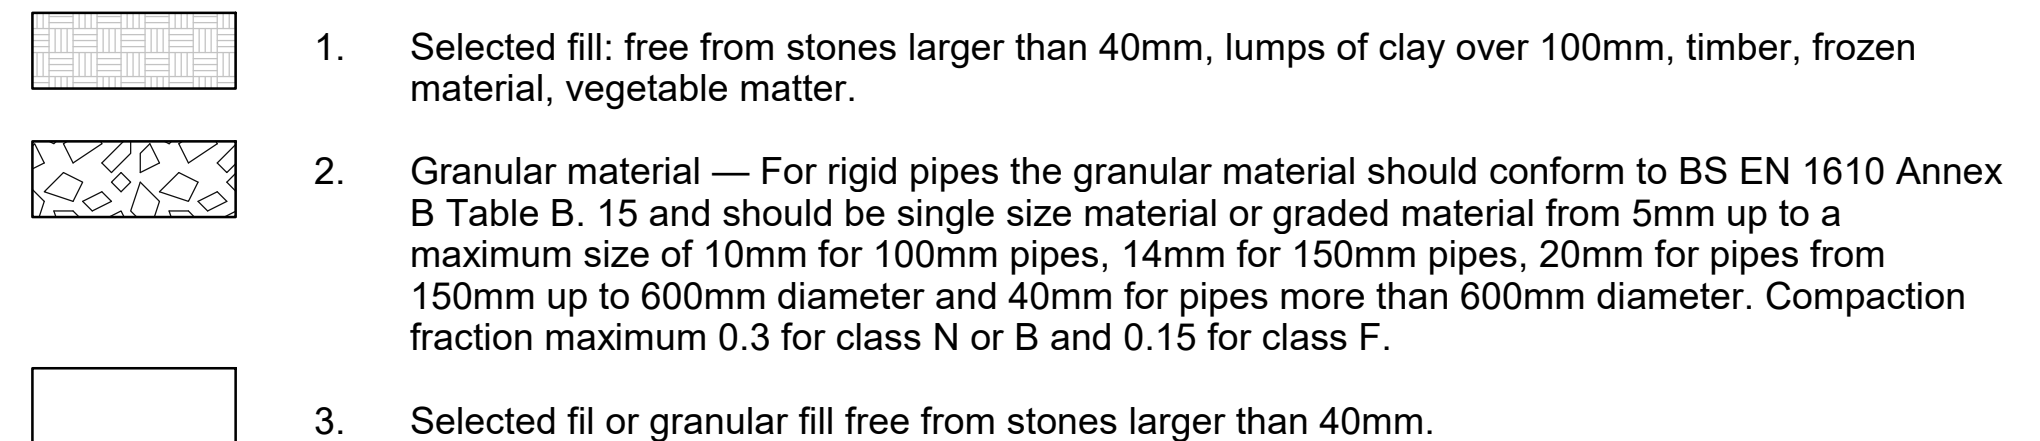

1. I Provision may be required to prevent groundwater flow trenches with class N, F or B type bedding.
2. Where the pipe has sockets and Class D bedding is used, holes which should be as short as is practicable should be prepared in the trench bottom to a given clearance of 50mm beneath the socket.
3. Where the pipe has sockets and Class F or N bedding is used, the sockets should be not be less than 50mm above the floor or the trench.
4. All dimensions are in mm.

8 Key Notes2
1 : 5

Copyright in this drawing remains with AECDesign. Do not scale from this drawing, work to figured dimensions. Check all dimensions on-site. In the event of any discrepancy, please refer query to AECDesign.

Revision



Project No. **AECD_M20 1BU_2022_0001**

Sheet Name **Proposed Drainage Details**

Scale	1 : 5
Client Name	Khaled Muwahed
Project Address	Sheet No.
479 Princess Road Manchester M20 1BU	P109