


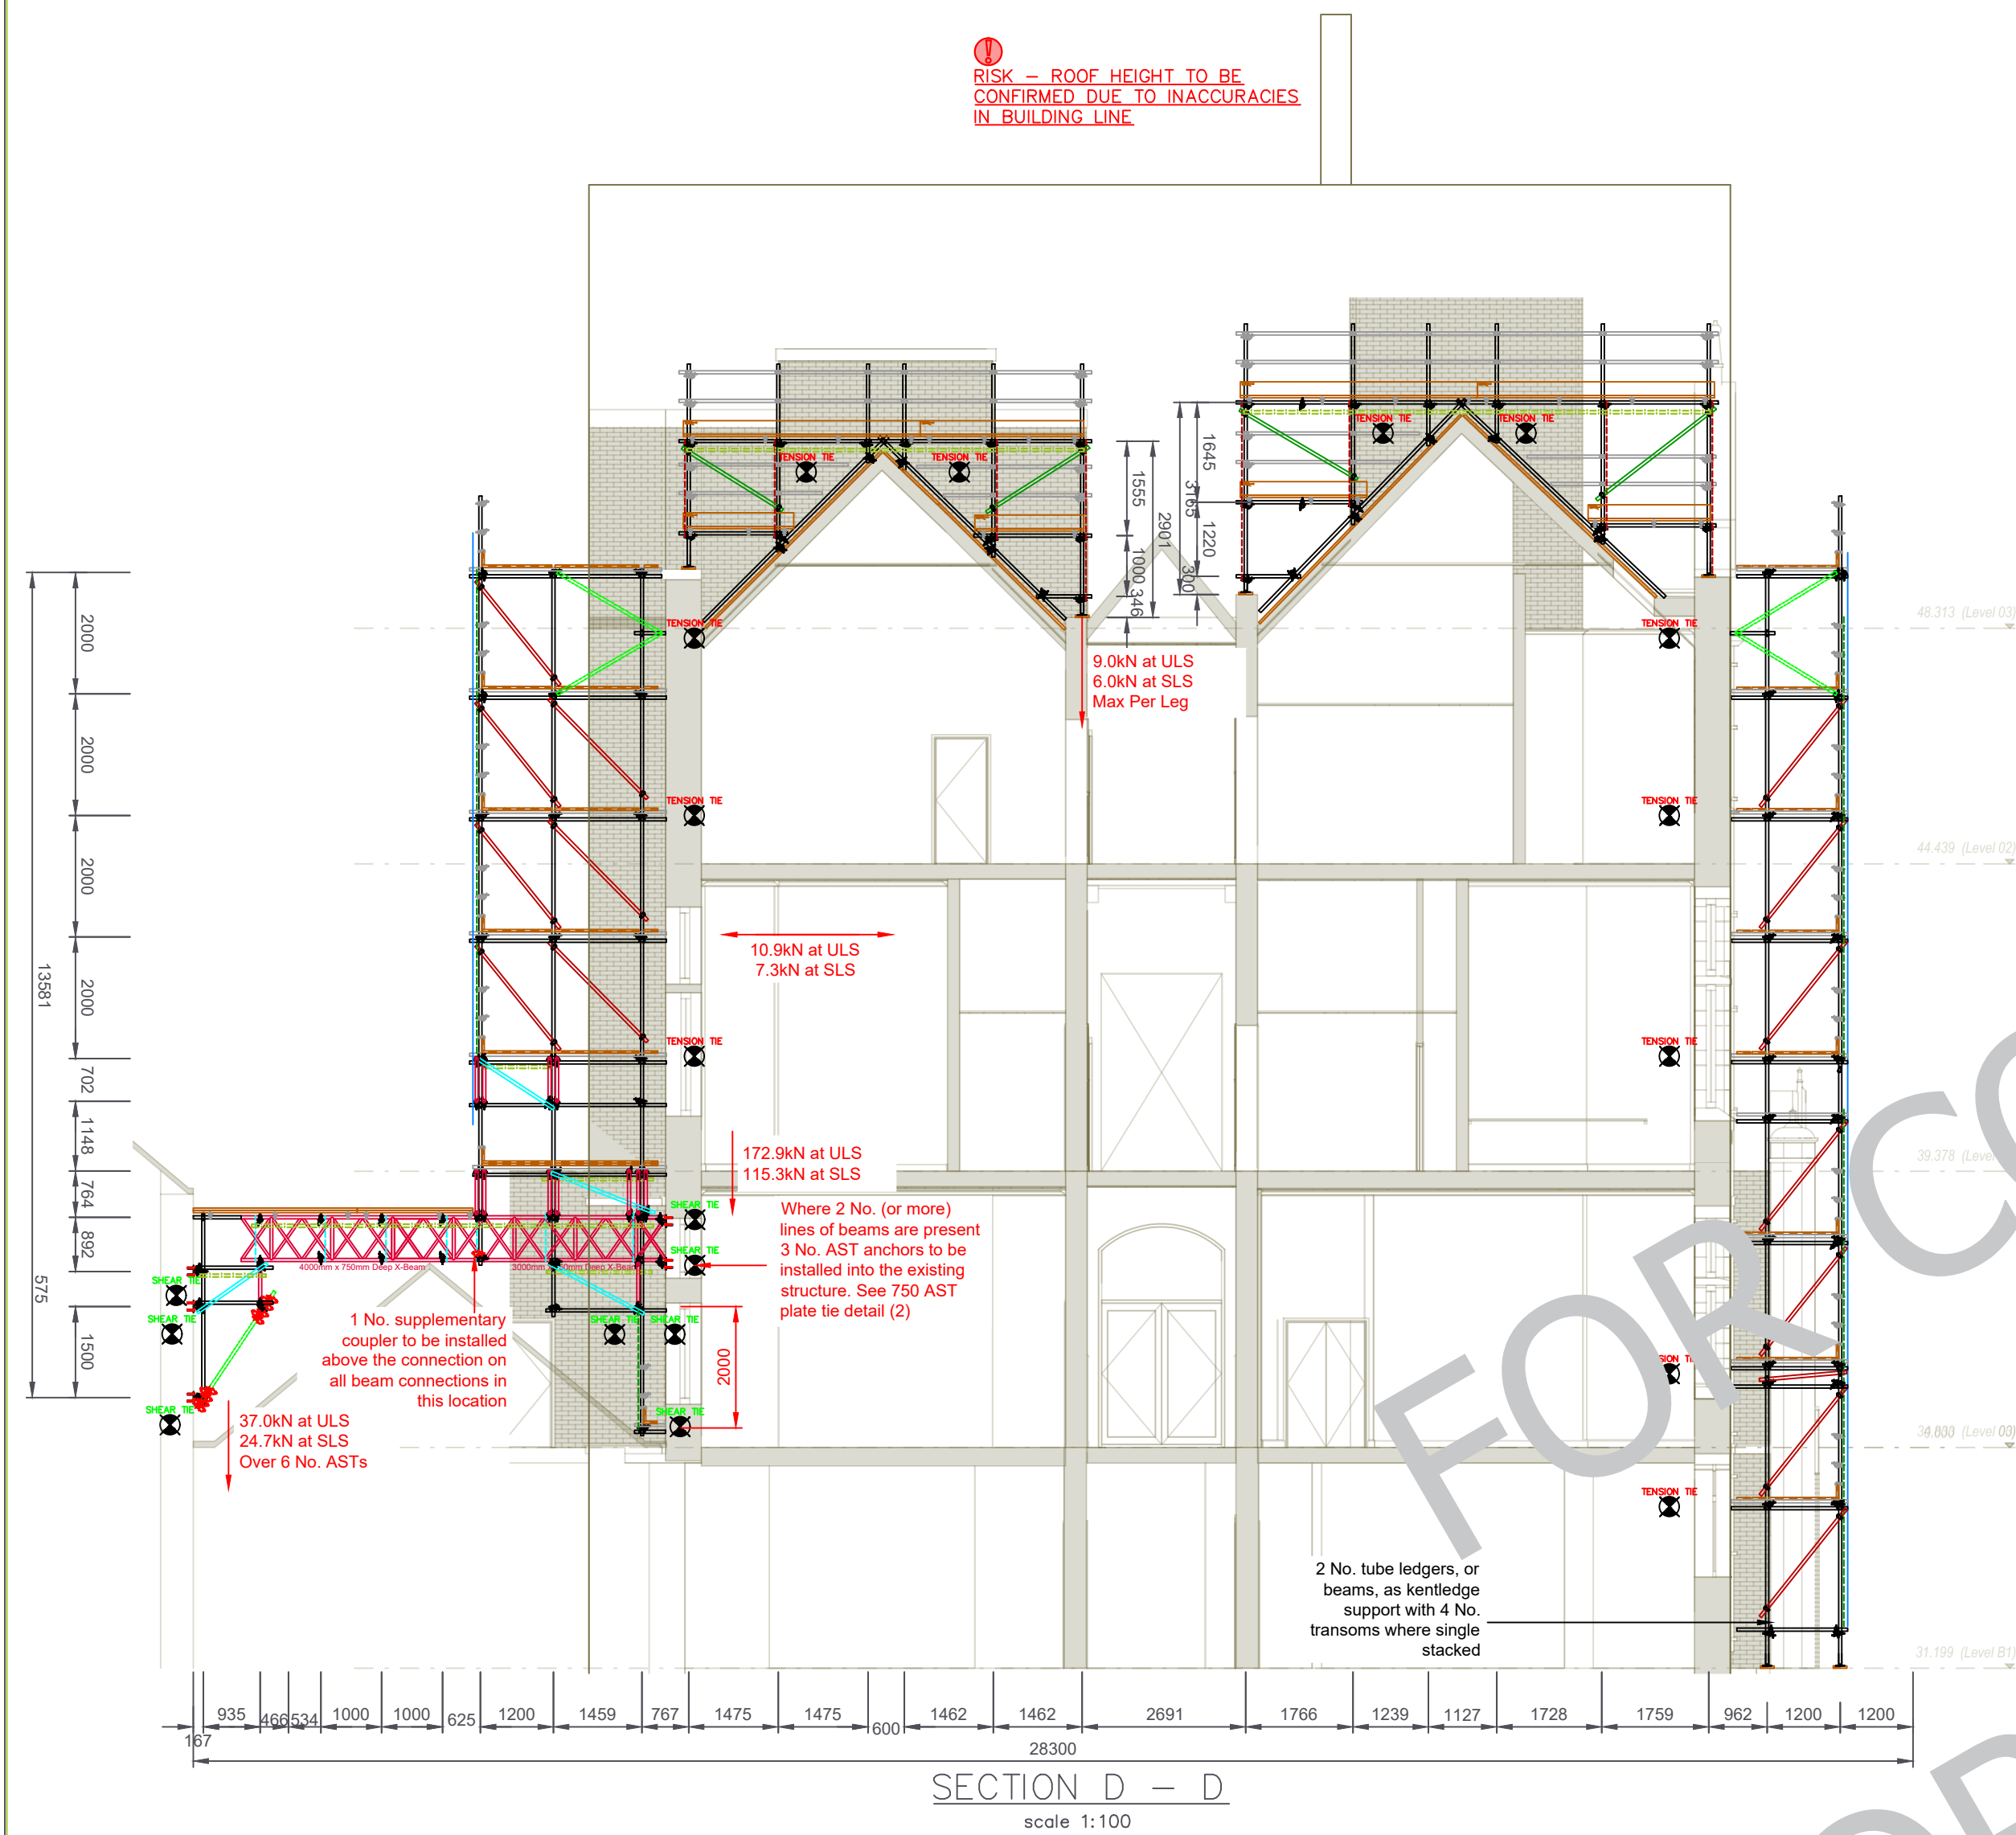
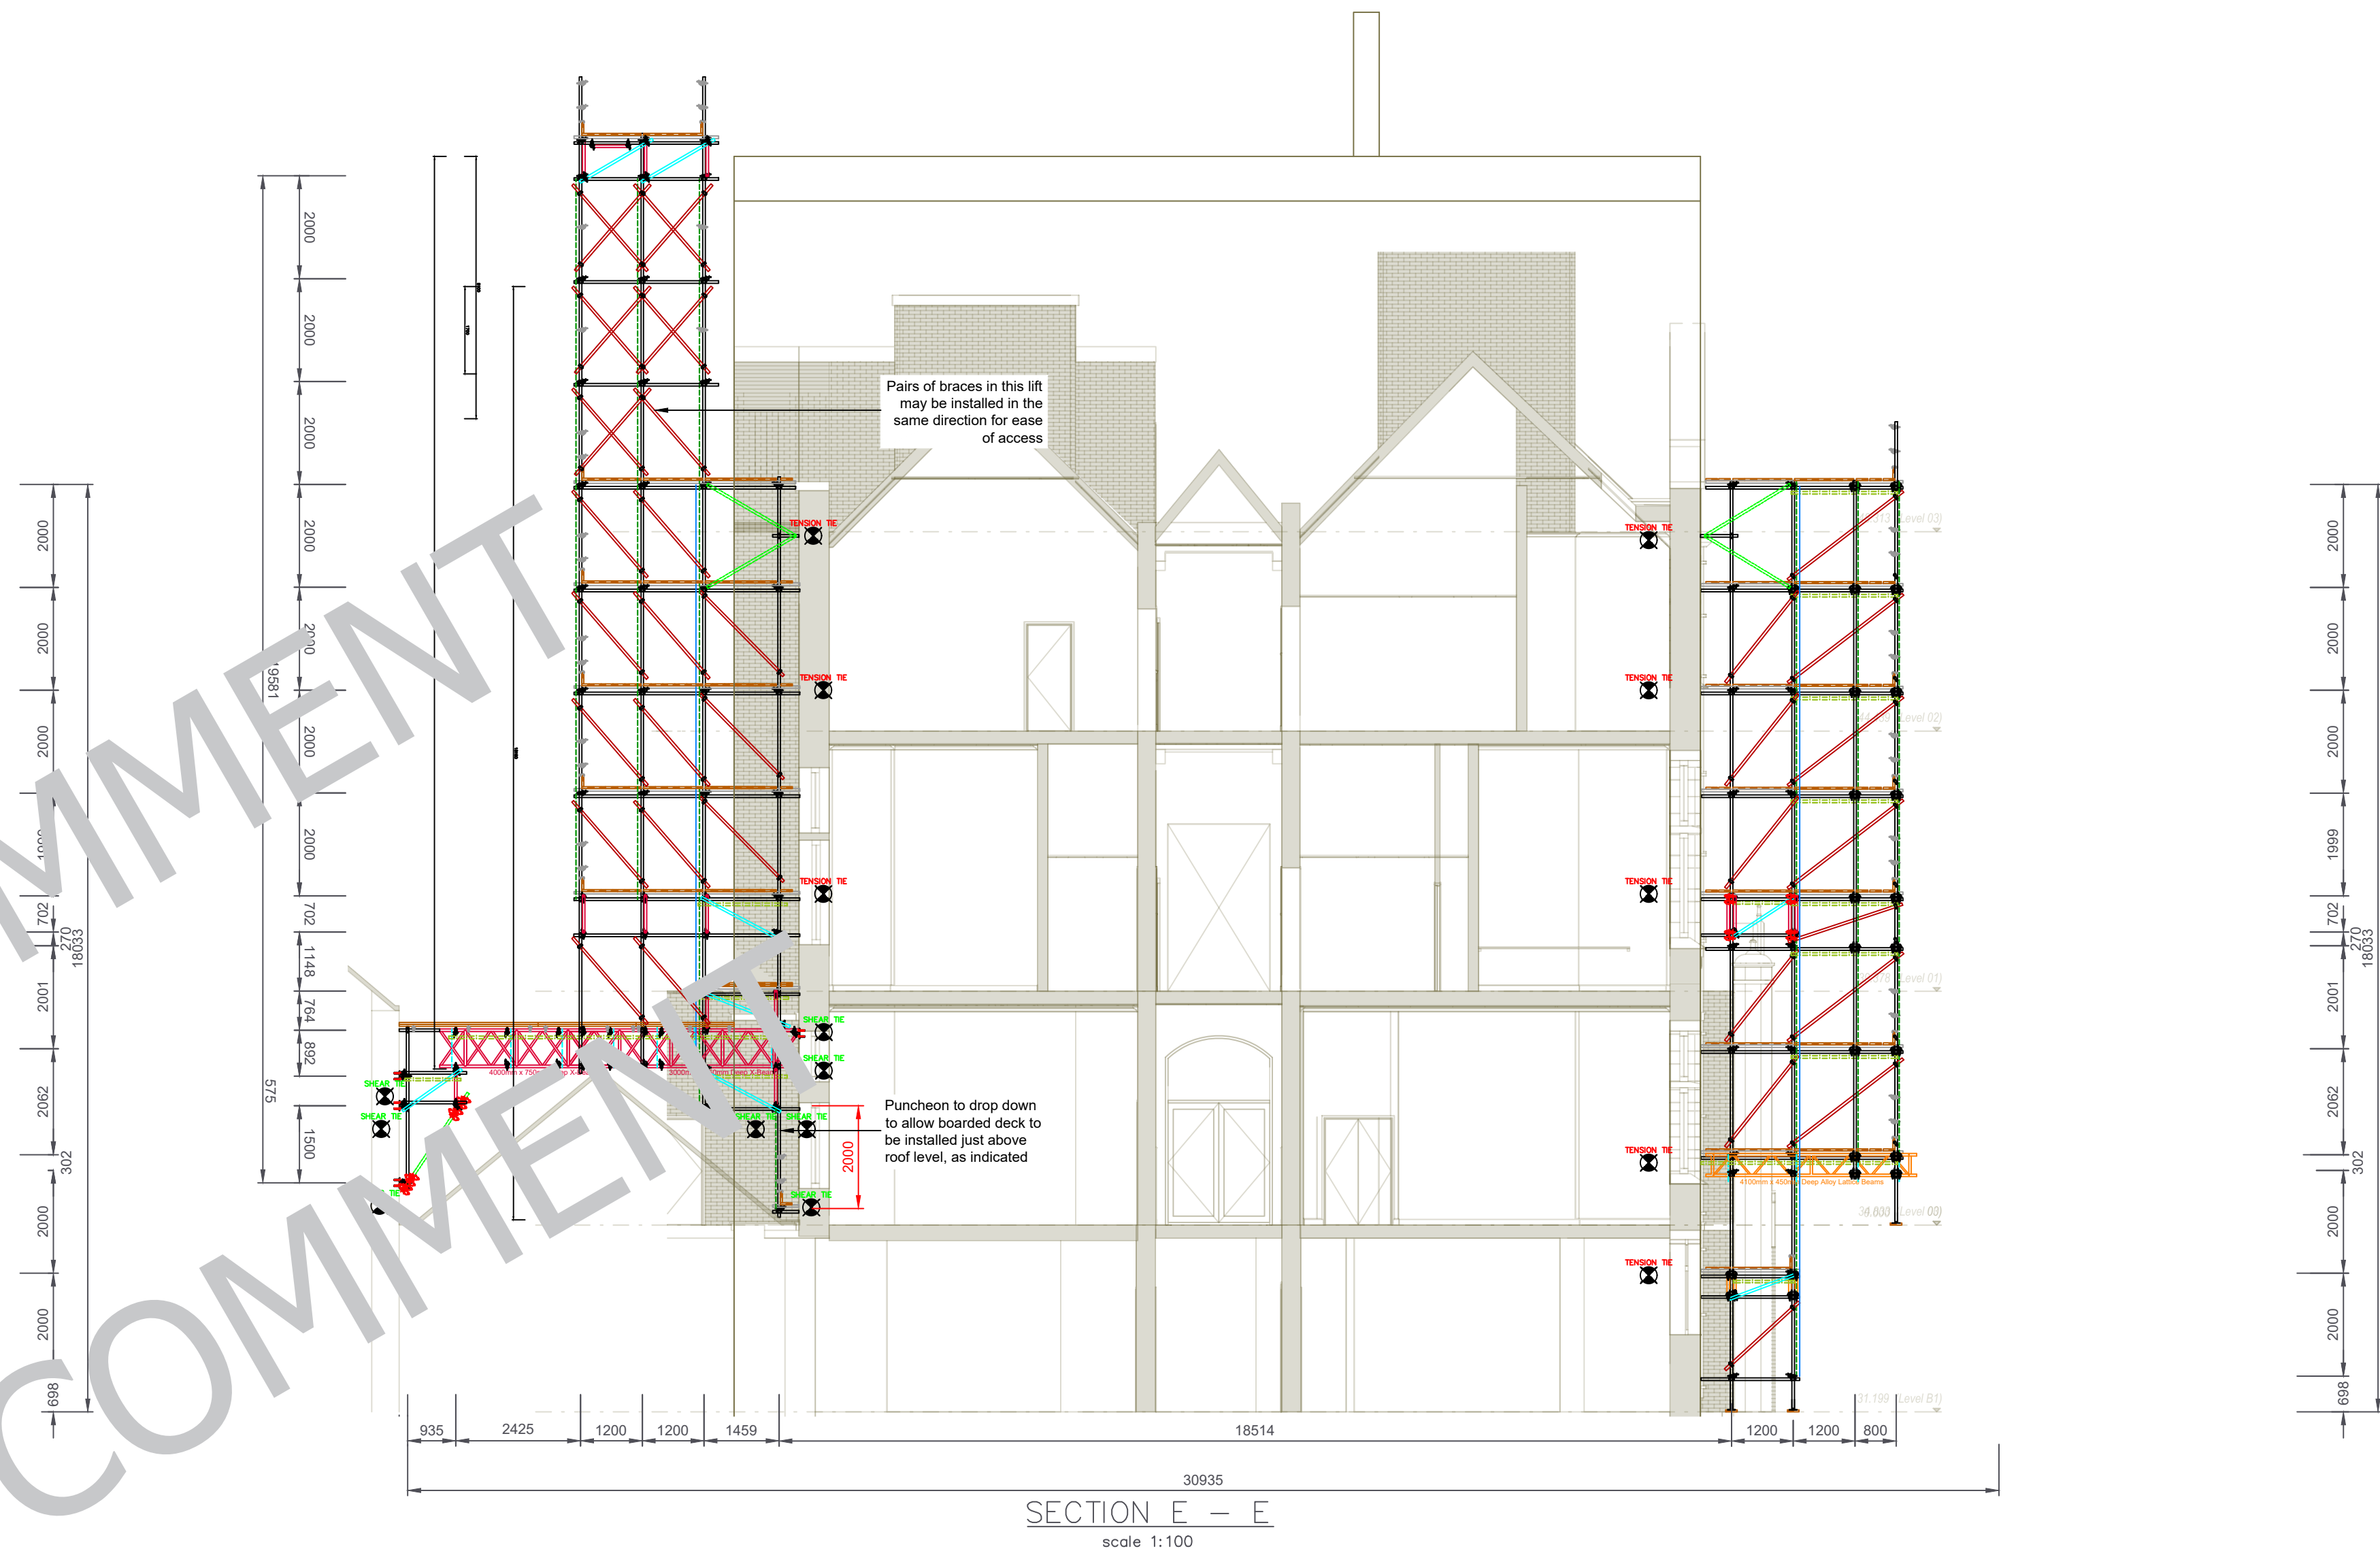


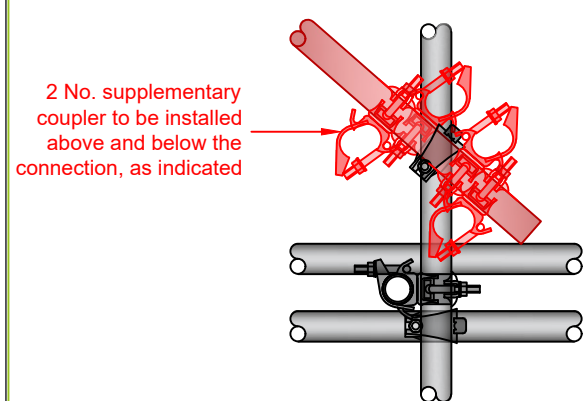

CROSS BRACING SUPPLEMENTARY
COUPLER DETAIL (2)
scale: NTS

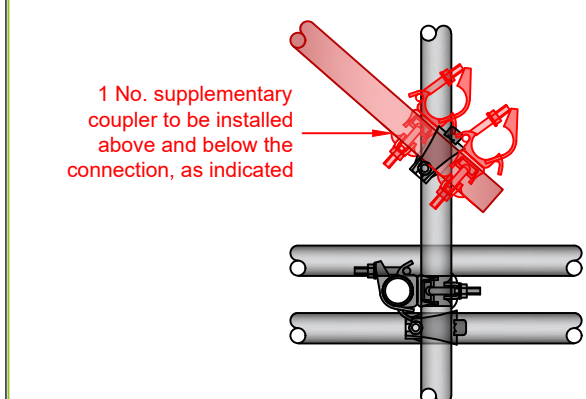

CROSS BRACING SUPPLEMENTARY
COUPLER DETAIL
scale: NTS

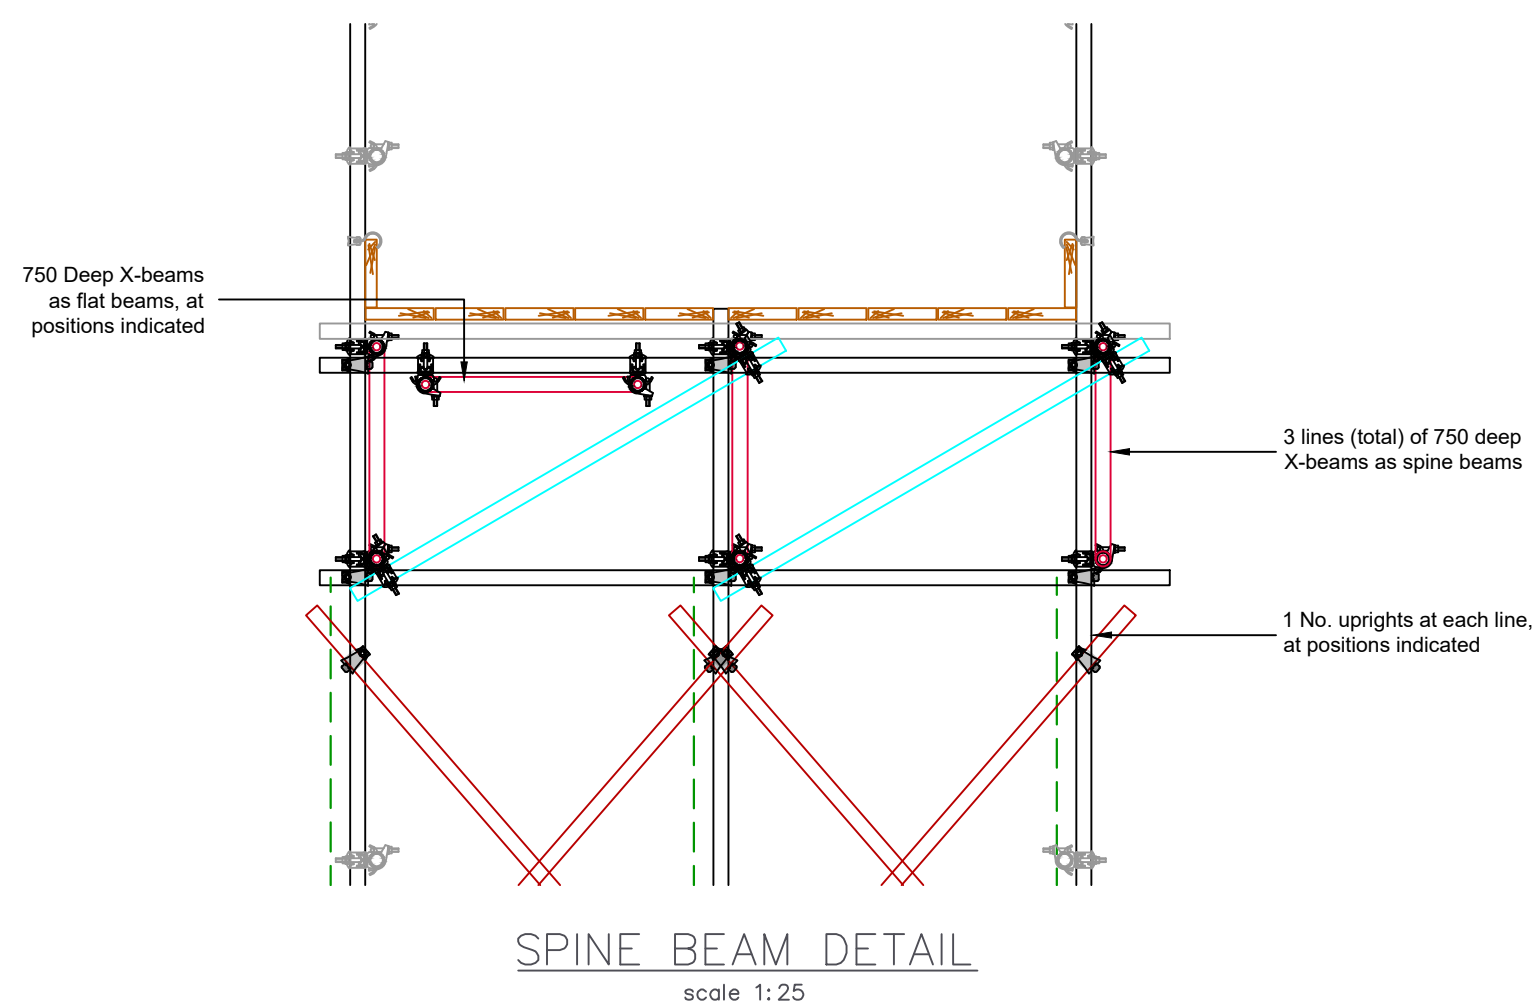

ALL 2M LIFTS MAY BE ERECTED AT
2.1M AS REQUIRED TO ENSURE TOP
WORKING LIFT IS LESS THAN 450MM
DOWN FROM EAVES LEVEL

FOR FULL DETAILS SEE PAGE 11

FOR FULL RISKS SEE PAGE 12

ALL BOARDS TO BE SECURED
DOWN

HAZI STAIRCASE TO BE POSITION
WHERE REQUIRED

HOARDING AT BASE IF REQUIRED

ALL COUPLERS TO BE CLASS B

DOCUMENT REFERENCES					
This design is to be read in conjunction with the following design drawings and/or documents:					
CRE-SEDD001-012-005B_REPORT					
APPENDIX A -					
CRE-SEDD001-012-005B_1,2,3,4,5,6,7,8,9,10,11.dwg					
AMENDMENTS / REVISIONS					
REV	BY	DATE	CHECK	DATE	APPD
B	AJB	15.03.24			
A	AJB	11.03.24			
-	AJB	28.02.24			
FOR COMMENT					
ACCESS SCAFFOLD					
RUTHERFORD BUILDING					
MANCHESTER					
M13					
SEE QUOTE					
CREATOR SCAFFOLD DESIGNS & TEMPORARY WORKS CONSULTANTS LTD					