




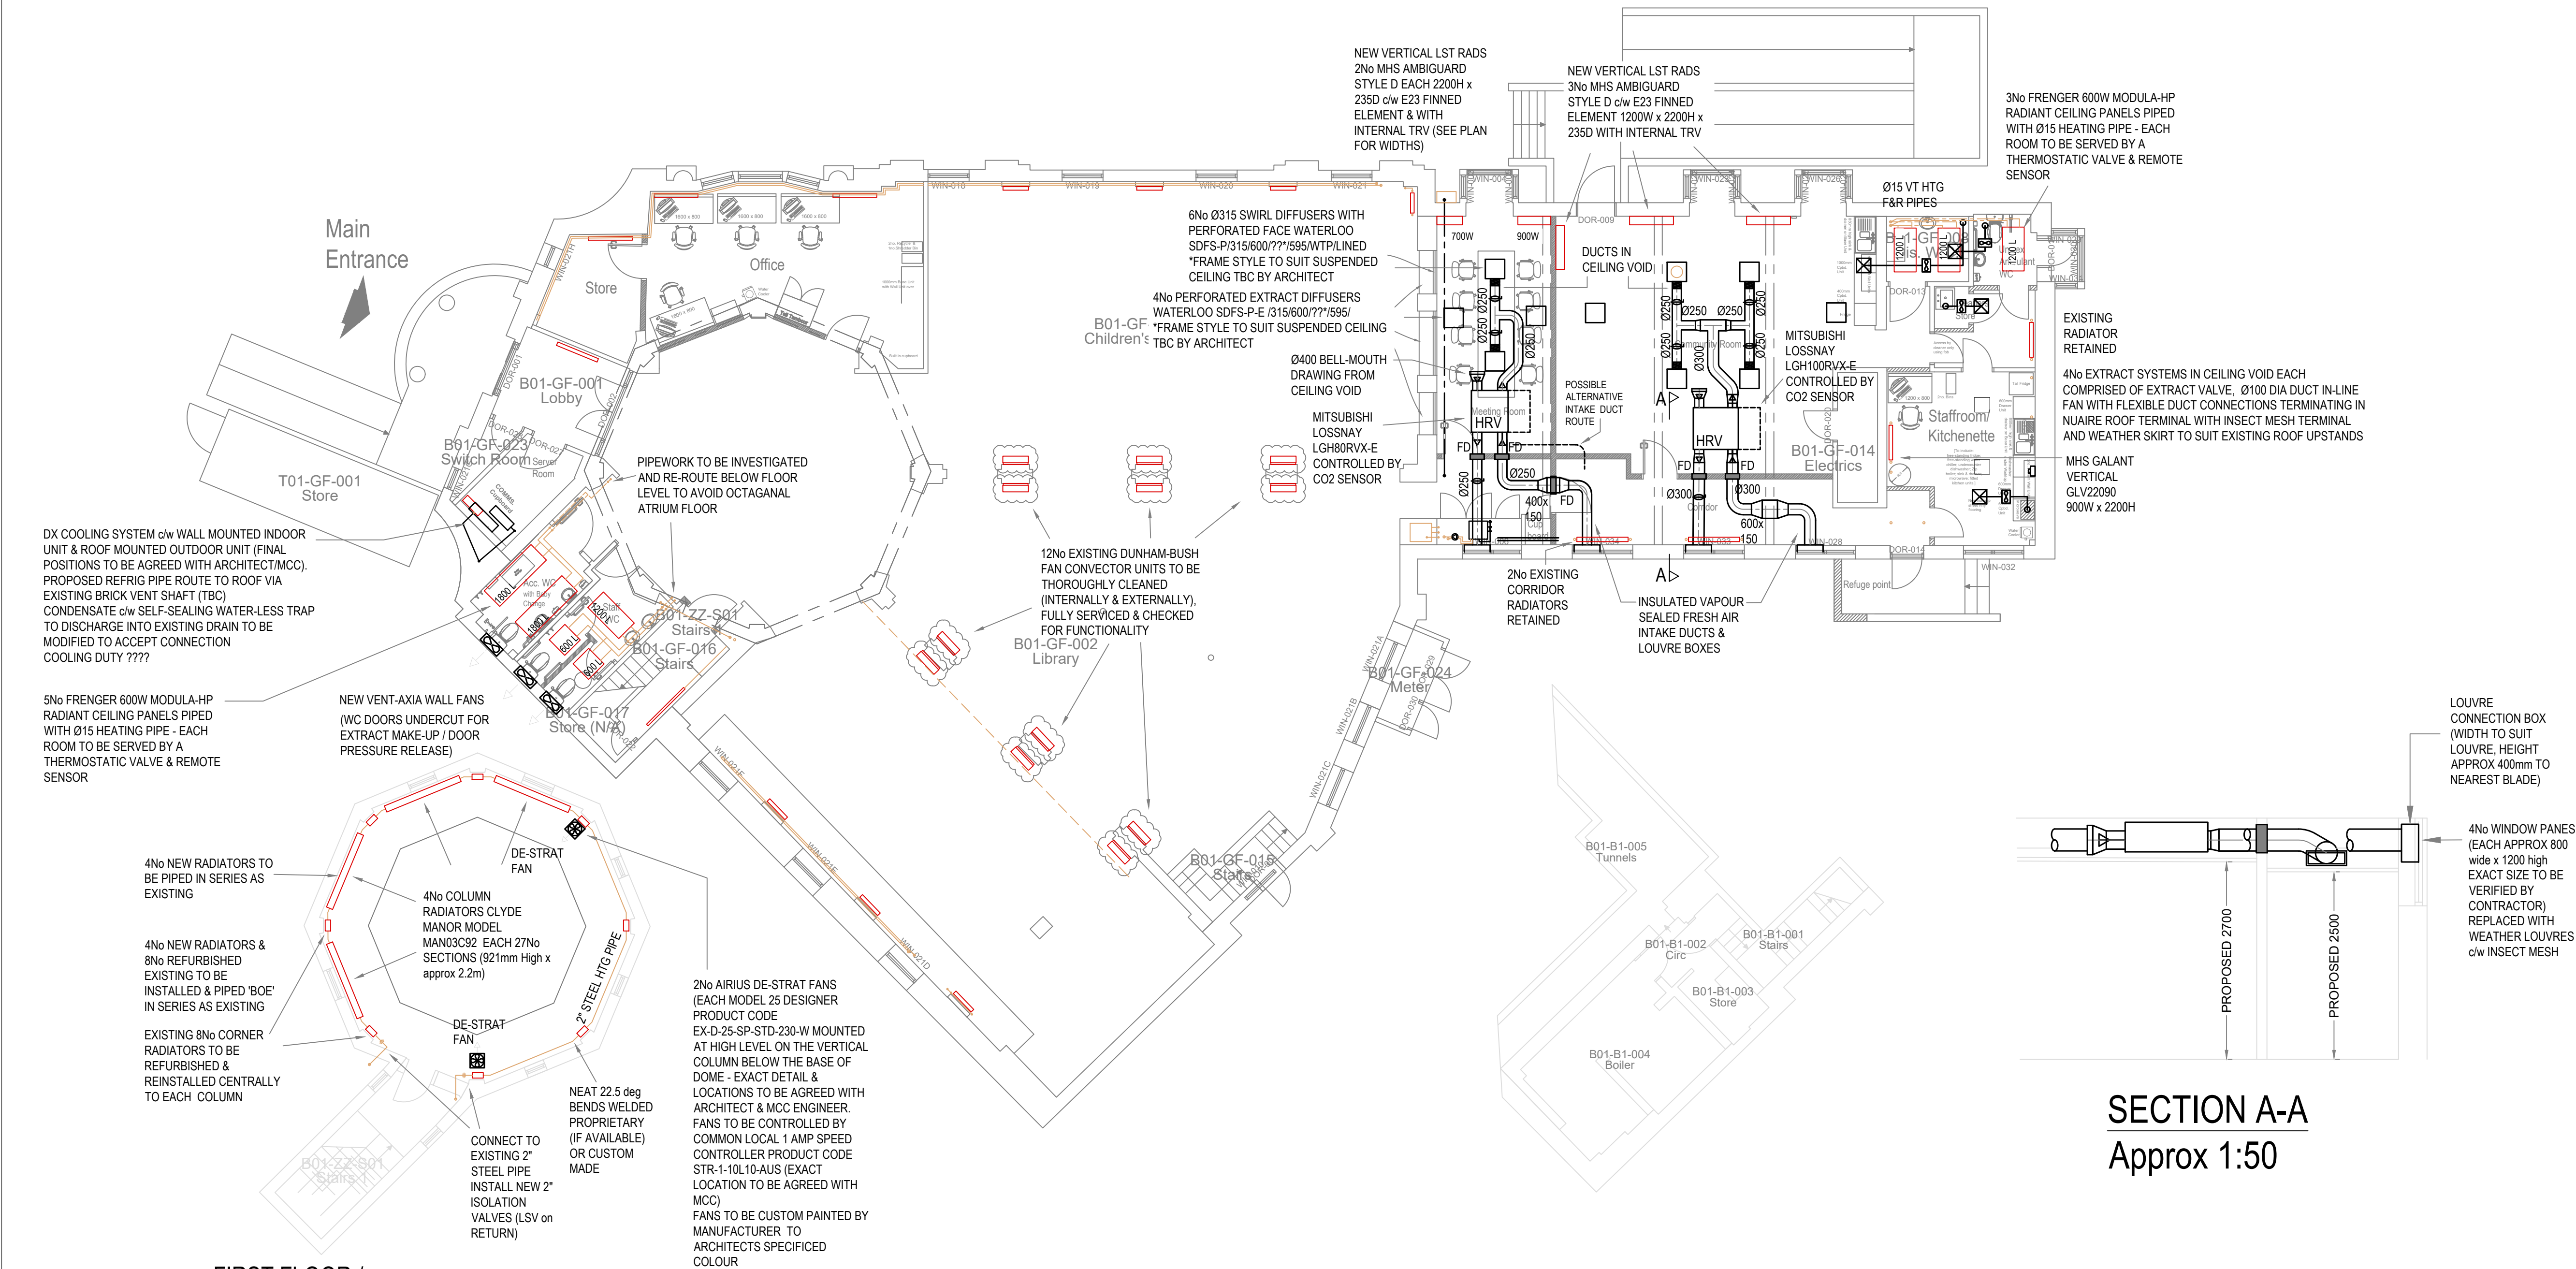


FIRST FLOOR /
BALCONY LEVEL

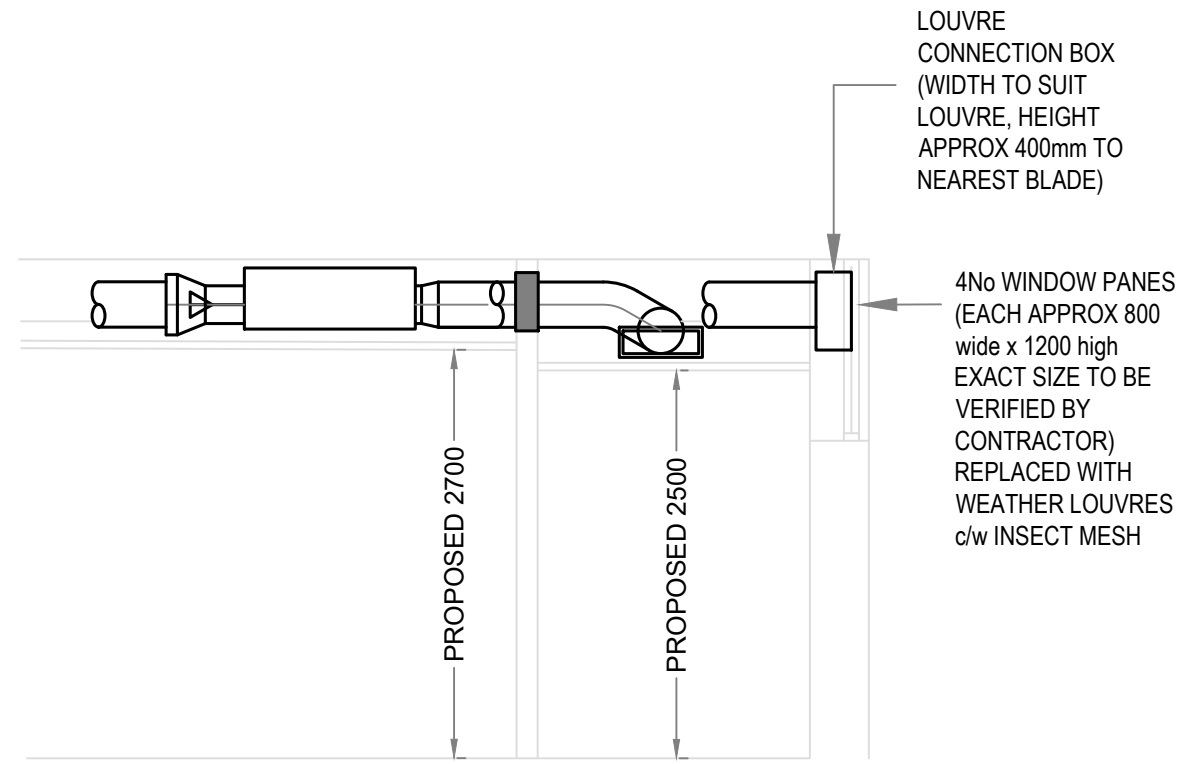

SECTION A-A
Approx 1:50

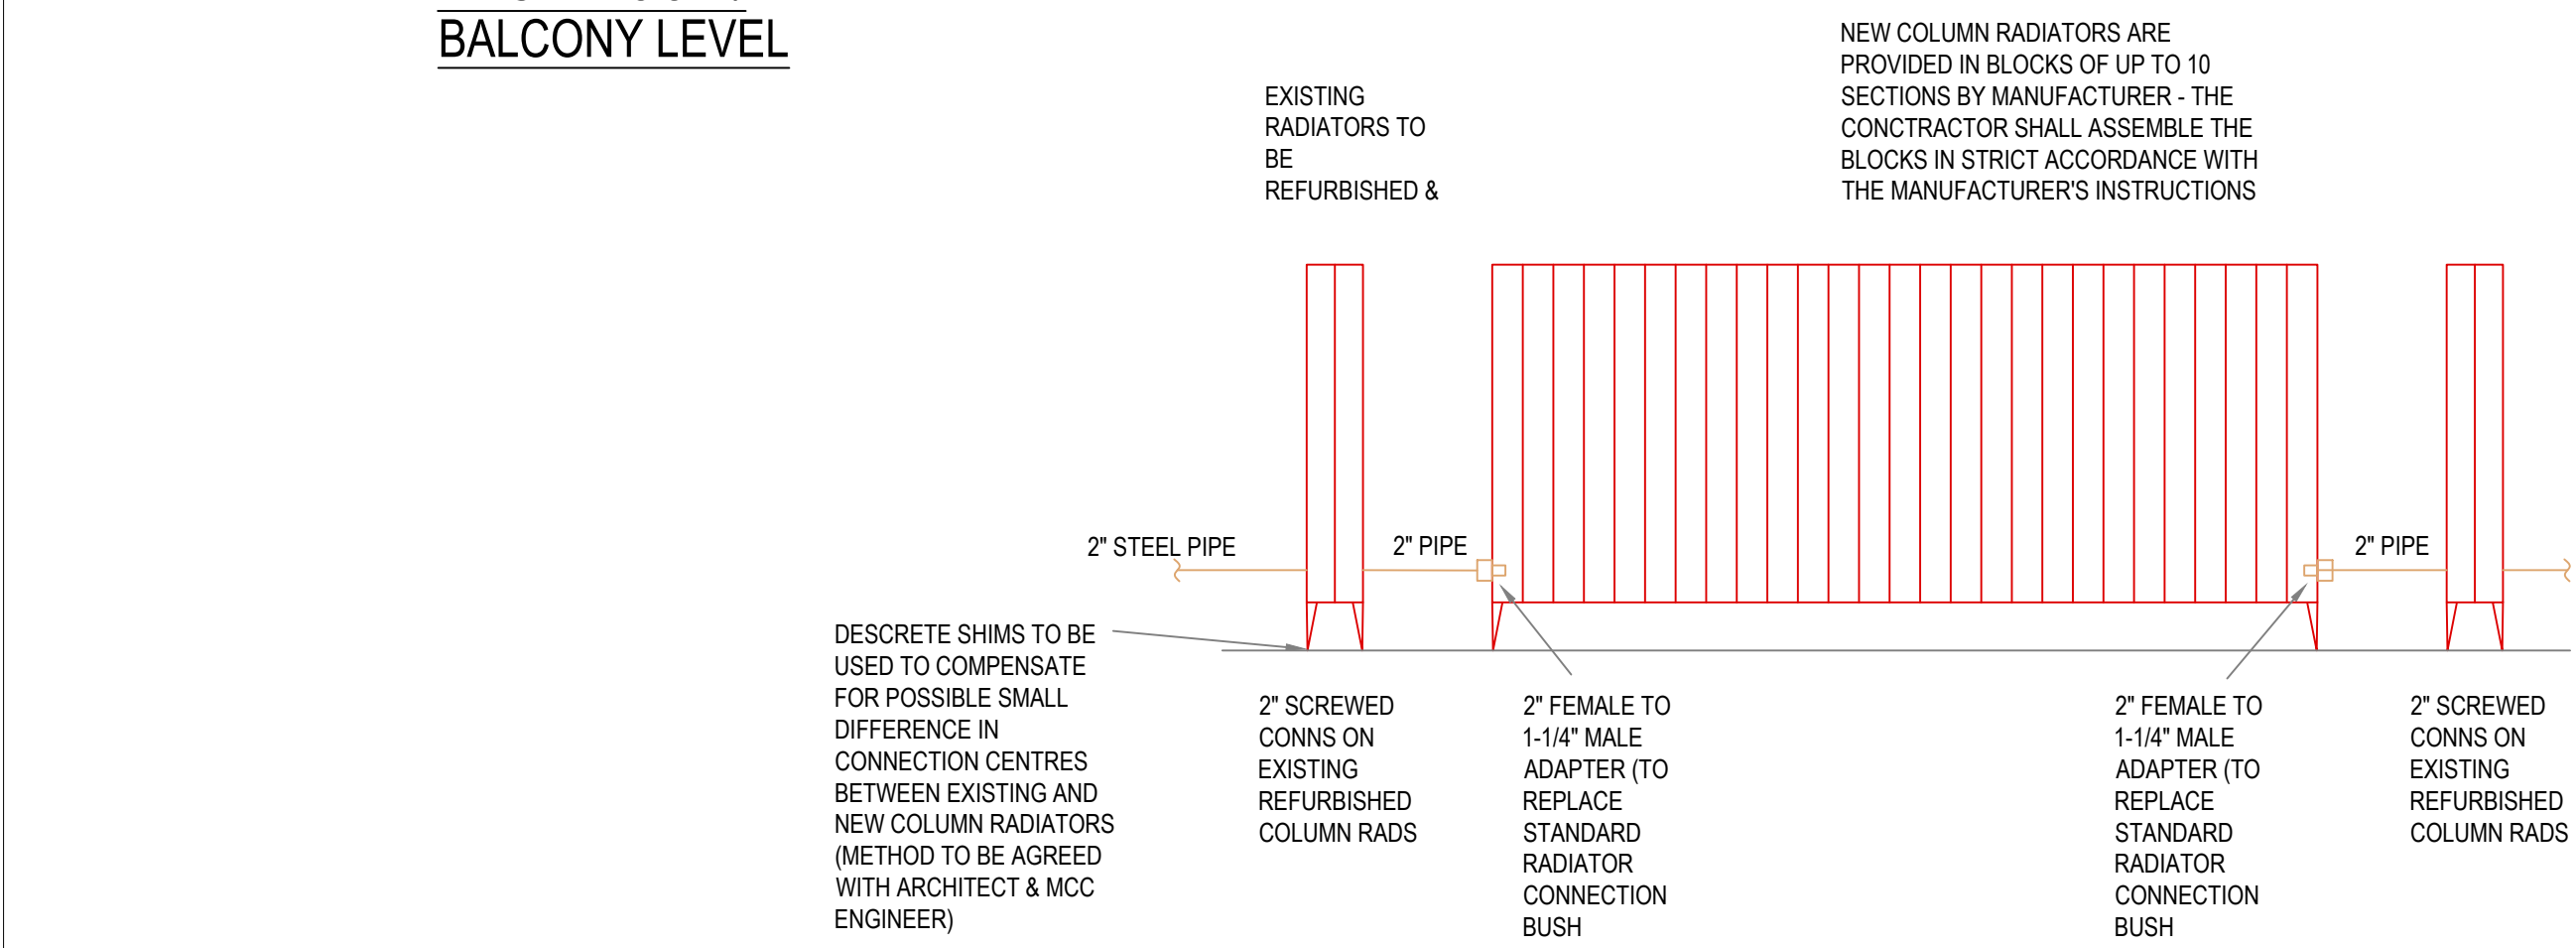

BALCONY RADIATOR PIPING
(NTS)



No part of this drawing or data file may be reproduced without prior written permission of the Manchester City Council or approved representative.

1:100

0 2m 4m 6m 8m 10m

ABBREVIATIONS	
LTHW	LOW TEMPERATURE HOT WATER
NG	NATURAL GAS
MCWS	MAINS COLD WATER SERVICE
HWS	HOT WATER SERVICE
CV	CEILING VOID
FV	FLOOR VOID
FA	FROM ABOVE
FB	FROM BELOW
TA	TO ABOVE
TB	TO BELOW
LL	LOW LEVEL
HL	HIGH LEVEL
c/w	COMPLETE WITH
MC	MAIN CONTRACTOR
H&CWS	HOT & COLD WATER SERVICES
SVs	SERVICE VALVES
HRV	HEAT RECOVERY VENTILATION

- NOTES
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER CONTRACT DOCUMENTATION.
 - DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS TO BE CONFIRMED ON SITE.
 - ALL FINAL POSITIONS AND DETAILS TO BE COORDINATED WITH OTHER SERVICES & BUILDING FEATURES AND AGREED WITH MCC.
 - FIRE STRATEGY TO BE CONFIRMED - THIS MAY AFFECT THE FINAL NUMBER AND TYPE OF FIRE DAMPERS.
 - ALL EQUIPMENT SIZES AND PROPOSED LOCATIONS TO BE CHECKED FOR COMPATIBILITY PRIOR TO ORDERING OF EQUIPMENT.
 - ALL NEW & EXISTING SERVICES & BUILDING DETAILS TO BE VERIFIED BY THE CONTRACTOR.
 - THE CONTRACTOR SHALL PROVIDE ALL PRIMARY AND SECONDARY SUPPORTS. ALL CEILING VOID LEVEL MECHANICAL SERVICES SHALL BE SUPPORTED FROM THE BUILDING STRUCTURE (NOT FROM SUSPENDED CEILINGS).
 - THE CONTRACTOR SHALL PROVIDE WORKING DRAWINGS AND COORDINATED BUILDERSWORK DETAILS.
 - ALL FRESH AIR INTAKE DUCTS SHALL BE INSULATED AND VAPOUR SEALED TO PREVENT CONDENSATION.
 - FLEXIBLE DUCT SHALL ONLY BE USED FOR FINAL CONNECTIONS TO DIFFUSER GRILLE & LOUVRE BOXES (MAX 300mm LONG) AND NOT USED FOR CHANGES IN DUCT DIRECTION.



**MANCHESTER
CITY COUNCIL**

**Capital Programmes
Division**

Manchester City Council
PO Box 532, Town Hall
Manchester
M60 2LA

DRAWING STATUS		Information	
PROPERTY TITLE		Chorlton District Library Manchester Road, Chorlton M21 9PN	
UPRN		DfE NO.	
010023047970		-	
PROJECT TITLE		Open Libraries	
DRAWING TITLE		Proposed Heating & Ventilation	
JOB NO.		DATE	
LG44705.1		July 22	
SCALE		AUTHOR	
1:100@A1 & as shown		SF	
CHECKED BY		APPROVED BY	
TJ		TJ	
DRAWING NO.		MCC B01 01 DR M 0012	