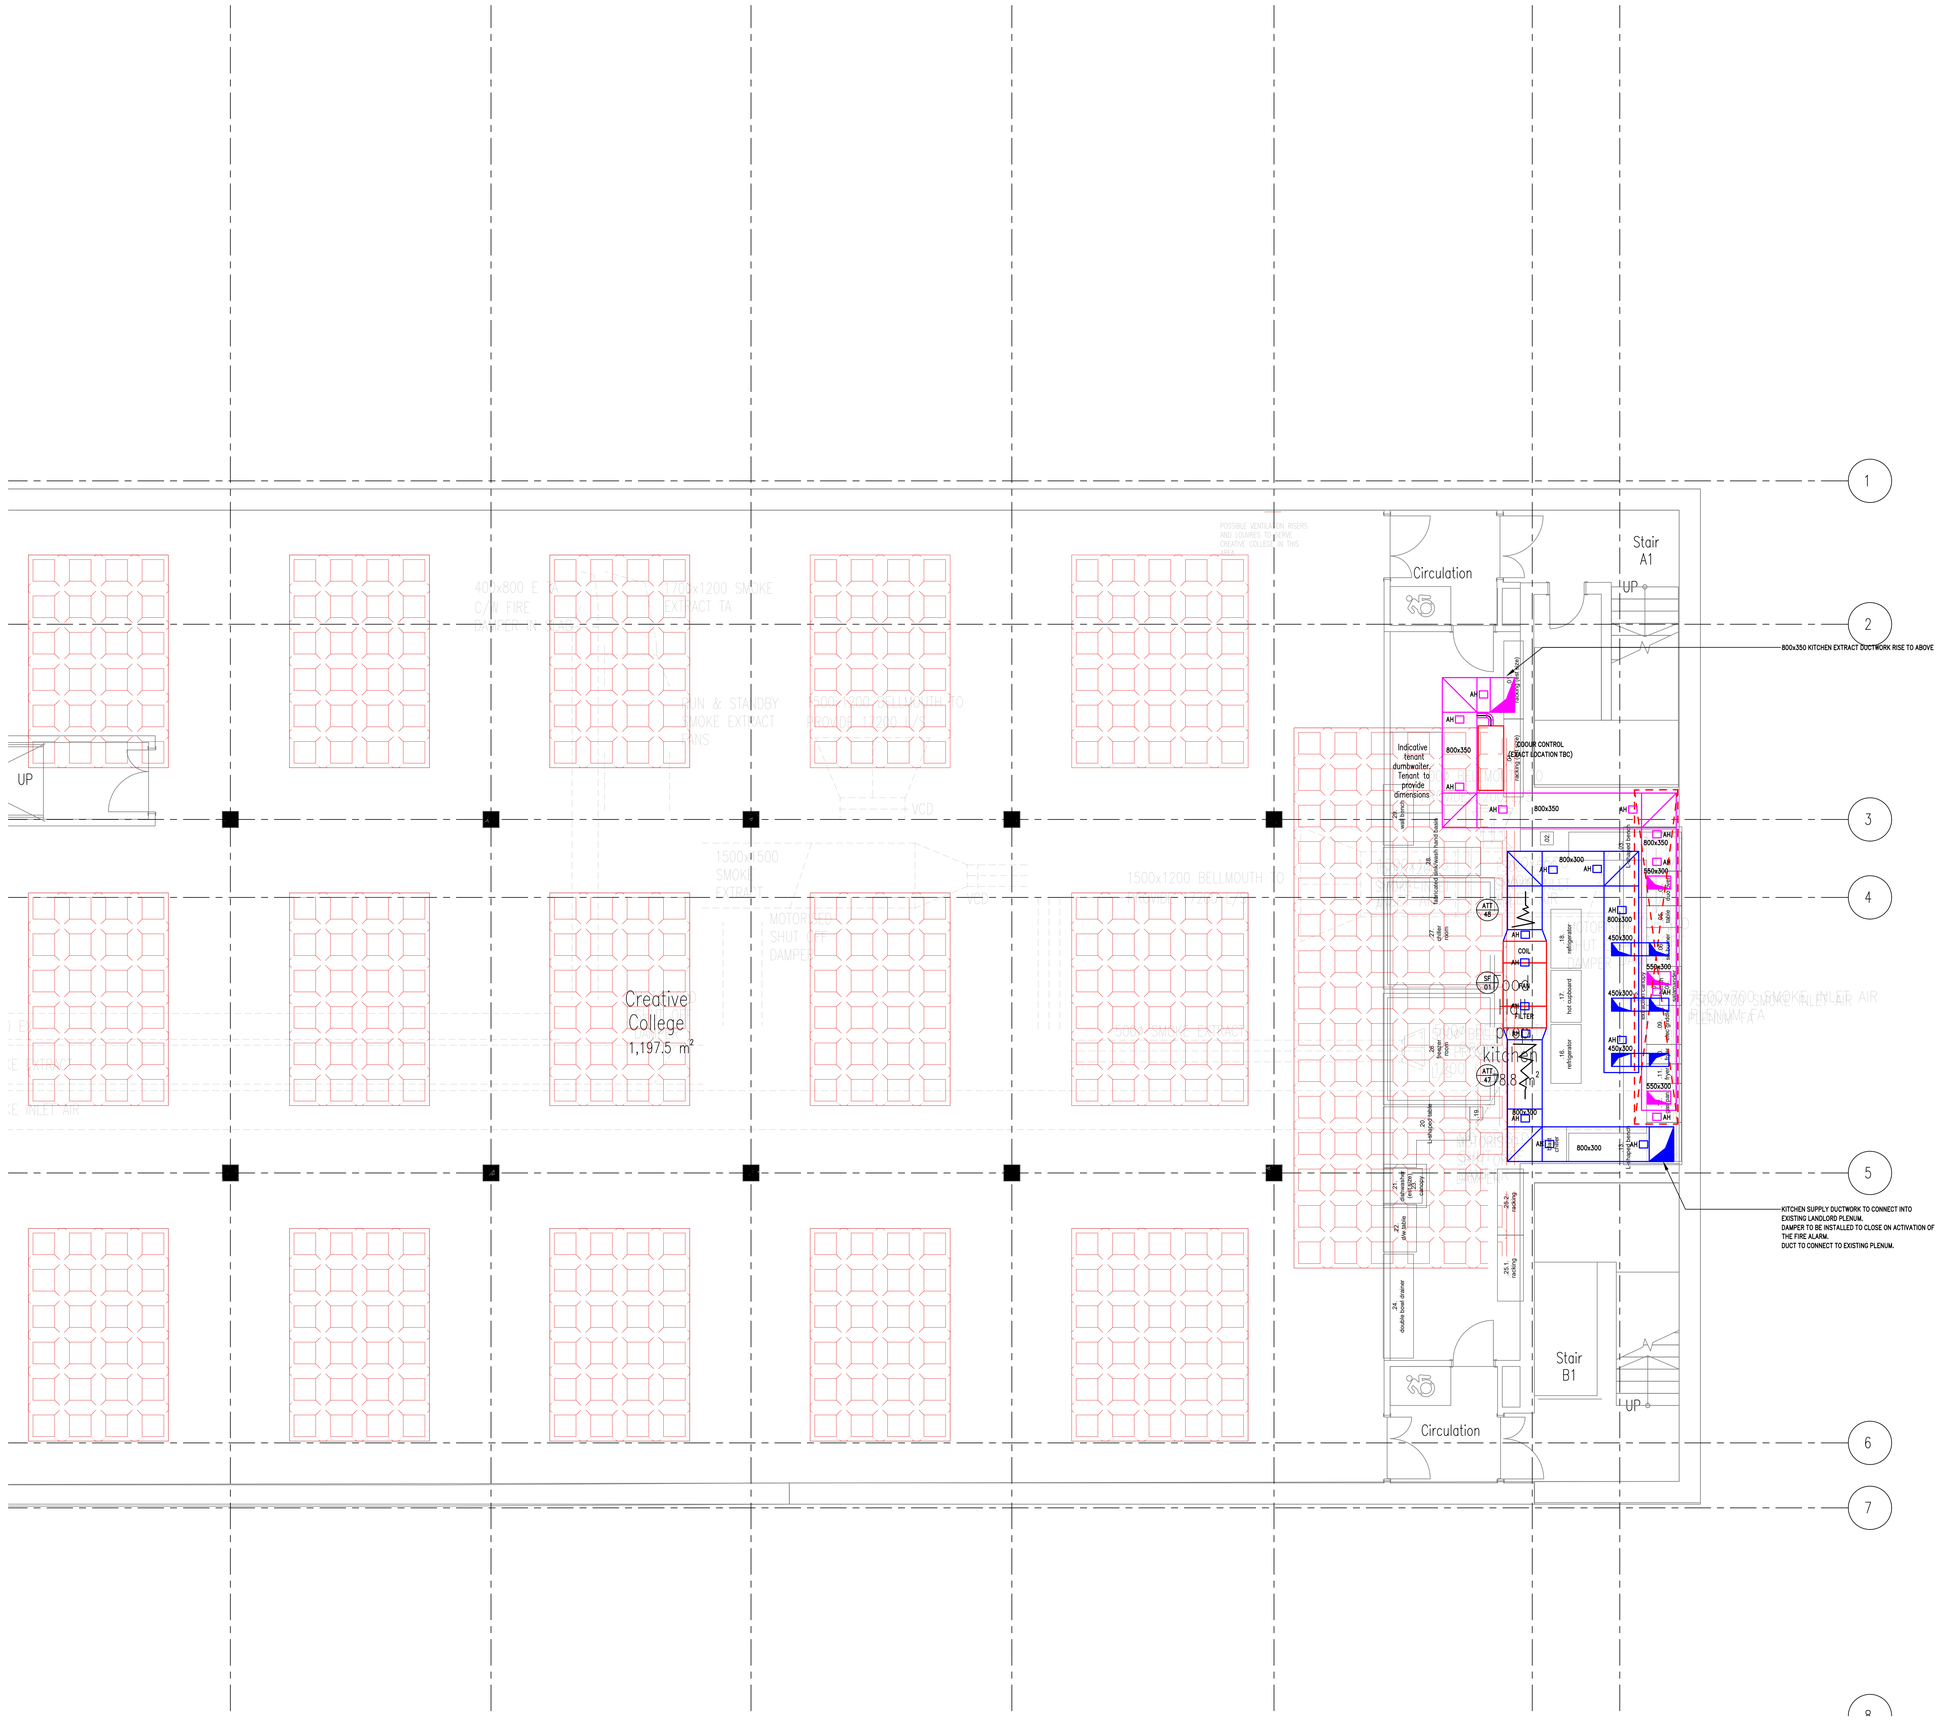


MECHANICAL VENTILATION LAYOUT LEGEND

- EXISTING SERVICES
- SA — SUPPLY DUCTWORK
- EA — EXTRACT DUCTWORK
- DE — DIRTY EXTRACT DUCTWORK
- SUPPLY GRILLE
- EXTRACT GRILLE
- DIRTY EXTRACT GRILLE
- AIR VALVE
- ATTENUATOR/CROSS-TALK ATTENUATOR
- VCD — VOLUME CONTROL DAMPER
- MD — MOTORISED DAMPER
- LOUVRE
- FD — FIRE DAMPER
- AH — ACCESS HATCH
- FLEXIBLE DUCT CONNECTION
- PIR — PASSIVE INFRARED SENSOR
- HEAT RECOVERY UNIT
- DUCTED FAN COIL UNIT
- SUPPLY/EXTRACT FAN
- PLANT REFERENCE
- PLANT ACCESS

FIRE RATED DUCT NOTES

FIRE RATED DUCT TO BE AS LINDAB THOR DUCT AND SHALL BE TEST IN ACCORDANCE WITH BS476 PART 24.

DUCTWORK MEETS THE REQUIREMENTS OF BS9999 METHOD 3 – FIRE RESISTING DUCTWORK.

PROPRIETARY BRACKETS/INSULATION/HANGERS/ACCESS DOORS SHALL ALSO BE PROVIDED.

PRELIMINARY

UPDATED INLINE WITH COMMENTS RECEIVED — 23.2.22 — AP
PRELIMINARY — 08.02.22 — AP

Revision description — No. — Date — Drawn by

Client: Workspace Design & Build Ltd

Project: New Century Hall

Title: AC & Ventilation Basement

Solution environmental services
Pure Office, Brooks Drive
Cheadle Royal Business Park, Cheadle, SK8 7TD
Tel: 0161 532 9460
www.solution-es.co.uk

Drawn by	Checked by	Scale	Sheet Size	Date
K.H	J.H	1:50	A0	08.02.22

Drawing No. QS4669/JH/M10 — Revision P2