



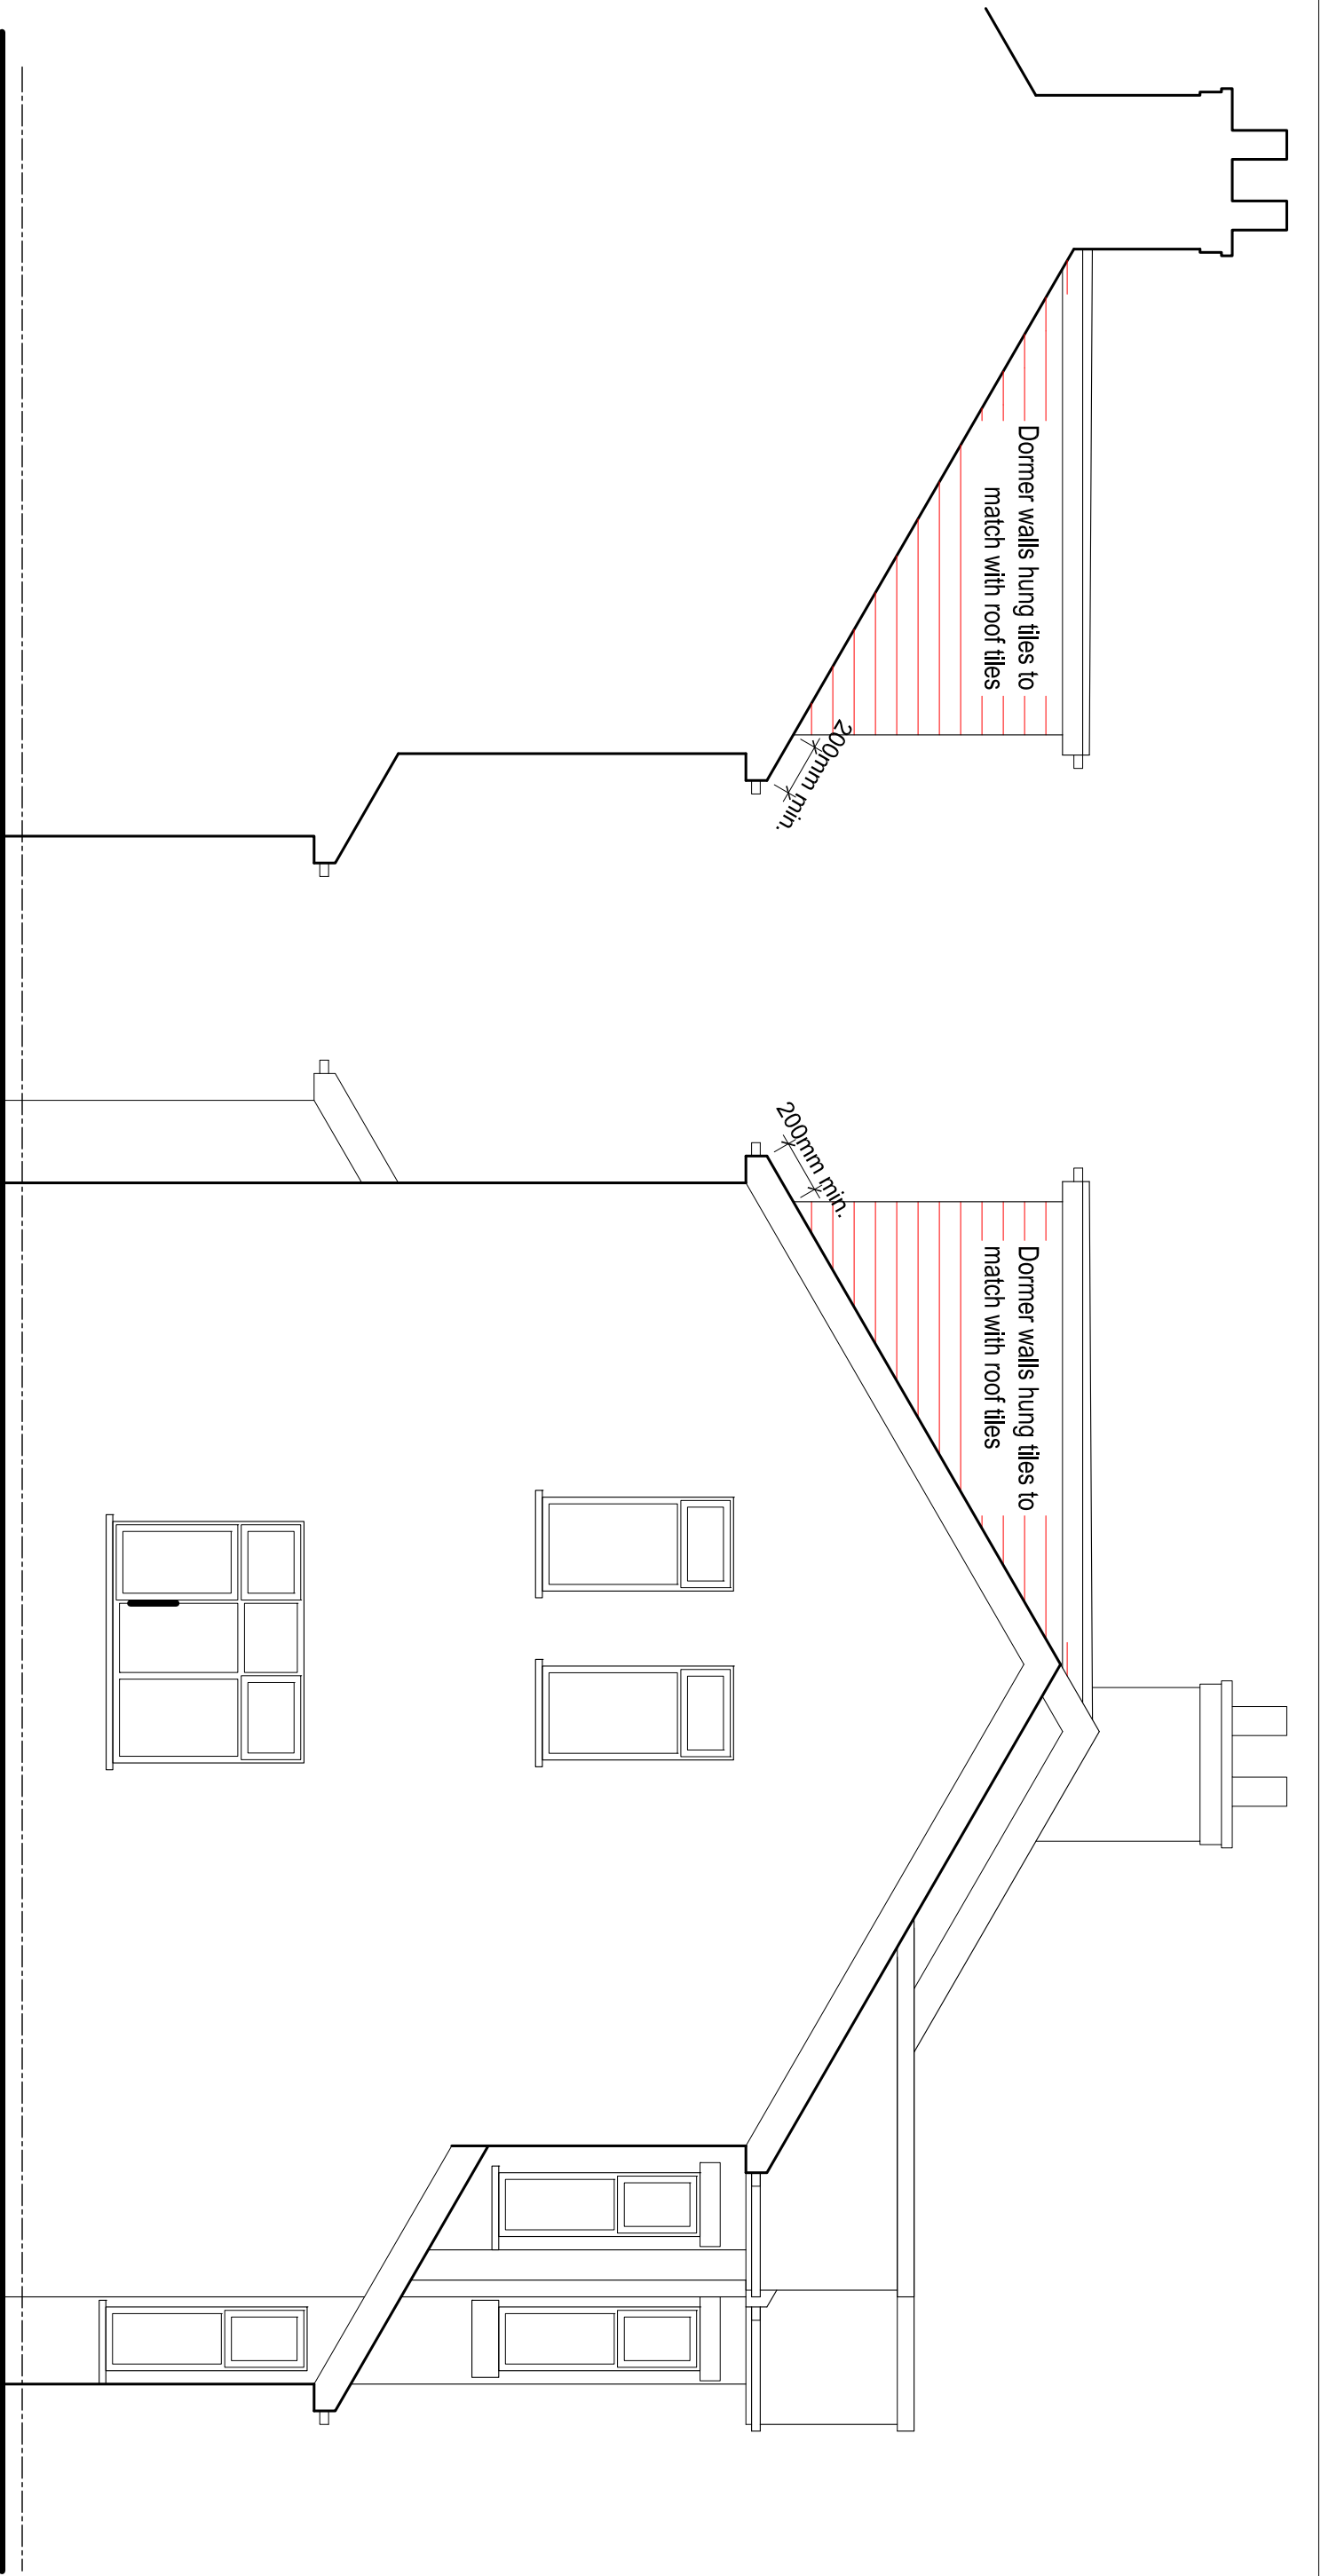

PROPOSED SIDE ELEVATION

PROPOSED SIDE ELEVATION

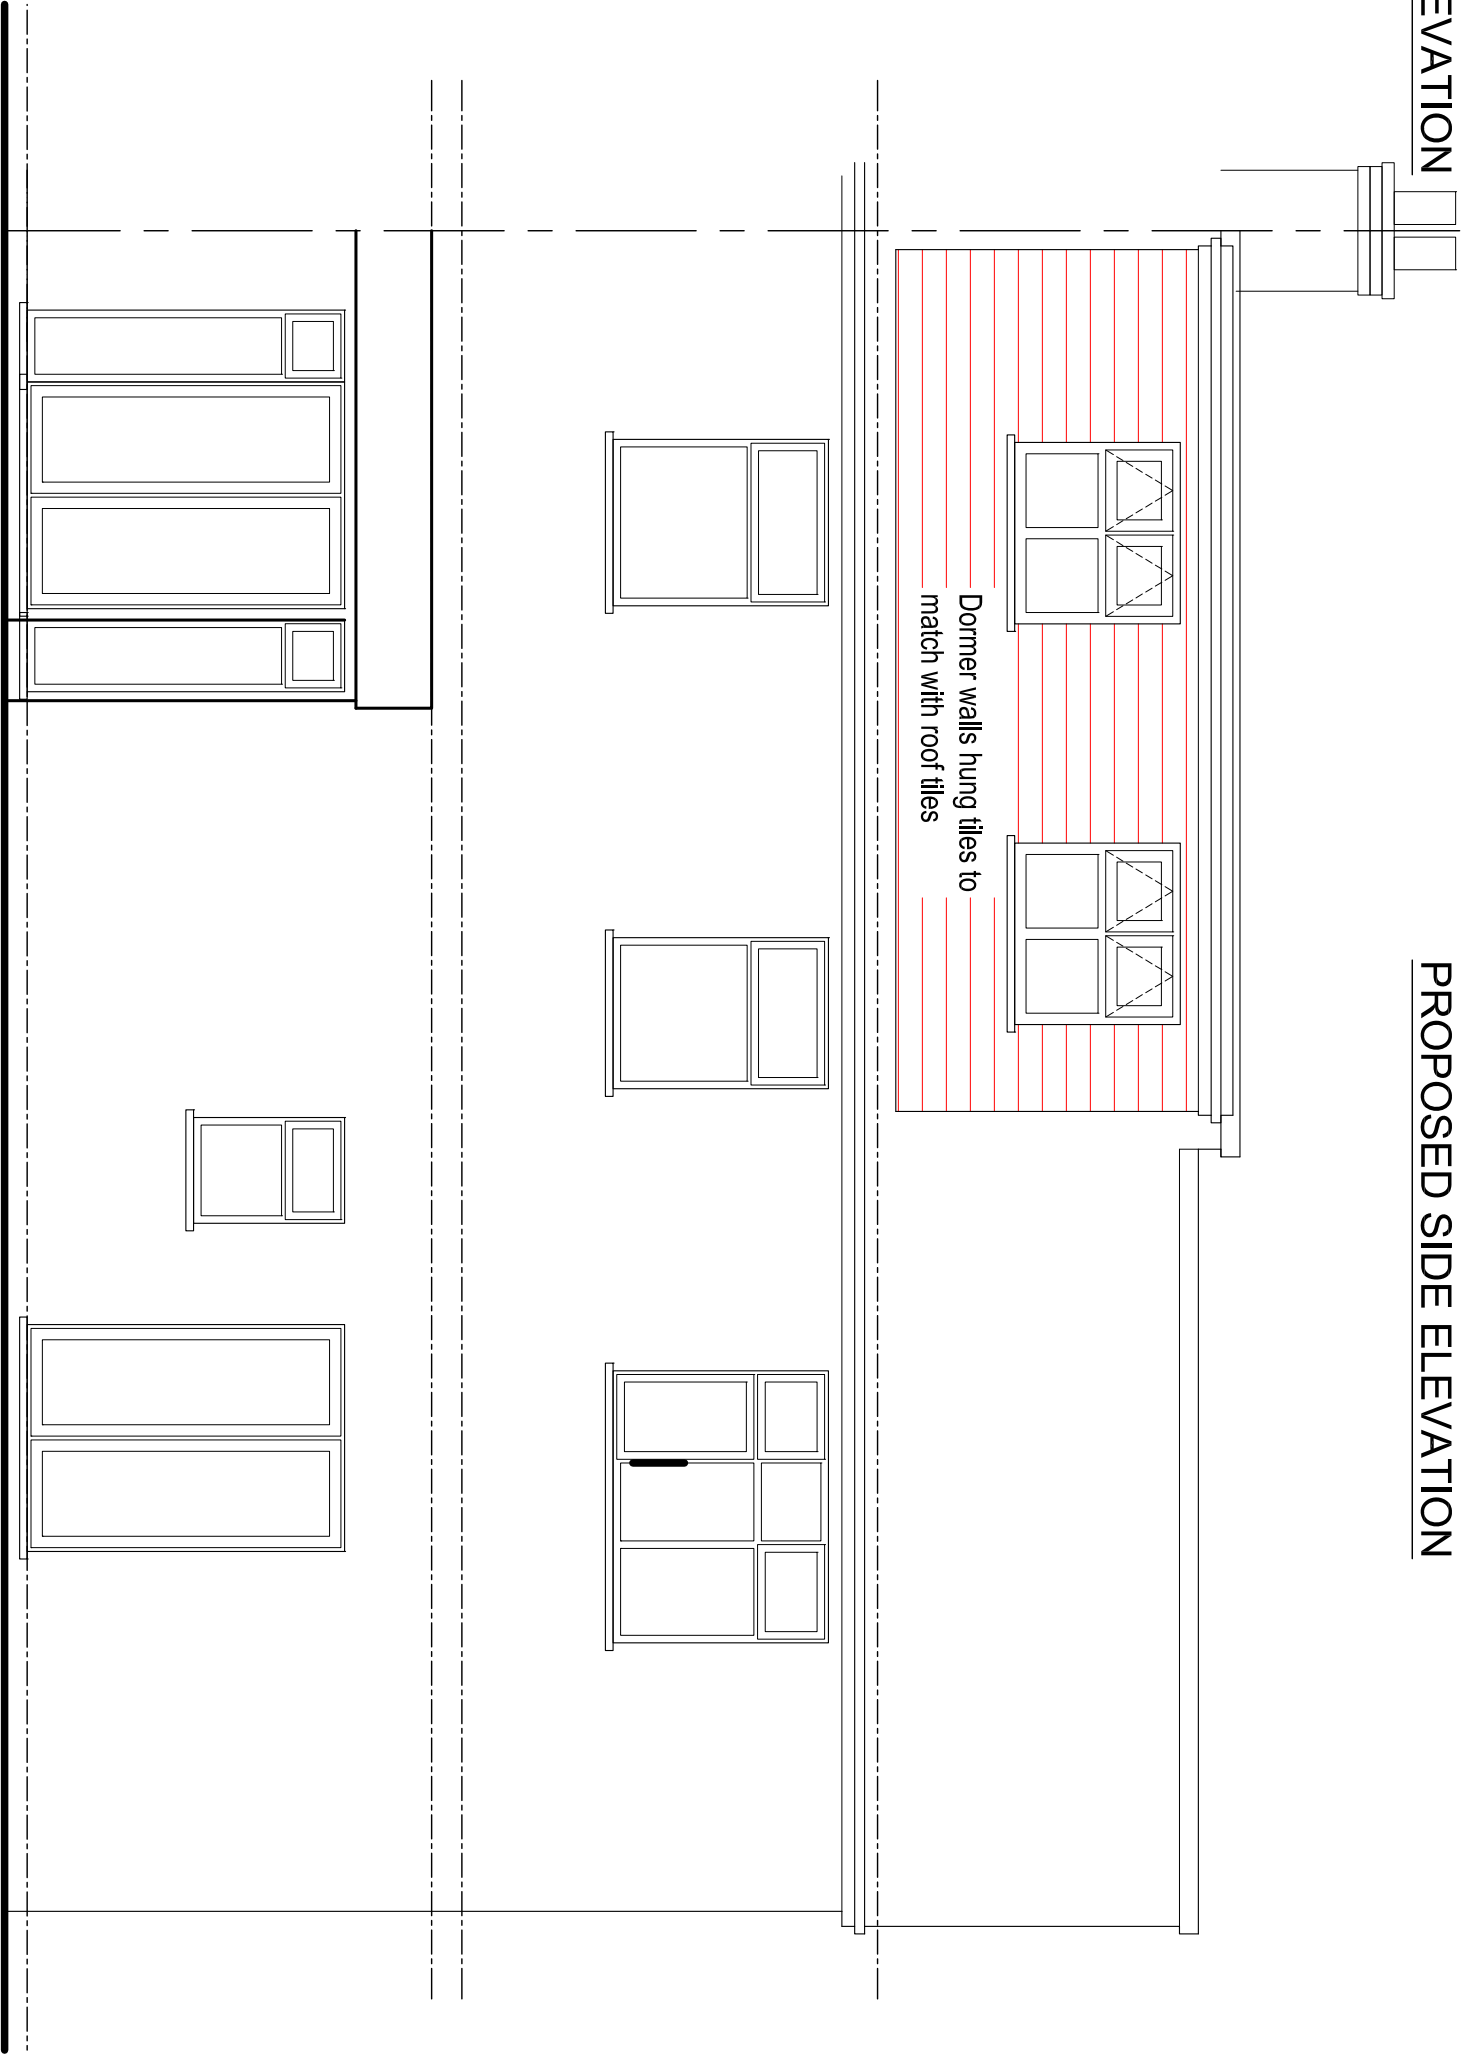

PROPOSED REAR ELEVATION

PURPOSE OF ISSUE	BUILDING CONTROL
Do not scale from this drawing. All information should be checked by the contractor on site before commencing work. Any discrepancies should be reported to the architect immediately. All rights are reserved and are not transferable. Unauthorised reproductions of this drawing are not permitted.	

GENERAL NOTES

- (1) THE CONTRACTOR IS TO CHECK AND VERIFY ALL BUILDING AND SITE DIMENSIONS, LEVELS AND SEWER INVERT LEVELS AT CONNECTION POINTS BEFORE WORK COMMENCES.
- (2) THE CONTRACTOR IS TO COMPLY IN ALL RESPECTS WITH THE BUILDING REGULATIONS, 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (3) BEFORE WORK COMMENCES – ENSURE ALL PLANNING CONDITIONS AND BUILDING REGULATION CONDITIONS HAVE BEEN RESOLVED TO THE SATISFACTION OF THE LOCAL AUTHORITY.
- (4) ALL WORKS TO COMPLY WITH THE WORKMANSHIP CLAUSES IN BS8000 SERIES AND TO BE IN FULL COMPLIANCE WITH THE BUILDING REGULATIONS.
- (5) CONTRACTOR IS TO NOTIFY BUILDING CONTROL AT THE APPROPRIATE STAGES IN CONSTRUCTION, NECESSARY FOR THE BUILDING REGULATIONS, 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (6) THE BUILDER IS TO FURNISH HIMSELF AND FULLY UNDERSTAND THE PLANS AND ANY APPROPRIATE STRUCTURAL DETAILS BEFORE ANY WORK COMMENCES ON SITE.
- (7) THE PLANS RELATING TO THE PROPOSED PROJECT TO BE READ IN CONJUNCTION WITH ALL APPROPRIATE STRUCTURAL ENGINEERS' DETAILS.
- (8) DO NOT SCALE FROM PLANS. USE FIGURED AND ON SITE DIMENSIONS ONLY. IF QUERIES ARISE ON SITE CONTACT SITE AGENT.
- (9) THE CONTRACTOR IS TO CHECK ALL DIMENSIONS ON SITE BEFORE COMMENCEMENT OF WORK ON SITE AND ANY DISCREPANCIES BE BROUGHT TO THE ATTENTION OF THE SITE AGENT.
- (10) ALL SITE WORK TO BE CARRIED OUT TO THE BUILDING REGULATIONS 2010, ITS REVISIONS, CURRENT BRITISH STANDARDS AND CODES OF PRACTICE.
- (11) ALL STATUTORY SITE INSPECTIONS ARE TO BE SEEN AND APPROVED BY L.A.B.C.O. PRIOR TO ANY COVERING UP OF WORK.
- (12) NO WORK IS TO BE CARRIED OUT FROM THIS PLAN UNTIL IT HAS BEEN STAMPED APPROVED BY COUNCIL BUILDING CONTROL AND FURNISHED WITH A PERMIT TO WORK.
- (13) ALL WORK TO BE CARRIED OUT TO THE CONDITIONS ENCOUNTERED ON SITE.
- (14) ALL CONCRETE WORK TO BE CARRIED OUT TO BS5328:1981 AND BS1282:1985.
- (15) ALL BRICKWORK TO BE CARRIED OUT TO BS5328:PT3:1985.
- (16) ALL TIMBER TO BE TREATED WITH A SUITABLE PRESERVATIVE TO BS1262:1975.
- (17) ALL WORK REGARDING THIS PROJECT IS SUBJECT TO THE BCO'S APPROVAL AND SATISFACTION.
- (18) ALL STRUCTURAL WORK MUST BE INSPECTED AT THE RELEVANT STAGES BY THE STRUCTURAL ENGINEER AND/OR THE BUILDING CONTROL OFFICER, AND COMPLY WITH THEIR REQUIREMENTS.
- (19) ALL ELECTRICAL WORK IS TO COMPLY WITH ALL THE RELEVANT REQUIREMENTS OF PART P COMPLETION CERTIFICATE TO BE PROVIDED ON COMPLETION OF WORK.
- (20) SITE TO BE LEFT CLEAN BY CONTRACTOR AFTER COMPLETION OF PROJECT.
- (21) CODE 4 LEAD FLASHINGS (MIN UPSTAND 150mm & MIN 150mm SPREAD ON TILE) AND CAVITY TRAYS ARE TO BE USED WHERE INDICATED.
- (22) DOUBLE GLAZING TO BE PROVIDED TO ALL WINDOWS TO NEW STRUCTURE. THEREFORE U-VALUE OF WALLS TO BE 0.28w/m² K AND U-VALUE OF WINDOWS TO BE 1.6w/m² K, & EXTERNAL DOOR 1.8w/m² K (I.E.: CONSTRUCTED AS INDICATED).
- (23) WHERE EXISTING GROUND FLOOR IS OF THE SUSPENDED TYPE, THE EXISTING FLOOR IS TO BE REMOVED AND REPLACED WITH A NEW FLOOR OF 100mm POLYSTYRENE INSULATION, 1200 GAUGE DPM AND FULLY LAP WITH DPC. ANY JOINTS IN DPM TO BE LAPPED MIN 300mm. PROVIDE 100mm POLYFOAM PLUS FLOORBOARD 220' INSULATION/KINGSSPAN/EXTRAHERM AS SHOWN ON SECTION. LAY MIN. 100mm CONCRETE (1:2.4:20mm AGGREGATE) SLAB FINISH SURFACE OF WITH 65mm SAND/CEMENT SCREED OR 25mm ASPHALT.
- (24) EXISTING WOOD FLOOR VENTILATION: FOR VENTILATION OF EXISTING WOOD FLOOR LAY 100MM DIA PVC PIPE IN NEW GROUND FLOOR.

NEW GROUND FLOOR

ALL VEGETABLE SOIL AND DETERIOROUS MATTER STRIPPED OFF SITE. LAY MIN. 150mm OF CLEAN CRUSHED STONE HARDCORE AND COMPACT. LAY 1200 GAUGE DPM AND FULLY LAP WITH DPC. ANY JOINTS IN DPM TO BE LAPPED MIN 300mm. PROVIDE 100mm POLYSTYRENE PLUS FLOORBOARD 220' INSULATION/KINGSSPAN/EXTRAHERM AS SHOWN ON SECTION. LAY MIN. 100mm CONCRETE (1:2.4:20mm AGGREGATE) SLAB FINISH SURFACE OF WITH 65mm SAND/CEMENT SCREED OR 25mm ASPHALT.

PROJECT
48 Lindsay Avenue,
MCR

CLIENT
Mr. Akmal

DRAWING TITLE
Proposed Elevation

JOB No
DRAWING No
NA-B03

SCALE
1:50@A2
DATE
Jan. 2026
REVISION
-

t: 0782 895 3405

e: nadesignandbuilds@gmail.com

nadesign
and
builds