



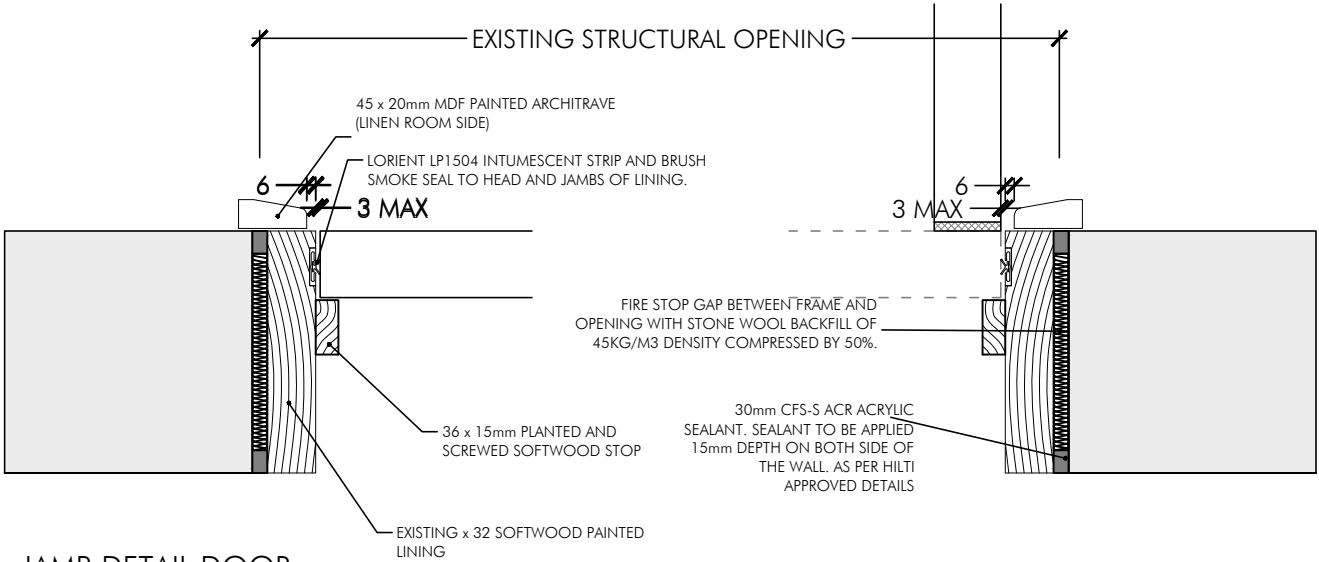

JAMB DETAIL DOOR
TYPE F
SCALE 1:5

NOTE: SEE GENERAL
ARRANGEMENT DRAWINGS
FOR DOOR HINGE SIDE

DOOR TYPE F: SERVICE CUPBOARD
DOOR No. 1D.10 & 1D.11 / TOTAL No. OF DOORS = 2

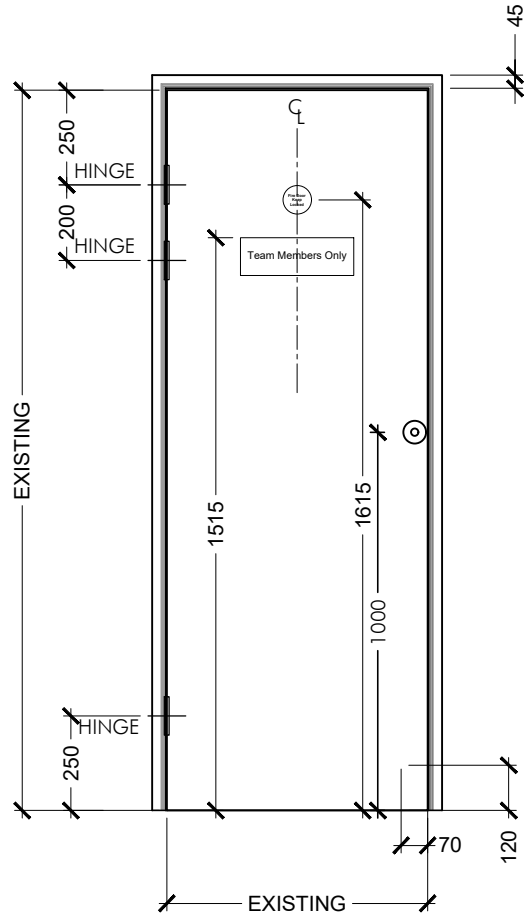

DOOR TYPE F
SERVICE CUPBOARD CORRIDOR SIDE
SCALE 1:20

DESCRIPTION: DOOR TYPE F

STRUCTURAL OPENING: EXISTING x EXISTING mm
LEAF SIZE: EXISTING x EXISTING mm

FINISH: PAINTED DOOR
COLOUR TBC.
DOOR EDGES PAINTED TO MATCH DOOR FACE


FIRE RATING: FD30S

IRONMONGERY PACK REF:
1.5 x PAIR BALL BEARING BUTT HINGES.
1 x CAM ACTION OVERHEAD DOOR CLOSER.
1 x MANUAL STAR LOCK

DOOR DOES NOT REQUIRE ELECTRONIC
LOCKING

DOOR SEALS = LORIENT LP1504 INTUMESCENT
STRIP SEAL TO HEAD AND JAMBS.
LORIENT LAS1010 BATWING SEAL TO HEAD AND
JAMBS.
LORIENT IS8010 SI DROP-DOWN THRESHOLD
SEAL RECESSED INTO THE BOTTOM OF THE
DOOR LEAF.
COLOUR: TBC

SIGNAGE = 1 x TEAM MEMBERS ONLY
2 x FIRE DOOR KEEP LOCKED SIGN

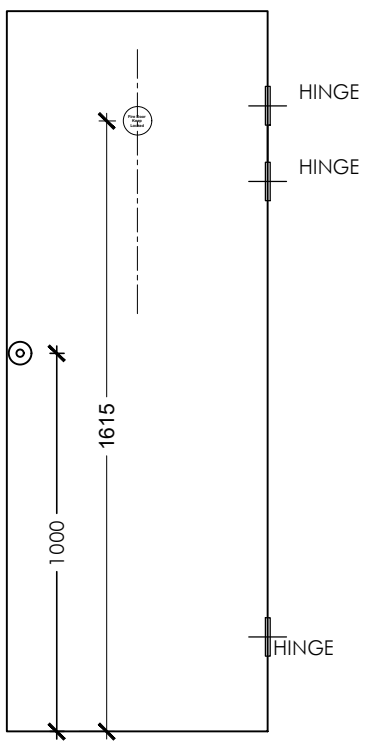

DOOR TYPE F
SERVICE CUPBOARD SIDE
SCALE 1:20

NOTE:
ALL DIMENSIONS TO BE CHECKED ON SITE AND ANY
DISCREPANCIES REPORTED PRIOR TO COMMENCEMENT OF
WORK.

ALL EXISTING OPENINGS TO BE MEASURED ON SITE PRIOR TO
MANUFACTURING OF NEW DOORS.

DO NOT SCALE FROM THE DRAWING. IF IN DOUBT ASK.

NOTE:
FIRE STOPPING MEASURES TO EXISTING DOORS HAS BEEN
ASSUMED FOR THE PURPOSE OF TENDER ONLY. FRMA WILL
PROVIDE GUIDANCE ON FIRE STOPPING.

FIRE DOOR INSTALLATION NOTES:

NOTE: IN ALL CASES, ALL FRAME, JOINERY AND IRONMONGERY
MATERIALS TO BE SUPPLIED AND INSTALLED IN ACCORDANCE
WITH THE APPLICABLE FIRE CERTIFICATE TEST DETAILS.
GAPS BETWEEN DOOR LIPPING AND FRAME AT BOTH JAMBS AND
HEAD TO BE 3-4mm. WHERE DROP-DOWN SEAL TO BASE OF
DOOR IS TO BE PROVIDED, GAP BETWEEN THRESHOLD AND
DOOR TO BE MAX 13mm, IF NO DROP-SEAL IS PROPOSED, GAP
TO BE AS SPECIFIED IN THE FIRE CERTIFICATE TEST DETAILS.
ALLOW FOR INTUMESCENT HINGE LINERS TO BE INSTALLED IN
ACCORDANCE WITH THE TEST CERTIFICATE DETAILS, AND ALLOW
FOR INTUMESCENT LINERS TO ANY DOOR LOCK SETS AND KEEP.
BATWING SEALS TO BE TIGHTLY MITRED AT TOP CORNER
JUNCTIONS AND FITTED IN STRICT ACCORDANCE WITH LORIENT
INSTRUCTIONS.
INSTALLING CONTRACTOR TO REFER TO BWF-CERTIFIRE BEST
PRACTICE GUIDE (FIRE DOORS AND DOORSETS) FOR FURTHER
DETAILED GUIDANCE.
WHERE REPAIR AND UPGRADE WORKS ARE BEING DONE TO
EXISTING DOORS, THE INSTITUTION OF FIRE ENGINEERS 'GUIDE
TO THE FIRE RESISTANCE OF HISTORIC TIMBER PANEL DOORS'
AND REPORT 'TBC' BY FRMA ARE TO BE USED FOR GUIDANCE
AND INFORMATION.

TENDER ISSUE

RSB
DRAWN

DRAWN
REVISION

DEC 25
DATE

PC
VER

ARCHITECTS & DESIGNERS

7 Buxton Road West, Disley,
Stockport, Cheshire, SK12 2AE.
Website: www.allisonpike.com

Telephone: 01663 763000
Facsimile: 01663 766772
Email: studio@allisonpike.com

© Allison Pike Partnership Limited.

PROJECT
INNKEEPERS COLLECTION
1-3 YORK STREET (BROWNS)
MANCHESTER

TITLE
DOOR TYPE F
SCHEDULE AND DETAILS

SCALE
1:20, AND 1:5 @ A3

JOB No MAB46	DRAWING No AZ66	REV /
-----------------	--------------------	----------