

Our Ref/EKA251101

Rob McCann
Community Manager
Urbanbubble,
Sevendale House,
7 Dale Street,
Manchester,
M1 1JA

14 January 2026

Dear Rob,

Akt's response to GIA's letter 06 January 2026, regarding their rebuttal of the (Akt. Rights to Light Surveyors Ltd) Independent Stage 2 – Technical Daylight Report of the Stocktons Site, 140 Great Ancoats Street, Manchester M4 6DU - Effect on Oxygen Towers, Store Street, Manchester M1 2FU dated 17 December 2025.

Thank you for sharing GIA's letter (6 January 2026, by Nicola Hensey) in relation to their rebuttal comments to our Independent Stage 2 – Technical Daylight Report of 17 December 2025. I also acknowledge receipt of the covering email from Andrew Bickerdike from Turley dated 6 January 2026. I also acknowledge receipt of the planning officers latest report.

The author of this response, Daniel Wade, is a Director at Akt and has been specialising in daylight and sunlight matters for 28 years. Advising on landmark cases and representing clients in planning issues, committees and planning inquiries on major developments, covering all major cities across the UK including Manchester.

We are grateful to the committee and the applicant by accepting our 17 December 2025 report at the 11th hour, they acknowledge the levels and volume of work required to highlight our client's concerns.

We note that GIA seek to address the points and matters of concern raised by AKT in the Independent review (17 December 2025) in the following three main headings; -

1. Summary of the Stage 2 DS Review
2. What Constitutes Sufficient Light?
3. The AKT Assessments

**Dependable Specialists
in Natural Light Matters**

I shall respond to the pertinent points raised by GIA in turn.

We have undertaken further assessments since the completion of our Stage 2 Daylight Report, these are cover in the following sections.

4. Daylight Report Addendum (13 January 2026)
5. Average Daylight Factor Assessment
6. The Overall Conclusion

1, Summary of the Stage 2 DS Review

GIA have acknowledged that AKT have conducted an independent technical assessment and have reiterated our stance on this matter. We stand by our conclusion *“It is recommended that the planning committee take heed of this report and reject/defer the application decision until such time the design allows/maintains sufficient light into Oxygen Towers”*. GIA also recognise that AKT have covered 8 scenarios within our technical works.

As discussed later in this letter, we have since produced further information to evidence the damaging impact of the Stockton’s proposed development, plus the additional cumulative impact of the wider context proposals on the occupants of Oxygen Towers.

2, What Constitutes Sufficient Light?

We acknowledge this approach by GIA and their 12 case examples within their letter.

What constitutes sufficient light in a city centre is certainly subjective and also variable dependent on the particular area within the city and the style of the predominant architecture. Below are our thoughts on the policies from Oxygen Towers resident’s perspective which are underlined.

Policy DM1 of the Manchester Core Strategy states:

“Development should have regard to the character of the surrounding area”.

GIA State *“In other words, when considering acceptability of matters such as daylight and sunlight, the height, proximity and levels of light already established in should be taken into account”*.

This approach is endorsed by the BRE Guidelines, which state at paragraph 1.6 that the numerical guidelines *“should be interpreted flexibly”*, whilst the same paragraph goes on to state:

**Dependable Specialists
in Natural Light Matters**

“in a historic city centre, or in an area with modern high-rise buildings, a higher degree of obstruction may be unavoidable if new developments are to match the height and proportions of existing buildings”

Additionally, the National Planning Policy Framework (“NPPF”) states the following at paragraph 130 (c):

“...when considering applications for housing, authorities should take a flexible approach in applying policies or guidance relating to daylight and sunlight...(as long as the resulting scheme would provide acceptable living standards).”

First and foremost, Stocktons development does not match the height or proportions of the existing Oxygen Towers, it dwarfs Oxygen Towers and all other neighbouring developments within this area in terms of sheer height. Secondly the proposed development itself is unlikely to provide acceptable living standards within the proposed habitable units on the Store Street elevation. We shall elaborate on this later in the report based on our additional technical assessments.

GIA go on to refer to PPG’s relevant to the development.

Paragraph 007 Reference ID: 66-007-20190722

“All developments should maintain acceptable living standards. What this means in practice, in relation to assessing appropriate levels of sunlight and daylight, will depend to some extent on the context for the development [emphasis added] as well as its detailed design. For example, in areas of high-density historic buildings, or city centre locations where tall modern buildings predominate, lower daylight and sunlight levels at some windows may be unavoidable...”

Whilst we appreciate this point, it is clear and evident that the proposed Stockton’s development goes well beyond acceptable levels based on a detailed design technical analysis approach for the impact on Oxygen Towers.

Paragraph: 004 Reference ID: 66-004-20190722

“A range of considerations should be taken into account in establishing appropriate densities on a site or in a particular area. Tools that can assist with this include...characterisation studies [emphasis added] and design strategies, dealing with issues such as urban form, historic character, building typologies, prevailing sunlight and daylight levels [emphasis added], green infrastructure and amenity space...”

GIA State “The VSC assessment has been used to inform the study on the basis that the BRE guidelines state at paragraph F7:

“In assessing the loss of light to an existing building, the VSC is generally recommended as the appropriate parameter to use. This is because the VSC depends only on obstruction, and is therefore a measure of the daylight environment as a whole.”

Whilst I agree that characterisation studies to establish what the prevailing sunlight and daylight levels could be in an area, I only agree with this approach insofar as for assessments where internal layout information of a building is unknown, and where there is no better substitute for understanding or appreciating light levels within the internal rooms of a neighbouring building.

GIA State “The characterisation study provides a benchmark as to what is acceptable / sufficient daylight in context and, indeed, what residents living within Manchester city centre, in which a successful residential market operates and where properties are in high demand, experience when exercising choice in where they live”.

This is a sweeping statement that works for developers, are these daylight levels actually acceptable to impacted neighbouring residents or are MCC just being told that they are based on pseudo colour scales for light levels on the outside face of the window. The true level of impact is how the light that penetrates through the window is impacted within the room itself, where the light is needed for the continued function of each room of every apartment in the case of Oxygen Towers.

GIA have provided 12 case examples, they state that these are successful residential buildings where people choose to live, however they fail to recognise that some of the more recently completed developments such as Oxygen Towers offer unique open vistas and excellent daylight / sunlight levels which lured potential purchasers to buy an apartment in a tower they now call home. Now half of the Oxygen Tower’s residents face the prospect of losing unique views and natural daylight across all floors including the much sought after penthouse suites. One would not expect to see rooms fail BRE Daylight levels on the 32nd floor in any tower in the UK.

The retained daylight levels table for average and minimum VSC levels is misleading, this does not show how many units, windows / rooms will be affected nor does it account for future cumulative effects too. It does not show if there were any neighbouring objections to daylight loss from the affected residents and the light loss to the internal areas of the room behind each affected window.

GIA state “The study clearly demonstrates that there are a number of successful residential buildings in Manchester with daylight levels that fall below those anticipated by the BRE in spite of which, they are recognised as positive urban environments that people choose to live in, and the levels of daylight are therefore contextually appropriate (sufficient) for the city environment.

Oxygen will evidentially maintain a level of daylight which is entirely in keeping with, and sufficient for, expectations in the city centre.

I disagree with this statement, many of the GIA case examples already had poor light levels to start with, therefore the degree of change from existing low retained levels to the proposed slightly lower retained levels of light is less noticeable. Conversely, the occupants of Oxygen Towers will have a highly perceptible impact on their daylight and amenity within their apartments. The residents chose to live Oxygen Towers to enjoy the daylight afforded by the design of the building, its outlook and location, this is demonstrated in our Average Daylight Factor assessment.

3, The AKT Assessments

AKT have not been provided with GIA's technical analysis model and, therefore unable to comment on the accuracy of their analysis that accompanied the planning application. We have only been able to compare the data and drawings provided with those produced from the assessments undertaken in GIA's technical model.

GIA have made the same statement regarding the AKT analysis 3D model. I shall respond to their general points of note.

GIA State "AKT have, in each of their assessment scenarios, calculated the effect of the Proposed Development on Oxygen on the basis that the recently consented Former Central Retail Park buildings are already constructed. This is not the case. The AKT assessments will, therefore, differ from GIA's as a result of this additional massing".


As stated in our 17 December 2025 report we have based our analysis on the current planning status scenario, therefore the baseline existing scenario includes all of the current live planning consents for both those being implemented and those that are not. This actually works against our claims as we are reducing the existing levels of light which in turn reduce the percentage difference between the existing and proposed results. We have covered the worst case scenario from our client's perspective to provide a fair balanced approach.

GIA state "AKT have assessed the effect of the Proposed Development upon the non-residential lobby and office space on the ground floor. We have, therefore, discounted these areas for the purpose of our comparison as these areas were not assessed by GIA in accordance with BRE guidelines".

We have also assessed the effect on the en suite and bathroom on the 10th floor penthouse suite. I notice that GIA have not modelled the windows for the LKD room in this penthouse from the imagery of their 3D models. There are provisions within the BRE guidelines to assess all rooms for those that are deemed to be sensitive receptors such as offices where

**Dependable Specialists
in Natural Light Matters**

natural light is required. However, in the grand scheme of things, we are talking about excluding 4 non-habitable rooms out of the 509 rooms that were assessed. This will make a minor to miniscule difference to the percentages we have reported. Upon review of the GIA report I see that they assessed the reception area as 3 separate rooms (See below).

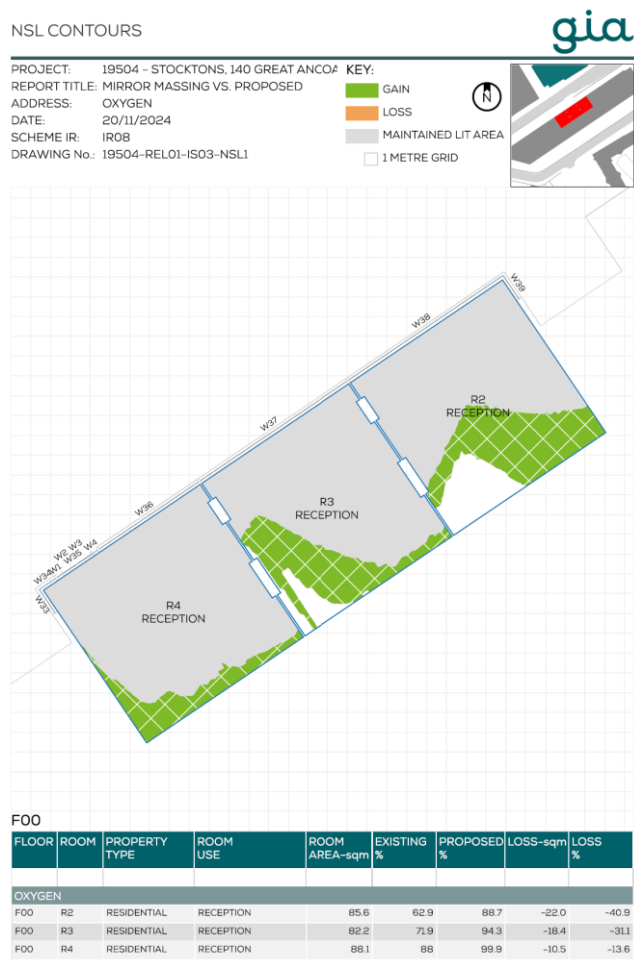

GIA State, “AKT have assessed 900 residential windows. GIA have assessed 858. The reason for the difference is that AKT have assessed some mitigating windows which do not face the Proposed Development, and also because some windows have been assessed as individual panes of glazing by one consultant and as a single glazing pane by the other”.

I disagree with this statement, we have modelled every room that has at least one window or structural opening that faces the Stockton development to establish the impact. This was for dual purpose, to allow us to conduct a “light within analysis” to establish the quality of light within the rooms at the time of design. Upon review, I see that that GIA have not modelled the corner room overlooking the junction of Store Street and Millbank Street. We included these rooms on the 4th to 9th floors as there is a structural opening on the Store Street elevation that serves the balcony windows as shown in the image overleaf. This is the main difference between the window count number.

Dependable Specialists in Natural Light Matters



GIA have mentioned that AKT have assessed each glazing panel on the 3rd floor rooms which is correct, we have done the same for the ground floor reception too. As GIA state, this makes very little change to the results and that the results published for both GIA and AKT assessments broadly compare. However, it is the interpretation of the results where we have a huge difference in opinion.

**Dependable Specialists
in Natural Light Matters**

“Retained Daylight with the Proposed Development and Emerging Context in Place”

GIA have not conducted this assessment, stating there was not a requirement to do so under EIA Regulations. Whilst that may be the case, surely MCC and their knowledge for future masterplans would need to understand the long term and wider implications for the masterplan impact on neighbouring properties. Our client has requested this assessment to fully appreciate the proposed light levels upon completion of a consent for Stocktons and then a further assessment to appreciate the full doomsday scenario of the cumulative impact of the wider emerging context on their property. Having been into some of the apartments and picturing the severely reduced outlook, the future daylight levels look set to be grim for Oxygen residents to put it mildly.

“Cutbacks to the Proposed Development to Improve the Levels of Retained Daylight in Oxygen”

“Retained Daylight with Alternate Configurations of the Proposed Development”

GIA have not conducted either of the above assessments. When a proposed development is trying to take more than its fair share of the neighbours light, the developer would usually wish to know their own doomsday scenario in terms of what they could build should the development need to respect and adhere to the BRE Guidelines for planning, and also the requirements for common law matters, pertaining to neighbouring easement to rights of light. GIA in their wealth of experience know this. To say that “*Oxygen will evidently maintain a level of daylight which is entirely in keeping with expectations (sufficient) for daylight in the city centre*” is an incredulous statement. If the impacts reported were restricted to only the lower parts of Oxygen Towers, then I would be minded to agree. However, impacts extending to the full height of Oxygen Towers is hardly in keeping with the sufficient daylight in the City Centre. Most of GIA’s 12 examples show very good retained light levels on the higher levels of the respective affected properties. Incidentally the highest storey test for any of the 12 examples is the 16th floor, all 12 examples are at least half the height or less compared to the Oxygen Towers example.

4, Daylight Report Addendum

Further to the submission of the AKT Daylight Report 17 December 2025, it was brought to our attention that the East Village SRF had been updated to show much taller towers on the Diecast Site. Therefore we had not reported the worst case future cumulative scenario based on the future master plan.

Therefore, our client instructed us to conduct an additional assessment to include the latest masterplan height, bulk and massing. The results for this are contained within the AKT Addendum Report 13 January 2026 supplementing the 17 December 2025 report. The


report has been submitted to MCC and this additional scenario Existing vs Proposed (Plus Emerging Context and East Village SRF Update) is contained within Appendix H.1. Extract of the report below showing the 3D model scenarios.

7.0 Existing vs Proposed (Plus Emerging Context and East Village SRF Update)

This is the existing site vs proposed (Plus Emerging Context and East Village SRF Update) development scenario. This is shown in the graphic of the 3D model images below. Aerial Image showing existing building in orange, full drawings in Appendix H.1 in EKA251011 DSO-3D_01, 03, 05, 07 & 09 Rev B.



Aerial Image showing proposed building in blue, full drawings in Appendix H.1 in EKA251011 DSO-3D_02, 04, 06, 08 & 10 Rev H.

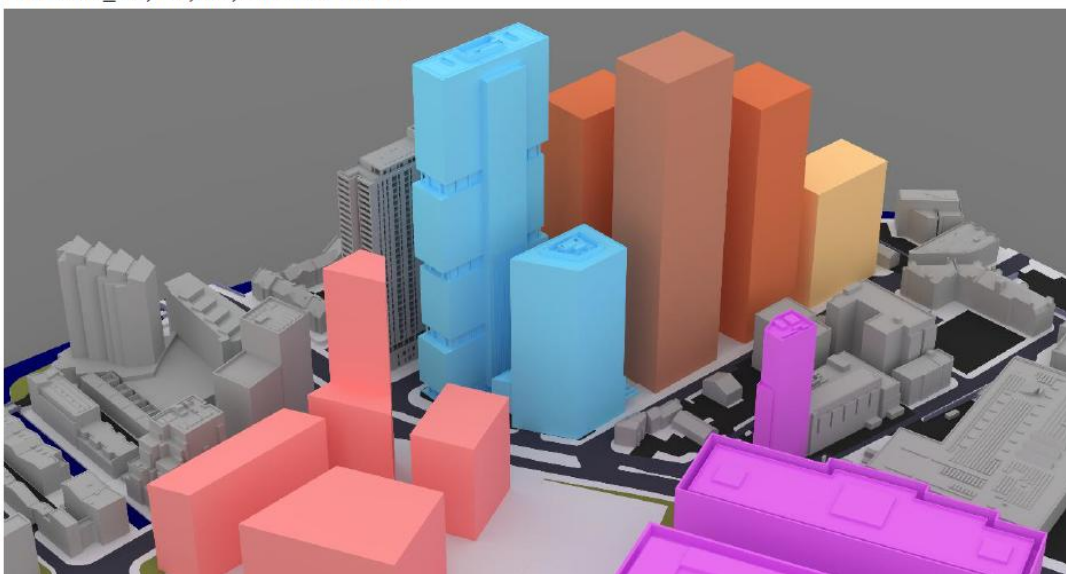

**Dependable Specialists
in Natural Light Matters**

5, Average Daylight Factor Assessment

During design stage, and certainly for planning submission, it is not unusual for the local authority to request a daylight, sunlight and overshadowing assessment within the proposed building itself. This is to ensure that the proposed habitable rooms and amenity areas have been designed to meet the relevant requirements and guidance of the BRE 209 paper at the time of the relevant publication.

At the time of Oxygen Towers planning submission the relevant BRE 209 paper was the 2nd edition, 2011. Within this BRE document, it details the methodology for assessing the quality of light within the proposed rooms. Back then the relevant methodology was the ADF (Average Daylight Factor) assessment. For brevity, I shall not reiterate the full mechanics of the ADF assessment as it is detailed within the BRE 209 Paper 2nd edition. However, the target values are set depending on the room use. At the time, the BRE recommended that proposed developments are designed to receive at least the following minimum levels of light in each room type.

- Kitchens - 2.0% ADF
- Living Rooms - 1.5% ADF
- Bedrooms - 1.0% ADF
- Multiuse Rooms, such as Living / Kitchen / Diners - 2.0% ADF

The BRE state in paragraph “2.1.9 *With a higher ADF, indoor daylight will be sufficient for more of the year. So although BS 8206-2 minimum values can be used as targets for daylight in obstructed situations, achieving 2% in living rooms, for instance, will give improved daylight provision, and 3% or 4% would be better still. The higher values would be particularly appropriate in housing for the elderly, because they require more light and are more likely to be at home during the day*”.

Therefore, in light of this we have been instructed to look into the ADF levels retrospectively to see how they stack up against the BRE recommended targets in the following scenarios:

1. Baseline (existing plus the cumulative planning consents, implemented or not)
2. Proposed Stocktons development
3. Mirrored Massing Scenario
4. Proposed Stocktons (Plus Emerging Context and East Village SRF Update)

These scenarios cover the extremes and a balanced view of the impacts against the design of the current layout in Oxygen Towers. The detailed ADF results for each room are in their relevant numbered enclosure with this letter. Apologies for the length of the spreadsheets, it's due the volume of windows and rooms assessed in this property. Although it does magnify how many apartments will be affected by the Stocktons development.

The table below shows a summary of the results and comparison of the resultant failures due to the Stocktons development. This table ignores the 4 non-residential rooms.

ADF Assessment Scenario	Number of Rooms Tested for ADF	Rooms satisfying BRE ADF		Rooms not satisfying BRE ADF	
		No.	%	No.	%
1. Baseline (existing plus the cumulative planning consents, implemented or not)	505	486	96.24%	19	3.76%
2. Proposed Stocktons development	505	134	26.53%	371	73.47%
3. Mirrored Massing Scenario	505	215	42.57%	290	57.43%
4. Proposed Stocktons (Plus Emerging Context and East Village SRF Update)	505	44	8.71%	461	91.29%

Scenario 1, Baseline (existing plus the cumulative planning consents, implemented or not)

The results show that 486 rooms (96.24%) still meet BRE ADF requirements despite the baseline level of light changing following the subsequent neighbouring consents. This shows that Oxygen Towers was designed to meet ADF BRE requirements and the occupants currently received sufficient levels of light above minimum targets. The 19 rooms (3.76%) that fell short are located on the ground to second floors which are compromised by the existing Stocktons and Diecast buildings. An overall pass rate of 96.24% shows a well-designed building within the City Centre.

Scenario 2, Proposed Stocktons development

The results show that only 134 rooms (26.53%) would meet BRE ADF requirements once the Stocktons planning submission scheme is in-situ. This shows that the design of Oxygen Towers to receive sufficient light was futile and that Stocktons is taking more than its fair share of light away from Oxygen Towers. As a result 371 rooms 73.47% will be receiving light levels below the minimum BRE recommended levels compared with the baseline results.

Scenario 3, Mirrored Massing Scenario

We have run this scenario for a balanced approach, for the hypothetical scenario of the mirrored mass becoming the alternative baseline to compare future developments for an alternative target value setting.

The results show that 215 rooms (42.57%) would meet BRE 209 minimum criteria for ADF. 290 rooms (57.43%) would not meet the minimum criteria for ADF but hypothetically become the alternative baseline. If we compare the results to the Proposed Stocktons scenario, it shows that a further 81 additional rooms (16.03%) go beyond what is portrayed as being acceptable, and these rooms would be deemed insufficiently lit by ADF standards. This demonstrates that the Stocktons development is taking more than its fair share of light.

To have 290 failing rooms set a new baseline level of light in the Mirror Massing Scenario is utter madness, this highlights why mirrored massing is flawed in this scenario. We strongly

**Dependable Specialists
in Natural Light Matters**

oppose the use of the mirror massing argument for the assessment of light in Oxygen Towers.

Scenario 4, Proposed Stocktons (Plus Emerging Context and East Village SRF Update)

The results show and spell the doomsday scenario that only 44 rooms (8.71%) would meet BRE ADF requirements once the Stocktons planning submission scheme is in-situ along with the cumulative impact from the implementation of neighbouring masterplan schemes!

No building's design can withstand the level of daylight deterioration set for Oxygen Towers in this scenario!

If MCC feel that a long term impact upon 461 Rooms (91.29%) creating substandard ADF levels is acceptable then I urge that you seek legal advice on the matter. This level of impact goes way beyond an urban grain or inner city acceptability against residential property!

How can a building such as Oxygen Towers go from a BRE compliant ADF designed 96.24% healthy pass rate, down to an inflicted catastrophic pass rate of 8.71%. It has nothing to do with its own inherent design but everything to do with the neighbouring proposed developments should they be granted consent in their current guise.

Stocktons Proposed Habitable Rooms

The mirror massing impact also highlights the likely light levels within the proposed Stocktons development rooms itself. This certainly shows in our own analysis mirror massing assessment results, where it is clear that many of the proposed habitable rooms on the Store Street elevation will not meet the minimum internal requirements for their own daylight.

We have not had the opportunity to assess the light levels for the proposed units within Stocktons and nor should it be incumbent on us to do so. Although we would hope that MCC are inclined to request this information to validate the application. This is to ensure the proposed development has been designed to meet the minimum requirements of the BRE 209 Paper 3rd Edition 2022, for both the Daylight Factor (DF) and Spatial Daylight Autonomy (sDA) Assessments for each proposed room use / type. It would be interesting to see the percentage pass rate performance of Stocktons to demonstrate that the proposed habitable rooms receive sufficient light in the emerging context scenario. Hopefully MCC will request an assessment of sorts.

6, Overall Conclusion

AKT fully acknowledge the points raised in GIA's rebuttal on behalf of their Applicant within their letter dated 6 January 2026.

This letter provides a review of the three pertinent points raised by GIA upon reflection of our independent Daylight Report (17 December 2025) submission to Manchester City Council detailing the likely impacts across a number of scenarios.

This letter also provides an insight into our further technical investigations regarding the overall impact of the Stocktons development in conjunction with the emerging context masterplan developments. We have submitted an Addendum Report (13 January 2026) showing our daylight calculations and the likely impacts to Oxygen Towers based on the Proposed Stocktons (Plus Emerging Context and East Village SRF Update).

The results of this assessment show the catastrophic daylight losses the Oxygen Tower residents can expect to permanently endure if MCC sanction this development along with the emerging context masterplan schemes.

To demonstrate that Oxygen Towers is a well-designed scheme and a "good neighbour", we undertook a retrospective ADF (Average Daylight Factor) assessment for the habitable rooms with Oxygen Towers Store Street elevation. This assessment is / was routinely requested by local authorities within the UK particularly for major cities to demonstrate that the room and its use has been designed to receive adequate daylight. At the time, Oxygen Towers design would need to have met BRE 209 Paper 2nd Edition 2011 criteria.

Our baseline (existing) assessment showed that 96.24% of habitable rooms assessed met or exceeded BRE requirements showing very good design at the time of the Oxygen Towers application.

The Proposed Stockton scheme shows that only 26.53% of Oxygen Towers habitable rooms will stay above BRE minimum ADF targets.

The Proposed Stocktons (Plus Emerging Context and East Village SRF Update) shows that only a mere 8.71% of Oxygen Towers habitable rooms will stay above BRE minimum ADF targets.

These results clearly demonstrate that the Stocktons Proposed development is an "overdevelopment" from the perspective of the Oxygen Towers residents. Turning Oxygen Towers from a compliant designed naturally well-lit pleasant building into one with permanent dark dingy rooms, that will fall way short of BRE's own recommendations and target values through no fault of their own.

Whilst the Oxygen Towers residents are expecting a neighbouring development of sorts to occur at some point in the future, they would like to ensure that their views and concerns are being heard and reliably hope that MCC ensure the development can be designed to ensure sufficient / maximised light is maintained within their property.

The current design goes way beyond the realms of acceptability in terms of daylight impact, there are several mitigation measures that could be employed to reduce the light losses to Oxygen Towers, that would not only benefit Oxygen Towers but also future occupants of Stocktons in better lit homes on the opposite side of Store Street.

Should the residents views and concerns be ignored, I recommend that you seek legal advice for both planning and common law matters to pursue the matter further. Let's hope commonsense prevails and the planning committee take heed of this letter.

I have seen many cases and planning consents with reduced levels of light being accepted and plenty pushing the boundaries of tolerance in an urban environment. However in my 28 years practicing as a natural light surveyor, none have been on this percentage change magnitude and overall residual impact. I am genuinely concerned for the residents.

If you have any further questions or concerns please do not hesitate to contact us.

Yours sincerely,



Daniel Wade

Director – Rights of Light, Daylight and Sunlight

For and on behalf of

Akt Rights to Light Surveyors Limited

The Building Centre, 26 Store Street, London WC1E 7BT

Tel: **0203 488 0516** | Email: **dan@akt-surveyors.com** | Web: **www.akt-surveyors.com**

- Encs: 1, ADF Existing Scenario Spreadsheets
2, ADF Proposed Scenario Spreadsheets
3, ADF Mirror Mass Scenario Spreadsheets
4, ADF Proposed (Plus Emerging Context & East Village SRF Update) Spreadsheets

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
Oxygen Towers															
00 GF	R1	Residential	Lobby	W1	0.68	0.99	3.12	46.26	729.43	0.50	1.00	0.18	6.64	-1.00	NO
				W2	0.68	0.99	0.91	70.93	729.43	0.50	1.00	0.08			
				W3	0.68	0.99	4.22	69.93	729.43	0.50	1.00	0.36			
				W4	0.68	0.99	4.22	69.13	729.43	0.50	1.00	0.36			
				W5	0.68	0.99	4.22	68.50	729.43	0.50	1.00	0.36			
				W6	0.68	0.99	4.22	67.90	729.43	0.50	1.00	0.35			
				W7	0.68	0.99	4.22	67.46	729.43	0.50	1.00	0.35			
				W8	0.68	0.99	4.22	67.10	729.43	0.50	1.00	0.35			
				W9	0.68	0.99	4.22	66.65	729.43	0.50	1.00	0.35			
				W10	0.68	0.99	4.22	66.27	729.43	0.50	1.00	0.34			
				W11	0.68	0.99	4.22	65.91	729.43	0.50	1.00	0.34			
				W12	0.68	0.99	4.22	65.55	729.43	0.50	1.00	0.34			
				W13	0.68	0.99	4.22	65.16	729.43	0.50	1.00	0.34			
				W14	0.68	0.99	4.22	64.69	729.43	0.50	1.00	0.34			
				W15	0.68	0.99	4.22	64.19	729.43	0.50	1.00	0.33			
				W16	0.68	0.99	4.22	63.65	729.43	0.50	1.00	0.33			
				W17	0.68	0.99	4.22	62.07	729.43	0.50	1.00	0.32			
				W18	0.68	0.99	4.29	54.55	729.43	0.50	1.00	0.29			
				W19-L	0.68	0.99	0.41	45.79	729.43	0.50	0.15	0.00			
				W19-U	0.68	0.99	1.39	41.10	729.43	0.50	1.00	0.07			
				W20-L	0.68	0.99	0.90	52.46	729.43	0.50	0.15	0.01			
				W20-U	0.68	0.99	1.46	44.91	729.43	0.50	1.00	0.08			
				W21-L	0.68	0.99	0.90	52.24	729.43	0.50	0.15	0.01			
				W21-U	0.68	0.99	1.46	44.57	729.43	0.50	1.00	0.08			
				W22-L	0.68	0.99	0.43	47.04	729.43	0.50	0.15	0.00			
				W22-U	0.68	0.99	1.46	40.21	729.43	0.50	1.00	0.07			
				W23	0.68	0.99	3.17	12.73	729.43	0.50	1.00	0.05			
				W24	0.68	0.99	4.31	53.82	729.43	0.50	1.00	0.29			
				W25	0.68	0.99	1.40	60.47	729.43	0.50	1.00	0.10			
				W26	0.68	0.99	3.12	42.02	729.43	0.50	1.00	0.16			
00 GF	R2	Residential	Office	W27-L	0.68	0.99	0.92	47.59	173.50	0.50	0.15	0.03	1.11	-1.00	NO
				W27-U	0.68	0.99	2.43	40.76	173.50	0.50	1.00	0.51			
				W28-L	0.68	0.99	0.87	51.92	173.50	0.50	0.15	0.03			
				W28-U	0.68	0.99	2.30	44.22	173.50	0.50	1.00	0.53			
01st	R1	Residential	Bedroom	W1-L	0.68	0.99	0.63	61.11	79.58	0.50	0.15	0.07	0.93	1.00	NO
				W1-U	0.68	0.99	1.28	59.68	79.58	0.50	1.00	0.86			
01st	R2	Residential	Bedroom	W2-L	0.68	0.99	0.63	60.92	66.30	0.50	0.15	0.08	1.11	1.00	YES
				W2-U	0.68	0.99	1.28	59.53	66.30	0.50	1.00	1.03			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
01st	R3		Residential	LKD	W3-L	0.68	0.99	0.75	68.77	149.08	0.50	0.15	0.05		
					W3-U	0.68	0.99	1.51	66.26	149.08	0.50	1.00	0.60		
					W4-L	0.68	0.99	0.75	69.36	149.08	0.50	0.15	0.05		
					W4-U	0.68	0.99	1.51	66.76	149.08	0.50	1.00	0.61		
					W5	0.68	0.99	1.76	63.95	149.08	0.50	1.00	0.68		
													1.98	2.00	NO
01st	R4		Residential	Bedroom	W6-L	0.68	0.99	0.64	52.43	61.38	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.27	53.19	61.38	0.50	1.00	0.99		
													1.06	1.00	YES
01st	R5		Residential	LKD	W7-L	0.68	0.99	0.75	59.98	110.38	0.50	0.15	0.06		
					W7-U	0.68	0.99	1.50	59.79	110.38	0.50	1.00	0.73		
					W8-L	0.68	0.99	0.75	59.81	110.38	0.50	0.15	0.06		
					W8-U	0.68	0.99	1.50	59.66	110.38	0.50	1.00	0.73		
													1.57	2.00	NO
01st	R6		Residential	Bedroom	W9-L	0.68	0.99	0.64	52.22	63.77	0.50	0.15	0.07		
					W9-U	0.68	0.99	1.27	52.96	63.77	0.50	1.00	0.95		
													1.02	1.00	YES
01st	R7		Residential	LKD	W10-L	0.68	0.99	0.75	60.26	120.57	0.50	0.15	0.05		
					W10-U	0.68	0.99	1.50	59.84	120.57	0.50	1.00	0.67		
					W11-L	0.68	0.99	0.75	59.93	120.57	0.50	0.15	0.05		
					W11-U	0.68	0.99	1.50	59.60	120.57	0.50	1.00	0.67		
													1.44	2.00	NO
01st	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	52.26	63.77	0.50	0.15	0.07		
					W12-U	0.68	0.99	1.27	52.92	63.77	0.50	1.00	0.95		
													1.02	1.00	YES
01st	R9		Residential	LKD	W13-L	0.68	0.99	0.75	60.73	120.31	0.50	0.15	0.05		
					W13-U	0.68	0.99	1.50	60.24	120.31	0.50	1.00	0.68		
					W14-L	0.68	0.99	0.75	60.46	120.31	0.50	0.15	0.05		
					W14-U	0.68	0.99	1.50	60.03	120.31	0.50	1.00	0.67		
													1.45	2.00	NO
01st	R10		Residential	Bedroom	W15-L	0.68	0.99	0.64	53.58	63.92	0.50	0.15	0.07		
					W15-U	0.68	0.99	1.27	54.05	63.92	0.50	1.00	0.97		
													1.04	1.00	YES
01st	R11		Residential	LKD	W16-L	0.68	0.99	0.75	62.41	121.43	0.50	0.15	0.05		
					W16-U	0.68	0.99	1.50	61.74	121.43	0.50	1.00	0.69		
					W17-L	0.68	0.99	0.75	62.13	121.43	0.50	0.15	0.05		
					W17-U	0.68	0.99	1.50	61.55	121.43	0.50	1.00	0.68		
													1.48	2.00	NO
01st	R12		Residential	Bedroom	W18-L	0.68	0.99	0.75	63.06	64.74	0.50	0.15	0.10		
					W18-U	0.68	0.99	1.50	62.30	64.74	0.50	1.00	1.30		
					W19-L	0.68	0.99	0.75	62.76	64.74	0.50	0.15	0.10		
					W19-U	0.68	0.99	1.50	62.03	64.74	0.50	1.00	1.29		
													2.79	1.00	YES
01st	R13		Residential	Bedroom	W20-L	0.68	0.99	0.64	55.61	64.85	0.50	0.15	0.07		
					W20-U	0.68	0.99	1.27	55.64	64.85	0.50	1.00	0.98		

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R1		Residential	Bedroom	W1-L	0.68	0.99	0.64	61.90	77.13	0.50	0.15	1.05	1.00	YES
					W1-U	0.68	0.99	1.22	60.59	77.13	0.50	1.00	0.07	0.86	
02nd	R2		Residential	LKD	W2-L	0.68	0.99	0.75	70.47	114.20	0.50	0.15	0.93	1.00	NO
					W2-U	0.68	0.99	1.44	68.01	114.20	0.50	1.00	0.06	0.77	
					W3-L	0.68	0.99	0.75	70.84	114.20	0.50	0.15	0.06	0.77	
					W3-U	0.68	0.99	1.44	68.28	114.20	0.50	1.00	0.06	0.77	
02nd	R3		Residential	Bedroom	W4-L	0.68	0.99	0.64	61.69	61.36	0.50	0.15	1.67	2.00	NO
					W4-U	0.68	0.99	1.22	60.39	61.36	0.50	1.00	0.09	1.07	
02nd	R4		Residential	LKD	W5-L	0.68	0.99	0.75	70.32	116.39	0.50	0.15	1.16	1.00	YES
					W5-U	0.68	0.99	1.44	67.90	116.39	0.50	1.00	0.06	0.75	
					W6-L	0.68	0.99	0.75	70.60	116.39	0.50	0.15	0.06	0.75	
					W6-U	0.68	0.99	1.44	68.09	116.39	0.50	1.00	0.06	0.76	
02nd	R5		Residential	Bedroom	W7-L	0.68	0.99	0.64	61.48	61.51	0.50	0.15	1.63	2.00	NO
					W7-U	0.68	0.99	1.22	60.27	61.51	0.50	1.00	0.09	1.07	
02nd	R6		Residential	LKD	W8-L	0.68	0.99	0.75	69.84	117.52	0.50	0.15	1.16	1.00	YES
					W8-U	0.68	0.99	1.44	67.61	117.52	0.50	1.00	0.06	0.74	
					W9-L	0.68	0.99	0.75	70.13	117.52	0.50	0.15	0.06	0.75	
					W9-U	0.68	0.99	1.44	67.82	117.52	0.50	1.00	0.06	0.75	
02nd	R7		Residential	LKD	W10-L	0.68	0.99	0.75	69.43	115.75	0.50	0.15	1.61	2.00	NO
					W10-U	0.68	0.99	1.44	67.29	115.75	0.50	1.00	0.06	0.75	
					W11-L	0.68	0.99	0.75	69.75	115.75	0.50	0.15	0.06	0.75	
					W11-U	0.68	0.99	1.44	67.51	115.75	0.50	1.00	0.06	0.75	
02nd	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	60.62	62.85	0.50	0.15	1.63	2.00	NO
					W12-U	0.68	0.99	1.22	59.60	62.85	0.50	1.00	0.08	1.04	
02nd	R9		Residential	LKD	W13-L	0.68	0.99	0.93	48.50	126.59	0.50	0.15	1.12	1.00	YES
					W13-U	0.68	0.99	1.77	47.63	126.59	0.50	1.00	0.05	0.60	
					W14-L	0.68	0.99	1.60	74.68	126.59	0.50	0.15	0.13	0.13	
					W14-U	0.68	0.99	3.05	71.34	126.59	0.50	1.00	1.54	0.04	
					W15-L	0.68	0.99	0.64	59.26	126.59	0.50	0.15	0.04	0.50	
					W15-U	0.68	0.99	1.22	58.28	126.59	0.50	1.00	0.04	0.50	
02nd	R10		Residential	Bedroom	W16-L	0.68	0.99	0.64	59.24	65.12	0.50	0.15	2.86	2.00	YES
					W16-U	0.68	0.99	1.22	58.33	65.12	0.50	1.00	0.08	0.98	
02nd	R11		Residential	Bedroom	W17-L	0.68	0.99	0.64	59.30	79.27	0.50	0.15	1.06	1.00	YES
					W17-U	0.68	0.99	1.22	58.44	79.27	0.50	1.00	0.06	0.81	

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R12		Residential	Bedroom	W18-L	0.68	0.99	0.64	59.27	77.41	0.50	0.15	0.87	1.00	NO
					W18-U	0.68	0.99	1.22	58.30	77.41	0.50	1.00	0.07		
02nd	R13		Residential	LKD	W19-L	0.68	0.99	0.64	58.95	124.30	0.50	0.15	0.89	1.00	NO
					W19-U	0.68	0.99	1.22	58.07	124.30	0.50	1.00	0.04		
					W20-L	0.68	0.99	0.64	58.62	124.30	0.50	0.15	0.51		
					W20-U	0.68	0.99	1.22	57.88	124.30	0.50	1.00	0.04		
													0.51		
02nd	R14		Residential	Bedroom	W21-L	0.68	0.99	0.64	58.46	64.00	0.50	0.15	1.10	2.00	NO
					W21-U	0.68	0.99	1.22	57.84	64.00	0.50	1.00	0.08		
02nd	R15		Residential	Bedroom									0.99		
					W22-L	0.68	0.99	0.64	58.00	80.34	0.50	0.15	1.07	1.00	YES
					W22-U	0.68	0.99	1.22	57.61	80.34	0.50	1.00	0.06		
02nd	R16		Residential	Bedroom									0.78		
													0.85	1.00	NO
					W23-L	0.68	0.99	0.64	57.75	65.31	0.50	0.15	0.08		
					W23-U	0.68	0.99	1.22	57.41	65.31	0.50	1.00	0.96		
													1.04	1.00	YES
02nd	R17		Residential	LKD	W24-L	0.68	0.99	1.70	72.42	125.64	0.50	0.15	0.13		
					W24-U	0.68	0.99	3.24	70.01	125.64	0.50	1.00	1.62		
					W25-L	0.68	0.99	0.93	46.80	125.64	0.50	0.15	0.05		
					W25-U	0.68	0.99	1.77	46.39	125.64	0.50	1.00	0.59		
													2.39	2.00	YES
02nd	R18		Residential	Bedroom	W26-L	0.68	0.99	0.64	58.19	61.31	0.50	0.15	0.08		
					W26-U	0.68	0.99	1.22	57.90	61.31	0.50	1.00	1.03		
02nd	R19		Residential	LKD									1.11	1.00	YES
					W27-L	0.68	0.99	0.75	66.53	110.38	0.50	0.15	0.06		
					W27-U	0.68	0.99	1.44	65.26	110.38	0.50	1.00	0.76		
					W28-L	0.68	0.99	0.75	66.44	110.38	0.50	0.15	0.06		
					W28-U	0.68	0.99	1.44	65.22	110.38	0.50	1.00	0.76		
02nd	R20		Residential	Bedroom									1.65	2.00	NO
					W29-L	0.68	0.99	0.64	58.02	63.77	0.50	0.15	0.08		
					W29-U	0.68	0.99	1.22	57.93	63.77	0.50	1.00	0.99		
													1.07	1.00	YES
02nd	R21		Residential	LKD	W30-L	0.68	0.99	0.75	66.53	120.31	0.50	0.15	0.06		
					W30-U	0.68	0.99	1.44	65.58	120.31	0.50	1.00	0.70		
					W31-L	0.68	0.99	0.75	66.41	120.31	0.50	0.15	0.06		
					W31-U	0.68	0.99	1.44	65.59	120.31	0.50	1.00	0.70		
													1.52	2.00	NO
02nd	R22		Residential	Bedroom	W32-L	0.68	0.99	0.64	58.06	63.77	0.50	0.15	0.08		
					W32-U	0.68	0.99	1.22	58.32	63.77	0.50	1.00	1.00		
02nd	R23		Residential	LKD									1.08	1.00	YES
					W33-L	0.68	0.99	0.75	67.03	120.84	0.50	0.15	0.06		
					W33-U	0.68	0.99	1.44	65.94	120.84	0.50	1.00	0.71		
					W34-L	0.68	0.99	0.75	66.92	120.84	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R24	Residential	Bedroom		W34-U	0.68	0.99	1.44	65.83	120.84	0.50	1.00	0.70	2.00	NO
					W35-L	0.68	0.99	0.64	58.83	63.77	0.50	0.15	0.08		
					W35-U	0.68	0.99	1.22	58.39	63.77	0.50	1.00	1.00		
													1.08		
02nd	R25	Residential	LKD		W36-L	0.68	0.99	0.75	67.79	133.29	0.50	0.15	0.05	1.00	YES
					W36-U	0.68	0.99	1.44	66.11	133.29	0.50	1.00	0.64		
					W37-L	0.68	0.99	0.75	67.64	133.29	0.50	0.15	0.05		
					W37-U	0.68	0.99	1.44	66.06	133.29	0.50	1.00	0.64		
03rd	R1	Residential	LKD										1.38	2.00	NO
					W1-L	0.68	0.99	1.27	28.04	109.18	0.50	0.15	0.04		
					W1-U	0.68	0.99	3.88	22.95	109.18	0.50	1.00	0.73		
					W2-L	0.68	0.99	1.27	27.51	109.18	0.50	0.15	0.04		
					W2-U	0.68	0.99	3.88	22.90	109.18	0.50	1.00	0.73		
					W3-L	0.68	0.99	1.27	23.58	109.18	0.50	0.15	0.04		
					W3-U	0.68	0.99	3.88	21.62	109.18	0.50	1.00	0.69		
					W4-L	0.68	0.99	0.97	15.39	109.18	0.50	0.15	0.02		
					W4-U	0.68	0.99	2.96	19.84	109.18	0.50	1.00	0.48		
					W5-L	0.68	0.99	0.15	2.01	109.18	0.50	0.15	0.00		
					W5-U	0.68	0.99	0.45	7.67	109.18	0.50	1.00	0.03		
					W6-L	0.68	0.99	0.14	5.95	109.18	0.50	0.15	0.00		
					W6-U	0.68	0.99	0.45	6.03	109.18	0.50	1.00	0.02		
					W7-L	0.68	0.99	0.95	45.93	109.18	0.50	0.15	0.05		
					W7-U	0.68	0.99	2.96	61.98	109.18	0.50	1.00	1.51		
					W8-L	0.68	0.99	1.24	56.04	109.18	0.50	0.15	0.09		
					W8-U	0.68	0.99	3.88	62.34	109.18	0.50	1.00	1.99		
					W9-L	0.68	0.99	0.70	49.28	109.18	0.50	0.15	0.04		
					W9-U	0.68	0.99	2.20	53.81	109.18	0.50	1.00	0.97		
03rd	R2	Residential	Bedroom										7.49	2.00	YES
					W10-L	0.68	0.99	0.70	49.10	48.94	0.50	0.15	0.10		
					W10-U	0.68	0.99	2.20	52.32	48.94	0.50	1.00	2.11		
					W11-L	0.68	0.99	1.24	58.30	48.94	0.50	0.15	0.20		
03rd	R3	Residential	Bedroom		W12-L	0.68	0.99	1.24	58.48	56.34	0.50	0.15	0.17	1.00	YES
					W12-U	0.68	0.99	3.88	62.74	56.34	0.50	1.00	3.88		
					W13-L	0.68	0.99	0.70	49.71	56.34	0.50	0.15	0.08		
					W13-U	0.68	0.99	2.20	53.92	56.34	0.50	1.00	1.89		
03rd	R4	Residential	Bedroom										6.03	1.00	YES
					W14-L	0.68	0.99	0.70	49.10	61.36	0.50	0.15	0.08		
					W14-U	0.68	0.99	2.20	52.17	61.36	0.50	1.00	1.68		
					W15-L	0.68	0.99	1.24	58.30	61.36	0.50	0.15	0.16		
03rd	R5	Residential	LKD		W15-U	0.68	0.99	3.88	62.22	61.36	0.50	1.00	3.53	1.00	YES
													5.45		
					W16-L	0.68	0.99	1.24	58.49	142.83	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Existing Scenario
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	3.88	62.61	142.83	0.50	1.00	1.53		
					W17-L	0.68	0.99	0.70	49.71	142.83	0.50	0.15	0.03		
					W17-U	0.68	0.99	2.20	53.81	142.83	0.50	1.00	0.74		
					W18-L	0.68	0.99	0.70	49.08	142.83	0.50	0.15	0.03		
					W18-U	0.68	0.99	2.20	52.03	142.83	0.50	1.00	0.72		
					W19-L	0.68	0.99	1.24	58.24	142.83	0.50	0.15	0.07		
					W19-U	0.68	0.99	3.88	61.97	142.83	0.50	1.00	1.51		
													4.70	2.00	YES
03rd	R6	Residential	LKD	W20-L	0.68	0.99	1.24	58.35	137.66	0.50	0.15	0.07			
				W20-U	0.68	0.99	3.88	62.01	137.66	0.50	1.00	1.57			
				W21-L	0.68	0.99	0.70	49.66	137.66	0.50	0.15	0.03			
				W21-U	0.68	0.99	2.19	53.48	137.66	0.50	1.00	0.77			
				W22-L	0.68	0.99	0.70	49.18	137.66	0.50	0.15	0.03			
				W22-U	0.68	0.99	2.20	52.14	137.66	0.50	1.00	0.75			
				W23-L	0.68	0.99	1.24	58.33	137.66	0.50	0.15	0.07			
W23-U	0.68	0.99	3.88	62.31	137.66	0.50	1.00	1.58							
													4.87	2.00	YES
03rd	R7	Residential	Bedroom	W24-L	0.68	0.99	1.24	58.11	67.96	0.50	0.15	0.14			
				W24-U	0.68	0.99	3.88	62.05	67.96	0.50	1.00	3.18			
				W25-L	0.68	0.99	0.70	49.19	67.96	0.50	0.15	0.07			
				W25-U	0.68	0.99	2.20	53.21	67.96	0.50	1.00	1.55			
													4.94	1.00	YES
03rd	R8	Residential	Bedroom	W26-L	0.68	0.99	0.98	50.60	68.57	0.50	0.15	0.10			
				W26-U	0.68	0.99	3.16	55.42	68.57	0.50	1.00	2.30			
				W27-L	0.68	0.99	1.21	57.84	68.57	0.50	0.15	0.14			
				W27-U	0.68	0.99	3.90	62.63	68.57	0.50	1.00	3.20			
													5.73	1.00	YES
03rd	R9	Residential	LKD	W28-L	0.68	0.99	1.21	59.13	142.17	0.50	0.15	0.07			
				W28-U	0.68	0.99	3.90	63.13	142.17	0.50	1.00	1.56			
				W29-L	0.68	0.99	1.21	58.75	142.17	0.50	0.15	0.07			
				W29-U	0.68	0.99	3.90	62.63	142.17	0.50	1.00	1.55			
				W30-L	0.68	0.99	1.21	56.21	142.17	0.50	0.15	0.06			
				W30-U	0.68	0.99	3.90	60.57	142.17	0.50	1.00	1.49			
				W31-L	0.68	0.99	0.45	44.56	142.17	0.50	0.15	0.02			
W31-U	0.68	0.99	1.46	48.55	142.17	0.50	1.00	0.45							
													5.26	2.00	YES
03rd	R10	Residential	LKD	W32-L	0.68	0.99	0.54	47.12	138.93	0.50	0.15	0.02			
				W32-U	0.68	0.99	1.70	50.88	138.93	0.50	1.00	0.56			
				W33-L	0.68	0.99	1.24	56.68	138.93	0.50	0.15	0.07			
				W33-U	0.68	0.99	3.88	61.16	138.93	0.50	1.00	1.53			
				W34-L	0.68	0.99	1.24	58.70	138.93	0.50	0.15	0.07			
				W34-U	0.68	0.99	3.88	62.92	138.93	0.50	1.00	1.58			
				W35-L	0.68	0.99	1.24	58.91	138.93	0.50	0.15	0.07			
W35-U	0.68	0.99	3.88	63.20	138.93	0.50	1.00	1.58							
													5.49	2.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R11		Residential	Bedroom	W36-L	0.68	0.99	1.24	56.53	62.59	0.50	0.15	0.15	1.00	YES
					W36-U	0.68	0.99	3.88	61.04	62.59	0.50	1.00	3.40		
					W37-L	0.68	0.99	0.58	46.34	62.59	0.50	0.15	0.06		
					W37-U	0.68	0.99	1.83	50.30	62.59	0.50	1.00	1.32		
03rd	R12		Residential	Bedroom	W38-L	0.68	0.99	0.78	49.16	65.95	0.50	0.15	0.08	1.00	YES
					W38-U	0.68	0.99	2.44	52.65	65.95	0.50	1.00	1.75		
					W39-L	0.68	0.99	1.24	57.25	65.95	0.50	0.15	0.15		
					W39-U	0.68	0.99	3.88	61.60	65.95	0.50	1.00	3.25		
03rd	R13		Residential	LKD	W40-L	0.68	0.99	1.24	58.91	141.83	0.50	0.15	0.07	2.00	YES
					W40-U	0.68	0.99	3.88	62.88	141.83	0.50	1.00	1.54		
					W41-L	0.68	0.99	1.24	58.69	141.83	0.50	0.15	0.07		
					W41-U	0.68	0.99	3.88	62.91	141.83	0.50	1.00	1.54		
					W42-L	0.68	0.99	1.24	56.69	141.83	0.50	0.15	0.07		
					W42-U	0.68	0.99	3.88	61.64	141.83	0.50	1.00	1.51		
					W43-L	0.68	0.99	0.70	47.09	141.83	0.50	0.15	0.03		
					W43-U	0.68	0.99	2.20	51.97	141.83	0.50	1.00	0.72		
03rd	R14		Residential	Bedroom	W44-L	0.68	0.99	0.72	48.42	46.04	0.50	0.15	0.10	1.00	YES
					W44-U	0.68	0.99	2.26	52.80	46.04	0.50	1.00	2.33		
					W45-L	0.68	0.99	1.24	57.31	46.04	0.50	0.15	0.21		
					W45-U	0.68	0.99	3.88	61.82	46.04	0.50	1.00	4.67		
03rd	R15		Residential	LKD	W46-L	0.68	0.99	1.24	57.56	89.76	0.50	0.15	0.11	2.00	YES
					W46-U	0.68	0.99	3.88	62.05	89.76	0.50	1.00	2.41		
					W47-L	0.68	0.99	0.72	48.73	89.76	0.50	0.15	0.05		
					W47-U	0.68	0.99	2.26	52.68	89.76	0.50	1.00	1.19		
03rd	R16		Residential	Bedroom	W48-L	0.68	0.99	0.72	49.19	59.61	0.50	0.15	0.08	1.00	YES
					W48-U	0.68	0.99	2.26	53.08	59.61	0.50	1.00	1.81		
					W49-L	0.68	0.99	1.24	57.65	59.61	0.50	0.15	0.16		
					W49-U	0.68	0.99	3.88	61.95	59.61	0.50	1.00	3.62		
03rd	R17		Residential	LKD	W50-L	0.68	0.99	1.24	57.51	83.41	0.50	0.15	0.12	2.00	YES
					W50-U	0.68	0.99	3.88	61.75	83.41	0.50	1.00	2.58		
					W51-L	0.68	0.99	0.72	48.65	83.41	0.50	0.15	0.06		
					W51-U	0.68	0.99	2.26	52.48	83.41	0.50	1.00	1.28		
03rd	R18		Residential	Bedroom	W52-L	0.68	0.99	0.72	49.26	59.27	0.50	0.15	0.08	1.00	YES
					W52-U	0.68	0.99	2.26	53.47	59.27	0.50	1.00	1.83		
					W53-L	0.68	0.99	1.24	57.74	59.27	0.50	0.15	0.16		
					W53-U	0.68	0.99	3.88	62.35	59.27	0.50	1.00	3.66		
03rd	R19		Residential	Bedroom	W54-L	0.68	0.99	1.24	57.59	50.06	0.50	0.15	0.19		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R20	Residential	LKD	W54-U	0.68	0.99	3.88	62.14	50.06	0.50	1.00	4.32			
				W55-L	0.68	0.99	0.72	48.69	50.06	0.50	0.15	0.09			
				W55-U	0.68	0.99	2.26	52.59	50.06	0.50	1.00	2.14			
													6.74	1.00	YES
				W56-L	0.68	0.99	0.70	48.91	103.83	0.50	0.15	0.04			
				W56-U	0.68	0.99	2.20	52.98	103.83	0.50	1.00	1.01			
				W57-L	0.68	0.99	1.24	57.53	103.83	0.50	0.15	0.09			
				W57-U	0.68	0.99	3.88	62.01	103.83	0.50	1.00	2.08			
				W58-L	0.68	0.99	0.75	58.61	103.83	0.50	0.15	0.06			
				W58-U	0.68	0.99	2.34	63.04	103.83	0.50	1.00	1.28			
				W59-L	0.68	0.99	0.14	13.20	103.83	0.50	0.15	0.00			
				W59-U	0.68	0.99	0.45	11.30	103.83	0.50	1.00	0.04			
				W60-L	0.68	0.99	0.17	22.67	103.83	0.50	0.15	0.00			
				W60-U	0.68	0.99	0.51	21.77	103.83	0.50	1.00	0.10			
				W61-L	0.68	0.99	0.97	32.79	103.83	0.50	0.15	0.04			
				W61-U	0.68	0.99	2.96	30.43	103.83	0.50	1.00	0.78			
				W62-L	0.68	0.99	1.27	27.94	103.83	0.50	0.15	0.05			
				W62-U	0.68	0.99	3.88	24.45	103.83	0.50	1.00	0.82			
				W63-L	0.68	0.99	1.27	25.20	103.83	0.50	0.15	0.04			
				W63-U	0.68	0.99	3.87	22.07	103.83	0.50	1.00	0.74			
				W64-L	0.68	0.99	1.27	25.42	103.83	0.50	0.15	0.04			
				W64-U	0.68	0.99	3.88	22.83	103.83	0.50	1.00	0.77			
													7.98	2.00	YES
04th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	33.33	125.20	0.50	0.15	0.06			
				W1-U	0.68	0.99	3.19	25.97	125.20	0.50	1.00	0.59			
				W2-L	0.68	0.99	1.93	35.92	125.20	0.50	0.15	0.07			
				W2-U	0.68	0.99	3.57	26.47	125.20	0.50	1.00	0.68			
				W3-L	0.68	0.99	1.72	32.95	125.20	0.50	0.15	0.06			
				W3-U	0.68	0.99	3.19	22.96	125.20	0.50	1.00	0.53			
				W4-L	0.68	0.99	0.70	74.17	125.20	0.50	0.15	0.06			
				W4-U	0.68	0.99	1.29	73.87	125.20	0.50	1.00	0.68			
													2.74	2.00	YES
04th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	74.13	66.26	0.50	0.15	0.11			
				W5-U	0.68	0.99	1.29	73.83	66.26	0.50	1.00	1.29			
													1.40	1.00	YES
04th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	74.07	66.49	0.50	0.15	0.10			
				W6-U	0.68	0.99	1.29	73.77	66.49	0.50	1.00	1.29			
													1.39	1.00	YES
04th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	77.80	104.32	0.50	0.15	0.07			
				W7-U	0.68	0.99	1.29	77.03	104.32	0.50	1.00	0.86			
				W8-L	0.68	0.99	1.36	80.68	104.32	0.50	0.15	0.14			
				W8-U	0.68	0.99	2.52	79.69	104.32	0.50	1.00	1.73			
													2.80	2.00	YES
04th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	73.92	65.09	0.50	0.15	0.11			
				W9-U	0.68	0.99	1.29	73.63	65.09	0.50	1.00	1.31			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	77.64	121.62	0.50	0.15	1.42	1.00	YES
					W10-U	0.68	0.99	1.29	76.87	121.62	0.50	1.00	0.06		
					W11-L	0.68	0.99	1.36	80.57	121.62	0.50	0.15	0.73		
					W11-U	0.68	0.99	2.52	79.58	121.62	0.50	1.00	0.12		
04th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	73.82	56.77	0.50	0.15	1.48	2.00	YES
					W12-U	0.68	0.99	1.29	73.53	56.77	0.50	1.00	2.40		
													0.12		
													1.50		
04th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	73.71	56.45	0.50	0.15	1.63	1.00	YES
					W13-U	0.68	0.99	1.29	73.42	56.45	0.50	1.00	0.12		
													1.51		
													1.63		
04th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	77.43	119.79	0.50	0.15	0.06		
					W14-U	0.68	0.99	1.29	76.67	119.79	0.50	1.00	0.74		
					W15-L	0.68	0.99	1.36	80.30	119.79	0.50	0.15	0.12		
					W15-U	0.68	0.99	2.52	79.33	119.79	0.50	1.00	1.50		
04th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	73.52	59.49	0.50	0.15	2.43	2.00	YES
					W16-U	0.68	0.99	1.29	73.25	59.49	0.50	1.00	0.12		
					W17-L	0.68	0.99	0.36	35.60	59.49	0.50	0.15	1.43		
					W17-U	0.68	0.99	0.67	35.53	59.49	0.50	1.00	0.03		
04th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	38.13	116.88	0.50	0.15	0.36	1.00	YES
					W18-U	0.68	0.99	0.67	38.04	116.88	0.50	1.00	0.02		
					W19-L	0.68	0.99	0.70	77.03	116.88	0.50	0.15	0.20		
					W19-U	0.68	0.99	1.29	76.30	116.88	0.50	1.00	0.06		
04th	R12		Residential	Bedroom	W20-L	0.68	0.99	1.36	79.91	116.88	0.50	0.15	0.76		
					W20-U	0.68	0.99	2.52	78.96	116.88	0.50	1.00	0.13		
													1.53		
													2.69	2.00	YES
04th	R13		Residential	Bedroom	W21-L	0.68	0.99	0.70	73.21	55.29	0.50	0.15	0.12		
					W21-U	0.68	0.99	1.29	72.95	55.29	0.50	1.00	1.53		
													1.66	1.00	YES
													0.10		
04th	R14		Residential	Bedroom	W22-L	0.68	0.99	0.70	73.10	69.09	0.50	0.15	1.22		
					W22-U	0.68	0.99	1.29	72.86	69.09	0.50	1.00	1.32	1.00	YES
													0.10		
													1.25		
04th	R15		Residential	LKD	W23-L	0.68	0.99	0.70	73.04	67.42	0.50	0.15	1.35	1.00	YES
					W23-U	0.68	0.99	1.29	72.80	67.42	0.50	1.00	0.06		
													0.76		
													0.13		
04th	R16		Residential	Bedroom	W24-L	0.68	0.99	0.70	76.72	116.39	0.50	0.15	1.53		
					W24-U	0.68	0.99	1.29	76.01	116.39	0.50	1.00	2.47	2.00	YES
					W25-L	0.68	0.99	1.36	79.57	116.39	0.50	0.15	0.12		
					W25-U	0.68	0.99	2.52	78.64	116.39	0.50	1.00	1.53		
04th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	72.96	55.28	0.50	0.15	0.12		
					W26-U	0.68	0.99	1.29	72.72	55.28	0.50	1.00	1.53		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	72.90	69.08	0.50	0.15	1.65	1.00	YES
					W27-U	0.68	0.99	1.29	72.66	69.08	0.50	1.00	0.10		
04th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	72.88	55.32	0.50	0.15	1.32	1.00	YES
					W28-U	0.68	0.99	1.29	72.64	55.32	0.50	1.00	0.12		
04th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	76.63	117.45	0.50	0.15	1.65	1.00	YES
					W29-U	0.68	0.99	1.29	75.93	117.45	0.50	1.00	0.06		
04th	R19		Residential	LKD	W30-L	0.68	0.99	1.36	79.51	117.45	0.50	0.15	0.75		
					W30-U	0.68	0.99	2.52	78.59	117.45	0.50	1.00	0.12		
04th	R19		Residential	LKD	W31-L	0.68	0.99	0.36	35.85	117.45	0.50	0.15	1.51		
					W31-U	0.68	0.99	0.67	35.80	117.45	0.50	1.00	0.01		
04th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	38.07	58.24	0.50	0.15	0.18		
					W32-U	0.68	0.99	0.67	37.96	58.24	0.50	1.00	2.65	2.00	YES
04th	R20		Residential	Bedroom	W33-L	0.68	0.99	0.70	72.98	58.24	0.50	0.15	0.03		
					W33-U	0.68	0.99	1.29	72.75	58.24	0.50	1.00	0.39		
04th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	76.73	117.07	0.50	0.15	1.99	1.00	YES
					W34-U	0.68	0.99	1.29	76.03	117.07	0.50	1.00	0.12		
04th	R21		Residential	LKD	W35-L	0.68	0.99	1.36	79.69	117.07	0.50	0.15	0.75		
					W35-U	0.68	0.99	2.52	78.76	117.07	0.50	1.00	0.12		
04th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	73.07	59.45	0.50	0.15	2.46	2.00	YES
					W36-U	0.68	0.99	1.29	72.84	59.45	0.50	1.00	0.12		
04th	R22		Residential	Bedroom	W37-L	0.68	0.99	0.70	73.10	59.45	0.50	0.15	1.42		
					W37-U	0.68	0.99	1.29	72.87	59.45	0.50	1.00	0.12		
04th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	73.16	57.18	0.50	0.15	3.08	1.00	YES
					W38-U	0.68	0.99	1.29	72.93	57.18	0.50	1.00	1.42		
04th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	76.95	119.55	0.50	0.15	1.60	1.00	YES
					W39-U	0.68	0.99	1.29	76.24	119.55	0.50	1.00	0.12		
04th	R24		Residential	LKD	W40-L	0.68	0.99	1.36	79.90	119.55	0.50	0.15	0.06		
					W40-U	0.68	0.99	2.52	78.97	119.55	0.50	1.00	0.74		
04th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	73.26	69.12	0.50	0.15	2.42	2.00	YES
					W41-U	0.68	0.99	1.29	73.03	69.12	0.50	1.00	0.12		
04th	R25		Residential	Bedroom	W42-L	0.68	0.99	0.70	73.27	69.12	0.50	0.15	1.23		
					W42-U	0.68	0.99	1.29	73.05	69.12	0.50	1.00	0.10		
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	73.34	66.25	0.50	0.15	2.65	1.00	YES
					W43-U	0.68	0.99	1.29	73.11	66.25	0.50	1.00	1.28		
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	73.34	66.25	0.50	0.15	1.38	1.00	YES
					W43-U	0.68	0.99	1.29	73.11	66.25	0.50	1.00	1.28		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	73.36	56.67	0.50	0.15	0.12	1.50	
					W44-U	0.68	0.99	1.29	73.14	56.67	0.50	1.00	1.50		
04th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	41.47	151.85	0.50	0.15	0.06	2.00	YES
					W45-U	0.68	0.99	3.18	31.22	151.85	0.50	1.00	0.59		
					W46-L	0.68	0.99	1.93	44.42	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	34.14	151.85	0.50	1.00	0.72		
					W47-L	0.68	0.99	1.72	39.70	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	29.83	151.85	0.50	1.00	0.56		
					2.07	2.00	YES								
05th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	34.00	125.20	0.50	0.15	0.06	2.00	YES
					W1-U	0.68	0.99	3.19	26.47	125.20	0.50	1.00	0.61		
					W2-L	0.68	0.99	1.93	36.71	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	27.12	125.20	0.50	1.00	0.69		
					W3-L	0.68	0.99	1.72	33.84	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	23.79	125.20	0.50	1.00	0.54		
					W4-L	0.68	0.99	0.70	74.72	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	74.41	125.20	0.50	1.00	0.69		
2.79	2.00	YES													
05th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	74.69	66.26	0.50	0.15	0.11	1.00	YES
					W5-U	0.68	0.99	1.29	74.37	66.26	0.50	1.00	1.30		
05th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	74.63	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	74.31	66.49	0.50	1.00	1.30		
05th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	78.41	104.32	0.50	0.15	0.07	2.00	YES
					W7-U	0.68	0.99	1.29	77.62	104.32	0.50	1.00	0.86		
					W8-L	0.68	0.99	1.36	81.36	104.32	0.50	0.15	0.14		
					W8-U	0.68	0.99	2.52	80.33	104.32	0.50	1.00	1.74		
2.82	2.00	YES													
05th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	74.49	65.09	0.50	0.15	0.11	1.00	YES
					W9-U	0.68	0.99	1.29	74.18	65.09	0.50	1.00	1.32		
05th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	78.26	121.62	0.50	0.15	0.06	2.00	YES
					W10-U	0.68	0.99	1.29	77.47	121.62	0.50	1.00	0.74		
					W11-L	0.68	0.99	1.36	81.25	121.62	0.50	0.15	0.12		
					W11-U	0.68	0.99	2.52	80.23	121.62	0.50	1.00	1.49		
2.42	2.00	YES													
05th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	74.39	56.77	0.50	0.15	0.12	1.00	YES
					W12-U	0.68	0.99	1.29	74.08	56.77	0.50	1.00	1.51		
05th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	74.29	56.45	0.50	0.15	0.12	1.00	YES
					W13-U	0.68	0.99	1.29	73.98	56.45	0.50	1.00	1.52		
1.64	1.00	YES													
05th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	78.06	119.79	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	77.29	119.79	0.50	1.00	0.75	2.00	YES
					W15-L	0.68	0.99	1.36	80.99	119.79	0.50	0.15	0.12		
					W15-U	0.68	0.99	2.52	79.99	119.79	0.50	1.00	1.51		
05th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	74.11	59.49	0.50	0.15	0.12	1.00	YES
					W16-U	0.68	0.99	1.29	73.82	59.49	0.50	1.00	1.44		
					W17-L	0.68	0.99	0.36	35.71	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.61	59.49	0.50	1.00	0.36		
													1.95		
05th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	38.18	116.88	0.50	0.15	0.02	2.00	YES
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
					W19-L	0.68	0.99	0.70	77.71	116.88	0.50	0.15	0.06		
					W19-U	0.68	0.99	1.29	76.96	116.88	0.50	1.00	0.76		
					W20-L	0.68	0.99	1.36	80.65	116.88	0.50	0.15	0.13		
					W20-U	0.68	0.99	2.52	79.67	116.88	0.50	1.00	1.54		
05th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	73.83	55.29	0.50	0.15	0.13	1.00	YES
					W21-U	0.68	0.99	1.29	73.57	55.29	0.50	1.00	1.54		
													1.67		
05th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	73.75	69.09	0.50	0.15	0.10	1.00	YES
					W22-U	0.68	0.99	1.29	73.49	69.09	0.50	1.00	1.23		
													1.33		
05th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	73.69	67.42	0.50	0.15	0.10	1.00	YES
					W23-U	0.68	0.99	1.29	73.44	67.42	0.50	1.00	1.26		
													1.37		
05th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	77.44	116.39	0.50	0.15	0.06	2.00	YES
					W24-U	0.68	0.99	1.29	76.71	116.39	0.50	1.00	0.76		
					W25-L	0.68	0.99	1.36	80.35	116.39	0.50	0.15	0.13		
					W25-U	0.68	0.99	2.52	79.40	116.39	0.50	1.00	1.54		
													2.50		
05th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	73.64	55.28	0.50	0.15	0.13	1.00	YES
					W26-U	0.68	0.99	1.29	73.38	55.28	0.50	1.00	1.54		
													1.67		
05th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	73.59	69.08	0.50	0.15	0.10	1.00	YES
					W27-U	0.68	0.99	1.29	73.34	69.08	0.50	1.00	1.23		
													1.33		
05th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	73.57	55.32	0.50	0.15	0.12	1.00	YES
					W28-U	0.68	0.99	1.29	73.32	55.32	0.50	1.00	1.54		
													1.66		
05th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	77.38	117.45	0.50	0.15	0.06	1.00	
					W29-U	0.68	0.99	1.29	76.66	117.45	0.50	1.00	0.76		
					W30-L	0.68	0.99	1.36	80.31	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	79.36	117.45	0.50	1.00	1.53		
					W31-L	0.68	0.99	0.36	36.10	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	36.08	117.45	0.50	1.00	0.18		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
05th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	38.14	58.24	0.50	0.15	2.67	2.00	YES
					W32-U	0.68	0.99	0.67	37.99	58.24	0.50	1.00	0.03		
					W33-L	0.68	0.99	0.70	73.67	58.24	0.50	0.15	0.39		
					W33-U	0.68	0.99	1.29	73.42	58.24	0.50	1.00	0.12		
05th	R21		Residential	LKD									1.46		
													2.01	1.00	YES
					W34-L	0.68	0.99	0.70	77.48	117.07	0.50	0.15	0.06		
					W34-U	0.68	0.99	1.29	76.75	117.07	0.50	1.00	0.76		
05th	R22		Residential	Bedroom	W35-L	0.68	0.99	1.36	80.49	117.07	0.50	0.15	0.13		
					W35-U	0.68	0.99	2.52	79.53	117.07	0.50	1.00	1.54		
													2.49	2.00	YES
					W36-L	0.68	0.99	0.70	73.76	59.45	0.50	0.15	0.12		
05th	R23		Residential	Bedroom	W36-U	0.68	0.99	1.29	73.51	59.45	0.50	1.00	1.43		
					W37-L	0.68	0.99	0.70	73.79	59.45	0.50	0.15	0.12		
					W37-U	0.68	0.99	1.29	73.54	59.45	0.50	1.00	1.44		
													3.10	1.00	YES
05th	R24		Residential	LKD	W38-L	0.68	0.99	0.70	73.86	57.18	0.50	0.15	0.12		
					W38-U	0.68	0.99	1.29	73.61	57.18	0.50	1.00	1.49		
													1.61	1.00	YES
					W39-L	0.68	0.99	0.70	77.70	119.55	0.50	0.15	0.06		
05th	R25		Residential	Bedroom	W39-U	0.68	0.99	1.29	76.96	119.55	0.50	1.00	0.75		
					W40-L	0.68	0.99	1.36	80.71	119.55	0.50	0.15	0.12		
					W40-U	0.68	0.99	2.52	79.74	119.55	0.50	1.00	1.51		
													2.44	2.00	YES
05th	R26		Residential	Bedroom	W41-L	0.68	0.99	0.70	73.96	69.12	0.50	0.15	0.10		
					W41-U	0.68	0.99	1.29	73.70	69.12	0.50	1.00	1.24		
					W42-L	0.68	0.99	0.70	73.97	69.12	0.50	0.15	0.10		
					W42-U	0.68	0.99	1.29	73.72	69.12	0.50	1.00	1.24		
05th	R27		Residential	Bedroom									2.68	1.00	YES
					W43-L	0.68	0.99	0.70	74.05	66.25	0.50	0.15	0.10		
					W43-U	0.68	0.99	1.29	73.79	66.25	0.50	1.00	1.29		
													1.40	1.00	YES
05th	R28		Residential	LKD	W44-L	0.68	0.99	0.70	74.08	56.67	0.50	0.15	0.12		
					W44-U	0.68	0.99	1.29	73.83	56.67	0.50	1.00	1.51		
													1.63	1.00	YES
					W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
05th	R28		Residential	LKD	W45-U	0.68	0.99	3.18	32.75	151.85	0.50	1.00	0.62		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	35.67	151.85	0.50	1.00	0.75		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	31.58	151.85	0.50	1.00	0.60		
													2.17	2.00	YES
06th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	34.69	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	26.87	125.20	0.50	1.00	0.61		
					W2-L	0.68	0.99	1.93	37.50	125.20	0.50	0.15	0.08		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W2-U	0.68	0.99	3.57	27.70	125.20	0.50	1.00	0.71		
					W3-L	0.68	0.99	1.72	34.71	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	24.52	125.20	0.50	1.00	0.56		
					W4-L	0.68	0.99	0.70	75.25	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	74.91	125.20	0.50	1.00	0.69		
06th	R2		Residential	Bedroom									2.84	2.00	YES
					W5-L	0.68	0.99	0.70	75.21	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	74.88	66.26	0.50	1.00	1.31		
06th	R3		Residential	Bedroom									1.42	1.00	YES
					W6-L	0.68	0.99	0.70	75.15	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	74.83	66.49	0.50	1.00	1.31		
06th	R4		Residential	LKD									1.41	1.00	YES
					W7-L	0.68	0.99	0.70	78.99	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	78.17	104.32	0.50	1.00	0.87		
06th	R5		Residential	Bedroom									0.14		
					W8-L	0.68	0.99	1.36	81.98	104.32	0.50	0.15	0.14		
					W8-U	0.68	0.99	2.52	80.92	104.32	0.50	1.00	1.76		
06th	R6		Residential	LKD									2.84	2.00	YES
					W9-L	0.68	0.99	0.70	75.03	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	74.70	65.09	0.50	1.00	1.33		
06th	R7		Residential	Bedroom									1.44	1.00	YES
					W10-L	0.68	0.99	0.70	78.85	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	78.04	121.62	0.50	1.00	0.74		
06th	R8		Residential	Bedroom									0.12		
					W11-L	0.68	0.99	1.36	81.88	121.62	0.50	0.15	0.12		
					W11-U	0.68	0.99	2.52	80.82	121.62	0.50	1.00	1.50		
06th	R9		Residential	LKD									2.43	2.00	YES
					W12-L	0.68	0.99	0.70	74.93	56.77	0.50	0.15	0.12		
					W12-U	0.68	0.99	1.29	74.62	56.77	0.50	1.00	1.53		
06th	R10		Residential	Bedroom									1.65	1.00	YES
					W13-L	0.68	0.99	0.70	74.84	56.45	0.50	0.15	0.12		
					W13-U	0.68	0.99	1.29	74.53	56.45	0.50	1.00	1.53		
06th	R11		Residential	LKD									1.66	1.00	YES
					W14-L	0.68	0.99	0.70	78.67	119.79	0.50	0.15	0.06		
					W14-U	0.68	0.99	1.29	77.87	119.79	0.50	1.00	0.75		
06th	R12		Residential	Bedroom									0.12		
					W15-L	0.68	0.99	1.36	81.65	119.79	0.50	0.15	0.12		
					W15-U	0.68	0.99	2.52	80.61	119.79	0.50	1.00	1.52		
06th	R13		Residential	Bedroom									2.46	2.00	YES
					W16-L	0.68	0.99	0.70	74.68	59.49	0.50	0.15	0.12		
					W16-U	0.68	0.99	1.29	74.37	59.49	0.50	1.00	1.45		
06th	R14		Residential	LKD									0.03		
					W17-L	0.68	0.99	0.36	35.79	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.68	59.49	0.50	1.00	0.36		
06th	R15		Residential	Bedroom									1.96	1.00	YES
					W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
06th	R16		Residential	LKD									0.06		
					W19-L	0.68	0.99	0.70	78.36	116.88	0.50	0.15	0.06		
					W19-U	0.68	0.99	1.29	77.58	116.88	0.50	1.00	0.77		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	1.36	81.35	116.88	0.50	0.15	0.13		
					W20-U	0.68	0.99	2.52	80.33	116.88	0.50	1.00	1.56		
06th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	74.45	55.29	0.50	0.15	0.13		
					W21-U	0.68	0.99	1.29	74.15	55.29	0.50	1.00	1.56		
													2.73	2.00	YES
06th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	74.37	69.09	0.50	0.15	0.10		
					W22-U	0.68	0.99	1.29	74.08	69.09	0.50	1.00	1.24		
													1.35	1.00	YES
06th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	74.33	67.42	0.50	0.15	0.10		
					W23-U	0.68	0.99	1.29	74.04	67.42	0.50	1.00	1.27		
													1.38	1.00	YES
06th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	78.14	116.39	0.50	0.15	0.06		
					W24-U	0.68	0.99	1.29	77.38	116.39	0.50	1.00	0.77		
													0.13		
													1.56		
													2.52	2.00	YES
06th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	74.29	55.28	0.50	0.15	0.13		
					W26-U	0.68	0.99	1.29	74.01	55.28	0.50	1.00	1.55		
													1.68	1.00	YES
06th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	74.25	69.08	0.50	0.15	0.10		
					W27-U	0.68	0.99	1.29	73.99	69.08	0.50	1.00	1.24		
													1.34	1.00	YES
06th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	74.23	55.32	0.50	0.15	0.13		
					W28-U	0.68	0.99	1.29	73.96	55.32	0.50	1.00	1.55		
													1.68	1.00	YES
06th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	78.10	117.45	0.50	0.15	0.06		
					W29-U	0.68	0.99	1.29	77.35	117.45	0.50	1.00	0.76		
													0.13		
													1.54		
													0.02		
													0.19		
													2.70	2.00	YES
06th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	38.16	58.24	0.50	0.15	0.03		
					W32-U	0.68	0.99	0.67	38.01	58.24	0.50	1.00	0.39		
													0.12		
													1.48		
													2.02	1.00	YES
06th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	78.20	117.07	0.50	0.15	0.06		
					W34-U	0.68	0.99	1.29	77.44	117.07	0.50	1.00	0.77		
													0.13		
													1.55		
													2.51	2.00	YES
06th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	74.42	59.45	0.50	0.15	0.12		
					W36-U	0.68	0.99	1.29	74.14	59.45	0.50	1.00	1.45		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W37-L	0.68	0.99	0.70	74.45	59.45	0.50	0.15	0.12		
					W37-U	0.68	0.99	1.29	74.18	59.45	0.50	1.00	1.45		
06th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	74.52	57.18	0.50	0.15	0.12		
					W38-U	0.68	0.99	1.29	74.24	57.18	0.50	1.00	1.51		
													1.63	1.00	YES
													0.06		
06th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	78.41	119.55	0.50	0.15	0.06		
					W39-U	0.68	0.99	1.29	77.65	119.55	0.50	1.00	0.75		
													0.12		
													1.52		
													2.46	2.00	YES
06th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	74.61	69.12	0.50	0.15	0.10		
					W41-U	0.68	0.99	1.29	74.34	69.12	0.50	1.00	1.25		
													0.10		
													1.25		
													2.70	1.00	YES
06th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	74.71	66.25	0.50	0.15	0.11		
					W43-U	0.68	0.99	1.29	74.43	66.25	0.50	1.00	1.30		
													1.41	1.00	YES
06th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	74.74	56.67	0.50	0.15	0.12		
					W44-U	0.68	0.99	1.29	74.47	56.67	0.50	1.00	1.52		
													1.65	1.00	YES
06th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	33.97	151.85	0.50	1.00	0.64		
													0.08		
													0.78		
													0.06		
													0.62		
													2.24	2.00	YES
07th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	35.45	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	27.23	125.20	0.50	1.00	0.62		
													0.08		
													0.72		
													0.07		
													0.58		
													0.06		
													0.70		
													2.89	2.00	YES
07th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	75.72	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	75.38	66.26	0.50	1.00	1.32		
													1.43	1.00	YES
07th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	75.66	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	75.32	66.49	0.50	1.00	1.31		
													1.42	1.00	YES
													0.07		
07th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	79.55	104.32	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W7-U	0.68	0.99	1.29	78.70	104.32	0.50	1.00	0.88		
					W8-L	0.68	0.99	1.36	82.56	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	81.48	104.32	0.50	1.00	1.77		
07th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	75.54	65.09	0.50	0.15	0.11	2.00	YES
					W9-U	0.68	0.99	1.29	75.20	65.09	0.50	1.00	1.34		
													1.45		
07th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	79.41	121.62	0.50	0.15	0.06	2.00	YES
					W10-U	0.68	0.99	1.29	78.58	121.62	0.50	1.00	0.75		
					W11-L	0.68	0.99	1.36	82.47	121.62	0.50	0.15	0.12		
					W11-U	0.68	0.99	2.52	81.39	121.62	0.50	1.00	1.51		
07th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	75.45	56.77	0.50	0.15	0.12	1.00	YES
					W12-U	0.68	0.99	1.29	75.12	56.77	0.50	1.00	1.54		
													1.66		
07th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	75.37	56.45	0.50	0.15	0.13	1.00	YES
					W13-U	0.68	0.99	1.29	75.04	56.45	0.50	1.00	1.54		
													1.67		
07th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	79.25	119.79	0.50	0.15	0.06	2.00	YES
					W14-U	0.68	0.99	1.29	78.42	119.79	0.50	1.00	0.76		
					W15-L	0.68	0.99	1.36	82.26	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	81.19	119.79	0.50	1.00	1.53		
07th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	75.22	59.49	0.50	0.15	0.12	1.00	YES
					W16-U	0.68	0.99	1.29	74.90	59.49	0.50	1.00	1.46		
					W17-L	0.68	0.99	0.36	35.86	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.74	59.49	0.50	1.00	0.36		
07th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02	2.00	YES
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
					W19-L	0.68	0.99	0.70	78.97	116.88	0.50	0.15	0.06		
					W19-U	0.68	0.99	1.29	78.17	116.88	0.50	1.00	0.78		
					W20-L	0.68	0.99	1.36	81.99	116.88	0.50	0.15	0.13		
					W20-U	0.68	0.99	2.52	80.95	116.88	0.50	1.00	1.57		
07th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	75.02	55.29	0.50	0.15	0.13	1.00	YES
					W21-U	0.68	0.99	1.29	74.71	55.29	0.50	1.00	1.57		
													1.70		
07th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	74.95	69.09	0.50	0.15	0.10	1.00	YES
					W22-U	0.68	0.99	1.29	74.65	69.09	0.50	1.00	1.25		
													1.36		
07th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	74.91	67.42	0.50	0.15	0.10	1.00	YES
					W23-U	0.68	0.99	1.29	74.61	67.42	0.50	1.00	1.28		
													1.39		
07th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	78.79	116.39	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W24-U	0.68	0.99	1.29	77.99	116.39	0.50	1.00	0.78		
					W25-L	0.68	0.99	1.36	81.78	116.39	0.50	0.15	0.13		
					W25-U	0.68	0.99	2.52	80.75	116.39	0.50	1.00	1.57		
07th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	74.89	55.28	0.50	0.15	0.13	2.00	YES
					W26-U	0.68	0.99	1.29	74.60	55.28	0.50	1.00	1.57		
													1.69		
07th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	74.87	69.08	0.50	0.15	0.10	1.00	YES
					W27-U	0.68	0.99	1.29	74.58	69.08	0.50	1.00	1.25		
													1.35		
07th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	74.85	55.32	0.50	0.15	0.13	1.00	YES
					W28-U	0.68	0.99	1.29	74.55	55.32	0.50	1.00	1.56		
													1.69		
07th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	78.77	117.45	0.50	0.15	0.06	2.00	YES
					W29-U	0.68	0.99	1.29	77.98	117.45	0.50	1.00	0.77		
					W30-L	0.68	0.99	1.36	81.79	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	80.75	117.45	0.50	1.00	1.56		
					W31-L	0.68	0.99	0.36	37.17	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	37.55	117.45	0.50	1.00	0.19		
													2.72		
07th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	38.20	58.24	0.50	0.15	0.03	1.00	YES
					W32-U	0.68	0.99	0.67	38.05	58.24	0.50	1.00	0.39		
					W33-L	0.68	0.99	0.70	74.94	58.24	0.50	0.15	0.12		
					W33-U	0.68	0.99	1.29	74.65	58.24	0.50	1.00	1.49		
													2.03		
07th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	78.86	117.07	0.50	0.15	0.06	2.00	YES
					W34-U	0.68	0.99	1.29	78.07	117.07	0.50	1.00	0.77		
					W35-L	0.68	0.99	1.36	81.94	117.07	0.50	0.15	0.13		
					W35-U	0.68	0.99	2.52	80.91	117.07	0.50	1.00	1.56		
													2.53		
07th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	75.03	59.45	0.50	0.15	0.12	1.00	YES
					W36-U	0.68	0.99	1.29	74.73	59.45	0.50	1.00	1.46		
					W37-L	0.68	0.99	0.70	75.06	59.45	0.50	0.15	0.12		
					W37-U	0.68	0.99	1.29	74.76	59.45	0.50	1.00	1.46		
													3.16		
07th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	75.13	57.18	0.50	0.15	0.12	1.00	YES
					W38-U	0.68	0.99	1.29	74.82	57.18	0.50	1.00	1.52		
													1.64		
07th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	79.07	119.55	0.50	0.15	0.06	2.00	YES
					W39-U	0.68	0.99	1.29	78.26	119.55	0.50	1.00	0.76		
					W40-L	0.68	0.99	1.36	82.15	119.55	0.50	0.15	0.13		
					W40-U	0.68	0.99	2.52	81.10	119.55	0.50	1.00	1.54		
													2.48		
07th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	75.23	69.12	0.50	0.15	0.10		
					W41-U	0.68	0.99	1.29	74.92	69.12	0.50	1.00	1.26		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W42-L	0.68	0.99	0.70	75.25	69.12	0.50	0.15	0.10		
					W42-U	0.68	0.99	1.29	74.94	69.12	0.50	1.00	1.26		
07th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	75.32	66.25	0.50	0.15	0.11		
					W43-U	0.68	0.99	1.29	75.01	66.25	0.50	1.00	1.31		
													1.42	1.00	YES
					W44-L	0.68	0.99	0.70	75.36	56.67	0.50	0.15	0.12		
07th	R27		Residential	Bedroom	W44-U	0.68	0.99	1.29	75.04	56.67	0.50	1.00	1.54		
													1.66	1.00	YES
07th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	35.02	151.85	0.50	1.00	0.66		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	37.82	151.85	0.50	1.00	0.80		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	33.96	151.85	0.50	1.00	0.64		
													2.30	2.00	YES
08th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	36.28	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	27.56	125.20	0.50	1.00	0.63		
					W2-L	0.68	0.99	1.93	39.28	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	28.87	125.20	0.50	1.00	0.74		
					W3-L	0.68	0.99	1.72	36.61	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	25.98	125.20	0.50	1.00	0.59		
					W4-L	0.68	0.99	0.70	76.23	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	75.88	125.20	0.50	1.00	0.70		
													2.94	2.00	YES
08th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	76.20	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	75.86	66.26	0.50	1.00	1.33		
													1.44	1.00	YES
08th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	76.15	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	75.80	66.49	0.50	1.00	1.32		
													1.43	1.00	YES
08th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	80.07	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	79.21	104.32	0.50	1.00	0.88		
					W8-L	0.68	0.99	1.36	83.12	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	82.01	104.32	0.50	1.00	1.78		
													2.88	2.00	YES
08th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	76.02	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	75.68	65.09	0.50	1.00	1.35		
													1.46	1.00	YES
08th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	79.94	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	79.08	121.62	0.50	1.00	0.75		
					W11-L	0.68	0.99	1.36	83.02	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	81.92	121.62	0.50	1.00	1.52		
													2.47	2.00	YES
08th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	75.94	56.77	0.50	0.15	0.13		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	75.60	56.77	0.50	1.00	1.55	1.00	YES
													1.67		
08th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	75.86	56.45	0.50	0.15	0.13	1.00	YES
					W13-U	0.68	0.99	1.29	75.51	56.45	0.50	1.00	1.55		
08th	R9	Residential	LKD										1.68	1.00	YES
					W14-L	0.68	0.99	0.70	79.79	119.79	0.50	0.15	0.06		
08th	R9	Residential	LKD		W14-U	0.68	0.99	1.29	78.92	119.79	0.50	1.00	0.76	1.00	YES
					W15-L	0.68	0.99	1.36	82.83	119.79	0.50	0.15	0.13		
08th	R9	Residential	LKD		W15-U	0.68	0.99	2.52	81.72	119.79	0.50	1.00	1.54	1.00	YES
													2.50		
08th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	75.73	59.49	0.50	0.15	0.12	1.00	YES
					W16-U	0.68	0.99	1.29	75.38	59.49	0.50	1.00	1.47		
08th	R10	Residential	Bedroom		W17-L	0.68	0.99	0.36	35.91	59.49	0.50	0.15	0.03	1.00	YES
					W17-U	0.68	0.99	0.67	35.80	59.49	0.50	1.00	0.36		
08th	R11	Residential	LKD										1.98	1.00	YES
					W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
08th	R11	Residential	LKD		W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20	1.00	YES
					W19-L	0.68	0.99	0.70	79.54	116.88	0.50	0.15	0.06		
08th	R11	Residential	LKD		W19-U	0.68	0.99	1.29	78.70	116.88	0.50	1.00	0.78	1.00	YES
					W20-L	0.68	0.99	1.36	82.60	116.88	0.50	0.15	0.13		
08th	R11	Residential	LKD		W20-U	0.68	0.99	2.52	81.51	116.88	0.50	1.00	1.58	1.00	YES
													2.77		
08th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	75.55	55.29	0.50	0.15	0.13	1.00	YES
					W21-U	0.68	0.99	1.29	75.22	55.29	0.50	1.00	1.58		
08th	R13	Residential	Bedroom										1.71	1.00	YES
					W22-L	0.68	0.99	0.70	75.50	69.09	0.50	0.15	0.10		
08th	R13	Residential	Bedroom		W22-U	0.68	0.99	1.29	75.17	69.09	0.50	1.00	1.26	1.00	YES
													1.37		
08th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	75.46	67.42	0.50	0.15	0.11	1.00	YES
					W23-U	0.68	0.99	1.29	75.14	67.42	0.50	1.00	1.29		
08th	R15	Residential	LKD										1.40	1.00	YES
					W24-L	0.68	0.99	0.70	79.38	116.39	0.50	0.15	0.06		
08th	R15	Residential	LKD		W24-U	0.68	0.99	1.29	78.56	116.39	0.50	1.00	0.78	1.00	YES
					W25-L	0.68	0.99	1.36	82.42	116.39	0.50	0.15	0.13		
08th	R15	Residential	LKD		W25-U	0.68	0.99	2.52	81.35	116.39	0.50	1.00	1.58	1.00	YES
													2.56		
08th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	75.46	55.28	0.50	0.15	0.13	1.00	YES
					W26-U	0.68	0.99	1.29	75.13	55.28	0.50	1.00	1.58		
08th	R17	Residential	Bedroom										1.71	1.00	YES
					W27-L	0.68	0.99	0.70	75.44	69.08	0.50	0.15	0.10		
08th	R17	Residential	Bedroom		W27-U	0.68	0.99	1.29	75.13	69.08	0.50	1.00	1.26	1.00	YES
													1.36		
08th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	75.42	55.32	0.50	0.15	0.13	1.00	YES
					W28-U	0.68	0.99	1.29	75.11	55.32	0.50	1.00	1.58		
08th	R18	Residential	Bedroom										1.70	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
08th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	79.38	117.45	0.50	0.15	0.06		
					W29-U	0.68	0.99	1.29	78.57	117.45	0.50	1.00	0.78		
					W30-L	0.68	0.99	1.36	82.43	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	81.38	117.45	0.50	1.00	1.57		
					W31-L	0.68	0.99	0.36	38.83	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	39.96	117.45	0.50	1.00	0.20		
													2.76	2.00	YES
08th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	38.25	58.24	0.50	0.15	0.03		
					W32-U	0.68	0.99	0.67	38.11	58.24	0.50	1.00	0.39		
					W33-L	0.68	0.99	0.70	75.51	58.24	0.50	0.15	0.12		
					W33-U	0.68	0.99	1.29	75.20	58.24	0.50	1.00	1.50		
													2.05	1.00	YES
08th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	79.47	117.07	0.50	0.15	0.06		
					W34-U	0.68	0.99	1.29	78.65	117.07	0.50	1.00	0.78		
					W35-L	0.68	0.99	1.36	82.58	117.07	0.50	0.15	0.13		
					W35-U	0.68	0.99	2.52	81.52	117.07	0.50	1.00	1.58		
													2.55	2.00	YES
08th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	75.59	59.45	0.50	0.15	0.12		
					W36-U	0.68	0.99	1.29	75.27	59.45	0.50	1.00	1.47		
					W37-L	0.68	0.99	0.70	75.62	59.45	0.50	0.15	0.12		
					W37-U	0.68	0.99	1.29	75.30	59.45	0.50	1.00	1.47		
													3.18	1.00	YES
08th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	75.68	57.18	0.50	0.15	0.12		
					W38-U	0.68	0.99	1.29	75.35	57.18	0.50	1.00	1.53		
													1.65	1.00	YES
08th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	79.66	119.55	0.50	0.15	0.06		
					W39-U	0.68	0.99	1.29	78.82	119.55	0.50	1.00	0.77		
					W40-L	0.68	0.99	1.36	82.76	119.55	0.50	0.15	0.13		
					W40-U	0.68	0.99	2.52	81.68	119.55	0.50	1.00	1.55		
													2.50	2.00	YES
08th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	75.77	69.12	0.50	0.15	0.10		
					W41-U	0.68	0.99	1.29	75.43	69.12	0.50	1.00	1.27		
					W42-L	0.68	0.99	0.70	75.79	69.12	0.50	0.15	0.10		
					W42-U	0.68	0.99	1.29	75.45	69.12	0.50	1.00	1.27		
													2.74	1.00	YES
08th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	75.86	66.25	0.50	0.15	0.11		
					W43-U	0.68	0.99	1.29	75.52	66.25	0.50	1.00	1.32		
													1.43	1.00	YES
08th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	75.89	56.67	0.50	0.15	0.13		
					W44-U	0.68	0.99	1.29	75.55	56.67	0.50	1.00	1.55		
													1.67	1.00	YES
08th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	35.95	151.85	0.50	1.00	0.68		
					W46-L	0.68	0.99	1.93	45.00	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	38.68	151.85	0.50	1.00	0.82		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	34.91	151.85	0.50	1.00	0.66		
													2.36	2.00	YES
09th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08			
				W1-U	0.68	0.99	3.19	36.22	125.20	0.50	1.00	0.83			
				W2-L	0.68	0.99	1.93	44.01	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	38.62	125.20	0.50	1.00	0.99			
				W3-L	0.68	0.99	1.72	41.01	125.20	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.19	35.45	125.20	0.50	1.00	0.81			
				W4-L	0.68	0.99	0.70	76.72	125.20	0.50	0.15	0.06			
				W4-U	0.68	0.99	1.29	76.35	125.20	0.50	1.00	0.71			
													3.64	2.00	YES
09th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	76.69	66.26	0.50	0.15	0.11			
				W5-U	0.68	0.99	1.29	76.32	66.26	0.50	1.00	1.34			
													1.45	1.00	YES
09th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	76.63	66.49	0.50	0.15	0.11			
				W6-U	0.68	0.99	1.29	76.27	66.49	0.50	1.00	1.33			
													1.44	1.00	YES
09th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	80.60	104.32	0.50	0.15	0.07			
				W7-U	0.68	0.99	1.29	79.72	104.32	0.50	1.00	0.89			
				W8-L	0.68	0.99	1.36	83.68	104.32	0.50	0.15	0.15			
				W8-U	0.68	0.99	2.52	82.55	104.32	0.50	1.00	1.79			
													2.90	2.00	YES
09th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	76.52	65.09	0.50	0.15	0.11			
				W9-U	0.68	0.99	1.29	76.15	65.09	0.50	1.00	1.36			
													1.47	1.00	YES
09th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	80.46	121.62	0.50	0.15	0.06			
				W10-U	0.68	0.99	1.29	79.59	121.62	0.50	1.00	0.76			
				W11-L	0.68	0.99	1.36	83.58	121.62	0.50	0.15	0.13			
				W11-U	0.68	0.99	2.52	82.45	121.62	0.50	1.00	1.53			
													2.48	2.00	YES
09th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	76.43	56.77	0.50	0.15	0.13			
				W12-U	0.68	0.99	1.29	76.07	56.77	0.50	1.00	1.55			
													1.68	1.00	YES
09th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	76.35	56.45	0.50	0.15	0.13			
				W13-U	0.68	0.99	1.29	75.99	56.45	0.50	1.00	1.56			
													1.69	1.00	YES
09th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	80.30	119.79	0.50	0.15	0.06			
				W14-U	0.68	0.99	1.29	79.42	119.79	0.50	1.00	0.77			
				W15-L	0.68	0.99	1.36	83.37	119.79	0.50	0.15	0.13			
				W15-U	0.68	0.99	2.52	82.25	119.79	0.50	1.00	1.55			
													2.51	2.00	YES
09th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	76.21	59.49	0.50	0.15	0.12			
				W16-U	0.68	0.99	1.29	75.86	59.49	0.50	1.00	1.48			
				W17-L	0.68	0.99	0.36	35.99	59.49	0.50	0.15	0.03			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-U	0.68	0.99	0.67	35.91	59.49	0.50	1.00	0.36		
09th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02	1.99	1.00	YES
				W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20			
				W19-L	0.68	0.99	0.70	80.08	116.88	0.50	0.15	0.06			
				W19-U	0.68	0.99	1.29	79.23	116.88	0.50	1.00	0.79			
				W20-L	0.68	0.99	1.36	83.17	116.88	0.50	0.15	0.13			
				W20-U	0.68	0.99	2.52	82.07	116.88	0.50	1.00	1.59			
09th	R12	Residential	Bedroom	W21-L	0.68	0.99	0.70	76.06	55.29	0.50	0.15	0.13	2.78	2.00	YES
				W21-U	0.68	0.99	1.29	75.73	55.29	0.50	1.00	1.59			
				1.72	1.00	YES									
09th	R13	Residential	Bedroom	W22-L	0.68	0.99	0.70	76.01	69.09	0.50	0.15	0.10	1.37	1.00	YES
				W22-U	0.68	0.99	1.29	75.68	69.09	0.50	1.00	1.27			
				1.37	1.00	YES									
09th	R14	Residential	Bedroom	W23-L	0.68	0.99	0.70	75.98	67.42	0.50	0.15	0.11	1.41	1.00	YES
				W23-U	0.68	0.99	1.29	75.65	67.42	0.50	1.00	1.30			
				1.41	1.00	YES									
09th	R15	Residential	LKD	W24-L	0.68	0.99	0.70	79.95	116.39	0.50	0.15	0.06	2.58	2.00	YES
				W24-U	0.68	0.99	1.29	79.11	116.39	0.50	1.00	0.79			
				W25-L	0.68	0.99	1.36	83.01	116.39	0.50	0.15	0.13			
				W25-U	0.68	0.99	2.52	81.93	116.39	0.50	1.00	1.59			
				1.59	2.58	2.00	YES								
				1.72	1.00	YES									
09th	R16	Residential	Bedroom	W26-L	0.68	0.99	0.70	75.98	55.28	0.50	0.15	0.13	1.72	1.00	YES
				W26-U	0.68	0.99	1.29	75.66	55.28	0.50	1.00	1.59			
				1.72	1.00	YES									
09th	R17	Residential	Bedroom	W27-L	0.68	0.99	0.70	75.97	69.08	0.50	0.15	0.10	1.37	1.00	YES
				W27-U	0.68	0.99	1.29	75.65	69.08	0.50	1.00	1.27			
				1.37	1.00	YES									
09th	R18	Residential	Bedroom	W28-L	0.68	0.99	0.70	75.96	55.32	0.50	0.15	0.13	1.72	1.00	YES
				W28-U	0.68	0.99	1.29	75.64	55.32	0.50	1.00	1.59			
				1.72	1.00	YES									
09th	R19	Residential	LKD	W29-L	0.68	0.99	0.70	79.96	117.45	0.50	0.15	0.06	2.80	2.00	YES
				W29-U	0.68	0.99	1.29	79.13	117.45	0.50	1.00	0.78			
				W30-L	0.68	0.99	1.36	83.05	117.45	0.50	0.15	0.13			
				W30-U	0.68	0.99	2.52	81.97	117.45	0.50	1.00	1.58			
				W31-L	0.68	0.99	0.36	42.63	117.45	0.50	0.15	0.02			
				W31-U	0.68	0.99	0.67	44.76	117.45	0.50	1.00	0.23			
09th	R20	Residential	Bedroom	W32-L	0.68	0.99	0.36	38.34	58.24	0.50	0.15	0.03	2.06	1.00	YES
				W32-U	0.68	0.99	0.67	38.22	58.24	0.50	1.00	0.39			
				W33-L	0.68	0.99	0.70	76.07	58.24	0.50	0.15	0.12			
09th	R21	Residential	LKD	W33-U	0.68	0.99	1.29	75.75	58.24	0.50	1.00	1.51	2.06	1.00	YES
				1.51	2.06	1.00	YES								
				0.06											

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W34-U	0.68	0.99	1.29	79.23	117.07	0.50	1.00	0.79		
					W35-L	0.68	0.99	1.36	83.21	117.07	0.50	0.15	0.13		
					W35-U	0.68	0.99	2.52	82.13	117.07	0.50	1.00	1.59		
09th	R22		Residential	Bedroom									2.57	2.00	YES
					W36-L	0.68	0.99	0.70	76.13	59.45	0.50	0.15	0.12		
					W36-U	0.68	0.99	1.29	75.81	59.45	0.50	1.00	1.48		
					W37-L	0.68	0.99	0.70	76.16	59.45	0.50	0.15	0.12		
					W37-U	0.68	0.99	1.29	75.84	59.45	0.50	1.00	1.48		
09th	R23		Residential	Bedroom									3.20	1.00	YES
					W38-L	0.68	0.99	0.70	76.21	57.18	0.50	0.15	0.13		
					W38-U	0.68	0.99	1.29	75.88	57.18	0.50	1.00	1.54		
09th	R24		Residential	LKD									1.67	1.00	YES
					W39-L	0.68	0.99	0.70	80.22	119.55	0.50	0.15	0.06		
					W39-U	0.68	0.99	1.29	79.38	119.55	0.50	1.00	0.77		
					W40-L	0.68	0.99	1.36	83.35	119.55	0.50	0.15	0.13		
					W40-U	0.68	0.99	2.52	82.26	119.55	0.50	1.00	1.56		
09th	R25		Residential	Bedroom									2.52	2.00	YES
					W41-L	0.68	0.99	0.70	76.28	69.12	0.50	0.15	0.10		
					W41-U	0.68	0.99	1.29	75.94	69.12	0.50	1.00	1.28		
					W42-L	0.68	0.99	0.70	76.29	69.12	0.50	0.15	0.10		
					W42-U	0.68	0.99	1.29	75.95	69.12	0.50	1.00	1.28		
09th	R26		Residential	Bedroom									2.76	1.00	YES
					W43-L	0.68	0.99	0.70	76.36	66.25	0.50	0.15	0.11		
					W43-U	0.68	0.99	1.29	76.01	66.25	0.50	1.00	1.33		
09th	R27		Residential	Bedroom									1.44	1.00	YES
					W44-L	0.68	0.99	0.70	76.39	56.67	0.50	0.15	0.13		
					W44-U	0.68	0.99	1.29	76.05	56.67	0.50	1.00	1.56		
09th	R28		Residential	LKD									1.68	1.00	YES
					W45-L	0.68	0.99	1.72	45.19	151.85	0.50	0.15	0.07		
					W45-U	0.68	0.99	3.18	44.74	151.85	0.50	1.00	0.84		
					W46-L	0.68	0.99	1.93	48.77	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	48.55	151.85	0.50	1.00	1.03		
					W47-L	0.68	0.99	1.72	43.47	151.85	0.50	0.15	0.07		
					W47-U	0.68	0.99	3.20	43.73	151.85	0.50	1.00	0.83		
10th	R1		Residential	LKD									2.92	2.00	YES
					W1-L	0.68	0.99	1.72	38.27	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	28.47	125.20	0.50	1.00	0.65		
					W2-L	0.68	0.99	1.93	41.25	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	30.20	125.20	0.50	1.00	0.77		
					W3-L	0.68	0.99	1.72	38.70	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	27.63	125.20	0.50	1.00	0.63		
					W4-L	0.68	0.99	0.70	77.24	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	76.88	125.20	0.50	1.00	0.71		
													3.06		
10th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	77.22	66.26	0.50	0.15	0.11		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W5-U	0.68	0.99	1.29	76.85	66.26	0.50	1.00	1.35	1.00	YES
													1.46		
10th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	77.16	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	76.79	66.49	0.50	1.00	1.34		
													1.45	1.00	YES
10th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	81.17	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	80.27	104.32	0.50	1.00	0.89		
					W8-L	0.68	0.99	1.36	84.29	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	83.14	104.32	0.50	1.00	1.80		
													2.92	2.00	YES
10th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	77.05	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	76.68	65.09	0.50	1.00	1.37		
													1.48	1.00	YES
10th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	81.03	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	80.14	121.62	0.50	1.00	0.76		
					W11-L	0.68	0.99	1.36	84.18	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	83.02	121.62	0.50	1.00	1.55		
													2.50	2.00	YES
10th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	76.95	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	76.58	56.77	0.50	1.00	1.57		
													1.69	1.00	YES
10th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	76.87	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	76.50	56.45	0.50	1.00	1.57		
													1.70	1.00	YES
10th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	80.86	119.79	0.50	0.15	0.06		
					W14-U	0.68	0.99	1.29	79.96	119.79	0.50	1.00	0.77		
					W15-L	0.68	0.99	1.36	83.97	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	82.82	119.79	0.50	1.00	1.56		
													2.53	2.00	YES
10th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	76.74	59.49	0.50	0.15	0.12		
					W16-U	0.68	0.99	1.29	76.37	59.49	0.50	1.00	1.49		
					W17-L	0.68	0.99	0.36	36.16	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	36.13	59.49	0.50	1.00	0.37		
													2.01	1.00	YES
10th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
					W19-L	0.68	0.99	0.70	80.68	116.88	0.50	0.15	0.06		
					W19-U	0.68	0.99	1.29	79.79	116.88	0.50	1.00	0.79		
					W20-L	0.68	0.99	1.36	83.80	116.88	0.50	0.15	0.13		
					W20-U	0.68	0.99	2.52	82.67	116.88	0.50	1.00	1.60		
													2.80	2.00	YES
10th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	76.63	55.29	0.50	0.15	0.13		
					W21-U	0.68	0.99	1.29	76.26	55.29	0.50	1.00	1.60		
													1.73	1.00	YES
10th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	76.58	69.09	0.50	0.15	0.10		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W22-U	0.68	0.99	1.29	76.23	69.09	0.50	1.00	1.28	1.00	YES
													1.38		
10th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	76.56	67.42	0.50	0.15	0.11	1.00	YES
					W23-U	0.68	0.99	1.29	76.20	67.42	0.50	1.00	1.31		
													1.42	1.00	YES
10th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	80.57	116.39	0.50	0.15	0.07	1.00	
					W24-U	0.68	0.99	1.29	79.70	116.39	0.50	1.00	0.79		
					W25-L	0.68	0.99	1.36	83.68	116.39	0.50	0.15	0.13	1.00	
					W25-U	0.68	0.99	2.52	82.56	116.39	0.50	1.00	1.61		
													2.60	2.00	YES
10th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	76.58	55.28	0.50	0.15	0.13	1.00	YES
					W26-U	0.68	0.99	1.29	76.23	55.28	0.50	1.00	1.60		
													1.73	1.00	YES
10th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	76.57	69.08	0.50	0.15	0.10	1.00	YES
					W27-U	0.68	0.99	1.29	76.22	69.08	0.50	1.00	1.28		
													1.38	1.00	YES
10th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	76.56	55.32	0.50	0.15	0.13	1.00	YES
					W28-U	0.68	0.99	1.29	76.20	55.32	0.50	1.00	1.60		
													1.73	1.00	YES
10th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	80.60	117.45	0.50	0.15	0.06	1.00	
					W29-U	0.68	0.99	1.29	79.73	117.45	0.50	1.00	0.79		
					W30-L	0.68	0.99	1.36	83.72	117.45	0.50	0.15	0.13	1.00	
					W30-U	0.68	0.99	2.52	82.60	117.45	0.50	1.00	1.59		
					W31-L	0.68	0.99	0.36	47.93	117.45	0.50	0.15	0.02	1.00	
					W31-U	0.68	0.99	0.67	48.50	117.45	0.50	1.00	0.25		
													2.84	2.00	YES
10th	R20	Residential	Bathroom		W32-L	0.68	0.99	0.70	52.23	49.89	0.50	0.15	0.10	1.00	
					W32-U	0.68	0.99	1.19	54.78	49.89	0.50	1.00	1.17		
													1.27	-1.00	NO
10th	R21	Residential	Study		W33-L	0.68	0.99	0.69	67.43	63.55	0.50	0.15	0.10	1.00	
					W33-U	0.68	0.99	1.17	77.88	63.55	0.50	1.00	1.29		
					W34-L	0.68	0.99	0.69	67.08	63.55	0.50	0.15	0.10	1.00	
					W34-U	0.68	0.99	1.17	77.29	63.55	0.50	1.00	1.28		
													2.77	-1.00	NO
10th	R22	Residential	En Suite		W35-L	0.68	0.99	0.70	65.44	50.60	0.50	0.15	0.12	1.00	
					W35-U	0.68	0.99	1.19	75.24	50.60	0.50	1.00	1.59		
													1.71	-1.00	NO
10th	R23	Residential	Bedroom		W36-L	0.68	0.99	0.69	68.14	91.83	0.50	0.15	0.07	1.00	
					W36-U	0.68	0.99	1.17	77.94	91.83	0.50	1.00	0.90		
					W37-L	0.68	0.99	0.69	68.08	91.83	0.50	0.15	0.07	1.00	
					W37-U	0.68	0.99	1.17	77.87	91.83	0.50	1.00	0.89		
													1.93	1.00	YES
10th	R24	Residential	LKD		W38-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03	1.00	
					W38-U	0.68	0.99	1.19	75.32	228.51	0.50	1.00	0.35		
					W39-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03	1.00	

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W39-U	0.68	0.99	1.19	75.35	228.51	0.50	1.00	0.35		
					W40-L	0.68	0.99	1.71	78.70	228.51	0.50	0.15	0.08		
					W40-U	0.68	0.99	2.91	81.15	228.51	0.50	1.00	0.93		
					W41-L	0.68	0.99	1.71	76.40	228.51	0.50	0.15	0.08		
					W41-U	0.68	0.99	2.91	80.35	228.51	0.50	1.00	0.92		
					W42-L	0.68	0.99	1.71	73.90	228.51	0.50	0.15	0.07		
					W42-U	0.68	0.99	2.91	81.07	228.51	0.50	1.00	0.93		
					W43-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03		
					W43-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					W44-L	0.68	0.99	1.71	73.57	228.51	0.50	0.15	0.07		
					W44-U	0.68	0.99	2.91	80.50	228.51	0.50	1.00	0.92		
					W45-L	0.68	0.99	0.70	65.45	228.51	0.50	0.15	0.03		
					W45-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					11th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.27		
W1-U	0.68	0.99	3.19	29.76					125.20	0.50	1.00	0.68			
W2-L	0.68	0.99	1.93	42.22					125.20	0.50	0.15	0.09			
W2-U	0.68	0.99	3.57	31.59					125.20	0.50	1.00	0.81			
W3-L	0.68	0.99	1.72	39.70					125.20	0.50	0.15	0.07			
W3-U	0.68	0.99	3.19	29.19					125.20	0.50	1.00	0.67			
W4-L	0.68	0.99	0.70	77.68					125.20	0.50	0.15	0.06			
W4-U	0.68	0.99	1.29	77.28					125.20	0.50	1.00	0.72			
											5.55	2.00	YES		
11th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	77.65	66.26	0.50	0.15	0.11			
				W5-U	0.68	0.99	1.29	77.26	66.26	0.50	1.00	1.35			
11th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	77.60	66.49	0.50	0.15	0.11			
				W6-U	0.68	0.99	1.29	77.21	66.49	0.50	1.00	1.35			
11th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	81.63	104.32	0.50	0.15	0.07			
				W7-U	0.68	0.99	1.29	80.71	104.32	0.50	1.00	0.90			
				W8-L	0.68	0.99	1.36	84.78	104.32	0.50	0.15	0.15			
				W8-U	0.68	0.99	2.52	83.60	104.32	0.50	1.00	1.81			
11th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	77.48	65.09	0.50	0.15	0.11			
				W9-U	0.68	0.99	1.29	77.08	65.09	0.50	1.00	1.37			
11th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	81.49	121.62	0.50	0.15	0.06			
				W10-U	0.68	0.99	1.29	80.57	121.62	0.50	1.00	0.77			
				W11-L	0.68	0.99	1.36	84.65	121.62	0.50	0.15	0.13			
				W11-U	0.68	0.99	2.52	83.47	121.62	0.50	1.00	1.55			
11th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	77.37	56.77	0.50	0.15	0.13			
				W12-U	0.68	0.99	1.29	76.98	56.77	0.50	1.00	1.57			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
11th	R8	Residential	Bedroom	W13-L	W13-L	0.68	0.99	0.70	77.29	56.45	0.50	0.15	0.13	1.58	YES
					W13-U	0.68	0.99	1.29	76.90	56.45	0.50	1.00	1.58		
11th	R9	Residential	LKD	W14-L	W14-L	0.68	0.99	0.70	81.30	119.79	0.50	0.15	0.06	2.55	YES
				W14-U	W14-U	0.68	0.99	1.29	80.39	119.79	0.50	1.00	0.78		
				W15-L	W15-L	0.68	0.99	1.36	84.44	119.79	0.50	0.15	0.13		
				W15-U	W15-U	0.68	0.99	2.52	83.27	119.79	0.50	1.00	1.57		
													1.57		
11th	R10	Residential	Bedroom	W16-L	W16-L	0.68	0.99	0.70	77.16	59.49	0.50	0.15	0.12	2.02	YES
				W16-U	W16-U	0.68	0.99	1.29	76.77	59.49	0.50	1.00	1.50		
				W17-L	W17-L	0.68	0.99	0.36	36.44	59.49	0.50	0.15	0.03		
				W17-U	W17-U	0.68	0.99	0.67	36.51	59.49	0.50	1.00	0.37		
													0.37		
11th	R11	Residential	LKD	W18-L	W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02	2.82	YES
				W18-U	W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
				W19-L	W19-L	0.68	0.99	0.70	81.14	116.88	0.50	0.15	0.07		
				W19-U	W19-U	0.68	0.99	1.29	80.24	116.88	0.50	1.00	0.80		
				W20-L	W20-L	0.68	0.99	1.36	84.30	116.88	0.50	0.15	0.13		
				W20-U	W20-U	0.68	0.99	2.52	83.14	116.88	0.50	1.00	1.61		
11th	R12	Residential	Bedroom	W21-L	W21-L	0.68	0.99	0.70	77.07	55.29	0.50	0.15	0.13	1.74	YES
				W21-U	W21-U	0.68	0.99	1.29	76.69	55.29	0.50	1.00	1.61		
11th	R13	Residential	Bedroom	W22-L	W22-L	0.68	0.99	0.70	77.03	69.09	0.50	0.15	0.10	1.39	YES
				W22-U	W22-U	0.68	0.99	1.29	76.66	69.09	0.50	1.00	1.29		
11th	R14	Residential	Bedroom	W23-L	W23-L	0.68	0.99	0.70	77.01	67.42	0.50	0.15	0.11	1.43	YES
				W23-U	W23-U	0.68	0.99	1.29	76.64	67.42	0.50	1.00	1.32		
11th	R15	Residential	LKD	W24-L	W24-L	0.68	0.99	0.70	81.06	116.39	0.50	0.15	0.07	2.61	YES
				W24-U	W24-U	0.68	0.99	1.29	80.17	116.39	0.50	1.00	0.80		
				W25-L	W25-L	0.68	0.99	1.36	84.20	116.39	0.50	0.15	0.13		
				W25-U	W25-U	0.68	0.99	2.52	83.06	116.39	0.50	1.00	1.62		
													1.62		
11th	R16	Residential	Bedroom	W26-L	W26-L	0.68	0.99	0.70	77.03	55.28	0.50	0.15	0.13	1.74	YES
				W26-U	W26-U	0.68	0.99	1.29	76.67	55.28	0.50	1.00	1.61		
11th	R17	Residential	Bedroom	W27-L	W27-L	0.68	0.99	0.70	77.03	69.08	0.50	0.15	0.10	1.39	YES
				W27-U	W27-U	0.68	0.99	1.29	76.66	69.08	0.50	1.00	1.29		
11th	R18	Residential	Bedroom	W28-L	W28-L	0.68	0.99	0.70	77.01	55.32	0.50	0.15	0.13	1.74	YES
				W28-U	W28-U	0.68	0.99	1.29	76.65	55.32	0.50	1.00	1.61		
11th	R19	Residential	LKD	W29-L	W29-L	0.68	0.99	0.70	81.08	117.45	0.50	0.15	0.06	0.79	
				W29-U	W29-U	0.68	0.99	1.29	80.19	117.45	0.50	1.00	0.79		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W30-L	0.68	0.99	1.36	84.24	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	83.09	117.45	0.50	1.00	1.60		
					W31-L	0.68	0.99	0.36	49.18	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.31	117.45	0.50	1.00	0.25		
12th	R1	Residential	LKD										2.86	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	31.02	125.20	0.50	1.00	0.71		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	32.91	125.20	0.50	1.00	0.84		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	30.63	125.20	0.50	1.00	0.70		
					W4-L	0.68	0.99	0.70	78.08	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	77.67	125.20	0.50	1.00	0.72		
													3.27	2.00	YES
12th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	78.05	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	77.65	66.26	0.50	1.00	1.36		
12th	R3	Residential	Bedroom										1.47	1.00	YES
					W6-L	0.68	0.99	0.70	77.99	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	77.60	66.49	0.50	1.00	1.35		
12th	R4	Residential	LKD										1.46	1.00	YES
					W7-L	0.68	0.99	0.70	82.05	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	81.13	104.32	0.50	1.00	0.90		
					W8-L	0.68	0.99	1.36	85.24	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	84.04	104.32	0.50	1.00	1.82		
12th	R5	Residential	Bedroom										2.95	2.00	YES
					W9-L	0.68	0.99	0.70	77.87	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	77.47	65.09	0.50	1.00	1.38		
12th	R6	Residential	LKD										1.49	1.00	YES
					W10-L	0.68	0.99	0.70	81.91	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	80.98	121.62	0.50	1.00	0.77		
					W11-L	0.68	0.99	1.36	85.10	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	83.91	121.62	0.50	1.00	1.56		
12th	R7	Residential	Bedroom										2.53	2.00	YES
					W12-L	0.68	0.99	0.70	77.76	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	77.37	56.77	0.50	1.00	1.58		
12th	R8	Residential	Bedroom										1.71	1.00	YES
					W13-L	0.68	0.99	0.70	77.68	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	77.28	56.45	0.50	1.00	1.59		
12th	R9	Residential	LKD										1.72	1.00	YES
					W14-L	0.68	0.99	0.70	81.72	119.79	0.50	0.15	0.06		
					W14-U	0.68	0.99	1.29	80.79	119.79	0.50	1.00	0.78		
					W15-L	0.68	0.99	1.36	84.88	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	83.69	119.79	0.50	1.00	1.58		
12th	R10	Residential	Bedroom										2.56	2.00	YES
					W16-L	0.68	0.99	0.70	77.55	59.49	0.50	0.15	0.12		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	77.15	59.49	0.50	1.00	1.50		
					W17-L	0.68	0.99	0.36	37.05	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	37.34	59.49	0.50	1.00	0.38		
12th	R11	Residential	LKD										2.04	1.00	YES
					W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
					W19-L	0.68	0.99	0.70	81.58	116.88	0.50	0.15	0.07		
					W19-U	0.68	0.99	1.29	80.66	116.88	0.50	1.00	0.80		
					W20-L	0.68	0.99	1.36	84.77	116.88	0.50	0.15	0.13		
					W20-U	0.68	0.99	2.52	83.59	116.88	0.50	1.00	1.62		
12th	R12	Residential	Bedroom										2.83	2.00	YES
					W21-L	0.68	0.99	0.70	77.49	55.29	0.50	0.15	0.13		
					W21-U	0.68	0.99	1.29	77.09	55.29	0.50	1.00	1.62		
12th	R13	Residential	Bedroom										1.75	1.00	YES
					W22-L	0.68	0.99	0.70	77.46	69.09	0.50	0.15	0.11		
					W22-U	0.68	0.99	1.29	77.07	69.09	0.50	1.00	1.29		
12th	R14	Residential	Bedroom										1.40	1.00	YES
					W23-L	0.68	0.99	0.70	77.44	67.42	0.50	0.15	0.11		
					W23-U	0.68	0.99	1.29	77.05	67.42	0.50	1.00	1.33		
12th	R15	Residential	LKD										1.43	1.00	YES
					W24-L	0.68	0.99	0.70	81.53	116.39	0.50	0.15	0.07		
					W24-U	0.68	0.99	1.29	80.62	116.39	0.50	1.00	0.80		
					W25-L	0.68	0.99	1.36	84.71	116.39	0.50	0.15	0.13		
					W25-U	0.68	0.99	2.52	83.54	116.39	0.50	1.00	1.62		
12th	R16	Residential	Bedroom										2.63	2.00	YES
					W26-L	0.68	0.99	0.70	77.48	55.28	0.50	0.15	0.13		
					W26-U	0.68	0.99	1.29	77.09	55.28	0.50	1.00	1.62		
12th	R17	Residential	Bedroom										1.75	1.00	YES
					W27-L	0.68	0.99	0.70	77.48	69.08	0.50	0.15	0.11		
					W27-U	0.68	0.99	1.29	77.09	69.08	0.50	1.00	1.29		
12th	R18	Residential	Bedroom										1.40	1.00	YES
					W28-L	0.68	0.99	0.70	77.46	55.32	0.50	0.15	0.13		
					W28-U	0.68	0.99	1.29	77.07	55.32	0.50	1.00	1.62		
12th	R19	Residential	LKD										1.75	1.00	YES
					W29-L	0.68	0.99	0.70	81.56	117.45	0.50	0.15	0.07		
					W29-U	0.68	0.99	1.29	80.64	117.45	0.50	1.00	0.80		
					W30-L	0.68	0.99	1.36	84.74	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	83.56	117.45	0.50	1.00	1.61		
					W31-L	0.68	0.99	0.36	49.62	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.48	117.45	0.50	1.00	0.25		
13th	R1	Residential	LKD										2.88	2.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	32.25	125.20	0.50	1.00	0.74		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	34.20	125.20	0.50	1.00	0.88		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	32.02	125.20	0.50	1.00	0.73		
					W4-L	0.68	0.99	0.70	78.46	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	78.04	125.20	0.50	1.00	0.72		
13th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	78.43	66.26	0.50	0.15	0.11	3.37	2.00
					W5-U	0.68	0.99	1.29	78.01	66.26	0.50	1.00	1.37		
													1.48		
													1.00		
13th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	78.38	66.49	0.50	0.15	0.11	1.47	1.00
					W6-U	0.68	0.99	1.29	77.96	66.49	0.50	1.00	1.36		
													1.47		
													1.00		
13th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	82.47	104.32	0.50	0.15	0.07	2.96	2.00
					W7-U	0.68	0.99	1.29	81.52	104.32	0.50	1.00	0.91		
					W8-L	0.68	0.99	1.36	85.68	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	84.45	104.32	0.50	1.00	1.83		
13th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	78.26	65.09	0.50	0.15	0.11	1.50	1.00
					W9-U	0.68	0.99	1.29	77.84	65.09	0.50	1.00	1.39		
													1.50		
													1.00		
13th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	82.32	121.62	0.50	0.15	0.06	2.54	2.00
					W10-U	0.68	0.99	1.29	81.37	121.62	0.50	1.00	0.78		
					W11-L	0.68	0.99	1.36	85.54	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	84.31	121.62	0.50	1.00	1.57		
13th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	78.14	56.77	0.50	0.15	0.13	1.72	1.00
					W12-U	0.68	0.99	1.29	77.73	56.77	0.50	1.00	1.59		
													1.72		
													1.00		
13th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	78.05	56.45	0.50	0.15	0.13	1.73	1.00
					W13-U	0.68	0.99	1.29	77.64	56.45	0.50	1.00	1.60		
													1.73		
													1.00		
13th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	82.12	119.79	0.50	0.15	0.06	2.57	2.00
					W14-U	0.68	0.99	1.29	81.18	119.79	0.50	1.00	0.79		
					W15-L	0.68	0.99	1.36	85.32	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	84.11	119.79	0.50	1.00	1.59		
13th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	77.93	59.49	0.50	0.15	0.12	2.06	1.00
					W16-U	0.68	0.99	1.29	77.52	59.49	0.50	1.00	1.51		
					W17-L	0.68	0.99	0.36	38.36	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	39.18	59.49	0.50	1.00	0.40		
13th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
					W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20		
					W19-L	0.68	0.99	0.70	82.00	116.88	0.50	0.15	0.07		
					W19-U	0.68	0.99	1.29	81.07	116.88	0.50	1.00	0.80		
13th					W20-L	0.68	0.99	1.36	85.22	116.88	0.50	0.15	0.13		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-U	0.68	0.99	2.52	84.02	116.88	0.50	1.00	1.63	2.00	YES
													2.84		
13th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	77.88	55.29	0.50	0.15	0.13	1.00	YES
					W21-U	0.68	0.99	1.29	77.48	55.29	0.50	1.00	1.63		
13th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	77.87	69.09	0.50	0.15	0.11	1.00	YES
					W22-U	0.68	0.99	1.29	77.47	69.09	0.50	1.00	1.30		
13th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	77.85	67.42	0.50	0.15	0.11	1.00	YES
					W23-U	0.68	0.99	1.29	77.45	67.42	0.50	1.00	1.33		
13th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	81.97	116.39	0.50	0.15	0.07	2.00	YES
					W24-U	0.68	0.99	1.29	81.04	116.39	0.50	1.00	0.81		
13th	R16		Residential	Bedroom	W25-L	0.68	0.99	1.36	85.19	116.39	0.50	0.15	0.13	1.00	YES
					W25-U	0.68	0.99	2.52	83.99	116.39	0.50	1.00	1.63		
13th	R17		Residential	Bedroom	W26-L	0.68	0.99	0.70	77.90	55.28	0.50	0.15	0.13	1.00	YES
					W26-U	0.68	0.99	1.29	77.50	55.28	0.50	1.00	1.63		
13th	R18		Residential	Bedroom	W27-L	0.68	0.99	0.70	77.89	69.08	0.50	0.15	0.11	1.00	YES
					W27-U	0.68	0.99	1.29	77.49	69.08	0.50	1.00	1.30		
13th	R19		Residential	LKD	W28-L	0.68	0.99	0.70	77.87	55.32	0.50	0.15	0.13	1.00	YES
					W28-U	0.68	0.99	1.29	77.47	55.32	0.50	1.00	1.63		
13th	R20		Residential	LKD	W29-L	0.68	0.99	0.70	82.00	117.45	0.50	0.15	0.07	2.00	YES
					W29-U	0.68	0.99	1.29	81.06	117.45	0.50	1.00	0.80		
13th	R21		Residential	LKD	W30-L	0.68	0.99	1.36	85.21	117.45	0.50	0.15	0.13	1.00	YES
					W30-U	0.68	0.99	2.52	84.01	117.45	0.50	1.00	1.62		
13th	R22		Residential	LKD	W31-L	0.68	0.99	0.36	49.71	117.45	0.50	0.15	0.02	1.00	YES
					W31-U	0.68	0.99	0.67	49.60	117.45	0.50	1.00	0.25		
14th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	43.38	125.20	0.50	0.15	0.08	2.00	YES
					W1-U	0.68	0.99	3.19	42.30	125.20	0.50	1.00	0.97		
14th	R2		Residential	Bedroom	W2-L	0.68	0.99	1.93	46.63	125.20	0.50	0.15	0.10	1.00	YES
					W2-U	0.68	0.99	3.57	45.17	125.20	0.50	1.00	1.16		
14th	R3		Residential	Bedroom	W3-L	0.68	0.99	1.72	43.69	125.20	0.50	0.15	0.08	1.00	YES
					W3-U	0.68	0.99	3.19	42.45	125.20	0.50	1.00	0.97		
14th	R4		Residential	Bedroom	W4-L	0.68	0.99	0.70	78.79	125.20	0.50	0.15	0.06	1.00	YES
					W4-U	0.68	0.99	1.29	78.34	125.20	0.50	1.00	0.73		
14th	R5		Residential	Bedroom	W5-L	0.68	0.99	0.70	78.77	66.26	0.50	0.15	0.11	1.00	YES
					W5-U	0.68	0.99	1.29	78.31	66.26	0.50	1.00	1.37		
14th	R6		Residential	Bedroom	W6-L	0.68	0.99	0.70	78.72	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	78.26	66.49	0.50	1.00	1.37		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Existing Scenario
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	78.26	66.49	0.50	1.00	1.37	1.00	YES
					W7-L	0.68	0.99	0.70	82.83	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	81.84	104.32	0.50	1.00	0.91		
					W8-L	0.68	0.99	1.36	86.08	104.32	0.50	0.15	0.15		
14th	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	84.79	104.32	0.50	1.00	1.84	2.00	YES
													2.98		
					W9-L	0.68	0.99	0.70	78.60	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	78.15	65.09	0.50	1.00	1.39		
14th	R6	Residential	LKD										1.51	1.00	YES
					W10-L	0.68	0.99	0.70	82.69	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	81.71	121.62	0.50	1.00	0.78		
					W11-L	0.68	0.99	1.36	85.93	121.62	0.50	0.15	0.13		
14th	R7	Residential	Bedroom		W11-U	0.68	0.99	2.52	84.66	121.62	0.50	1.00	1.58	2.00	YES
													2.55		
					W12-L	0.68	0.99	0.70	78.49	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	78.04	56.77	0.50	1.00	1.60		
14th	R8	Residential	Bedroom										1.73	1.00	YES
					W13-L	0.68	0.99	0.70	78.41	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	77.97	56.45	0.50	1.00	1.60		
													1.73		
14th	R9	Residential	LKD										1.06	2.00	YES
					W14-L	0.68	0.99	0.70	82.50	119.79	0.50	0.15	0.06		
					W14-U	0.68	0.99	1.29	81.53	119.79	0.50	1.00	0.79		
					W15-L	0.68	0.99	1.36	85.73	119.79	0.50	0.15	0.13		
14th	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	84.48	119.79	0.50	1.00	1.60	2.00	YES
													2.58		
					W16-L	0.68	0.99	0.70	78.29	59.49	0.50	0.15	0.12		
					W16-U	0.68	0.99	1.29	77.86	59.49	0.50	1.00	1.52		
14th	R11	Residential	LKD		W17-L	0.68	0.99	0.36	41.23	59.49	0.50	0.15	0.03	1.00	YES
					W17-U	0.68	0.99	0.67	42.97	59.49	0.50	1.00	0.43		
													2.11		
					W18-L	0.68	0.99	0.36	38.19	116.88	0.50	0.15	0.02		
14th	R12	Residential	Bedroom		W18-U	0.68	0.99	0.67	38.08	116.88	0.50	1.00	0.20	2.00	YES
					W19-L	0.68	0.99	0.70	82.40	116.88	0.50	0.15	0.07		
					W19-U	0.68	0.99	1.29	81.44	116.88	0.50	1.00	0.81		
					W20-L	0.68	0.99	1.36	85.65	116.88	0.50	0.15	0.13		
14th	R13	Residential	Bedroom		W20-U	0.68	0.99	2.52	84.42	116.88	0.50	1.00	1.63	1.00	YES
													2.86		
					W21-L	0.68	0.99	0.70	78.26	55.29	0.50	0.15	0.13		
					W21-U	0.68	0.99	1.29	77.84	55.29	0.50	1.00	1.63		
14th	R14	Residential	Bedroom										1.77	1.00	YES
					W22-L	0.68	0.99	0.70	78.24	69.09	0.50	0.15	0.11		
					W22-U	0.68	0.99	1.29	77.82	69.09	0.50	1.00	1.31		
													1.41		
14th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	78.23	67.42	0.50	0.15	0.11		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R15	Residential	LKD		W23-U	0.68	0.99	1.29	77.81	67.42	0.50	1.00	1.34	1.00	YES
					W24-L	0.68	0.99	0.70	82.38	116.39	0.50	0.15	0.07		
					W24-U	0.68	0.99	1.29	81.42	116.39	0.50	1.00	0.81		
					W25-L	0.68	0.99	1.36	85.63	116.39	0.50	0.15	0.13		
14th	R16	Residential	Bedroom		W25-U	0.68	0.99	2.52	84.40	116.39	0.50	1.00	1.64	2.00	YES
					W26-L	0.68	0.99	0.70	78.28	55.28	0.50	0.15	0.13		
					W26-U	0.68	0.99	1.29	77.85	55.28	0.50	1.00	1.63		
					W27-L	0.68	0.99	0.70	78.27	69.08	0.50	0.15	0.11		
14th	R17	Residential	Bedroom		W27-U	0.68	0.99	1.29	77.84	69.08	0.50	1.00	1.31	1.00	YES
					W28-L	0.68	0.99	0.70	78.24	55.32	0.50	0.15	0.13		
					W28-U	0.68	0.99	1.29	77.82	55.32	0.50	1.00	1.63		
					W29-L	0.68	0.99	0.70	82.40	117.45	0.50	0.15	0.07		
14th	R18	Residential	Bedroom		W29-U	0.68	0.99	1.29	81.43	117.45	0.50	1.00	0.80	1.00	YES
					W30-L	0.68	0.99	1.36	85.64	117.45	0.50	0.15	0.13		
					W30-U	0.68	0.99	2.52	84.40	117.45	0.50	1.00	1.63		
					W31-L	0.68	0.99	0.36	49.91	117.45	0.50	0.15	0.02		
14th	R19	Residential	LKD		W31-U	0.68	0.99	0.67	49.87	117.45	0.50	1.00	0.26	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	34.72	125.20	0.50	1.00	0.79		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
15th	R1	Residential	LKD		W2-U	0.68	0.99	3.57	36.81	125.20	0.50	1.00	0.94	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	34.80	125.20	0.50	1.00	0.80		
					W4-L	0.68	0.99	0.70	79.11	125.20	0.50	0.15	0.06		
15th	R2	Residential	Bedroom		W4-U	0.68	0.99	1.29	78.61	125.20	0.50	1.00	0.73	1.00	YES
					W5-L	0.68	0.99	0.70	79.09	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	78.59	66.26	0.50	1.00	1.38		
					W6-L	0.68	0.99	0.70	79.04	66.49	0.50	0.15	0.11		
15th	R3	Residential	Bedroom		W6-U	0.68	0.99	1.29	78.55	66.49	0.50	1.00	1.37	1.00	YES
					W7-L	0.68	0.99	0.70	83.19	104.32	0.50	0.15	0.07		
					W7-U	0.68	0.99	1.29	82.15	104.32	0.50	1.00	0.91		
					W8-L	0.68	0.99	1.36	86.47	104.32	0.50	0.15	0.15		
15th	R4	Residential	LKD		W8-U	0.68	0.99	2.52	85.12	104.32	0.50	1.00	1.85	2.00	YES
					W9-L	0.68	0.99	0.70	78.94	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	78.45	65.09	0.50	1.00	1.40		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
15th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.06	121.62	0.50	0.15	1.51	1.00	YES
					W10-U	0.68	0.99	1.29	82.03	121.62	0.50	1.00	0.06		
					W11-L	0.68	0.99	1.36	86.35	121.62	0.50	0.15	0.78		
					W11-U	0.68	0.99	2.52	85.01	121.62	0.50	1.00	0.13		
													1.58		
15th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	78.84	56.77	0.50	0.15	2.56	2.00	YES
					W12-U	0.68	0.99	1.29	78.36	56.77	0.50	1.00	0.13		
													1.60		
													1.73	1.00	YES
													0.13		
15th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	78.77	56.45	0.50	0.15	1.61		
					W13-U	0.68	0.99	1.29	78.29	56.45	0.50	1.00	1.74	1.00	YES
													0.07		
													0.79		
													0.13		
15th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	82.90	119.79	0.50	0.15	1.60		
					W14-U	0.68	0.99	1.29	81.88	119.79	0.50	1.00	2.59	2.00	YES
					W15-L	0.68	0.99	1.36	86.16	119.79	0.50	0.15	0.07		
					W15-U	0.68	0.99	2.52	84.85	119.79	0.50	1.00	0.79		
													0.13		
15th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	78.67	59.49	0.50	0.15	0.48		
					W16-U	0.68	0.99	1.29	78.19	59.49	0.50	1.00	2.17	1.00	YES
					W17-L	0.68	0.99	0.36	46.65	59.49	0.50	0.15	0.12		
					W17-U	0.68	0.99	0.67	47.67	59.49	0.50	1.00	1.53		
													0.04		
15th	R11		Residential	LKD	W18-L	0.68	0.99	0.46	50.67	151.45	0.50	0.15	0.66		
					W18-U	0.68	0.99	0.93	78.14	151.45	0.50	1.00	2.09	2.00	YES
					W19-L	0.68	0.99	0.46	53.78	151.45	0.50	0.15	0.02		
					W19-U	0.68	0.99	0.93	83.69	151.45	0.50	1.00	0.43		
					W20-L	0.68	0.99	0.46	50.24	151.45	0.50	0.15	0.02		
					W20-U	0.68	0.99	0.93	77.82	151.45	0.50	1.00	0.46		
					W21-L	0.68	0.99	0.70	50.57	151.45	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.42	78.84	151.45	0.50	1.00	0.03		
													0.66		
15th	R12		Residential	Bedroom	W22-L	0.68	0.99	1.04	54.11	61.41	0.50	0.15	5.41	1.00	YES
					W22-U	0.68	0.99	2.11	83.67	61.41	0.50	1.00	0.12		
					W23-L	0.68	0.99	1.04	54.05	61.41	0.50	0.15	2.58		
					W23-U	0.68	0.99	2.11	83.63	61.41	0.50	1.00	0.12		
													2.58		
15th	R13		Residential	Bedroom	W24-L	0.68	0.99	1.04	54.11	95.91	0.50	0.15	1.05		
					W24-U	0.68	0.99	2.11	83.67	95.91	0.50	1.00	4.56	1.00	YES
					W25-L	0.68	0.99	1.04	54.11	95.91	0.50	0.15	0.08		
					W25-U	0.68	0.99	2.11	83.68	95.91	0.50	1.00	1.65		
					W26-L	0.68	0.99	0.70	50.57	95.91	0.50	0.15	0.05		
					W26-U	0.68	0.99	1.42	78.83	95.91	0.50	1.00	1.05		
15th	R14		Residential	Bedroom	W27-L	0.68	0.99	0.46	50.68	84.77	0.50	0.15	0.04		
					W27-U	0.68	0.99	0.93	78.13	84.77	0.50	1.00	0.77		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W28-L	0.68	0.99	0.46	53.97	84.77	0.50	0.15	0.04		
					W28-U	0.68	0.99	0.93	83.67	84.77	0.50	1.00	0.83		
					W29-L	0.68	0.99	0.46	50.68	84.77	0.50	0.15	0.04		
					W29-U	0.68	0.99	0.93	78.14	84.77	0.50	1.00	0.77		
15th	R15	Residential	Bedroom										2.49	1.00	YES
					W30-L	0.68	0.99	0.46	50.68	58.77	0.50	0.15	0.05		
					W30-U	0.68	0.99	0.93	78.12	58.77	0.50	1.00	1.12		
					W31-L	0.68	0.99	0.46	53.97	58.77	0.50	0.15	0.06		
					W31-U	0.68	0.99	0.93	83.69	58.77	0.50	1.00	1.20		
					W32-L	0.68	0.99	0.46	50.68	58.77	0.50	0.15	0.05		
					W32-U	0.68	0.99	0.93	78.12	58.77	0.50	1.00	1.12		
15th	R16	Residential	LKD										3.59	1.00	YES
					W33-L	0.68	0.99	1.04	54.09	137.56	0.50	0.15	0.05		
					W33-U	0.68	0.99	2.11	83.68	137.56	0.50	1.00	1.15		
					W34-L	0.68	0.99	1.04	54.11	137.56	0.50	0.15	0.05		
					W34-U	0.68	0.99	2.11	83.66	137.56	0.50	1.00	1.15		
					W35-L	0.68	0.99	0.70	50.45	137.56	0.50	0.15	0.03		
					W35-U	0.68	0.99	1.42	78.83	137.56	0.50	1.00	0.73		
16th	R1	Residential	LKD										3.18	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	35.73	125.20	0.50	1.00	0.82		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	37.90	125.20	0.50	1.00	0.97		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	35.93	125.20	0.50	1.00	0.82		
16th	R2	Residential	Bedroom										3.64	2.00	YES
					W4-L	0.68	0.99	0.70	79.28	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	78.74	125.20	0.50	1.00	0.73		
					W5-L	0.68	0.99	0.70	79.26	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	78.73	66.26	0.50	1.00	1.38		
													1.49	1.00	YES
16th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	79.22	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	78.69	66.49	0.50	1.00	1.37		
													1.49	1.00	YES
16th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	83.39	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.31	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	86.68	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.30	104.32	0.50	1.00	1.85		
16th	R5	Residential	Bedroom										2.99	2.00	YES
					W9-L	0.68	0.99	0.70	79.13	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	78.61	65.09	0.50	1.00	1.40		
													1.52	1.00	YES
16th	R6	Residential	LKD												
					W10-L	0.68	0.99	0.70	83.28	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.20	121.62	0.50	1.00	0.78		
					W11-L	0.68	0.99	1.36	86.58	121.62	0.50	0.15	0.13		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W11-U	0.68	0.99	2.52	85.20	121.62	0.50	1.00	1.59	2.00	YES
													2.56		
16th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.05	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	78.53	56.77	0.50	1.00	1.61		
													1.74	1.00	YES
16th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	78.99	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	78.47	56.45	0.50	1.00	1.61		
													1.74	1.00	YES
16th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	83.14	119.79	0.50	0.15	0.07		
					W14-U	0.68	0.99	1.29	82.07	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	86.43	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.05	119.79	0.50	1.00	1.61		
													2.60		
16th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	78.90	59.49	0.50	0.15	0.12		
					W16-U	0.68	0.99	1.29	78.38	59.49	0.50	1.00	1.53		
					W17-L	0.68	0.99	0.36	48.58	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	48.67	59.49	0.50	1.00	0.49		
													2.19		
17th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.79	125.20	0.50	1.00	0.99		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.88	125.20	0.50	1.00	0.84		
					W4-L	0.68	0.99	0.70	79.36	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	78.80	125.20	0.50	1.00	0.73		
													3.70		
17th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	79.34	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	78.78	66.26	0.50	1.00	1.38		
													1.49	1.00	YES
17th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.31	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	78.75	66.49	0.50	1.00	1.37		
													1.49	1.00	YES
17th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	83.49	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.38	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	86.80	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.38	104.32	0.50	1.00	1.85		
													3.00		
17th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	79.23	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	78.68	65.09	0.50	1.00	1.40		
													1.52	1.00	YES
17th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.40	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.29	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	86.71	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.30	121.62	0.50	1.00	1.59		

[illegible]

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
18th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.25	56.77	0.50	0.15	0.13	1.00	YES
					W12-U	0.68	0.99	1.29	78.70	56.77	0.50	1.00	1.61		
					1.74										
18th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	79.20	56.45	0.50	0.15	0.13	1.00	YES
					W13-U	0.68	0.99	1.29	78.66	56.45	0.50	1.00	1.62		
					1.75										
18th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	83.38	119.79	0.50	0.15	0.07	1.00	YES
					W14-U	0.68	0.99	1.29	82.28	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	86.69	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.29	119.79	0.50	1.00	1.61		
2.61													2.00		
18th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.14	59.49	0.50	0.15	0.12	1.00	YES
					W16-U	0.68	0.99	1.29	78.60	59.49	0.50	1.00	1.53		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
2.20													1.00		
19th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	1.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.95	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.08	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.45	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	78.88	125.20	0.50	1.00	0.73		
3.71													2.00		
19th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	79.44	66.26	0.50	0.15	0.11	1.00	YES
					W5-U	0.68	0.99	1.29	78.88	66.26	0.50	1.00	1.38		
1.49													1.00		
19th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.42	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	78.86	66.49	0.50	1.00	1.38		
1.49													1.00		
19th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	83.62	104.32	0.50	0.15	0.08	1.00	YES
					W7-U	0.68	0.99	1.29	82.50	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	86.95	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.52	104.32	0.50	1.00	1.86		
3.00													2.00		
19th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	79.37	65.09	0.50	0.15	0.11	1.00	YES
					W9-U	0.68	0.99	1.29	78.81	65.09	0.50	1.00	1.41		
1.52													1.00		
19th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.55	121.62	0.50	0.15	0.06	1.00	YES
					W10-U	0.68	0.99	1.29	82.44	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	86.88	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.47	121.62	0.50	1.00	1.59		
2.57													2.00		
19th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.32	56.77	0.50	0.15	0.13		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	78.77	56.77	0.50	1.00	1.61	1.00	YES
													1.74		
19th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	79.29	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	78.74	56.45	0.50	1.00	1.62		
													1.75	1.00	YES
													0.07		
19th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	83.47	119.79	0.50	0.15	0.80		
					W14-U	0.68	0.99	1.29	82.38	119.79	0.50	1.00	0.13		
					W15-L	0.68	0.99	1.36	86.79	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.40	119.79	0.50	1.00	1.61		
													2.61	2.00	YES
													0.13		
19th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	79.23	59.49	0.50	0.15	1.54		
					W16-U	0.68	0.99	1.29	78.69	59.49	0.50	1.00	0.04		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.50		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.73		
													2.20	1.00	YES
													0.07		
20th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.84		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.09		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	1.00		
					W2-U	0.68	0.99	3.57	39.02	125.20	0.50	1.00	0.07		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.85		
					W3-U	0.68	0.99	3.19	37.15	125.20	0.50	1.00	0.06		
					W4-L	0.68	0.99	0.70	79.49	125.20	0.50	0.15	0.73		
					W4-U	0.68	0.99	1.29	78.92	125.20	0.50	1.00	3.71		
													2.00	2.00	YES
													0.11		
20th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	79.49	66.26	0.50	0.15	1.38		
					W5-U	0.68	0.99	1.29	78.92	66.26	0.50	1.00	1.49		
													1.00	1.00	YES
													0.11		
20th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	79.47	66.49	0.50	0.15	1.38		
					W6-U	0.68	0.99	1.29	78.91	66.49	0.50	1.00	1.49		
													1.00	1.00	YES
													0.08		
20th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	83.68	104.32	0.50	0.15	0.92		
					W7-U	0.68	0.99	1.29	82.56	104.32	0.50	1.00	0.15		
					W8-L	0.68	0.99	1.36	87.01	104.32	0.50	0.15	1.86		
					W8-U	0.68	0.99	2.52	85.59	104.32	0.50	1.00	3.00		
													2.00	2.00	YES
													0.11		
20th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	79.43	65.09	0.50	0.15	1.41		
					W9-U	0.68	0.99	1.29	78.87	65.09	0.50	1.00	1.52		
													1.00	1.00	YES
													0.06		
20th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	83.63	121.62	0.50	0.15	0.79		
					W10-U	0.68	0.99	1.29	82.52	121.62	0.50	1.00	0.13		
					W11-L	0.68	0.99	1.36	86.97	121.62	0.50	0.15	1.59		
					W11-U	0.68	0.99	2.52	85.55	121.62	0.50	1.00	2.58		
													2.00	2.00	YES
													0.13		
20th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	79.40	56.77	0.50	0.15	1.61		
					W12-U	0.68	0.99	1.29	78.85	56.77	0.50	1.00	1.61		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
20th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	79.38	56.45	0.50	0.15	1.74	1.00	YES
					W13-U	0.68	0.99	1.29	78.83	56.45	0.50	1.00	0.13		
20th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	83.58	119.79	0.50	0.15	1.75	1.00	YES
					W14-U	0.68	0.99	1.29	82.47	119.79	0.50	1.00	0.07		
					W15-L	0.68	0.99	1.36	86.91	119.79	0.50	0.15	0.80		
					W15-U	0.68	0.99	2.52	85.50	119.79	0.50	1.00	0.13		
													1.62		
20th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	79.34	59.49	0.50	0.15	2.61	2.00	YES
					W16-U	0.68	0.99	1.29	78.79	59.49	0.50	1.00	0.13		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	1.54		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.04		
													0.50		
21st	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	2.20	1.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.07		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.84		
					W2-U	0.68	0.99	3.57	39.06	125.20	0.50	1.00	0.09		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	1.00		
					W3-U	0.68	0.99	3.19	37.20	125.20	0.50	1.00	0.07		
					W4-L	0.68	0.99	0.70	79.53	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	78.97	125.20	0.50	1.00	0.06		
													0.73		
													3.72	2.00	YES
21st	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	79.53	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	78.97	66.26	0.50	1.00	1.38		
21st	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	79.53	66.49	0.50	0.15	1.50	1.00	YES
					W6-U	0.68	0.99	1.29	78.96	66.49	0.50	1.00	0.11		
21st	R4	Residential	LKD		W7-L	0.68	0.99	0.70	83.74	104.32	0.50	0.15	1.38		
					W7-U	0.68	0.99	1.29	82.62	104.32	0.50	1.00	1.49	1.00	YES
					W8-L	0.68	0.99	1.36	87.09	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	85.66	104.32	0.50	1.00	0.92		
													0.15		
21st	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	79.50	65.09	0.50	0.15	1.86		
					W9-U	0.68	0.99	1.29	78.94	65.09	0.50	1.00	3.01	2.00	YES
21st	R6	Residential	LKD		W10-L	0.68	0.99	0.70	83.70	121.62	0.50	0.15	0.11		
					W10-U	0.68	0.99	1.29	82.60	121.62	0.50	1.00	1.41		
					W11-L	0.68	0.99	1.36	87.05	121.62	0.50	0.15	1.52	1.00	YES
					W11-U	0.68	0.99	2.52	85.63	121.62	0.50	1.00	0.06		
													0.79		
21st	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	79.47	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	78.92	56.77	0.50	1.00	1.61		
													1.74	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria							
21st	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	79.46	56.45	0.50	0.15	0.13	1.00								
					W13-U	0.68	0.99	1.29	78.91	56.45	0.50	1.00	1.62									
21st	R9		Residential	LKD	W14-L	0.68	0.99	0.70	83.67	119.79	0.50	0.15	0.07	1.00								
					W14-U	0.68	0.99	1.29	82.57	119.79	0.50	1.00	0.80									
					W15-L	0.68	0.99	1.36	87.01	119.79	0.50	0.15	0.13									
					W15-U	0.68	0.99	2.52	85.60	119.79	0.50	1.00	1.62									
21st	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.43	59.49	0.50	0.15	0.13	1.00								
					W16-U	0.68	0.99	1.29	78.89	59.49	0.50	1.00	1.54									
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04									
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50									
22nd	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	1.00								
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84									
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09									
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00									
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07									
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85									
					W4-L	0.68	0.99	0.70	79.58	125.20	0.50	0.15	0.06									
					W4-U	0.68	0.99	1.29	79.00	125.20	0.50	1.00	0.73									
					22nd	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70			79.58	66.26	0.50	0.15	0.11	1.00	
										W5-U	0.68	0.99	1.29			79.01	66.26	0.50	1.00	1.38		
22nd	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.58	66.49	0.50	0.15	0.11	1.00								
					W6-U	0.68	0.99	1.29	79.01	66.49	0.50	1.00	1.38									
22nd	R4		Residential	LKD	W7-L	0.68	0.99	0.70	83.80	104.32	0.50	0.15	0.08	1.00								
					W7-U	0.68	0.99	1.29	82.67	104.32	0.50	1.00	0.92									
					W8-L	0.68	0.99	1.36	87.16	104.32	0.50	0.15	0.15									
					W8-U	0.68	0.99	2.52	85.72	104.32	0.50	1.00	1.86									
22nd	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	79.56	65.09	0.50	0.15	0.11	1.00								
					W9-U	0.68	0.99	1.29	79.00	65.09	0.50	1.00	1.41									
22nd	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.78	121.62	0.50	0.15	0.06	1.00								
					W10-U	0.68	0.99	1.29	82.66	121.62	0.50	1.00	0.79									
					W11-L	0.68	0.99	1.36	87.14	121.62	0.50	0.15	0.13									
					W11-U	0.68	0.99	2.52	85.71	121.62	0.50	1.00	1.60									
22nd	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.55	56.77	0.50	0.15	0.13	1.00								
					W12-U	0.68	0.99	1.29	78.99	56.77	0.50	1.00	1.61									
22nd	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	79.55	56.45	0.50	0.15	0.13									

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
22nd	R9	Residential	LKD		W13-U	0.68	0.99	1.29	78.99	56.45	0.50	1.00	1.62	1.00	YES
					W14-L	0.68	0.99	0.70	83.77	119.79	0.50	0.15	0.07		
					W14-U	0.68	0.99	1.29	82.65	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	87.12	119.79	0.50	0.15	0.13		
22nd	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	85.70	119.79	0.50	1.00	1.62	2.00	YES
					W16-L	0.68	0.99	0.70	79.53	59.49	0.50	0.15	0.13		
					W16-U	0.68	0.99	1.29	78.98	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
23rd	R1	Residential	LKD		W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50	1.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
23rd	R2	Residential	Bedroom		W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.61	125.20	0.50	0.15	0.06		
23rd	R3	Residential	Bedroom		W4-U	0.68	0.99	1.29	79.03	125.20	0.50	1.00	0.73	1.00	YES
					W5-L	0.68	0.99	0.70	79.62	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.04	66.26	0.50	1.00	1.38		
					W6-L	0.68	0.99	0.70	79.62	66.49	0.50	0.15	0.11		
23rd	R4	Residential	LKD		W6-U	0.68	0.99	1.29	79.04	66.49	0.50	1.00	1.38	1.00	YES
					W7-L	0.68	0.99	0.70	83.85	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.71	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.21	104.32	0.50	0.15	0.15		
23rd	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	85.76	104.32	0.50	1.00	1.86	2.00	YES
					W9-L	0.68	0.99	0.70	79.61	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	79.03	65.09	0.50	1.00	1.41		
					W10-L	0.68	0.99	0.70	83.84	121.62	0.50	0.15	0.06		
23rd	R6	Residential	LKD		W10-U	0.68	0.99	1.29	82.70	121.62	0.50	1.00	0.79	2.00	YES
					W11-L	0.68	0.99	1.36	87.20	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.75	121.62	0.50	1.00	1.60		
					W12-L	0.68	0.99	0.70	79.60	56.77	0.50	0.15	0.13		
23rd	R7	Residential	Bedroom		W12-U	0.68	0.99	1.29	79.03	56.77	0.50	1.00	1.62	1.00	YES
					W13-L	0.68	0.99	0.70	79.60	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.03	56.45	0.50	1.00	1.62		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
23rd	R9		Residential	LKD	W14-L	0.68	0.99	0.70	83.83	119.79	0.50	0.15	1.76	1.00	YES
					W14-U	0.68	0.99	1.29	82.70	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	87.19	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.74	119.79	0.50	1.00	1.62		
													2.62	2.00	YES
23rd	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.59	59.49	0.50	0.15	0.13		
					W16-U	0.68	0.99	1.29	79.02	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
													2.20	1.00	YES
24th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.64	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.06	125.20	0.50	1.00	0.73		
													3.72	2.00	YES
24th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	79.64	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.06	66.26	0.50	1.00	1.38		
													1.50	1.00	YES
24th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.64	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	79.06	66.49	0.50	1.00	1.38		
													1.49	1.00	YES
24th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	83.87	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.73	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.24	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.78	104.32	0.50	1.00	1.86		
													3.01	2.00	YES
24th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	79.63	65.09	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.29	79.05	65.09	0.50	1.00	1.41		
													1.52	1.00	YES
24th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.86	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.72	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	87.23	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.78	121.62	0.50	1.00	1.60		
													2.58	2.00	YES
24th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.63	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	79.05	56.77	0.50	1.00	1.62		
													1.75	1.00	YES
24th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	79.63	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.05	56.45	0.50	1.00	1.62		
													1.76	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
24th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	83.86	119.79	0.50	0.15	0.07			
				W14-U	0.68	0.99	1.29	82.72	119.79	0.50	1.00	0.80			
				W15-L	0.68	0.99	1.36	87.23	119.79	0.50	0.15	0.13			
				W15-U	0.68	0.99	2.52	85.77	119.79	0.50	1.00	1.62			
													2.62	2.00	YES
24th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	79.62	59.49	0.50	0.15	0.13			
				W16-U	0.68	0.99	1.29	79.04	59.49	0.50	1.00	1.54			
				W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04			
				W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50			
													2.21	1.00	YES
25th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07			
				W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84			
				W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00			
				W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07			
				W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85			
				W4-L	0.68	0.99	0.70	79.66	125.20	0.50	0.15	0.06			
				W4-U	0.68	0.99	1.29	79.08	125.20	0.50	1.00	0.73			
													3.72	2.00	YES
25th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	79.66	66.26	0.50	0.15	0.11			
				W5-U	0.68	0.99	1.29	79.09	66.26	0.50	1.00	1.39			
													1.50	1.00	YES
25th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	79.66	66.49	0.50	0.15	0.11			
				W6-U	0.68	0.99	1.29	79.09	66.49	0.50	1.00	1.38			
													1.49	1.00	YES
25th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	83.89	104.32	0.50	0.15	0.08			
				W7-U	0.68	0.99	1.29	82.76	104.32	0.50	1.00	0.92			
				W8-L	0.68	0.99	1.36	87.27	104.32	0.50	0.15	0.15			
				W8-U	0.68	0.99	2.52	85.81	104.32	0.50	1.00	1.86			
													3.01	2.00	YES
25th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	79.65	65.09	0.50	0.15	0.11			
				W9-U	0.68	0.99	1.29	79.08	65.09	0.50	1.00	1.41			
													1.52	1.00	YES
25th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	83.89	121.62	0.50	0.15	0.06			
				W10-U	0.68	0.99	1.29	82.75	121.62	0.50	1.00	0.79			
				W11-L	0.68	0.99	1.36	87.26	121.62	0.50	0.15	0.13			
				W11-U	0.68	0.99	2.52	85.80	121.62	0.50	1.00	1.60			
													2.58	2.00	YES
25th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	79.65	56.77	0.50	0.15	0.13			
				W12-U	0.68	0.99	1.29	79.08	56.77	0.50	1.00	1.62			
													1.75	1.00	YES
25th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	79.65	56.45	0.50	0.15	0.13			
				W13-U	0.68	0.99	1.29	79.07	56.45	0.50	1.00	1.63			
													1.76	1.00	YES
25th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	83.88	119.79	0.50	0.15	0.07			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	82.75	119.79	0.50	1.00	0.80	2.00	YES
					W15-L	0.68	0.99	1.36	87.25	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.80	119.79	0.50	1.00	1.62		
25th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	79.64	59.49	0.50	0.15	0.13	1.00	YES
					W16-U	0.68	0.99	1.29	79.07	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.35	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50		
													2.21		
26th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.68	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.10	125.20	0.50	1.00	0.73		
													3.72		
26th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	79.68	66.26	0.50	0.15	0.11	1.00	YES
					W5-U	0.68	0.99	1.29	79.10	66.26	0.50	1.00	1.39		
26th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	79.68	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	79.10	66.49	0.50	1.00	1.38		
													1.49		
26th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	83.92	104.32	0.50	0.15	0.08	2.00	YES
					W7-U	0.68	0.99	1.29	82.78	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.29	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.83	104.32	0.50	1.00	1.86		
26th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	79.68	65.09	0.50	0.15	0.11	1.00	YES
					W9-U	0.68	0.99	1.29	79.10	65.09	0.50	1.00	1.41		
													1.53		
26th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	83.91	121.62	0.50	0.15	0.06	2.00	YES
					W10-U	0.68	0.99	1.29	82.77	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	87.29	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.83	121.62	0.50	1.00	1.60		
26th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	79.68	56.77	0.50	0.15	0.13	1.00	YES
					W12-U	0.68	0.99	1.29	79.10	56.77	0.50	1.00	1.62		
													1.75		
26th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	79.68	56.45	0.50	0.15	0.13	1.00	YES
					W13-U	0.68	0.99	1.29	79.10	56.45	0.50	1.00	1.63		
26th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	83.91	119.79	0.50	0.15	0.07	1.00	YES
					W14-U	0.68	0.99	1.29	82.77	119.79	0.50	1.00	0.80		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W15-L	0.68	0.99	1.36	87.28	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.82	119.79	0.50	1.00	1.62		
													2.62	2.00	YES
26th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	79.67	59.49	0.50	0.15	0.13		
					W16-U	0.68	0.99	1.29	79.09	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.36	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.23	59.49	0.50	1.00	0.50		
													2.21	1.00	YES
27th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.70	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.12	125.20	0.50	1.00	0.73		
													3.72	2.00	YES
27th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	79.71	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.13	66.26	0.50	1.00	1.39		
													1.50	1.00	YES
27th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	79.71	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	79.13	66.49	0.50	1.00	1.38		
													1.49	1.00	YES
27th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	83.94	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.80	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.32	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.86	104.32	0.50	1.00	1.86		
													3.01	2.00	YES
27th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	79.70	65.09	0.50	0.15	0.12		
					W9-U	0.68	0.99	1.29	79.12	65.09	0.50	1.00	1.41		
													1.53	1.00	YES
27th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	83.93	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.80	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	87.31	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.85	121.62	0.50	1.00	1.60		
													2.58	2.00	YES
27th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	79.70	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	79.12	56.77	0.50	1.00	1.62		
													1.75	1.00	YES
27th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	79.70	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.12	56.45	0.50	1.00	1.63		
													1.76	1.00	YES
27th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	83.93	119.79	0.50	0.15	0.07		
					W14-U	0.68	0.99	1.29	82.79	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	87.31	119.79	0.50	0.15	0.13		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
27th	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	85.85	119.79	0.50	1.00	1.62	2.00	YES
													2.62		
					W16-L	0.68	0.99	0.70	79.69	59.49	0.50	0.15	0.13		
					W16-U	0.68	0.99	1.29	79.12	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.37	59.49	0.50	0.15	0.04		
28th	R1	Residential	LKD		W17-U	0.68	0.99	0.67	49.24	59.49	0.50	1.00	0.50	1.00	YES
													2.21		
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
28th	R2	Residential	Bedroom		W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.72	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.14	125.20	0.50	1.00	0.73		
28th	R3	Residential	Bedroom										3.72	1.00	YES
					W5-L	0.68	0.99	0.70	79.73	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.15	66.26	0.50	1.00	1.39		
													1.50		
													1.49		
28th	R4	Residential	LKD		W6-L	0.68	0.99	0.70	79.73	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	79.15	66.49	0.50	1.00	1.38		
													1.86		
					W7-L	0.68	0.99	0.70	83.96	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.82	104.32	0.50	1.00	0.92		
28th	R5	Residential	Bedroom		W8-L	0.68	0.99	1.36	87.34	104.32	0.50	0.15	0.15	2.00	YES
					W8-U	0.68	0.99	2.52	85.88	104.32	0.50	1.00	1.86		
													3.01		
					W9-L	0.68	0.99	0.70	79.72	65.09	0.50	0.15	0.12		
					W9-U	0.68	0.99	1.29	79.14	65.09	0.50	1.00	1.41		
28th	R6	Residential	LKD										1.53	1.00	YES
													0.06		
					W10-L	0.68	0.99	0.70	83.96	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.82	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	87.34	121.62	0.50	0.15	0.13		
28th	R7	Residential	Bedroom		W11-U	0.68	0.99	2.52	85.88	121.62	0.50	1.00	1.60	2.00	YES
													2.58		
					W12-L	0.68	0.99	0.70	79.72	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	79.14	56.77	0.50	1.00	1.62		
													1.75		
28th	R8	Residential	Bedroom										0.13	1.00	YES
					W13-L	0.68	0.99	0.70	79.72	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.14	56.45	0.50	1.00	1.63		
													1.76		
													1.00		
28th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	83.96	119.79	0.50	0.15	0.07	1.00	YES
					W14-U	0.68	0.99	1.29	82.81	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	87.34	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.87	119.79	0.50	1.00	1.62		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
28th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.71	59.49	0.50	0.15	2.62	2.00	YES
					W16-U	0.68	0.99	1.29	79.13	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.40	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.26	59.49	0.50	1.00	0.50		
													2.21	1.00	YES
29th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.75	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.17	125.20	0.50	1.00	0.73		
29th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	79.75	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.17	66.26	0.50	1.00	1.39		
29th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.75	66.49	0.50	0.15	1.50	1.00	YES
					W6-U	0.68	0.99	1.29	79.17	66.49	0.50	1.00	1.38		
29th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	83.99	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.85	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.37	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.91	104.32	0.50	1.00	1.86		
29th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	79.74	65.09	0.50	0.15	3.01	2.00	YES
					W9-U	0.68	0.99	1.29	79.16	65.09	0.50	1.00	1.41		
29th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	83.98	121.62	0.50	0.15	1.53	1.00	YES
					W10-U	0.68	0.99	1.29	82.84	121.62	0.50	1.00	0.06		
					W11-L	0.68	0.99	1.36	87.37	121.62	0.50	0.15	0.79		
					W11-U	0.68	0.99	2.52	85.90	121.62	0.50	1.00	0.13		
29th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.74	56.77	0.50	0.15	1.60		
					W12-U	0.68	0.99	1.29	79.16	56.77	0.50	1.00	2.59	2.00	YES
29th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	79.74	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.16	56.45	0.50	1.00	1.62		
29th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	83.98	119.79	0.50	0.15	1.75	1.00	YES
					W14-U	0.68	0.99	1.29	82.84	119.79	0.50	1.00	0.13		
29th	R9		Residential	LKD	W15-L	0.68	0.99	1.36	87.37	119.79	0.50	0.15	1.63		
					W15-U	0.68	0.99	2.52	85.90	119.79	0.50	1.00	1.76	1.00	YES
													2.63	2.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
29th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.74	59.49	0.50	0.15	0.13	1.00	YES
					W16-U	0.68	0.99	1.29	79.16	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.46	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.32	59.49	0.50	1.00	0.50		
													2.21		
30th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.77	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.19	125.20	0.50	1.00	0.73		
30th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	79.77	66.26	0.50	0.15	0.11	1.00	YES
					W5-U	0.68	0.99	1.29	79.19	66.26	0.50	1.00	1.39		
30th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	79.77	66.49	0.50	0.15	0.11	1.00	YES
					W6-U	0.68	0.99	1.29	79.19	66.49	0.50	1.00	1.38		
30th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	84.01	104.32	0.50	0.15	0.08	1.00	YES
					W7-U	0.68	0.99	1.29	82.87	104.32	0.50	1.00	0.92		
30th	R5		Residential	Bedroom	W8-L	0.68	0.99	1.36	87.40	104.32	0.50	0.15	0.15	1.00	YES
					W8-U	0.68	0.99	2.52	85.94	104.32	0.50	1.00	1.86		
30th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	84.00	121.62	0.50	0.15	0.06	1.00	YES
					W10-U	0.68	0.99	1.29	82.87	121.62	0.50	1.00	0.79		
30th	R7		Residential	Bedroom	W11-L	0.68	0.99	1.36	87.39	121.62	0.50	0.15	0.13	1.00	YES
					W11-U	0.68	0.99	2.52	85.93	121.62	0.50	1.00	1.60		
30th	R8		Residential	Bedroom	W12-L	0.68	0.99	0.70	79.76	56.77	0.50	0.15	0.13	1.00	YES
					W12-U	0.68	0.99	1.29	79.19	56.77	0.50	1.00	1.62		
30th	R9		Residential	LKD	W13-L	0.68	0.99	0.70	79.76	56.45	0.50	0.15	0.13	1.00	YES
					W13-U	0.68	0.99	1.29	79.19	56.45	0.50	1.00	1.63		
30th	R10		Residential	Bedroom	W14-L	0.68	0.99	0.70	84.00	119.79	0.50	0.15	0.07	1.00	YES
					W14-U	0.68	0.99	1.29	82.86	119.79	0.50	1.00	0.80		
30th	R10		Residential	Bedroom	W15-L	0.68	0.99	1.36	87.39	119.79	0.50	0.15	0.13	1.00	YES
					W15-U	0.68	0.99	2.52	85.93	119.79	0.50	1.00	1.62		
30th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	79.76	59.49	0.50	0.15	0.13	1.00	YES
					W16-U	0.68	0.99	1.29	79.16	59.49	0.50	1.00	1.54		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	79.18	59.49	0.50	1.00	1.54		
					W17-L	0.68	0.99	0.36	49.55	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.44	59.49	0.50	1.00	0.50		
31st	R1	Residential	LKD										2.21	1.00	YES
					W1-L	0.68	0.99	1.72	40.58	125.20	0.50	0.15	0.08		
					W1-U	0.68	0.99	3.19	36.63	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	43.53	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.14	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08		
					W3-U	0.68	0.99	3.19	37.26	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	79.79	125.20	0.50	0.15	0.06		
					W4-U	0.68	0.99	1.29	79.21	125.20	0.50	1.00	0.73		
													3.73	2.00	YES
31st	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	79.79	66.26	0.50	0.15	0.11		
					W5-U	0.68	0.99	1.29	79.21	66.26	0.50	1.00	1.39		
31st	R3	Residential	Bedroom										1.50	1.00	YES
					W6-L	0.68	0.99	0.70	79.79	66.49	0.50	0.15	0.11		
					W6-U	0.68	0.99	1.29	79.21	66.49	0.50	1.00	1.38		
31st	R4	Residential	LKD										1.50	1.00	YES
					W7-L	0.68	0.99	0.70	84.03	104.32	0.50	0.15	0.08		
					W7-U	0.68	0.99	1.29	82.89	104.32	0.50	1.00	0.92		
					W8-L	0.68	0.99	1.36	87.42	104.32	0.50	0.15	0.15		
					W8-U	0.68	0.99	2.52	85.96	104.32	0.50	1.00	1.87		
31st	R5	Residential	Bedroom										3.02	2.00	YES
					W9-L	0.68	0.99	0.70	79.79	65.09	0.50	0.15	0.12		
					W9-U	0.68	0.99	1.29	79.21	65.09	0.50	1.00	1.41		
31st	R6	Residential	LKD										1.53	1.00	YES
					W10-L	0.68	0.99	0.70	84.03	121.62	0.50	0.15	0.06		
					W10-U	0.68	0.99	1.29	82.89	121.62	0.50	1.00	0.79		
					W11-L	0.68	0.99	1.36	87.42	121.62	0.50	0.15	0.13		
					W11-U	0.68	0.99	2.52	85.95	121.62	0.50	1.00	1.60		
31st	R7	Residential	Bedroom										2.59	2.00	YES
					W12-L	0.68	0.99	0.70	79.79	56.77	0.50	0.15	0.13		
					W12-U	0.68	0.99	1.29	79.21	56.77	0.50	1.00	1.62		
31st	R8	Residential	Bedroom										1.75	1.00	YES
					W13-L	0.68	0.99	0.70	79.79	56.45	0.50	0.15	0.13		
					W13-U	0.68	0.99	1.29	79.21	56.45	0.50	1.00	1.63		
31st	R9	Residential	LKD										1.76	1.00	YES
					W14-L	0.68	0.99	0.70	84.03	119.79	0.50	0.15	0.07		
					W14-U	0.68	0.99	1.29	82.88	119.79	0.50	1.00	0.80		
					W15-L	0.68	0.99	1.36	87.42	119.79	0.50	0.15	0.13		
					W15-U	0.68	0.99	2.52	85.95	119.79	0.50	1.00	1.62		
31st	R10	Residential	Bedroom										2.63	2.00	YES
					W16-L	0.68	0.99	0.70	79.78	59.49	0.50	0.15	0.13		
					W16-U	0.68	0.99	1.29	79.20	59.49	0.50	1.00	1.54		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Existing Scenario
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-L	0.68	0.99	0.36	49.76	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.73	59.49	0.50	1.00	0.50		
													2.21	1.00	YES
32nd	R1	Residential	Bedroom	W1-L	0.68	0.99	0.71	63.31	204.87	0.50	0.15	0.03			
				W1-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44			
				W2-L	0.68	0.99	0.71	62.13	204.87	0.50	0.15	0.03			
				W2-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44			
				W3-L	0.68	0.99	1.51	75.84	204.87	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.07	85.50	204.87	0.50	1.00	1.15			
				W4-L	0.68	0.99	1.51	74.26	204.87	0.50	0.15	0.07			
				W4-U	0.68	0.99	3.07	85.60	204.87	0.50	1.00	1.15			
				W5-L	0.68	0.99	0.46	40.16	204.87	0.50	0.15	0.01			
				W5-U	0.68	0.99	0.93	79.15	204.87	0.50	1.00	0.32			
				W6-L	0.68	0.99	0.46	43.05	204.87	0.50	0.15	0.01			
				W6-U	0.68	0.99	0.93	84.82	204.87	0.50	1.00	0.35			
				W7-L	0.68	0.99	0.46	40.16	204.87	0.50	0.15	0.01			
				W7-U	0.68	0.99	0.93	79.15	204.87	0.50	1.00	0.32			
				W8-L	0.68	0.99	0.70	39.85	204.87	0.50	0.15	0.02			
				W8-U	0.68	0.99	1.42	79.87	204.87	0.50	1.00	0.50			
													4.94	1.00	YES
32nd	R2	Residential	Bedroom	W9-L	0.68	0.99	0.70	39.85	83.23	0.50	0.15	0.04			
				W9-U	0.68	0.99	1.42	79.87	83.23	0.50	1.00	1.22			
				W10-L	0.68	0.99	0.46	40.16	83.23	0.50	0.15	0.03			
				W10-U	0.68	0.99	0.93	79.15	83.23	0.50	1.00	0.80			
				W11-L	0.68	0.99	0.46	43.05	83.23	0.50	0.15	0.03			
				W11-U	0.68	0.99	0.93	84.81	83.23	0.50	1.00	0.86			
				W12-L	0.68	0.99	0.46	40.16	83.23	0.50	0.15	0.03			
				W12-U	0.68	0.99	0.93	79.15	83.23	0.50	1.00	0.80			
													3.81	1.00	YES
32nd	R3	Residential	Bedroom	W13-L	0.68	0.99	0.46	40.16	74.19	0.50	0.15	0.03			
				W13-U	0.68	0.99	0.93	79.15	74.19	0.50	1.00	0.90			
				W14-L	0.68	0.99	0.46	43.05	74.19	0.50	0.15	0.04			
				W14-U	0.68	0.99	0.93	84.81	74.19	0.50	1.00	0.96			
				W15-L	0.68	0.99	0.46	40.16	74.19	0.50	0.15	0.03			
				W15-U	0.68	0.99	0.93	79.15	74.19	0.50	1.00	0.90			
													2.85	1.00	YES
32nd	R4	Residential	Bedroom	W16-L	0.68	0.99	1.04	43.20	134.08	0.50	0.15	0.05			
				W16-U	0.68	0.99	2.11	84.81	134.08	0.50	1.00	1.20			
				W17-L	0.68	0.99	1.04	43.20	134.08	0.50	0.15	0.05			
				W17-U	0.68	0.99	2.11	84.81	134.08	0.50	1.00	1.20			
				W18-L	0.68	0.99	0.70	39.85	134.08	0.50	0.15	0.03			
				W18-U	0.68	0.99	1.42	79.87	134.08	0.50	1.00	0.76			
													3.28	1.00	YES
32nd	R5	Residential	Bedroom	W19-L	0.68	0.99	0.46	40.04	63.41	0.50	0.15	0.04			
				W19-U	0.68	0.99	0.93	79.15	63.41	0.50	1.00	1.05			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Existing Scenario
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	0.46	42.94	63.41	0.50	0.15	0.04		
					W20-U	0.68	0.99	0.93	84.81	63.41	0.50	1.00	1.12		
					W21-L	0.68	0.99	0.46	40.16	63.41	0.50	0.15	0.04		
					W21-U	0.68	0.99	0.93	79.15	63.41	0.50	1.00	1.05		
													3.34	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
Oxygen Towers															
00 GF	R1	Residential	Lobby	W1	0.68	0.99	3.12	30.94	729.43	0.50	1.00	0.12	4.03	-1.00	NO
				W2	0.68	0.99	0.91	31.55	729.43	0.50	1.00	0.04			
				W3	0.68	0.99	4.22	31.31	729.43	0.50	1.00	0.16			
				W4	0.68	0.99	4.22	31.65	729.43	0.50	1.00	0.16			
				W5	0.68	0.99	4.22	32.53	729.43	0.50	1.00	0.17			
				W6	0.68	0.99	4.22	33.56	729.43	0.50	1.00	0.17			
				W7	0.68	0.99	4.22	34.59	729.43	0.50	1.00	0.18			
				W8	0.68	0.99	4.22	35.68	729.43	0.50	1.00	0.19			
				W9	0.68	0.99	4.22	36.76	729.43	0.50	1.00	0.19			
				W10	0.68	0.99	4.22	37.87	729.43	0.50	1.00	0.20			
				W11	0.68	0.99	4.22	39.04	729.43	0.50	1.00	0.20			
				W12	0.68	0.99	4.22	40.09	729.43	0.50	1.00	0.21			
				W13	0.68	0.99	4.22	40.96	729.43	0.50	1.00	0.21			
				W14	0.68	0.99	4.22	41.83	729.43	0.50	1.00	0.22			
				W15	0.68	0.99	4.22	42.86	729.43	0.50	1.00	0.22			
				W16	0.68	0.99	4.22	43.53	729.43	0.50	1.00	0.23			
				W17	0.68	0.99	4.22	42.49	729.43	0.50	1.00	0.22			
				W18	0.68	0.99	4.29	34.63	729.43	0.50	1.00	0.18			
				W19-L	0.68	0.99	0.41	35.39	729.43	0.50	0.15	0.00			
				W19-U	0.68	0.99	1.39	20.00	729.43	0.50	1.00	0.03			
				W20-L	0.68	0.99	0.90	37.56	729.43	0.50	0.15	0.01			
				W20-U	0.68	0.99	1.46	31.60	729.43	0.50	1.00	0.06			
				W21-L	0.68	0.99	0.90	39.82	729.43	0.50	0.15	0.01			
				W21-U	0.68	0.99	1.46	35.50	729.43	0.50	1.00	0.06			
				W22-L	0.68	0.99	0.43	35.04	729.43	0.50	0.15	0.00			
				W22-U	0.68	0.99	1.46	37.46	729.43	0.50	1.00	0.07			
				W23	0.68	0.99	3.17	9.91	729.43	0.50	1.00	0.04			
				W24	0.68	0.99	4.31	44.83	729.43	0.50	1.00	0.24			
				W25	0.68	0.99	1.40	45.73	729.43	0.50	1.00	0.08			
				W26	0.68	0.99	3.12	42.02	729.43	0.50	1.00	0.16			
00 GF	R2	Residential	Office	W27-L	0.68	0.99	0.92	47.59	173.50	0.50	0.15	0.03	1.07	-1.00	NO
				W27-U	0.68	0.99	2.43	40.76	173.50	0.50	1.00	0.51			
				W28-L	0.68	0.99	0.87	48.71	173.50	0.50	0.15	0.03			
				W28-U	0.68	0.99	2.30	40.79	173.50	0.50	1.00	0.49			
01st	R1	Residential	Bedroom	W1-L	0.68	0.99	0.63	33.05	79.58	0.50	0.15	0.04	0.50	1.00	NO
				W1-U	0.68	0.99	1.28	32.38	79.58	0.50	1.00	0.47			
01st	R2	Residential	Bedroom	W2-L	0.68	0.99	0.63	28.22	66.30	0.50	0.15	0.04	0.51	1.00	NO
				W2-U	0.68	0.99	1.28	27.57	66.30	0.50	1.00	0.48			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria	
01st	R3		Residential	LKD	W3-L	0.68	0.99	0.75	30.81	149.08	0.50	0.15	0.02			
					W3-U	0.68	0.99	1.51	29.30	149.08	0.50	1.00	0.27			
					W4-L	0.68	0.99	0.75	33.47	149.08	0.50	0.15	0.02			
					W4-U	0.68	0.99	1.51	31.65	149.08	0.50	1.00	0.29			
					W5	0.68	0.99	1.76	25.49	149.08	0.50	1.00	0.27			
01st	R4		Residential	Bedroom	W6-L	0.68	0.99	0.64	40.95	61.38	0.50	0.15	0.06			
					W6-U	0.68	0.99	1.27	41.51	61.38	0.50	1.00	0.77			
01st	R5		Residential	LKD	W7-L	0.68	0.99	0.75	48.28	110.38	0.50	0.15	0.04			
					W7-U	0.68	0.99	1.50	47.89	110.38	0.50	1.00	0.59			
					W8-L	0.68	0.99	0.75	43.63	110.38	0.50	0.15	0.04			
					W8-U	0.68	0.99	1.50	44.05	110.38	0.50	1.00	0.54			
01st	R6		Residential	Bedroom	W9-L	0.68	0.99	0.64	43.13	63.77	0.50	0.15	0.06			
					W9-U	0.68	0.99	1.27	43.61	63.77	0.50	1.00	0.78			
01st	R7		Residential	LKD	W10-L	0.68	0.99	0.75	50.93	120.57	0.50	0.15	0.04			
					W10-U	0.68	0.99	1.50	50.28	120.57	0.50	1.00	0.56			
					W11-L	0.68	0.99	0.75	46.12	120.57	0.50	0.15	0.04			
					W11-U	0.68	0.99	1.50	46.35	120.57	0.50	1.00	0.52			
01st	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	45.50	63.77	0.50	0.15	0.06			
					W12-U	0.68	0.99	1.27	45.84	63.77	0.50	1.00	0.82			
01st	R9		Residential	LKD	W13-L	0.68	0.99	0.75	53.24	120.31	0.50	0.15	0.04			
					W13-U	0.68	0.99	1.50	52.48	120.31	0.50	1.00	0.59			
					W14-L	0.68	0.99	0.75	48.41	120.31	0.50	0.15	0.04			
					W14-U	0.68	0.99	1.50	48.53	120.31	0.50	1.00	0.55			
01st	R10		Residential	Bedroom	W15-L	0.68	0.99	0.64	48.32	63.92	0.50	0.15	0.06			
					W15-U	0.68	0.99	1.27	48.44	63.92	0.50	1.00	0.87			
01st	R11		Residential	LKD	W16-L	0.68	0.99	0.75	56.22	121.43	0.50	0.15	0.05			
					W16-U	0.68	0.99	1.50	55.25	121.43	0.50	1.00	0.61			
					W17-L	0.68	0.99	0.75	51.39	121.43	0.50	0.15	0.04			
					W17-U	0.68	0.99	1.50	51.32	121.43	0.50	1.00	0.57			
01st	R12		Residential	Bedroom	W18-L	0.68	0.99	0.75	57.31	64.74	0.50	0.15	0.09			
					W18-U	0.68	0.99	1.50	56.26	64.74	0.50	1.00	1.17			
					W19-L	0.68	0.99	0.75	52.53	64.74	0.50	0.15	0.08			
					W19-U	0.68	0.99	1.50	52.30	64.74	0.50	1.00	1.09			
01st	R13		Residential	Bedroom	W20-L	0.68	0.99	0.64	51.68	64.85	0.50	0.15	0.07			
					W20-U	0.68	0.99	1.27	51.37	64.85	0.50	1.00	0.90			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R1		Residential	Bedroom	W1-L	0.68	0.99	0.64	33.43	77.13	0.50	0.15	0.97	1.00	NO
					W1-U	0.68	0.99	1.22	32.88	77.13	0.50	1.00	0.04		
02nd	R2		Residential	LKD	W2-L	0.68	0.99	0.75	34.39	114.20	0.50	0.15	0.50	1.00	NO
					W2-U	0.68	0.99	1.44	33.22	114.20	0.50	1.00	0.03		
					W3-L	0.68	0.99	0.75	37.11	114.20	0.50	0.15	0.38		
					W3-U	0.68	0.99	1.44	35.55	114.20	0.50	1.00	0.03		
													0.40		
02nd	R3		Residential	Bedroom	W4-L	0.68	0.99	0.64	25.27	61.36	0.50	0.15	0.84	2.00	NO
					W4-U	0.68	0.99	1.22	24.69	61.36	0.50	1.00	0.04		
02nd	R4		Residential	LKD	W5-L	0.68	0.99	0.75	28.46	116.39	0.50	0.15	0.47	1.00	NO
					W5-U	0.68	0.99	1.44	27.03	116.39	0.50	1.00	0.04		
					W6-L	0.68	0.99	0.75	30.91	116.39	0.50	0.15	0.30		
					W6-U	0.68	0.99	1.44	29.21	116.39	0.50	1.00	0.03		
													0.32		
02nd	R5		Residential	Bedroom	W7-L	0.68	0.99	0.64	15.29	61.51	0.50	0.15	0.68	2.00	NO
					W7-U	0.68	0.99	1.22	14.71	61.51	0.50	1.00	0.02		
02nd	R6		Residential	LKD	W8-L	0.68	0.99	0.75	23.26	117.52	0.50	0.15	0.28	1.00	NO
					W8-U	0.68	0.99	1.44	21.70	117.52	0.50	1.00	0.02		
					W9-L	0.68	0.99	0.75	24.55	117.52	0.50	0.15	0.24		
					W9-U	0.68	0.99	1.44	22.88	117.52	0.50	1.00	0.02		
													0.25		
02nd	R7		Residential	LKD	W10-L	0.68	0.99	0.75	21.66	115.75	0.50	0.15	0.53	2.00	NO
					W10-U	0.68	0.99	1.44	20.10	115.75	0.50	1.00	0.02		
					W11-L	0.68	0.99	0.75	22.17	115.75	0.50	0.15	0.22		
					W11-U	0.68	0.99	1.44	20.52	115.75	0.50	1.00	0.02		
													0.23		
02nd	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	2.69	62.85	0.50	0.15	0.49	2.00	NO
					W12-U	0.68	0.99	1.22	2.48	62.85	0.50	1.00	0.00		
02nd	R9		Residential	LKD									0.04		
													0.05	1.00	NO
					W13-L	0.68	0.99	0.93	32.90	126.59	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.77	33.18	126.59	0.50	1.00	0.42		
					W14-L	0.68	0.99	1.60	31.22	126.59	0.50	0.15	0.05		
					W14-U	0.68	0.99	3.05	28.91	126.59	0.50	1.00	0.63		
					W15-L	0.68	0.99	0.64	17.75	126.59	0.50	0.15	0.01		
02nd	R10		Residential	Bedroom	W15-U	0.68	0.99	1.22	17.26	126.59	0.50	1.00	0.15		
													1.29	2.00	NO
					W16-L	0.68	0.99	0.64	20.60	65.12	0.50	0.15	0.03		
					W16-U	0.68	0.99	1.22	20.09	65.12	0.50	1.00	0.34		
													0.36	1.00	NO
02nd	R11		Residential	Bedroom	W17-L	0.68	0.99	0.64	23.40	79.27	0.50	0.15	0.03		
					W17-U	0.68	0.99	1.22	22.86	79.27	0.50	1.00	0.31		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R12		Residential	Bedroom	W18-L	0.68	0.99	0.64	28.69	77.41	0.50	0.15	0.34	1.00	NO
					W18-U	0.68	0.99	1.22	28.07	77.41	0.50	1.00	0.03		
02nd	R13		Residential	LKD	W19-L	0.68	0.99	0.64	31.26	124.30	0.50	0.15	0.43	1.00	NO
					W19-U	0.68	0.99	1.22	30.63	124.30	0.50	1.00	0.02		
					W20-L	0.68	0.99	0.64	33.37	124.30	0.50	0.15	0.27		
					W20-U	0.68	0.99	1.22	32.74	124.30	0.50	1.00	0.02		
													0.29		
02nd	R14		Residential	Bedroom	W21-L	0.68	0.99	0.64	35.33	64.00	0.50	0.15	0.60	2.00	NO
					W21-U	0.68	0.99	1.22	34.73	64.00	0.50	1.00	0.05		
02nd	R15		Residential	Bedroom	W22-L	0.68	0.99	0.64	39.18	80.34	0.50	0.15	0.59		
					W22-U	0.68	0.99	1.22	38.75	80.34	0.50	1.00	0.64	1.00	NO
													0.04		
02nd	R16		Residential	Bedroom	W23-L	0.68	0.99	0.64	40.07	65.31	0.50	0.15	0.53		
					W23-U	0.68	0.99	1.22	39.81	65.31	0.50	1.00	0.67		
													0.72	1.00	NO
					W24-L	0.68	0.99	1.70	50.06	125.64	0.50	0.15	0.09		
					W24-U	0.68	0.99	3.24	48.68	125.64	0.50	1.00	1.13		
02nd	R17		Residential	LKD	W25-L	0.68	0.99	0.93	46.80	125.64	0.50	0.15	0.05		
					W25-U	0.68	0.99	1.77	46.39	125.64	0.50	1.00	0.59		
													1.85	2.00	NO
					W26-L	0.68	0.99	0.64	45.24	61.31	0.50	0.15	0.06		
					W26-U	0.68	0.99	1.22	45.14	61.31	0.50	1.00	0.80		
02nd	R18		Residential	Bedroom									0.87	1.00	NO
					W27-L	0.68	0.99	0.75	52.77	110.38	0.50	0.15	0.05		
					W27-U	0.68	0.99	1.44	51.80	110.38	0.50	1.00	0.61		
					W28-L	0.68	0.99	0.75	48.03	110.38	0.50	0.15	0.04		
					W28-U	0.68	0.99	1.44	47.78	110.38	0.50	1.00	0.56		
02nd	R19		Residential	LKD									1.26	2.00	NO
					W29-L	0.68	0.99	0.64	47.35	63.77	0.50	0.15	0.06		
					W29-U	0.68	0.99	1.22	47.21	63.77	0.50	1.00	0.81		
													0.87	1.00	NO
					W30-L	0.68	0.99	0.75	55.22	120.31	0.50	0.15	0.05		
02nd	R20		Residential	Bedroom	W30-U	0.68	0.99	1.44	54.19	120.31	0.50	1.00	0.58		
					W31-L	0.68	0.99	0.75	50.42	120.31	0.50	0.15	0.04		
					W31-U	0.68	0.99	1.44	50.23	120.31	0.50	1.00	0.54		
													1.21	2.00	NO
					W32-L	0.68	0.99	0.64	49.87	63.77	0.50	0.15	0.07		
02nd	R21		Residential	Bedroom	W32-U	0.68	0.99	1.22	49.80	63.77	0.50	1.00	0.85		
													0.92	1.00	NO
02nd	R22		Residential	LKD	W33-L	0.68	0.99	0.75	57.76	120.84	0.50	0.15	0.05		
					W33-U	0.68	0.99	1.44	56.50	120.84	0.50	1.00	0.60		
					W34-L	0.68	0.99	0.75	52.85	120.84	0.50	0.15	0.04		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R24	Residential	Bedroom		W34-U	0.68	0.99	1.44	52.40	120.84	0.50	1.00	0.56	2.00	NO
					W35-L	0.68	0.99	0.64	52.44	63.77	0.50	0.15	0.07		
					W35-U	0.68	0.99	1.22	51.85	63.77	0.50	1.00	0.89		
													0.96		
02nd	R25	Residential	LKD		W36-L	0.68	0.99	0.75	60.22	133.29	0.50	0.15	0.05	2.00	NO
					W36-U	0.68	0.99	1.44	58.59	133.29	0.50	1.00	0.57		
					W37-L	0.68	0.99	0.75	55.24	133.29	0.50	0.15	0.04		
					W37-U	0.68	0.99	1.44	54.47	133.29	0.50	1.00	0.53		
03rd	R1	Residential	LKD										1.18	2.00	NO
					W1-L	0.68	0.99	1.27	28.04	109.18	0.50	0.15	0.04		
					W1-U	0.68	0.99	3.88	22.95	109.18	0.50	1.00	0.73		
					W2-L	0.68	0.99	1.27	27.51	109.18	0.50	0.15	0.04		
					W2-U	0.68	0.99	3.88	22.90	109.18	0.50	1.00	0.73		
					W3-L	0.68	0.99	1.27	23.58	109.18	0.50	0.15	0.04		
					W3-U	0.68	0.99	3.88	21.62	109.18	0.50	1.00	0.69		
					W4-L	0.68	0.99	0.97	15.39	109.18	0.50	0.15	0.02		
					W4-U	0.68	0.99	2.96	19.84	109.18	0.50	1.00	0.48		
					W5-L	0.68	0.99	0.15	2.01	109.18	0.50	0.15	0.00		
					W5-U	0.68	0.99	0.45	7.67	109.18	0.50	1.00	0.03		
					W6-L	0.68	0.99	0.14	5.95	109.18	0.50	0.15	0.00		
					W6-U	0.68	0.99	0.45	6.03	109.18	0.50	1.00	0.02		
					W7-L	0.68	0.99	0.95	24.50	109.18	0.50	0.15	0.03		
					W7-U	0.68	0.99	2.96	40.75	109.18	0.50	1.00	0.99		
					W8-L	0.68	0.99	1.24	35.22	109.18	0.50	0.15	0.05		
					W8-U	0.68	0.99	3.88	40.11	109.18	0.50	1.00	1.28		
					W9-L	0.68	0.99	0.70	36.00	109.18	0.50	0.15	0.03		
					W9-U	0.68	0.99	2.20	38.89	109.18	0.50	1.00	0.70		
03rd	R2	Residential	Bedroom										5.92	2.00	YES
					W10-L	0.68	0.99	0.70	22.58	48.94	0.50	0.15	0.04		
					W10-U	0.68	0.99	2.20	24.00	48.94	0.50	1.00	0.97		
					W11-L	0.68	0.99	1.24	34.06	48.94	0.50	0.15	0.12		
03rd	R3	Residential	Bedroom		W12-L	0.68	0.99	1.24	32.36	56.34	0.50	0.15	0.10	1.00	YES
					W12-U	0.68	0.99	3.88	33.72	56.34	0.50	1.00	2.08		
					W13-L	0.68	0.99	0.70	30.67	56.34	0.50	0.15	0.05		
					W13-U	0.68	0.99	2.20	32.22	56.34	0.50	1.00	1.13		
03rd	R4	Residential	Bedroom										3.36	1.00	YES
					W14-L	0.68	0.99	0.70	14.55	61.36	0.50	0.15	0.02		
					W14-U	0.68	0.99	2.20	13.74	61.36	0.50	1.00	0.44		
					W15-L	0.68	0.99	1.24	29.26	61.36	0.50	0.15	0.08		
03rd	R5	Residential	LKD		W15-U	0.68	0.99	3.88	29.79	61.36	0.50	1.00	1.69	1.00	YES
													2.23		
					W16-L	0.68	0.99	1.24	27.74	142.83	0.50	0.15	0.03		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	3.88	27.62	142.83	0.50	1.00	0.67		
					W17-L	0.68	0.99	0.70	25.28	142.83	0.50	0.15	0.02		
					W17-U	0.68	0.99	2.20	25.40	142.83	0.50	1.00	0.35		
					W18-L	0.68	0.99	0.70	12.94	142.83	0.50	0.15	0.01		
					W18-U	0.68	0.99	2.20	11.74	142.83	0.50	1.00	0.16		
					W19-L	0.68	0.99	1.24	25.57	142.83	0.50	0.15	0.03		
					W19-U	0.68	0.99	3.88	24.84	142.83	0.50	1.00	0.61		
													1.88	2.00	NO
03rd	R6	Residential	LKD	W20-L	0.68	0.99	1.24	24.88	137.66	0.50	0.15	0.03			
				W20-U	0.68	0.99	3.88	23.82	137.66	0.50	1.00	0.60			
				W21-L	0.68	0.99	0.70	20.65	137.66	0.50	0.15	0.01			
				W21-U	0.68	0.99	2.19	19.76	137.66	0.50	1.00	0.28			
				W22-L	0.68	0.99	0.70	15.82	137.66	0.50	0.15	0.01			
				W22-U	0.68	0.99	2.20	14.73	137.66	0.50	1.00	0.21			
				W23-L	0.68	0.99	1.24	23.72	137.66	0.50	0.15	0.03			
W23-U	0.68	0.99	3.88	22.49	137.66	0.50	1.00	0.57							
													1.75	2.00	NO
03rd	R7	Residential	Bedroom	W24-L	0.68	0.99	1.24	23.39	67.96	0.50	0.15	0.06			
				W24-U	0.68	0.99	3.88	22.56	67.96	0.50	1.00	1.16			
				W25-L	0.68	0.99	0.70	16.81	67.96	0.50	0.15	0.02			
				W25-U	0.68	0.99	2.20	15.44	67.96	0.50	1.00	0.45			
													1.69	1.00	YES
03rd	R8	Residential	Bedroom	W26-L	0.68	0.99	0.98	23.95	68.57	0.50	0.15	0.05			
				W26-U	0.68	0.99	3.16	23.53	68.57	0.50	1.00	0.97			
				W27-L	0.68	0.99	1.21	26.99	68.57	0.50	0.15	0.06			
				W27-U	0.68	0.99	3.90	26.42	68.57	0.50	1.00	1.35			
													2.44	1.00	YES
03rd	R9	Residential	LKD	W28-L	0.68	0.99	1.21	29.81	142.17	0.50	0.15	0.03			
				W28-U	0.68	0.99	3.90	28.95	142.17	0.50	1.00	0.71			
				W29-L	0.68	0.99	1.21	30.26	142.17	0.50	0.15	0.03			
				W29-U	0.68	0.99	3.90	29.83	142.17	0.50	1.00	0.74			
				W30-L	0.68	0.99	1.21	27.90	142.17	0.50	0.15	0.03			
				W30-U	0.68	0.99	3.90	28.61	142.17	0.50	1.00	0.71			
				W31-L	0.68	0.99	0.45	3.61	142.17	0.50	0.15	0.00			
W31-U	0.68	0.99	1.46	3.19	142.17	0.50	1.00	0.03							
													2.29	2.00	YES
03rd	R10	Residential	LKD	W32-L	0.68	0.99	0.54	29.38	138.93	0.50	0.15	0.02			
				W32-U	0.68	0.99	1.70	30.72	138.93	0.50	1.00	0.34			
				W33-L	0.68	0.99	1.24	32.01	138.93	0.50	0.15	0.04			
				W33-U	0.68	0.99	3.88	32.98	138.93	0.50	1.00	0.83			
				W34-L	0.68	0.99	1.24	34.82	138.93	0.50	0.15	0.04			
				W34-U	0.68	0.99	3.88	35.78	138.93	0.50	1.00	0.90			
				W35-L	0.68	0.99	1.24	36.07	138.93	0.50	0.15	0.04			
W35-U	0.68	0.99	3.88	36.91	138.93	0.50	1.00	0.93							
													3.13	2.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R11		Residential	Bedroom	W36-L	0.68	0.99	1.24	35.00	62.59	0.50	0.15	0.09	1.00	YES
					W36-U	0.68	0.99	3.88	36.41	62.59	0.50	1.00	2.03		
					W37-L	0.68	0.99	0.58	22.33	62.59	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.83	24.00	62.59	0.50	1.00	0.63		
03rd	R12		Residential	Bedroom	W38-L	0.68	0.99	0.78	37.94	65.95	0.50	0.15	0.06	1.00	YES
					W38-U	0.68	0.99	2.44	39.91	65.95	0.50	1.00	1.33		
					W39-L	0.68	0.99	1.24	39.30	65.95	0.50	0.15	0.10		
					W39-U	0.68	0.99	3.88	41.30	65.95	0.50	1.00	2.18		
03rd	R13		Residential	LKD	W40-L	0.68	0.99	1.24	41.40	141.83	0.50	0.15	0.05	2.00	YES
					W40-U	0.68	0.99	3.88	43.10	141.83	0.50	1.00	1.06		
					W41-L	0.68	0.99	1.24	41.76	141.83	0.50	0.15	0.05		
					W41-U	0.68	0.99	3.88	43.72	141.83	0.50	1.00	1.07		
					W42-L	0.68	0.99	1.24	40.02	141.83	0.50	0.15	0.05		
					W42-U	0.68	0.99	3.88	42.74	141.83	0.50	1.00	1.05		
					W43-L	0.68	0.99	0.70	28.99	141.83	0.50	0.15	0.02		
					W43-U	0.68	0.99	2.20	32.23	141.83	0.50	1.00	0.45		
03rd	R14		Residential	Bedroom	W44-L	0.68	0.99	0.72	44.10	46.04	0.50	0.15	0.09	1.00	YES
					W44-U	0.68	0.99	2.26	46.33	46.04	0.50	1.00	2.05		
					W45-L	0.68	0.99	1.24	44.99	46.04	0.50	0.15	0.16		
					W45-U	0.68	0.99	3.88	47.14	46.04	0.50	1.00	3.56		
03rd	R15		Residential	LKD	W46-L	0.68	0.99	1.24	44.16	89.76	0.50	0.15	0.08	2.00	YES
					W46-U	0.68	0.99	3.88	46.98	89.76	0.50	1.00	1.82		
					W47-L	0.68	0.99	0.72	34.82	89.76	0.50	0.15	0.04		
					W47-U	0.68	0.99	2.26	37.29	89.76	0.50	1.00	0.84		
03rd	R16		Residential	Bedroom	W48-L	0.68	0.99	0.72	45.87	59.61	0.50	0.15	0.08	1.00	YES
					W48-U	0.68	0.99	2.26	48.38	59.61	0.50	1.00	1.65		
					W49-L	0.68	0.99	1.24	46.64	59.61	0.50	0.15	0.13		
					W49-U	0.68	0.99	3.88	48.95	59.61	0.50	1.00	2.86		
03rd	R17		Residential	LKD	W50-L	0.68	0.99	1.24	45.60	83.41	0.50	0.15	0.09	2.00	YES
					W50-U	0.68	0.99	3.88	48.32	83.41	0.50	1.00	2.02		
					W51-L	0.68	0.99	0.72	36.65	83.41	0.50	0.15	0.04		
					W51-U	0.68	0.99	2.26	39.17	83.41	0.50	1.00	0.95		
03rd	R18		Residential	Bedroom	W52-L	0.68	0.99	0.72	47.14	59.27	0.50	0.15	0.08	1.00	YES
					W52-U	0.68	0.99	2.26	50.20	59.27	0.50	1.00	1.72		
					W53-L	0.68	0.99	1.24	48.30	59.27	0.50	0.15	0.14		
					W53-U	0.68	0.99	3.88	51.01	59.27	0.50	1.00	3.00		
03rd	R19		Residential	Bedroom	W54-L	0.68	0.99	1.24	47.09	50.06	0.50	0.15	0.16		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R20	Residential	LKD		W54-U	0.68	0.99	3.88	50.21	50.06	0.50	1.00	3.49	1.00	YES
					W55-L	0.68	0.99	0.72	38.29	50.06	0.50	0.15	0.07		
					W55-U	0.68	0.99	2.26	40.86	50.06	0.50	1.00	1.66		
													5.38		
					W56-L	0.68	0.99	0.70	47.64	103.83	0.50	0.15	0.04		
					W56-U	0.68	0.99	2.20	50.96	103.83	0.50	1.00	0.97		
					W57-L	0.68	0.99	1.24	49.63	103.83	0.50	0.15	0.08		
					W57-U	0.68	0.99	3.88	52.34	103.83	0.50	1.00	1.76		
					W58-L	0.68	0.99	0.75	49.50	103.83	0.50	0.15	0.05		
					W58-U	0.68	0.99	2.34	52.46	103.83	0.50	1.00	1.06		
					W59-L	0.68	0.99	0.14	13.20	103.83	0.50	0.15	0.00		
					W59-U	0.68	0.99	0.45	11.30	103.83	0.50	1.00	0.04		
					W60-L	0.68	0.99	0.17	22.67	103.83	0.50	0.15	0.00		
					W60-U	0.68	0.99	0.51	21.77	103.83	0.50	1.00	0.10		
					W61-L	0.68	0.99	0.97	32.79	103.83	0.50	0.15	0.04		
					W61-U	0.68	0.99	2.96	30.43	103.83	0.50	1.00	0.78		
					W62-L	0.68	0.99	1.27	27.94	103.83	0.50	0.15	0.05		
					W62-U	0.68	0.99	3.88	24.45	103.83	0.50	1.00	0.82		
					W63-L	0.68	0.99	1.27	25.20	103.83	0.50	0.15	0.04		
					W63-U	0.68	0.99	3.87	22.07	103.83	0.50	1.00	0.74		
04th	R1	Residential	LKD		W64-L	0.68	0.99	1.27	25.42	103.83	0.50	0.15	0.04	2.00	YES
					W64-U	0.68	0.99	3.88	22.83	103.83	0.50	1.00	0.77		
													7.38		
					W1-L	0.68	0.99	1.72	33.33	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	25.97	125.20	0.50	1.00	0.59		
					W2-L	0.68	0.99	1.93	35.92	125.20	0.50	0.15	0.07		
					W2-U	0.68	0.99	3.57	26.47	125.20	0.50	1.00	0.68		
					W3-L	0.68	0.99	1.72	32.95	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	22.96	125.20	0.50	1.00	0.53		
					W4-L	0.68	0.99	0.70	47.25	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	47.03	125.20	0.50	1.00	0.44		
													2.47		
04th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	44.63	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	44.44	66.26	0.50	1.00	0.78		
													0.84		
04th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	41.75	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	41.56	66.49	0.50	1.00	0.73		
													0.78		
04th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	41.43	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	40.83	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.70	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	41.95	104.32	0.50	1.00	0.91		
													1.48		
04th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	34.38	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.15	65.09	0.50	1.00	0.61		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.20	121.62	0.50	0.15	0.66	1.00	NO
					W10-U	0.68	0.99	1.29	34.50	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	36.97	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.11	121.62	0.50	1.00	0.67		
													1.08	2.00	NO
04th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	28.76	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.45	56.77	0.50	1.00	0.58		
													0.63	1.00	NO
04th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.18	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	25.83	56.45	0.50	1.00	0.53		
													0.57	1.00	NO
04th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.01	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.18	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	32.73	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.79	119.79	0.50	1.00	0.60		
													0.96	2.00	NO
04th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.09	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.71	59.49	0.50	1.00	0.48		
					W17-L	0.68	0.99	0.36	35.60	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.53	59.49	0.50	1.00	0.36		
													0.91	1.00	NO
04th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	32.02	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.97	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	32.05	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	31.25	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.52	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.60	116.88	0.50	1.00	0.67		
04th	R12		Residential	Bedroom									1.24	2.00	NO
					W21-L	0.68	0.99	0.70	30.13	55.29	0.50	0.15	0.05		
					W21-U	0.68	0.99	1.29	29.80	55.29	0.50	1.00	0.63		
04th	R13		Residential	Bedroom									0.68	1.00	NO
					W22-L	0.68	0.99	0.70	33.72	69.09	0.50	0.15	0.05		
					W22-U	0.68	0.99	1.29	33.40	69.09	0.50	1.00	0.56		
04th	R14		Residential	Bedroom									0.61	1.00	NO
					W23-L	0.68	0.99	0.70	35.16	67.42	0.50	0.15	0.05		
					W23-U	0.68	0.99	1.29	34.85	67.42	0.50	1.00	0.60		
04th	R15		Residential	LKD									0.65	1.00	NO
					W24-L	0.68	0.99	0.70	42.12	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	41.42	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.13	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.33	116.39	0.50	1.00	0.86		
04th	R16		Residential	Bedroom									1.38	2.00	NO
					W26-L	0.68	0.99	0.70	41.75	55.28	0.50	0.15	0.07		
					W26-U	0.68	0.99	1.29	41.48	55.28	0.50	1.00	0.87		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	46.54	69.08	0.50	0.15	0.94	1.00	NO
					W27-U	0.68	0.99	1.29	46.33	69.08	0.50	1.00	0.06		
04th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	48.03	55.32	0.50	0.15	0.84	1.00	NO
					W28-U	0.68	0.99	1.29	47.86	55.32	0.50	1.00	0.08		
04th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	52.12	117.45	0.50	0.15	1.09	1.00	YES
					W29-U	0.68	0.99	1.29	51.58	117.45	0.50	1.00	0.04		
04th	R19		Residential	LKD	W30-L	0.68	0.99	1.36	53.63	117.45	0.50	0.15	0.51		
					W30-U	0.68	0.99	2.52	52.98	117.45	0.50	1.00	0.08		
04th	R19		Residential	LKD	W31-L	0.68	0.99	0.36	35.85	117.45	0.50	0.15	1.02		
					W31-U	0.68	0.99	0.67	35.80	117.45	0.50	1.00	0.01		
04th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	21.01	58.24	0.50	0.15	0.18		
					W32-U	0.68	0.99	0.67	20.84	58.24	0.50	1.00	1.85	2.00	NO
04th	R20		Residential	Bedroom	W33-L	0.68	0.99	0.70	53.54	58.24	0.50	0.15	0.02		
					W33-U	0.68	0.99	1.29	53.40	58.24	0.50	1.00	0.22		
04th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	57.69	117.07	0.50	0.15	1.09	1.00	YES
					W34-U	0.68	0.99	1.29	57.17	117.07	0.50	1.00	0.09		
04th	R21		Residential	LKD	W35-L	0.68	0.99	1.36	58.54	117.07	0.50	0.15	0.09		
					W35-U	0.68	0.99	2.52	57.94	117.07	0.50	1.00	1.12		
04th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	55.74	59.45	0.50	0.15	1.82	2.00	NO
					W36-U	0.68	0.99	1.29	55.59	59.45	0.50	1.00	0.09		
04th	R22		Residential	Bedroom	W37-L	0.68	0.99	0.70	56.34	59.45	0.50	0.15	1.09		
					W37-U	0.68	0.99	1.29	56.20	59.45	0.50	1.00	0.09		
04th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	57.52	57.18	0.50	0.15	2.36	1.00	YES
					W38-U	0.68	0.99	1.29	57.37	57.18	0.50	1.00	1.10		
04th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	61.32	119.55	0.50	0.15	1.16		
					W39-U	0.68	0.99	1.29	60.79	119.55	0.50	1.00	0.09		
04th	R24		Residential	LKD	W40-L	0.68	0.99	1.36	61.81	119.55	0.50	0.15	0.09		
					W40-U	0.68	0.99	2.52	61.22	119.55	0.50	1.00	1.16		
04th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	59.21	69.12	0.50	0.15	1.89	2.00	NO
					W41-U	0.68	0.99	1.29	59.07	69.12	0.50	1.00	0.08		
04th	R25		Residential	Bedroom	W42-L	0.68	0.99	0.70	59.71	69.12	0.50	0.15	0.99		
					W42-U	0.68	0.99	1.29	59.57	69.12	0.50	1.00	0.08		
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	60.71	66.25	0.50	0.15	1.00		
					W43-U	0.68	0.99	1.29	60.58	66.25	0.50	1.00	2.15	1.00	YES
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	60.71	66.25	0.50	0.15	0.09		
					W43-U	0.68	0.99	1.29	60.58	66.25	0.50	1.00	1.06		
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	60.71	66.25	0.50	0.15	1.15	1.00	YES
					W43-U	0.68	0.99	1.29	60.58	66.25	0.50	1.00	0.09		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R27	Residential	Bedroom		W44-L	0.68	0.99	0.70	61.44	56.67	0.50	0.15	0.10	1.00	YES
					W44-U	0.68	0.99	1.29	61.31	56.67	0.50	1.00	1.26		
04th	R28	Residential	LKD		W45-L	0.68	0.99	1.72	41.47	151.85	0.50	0.15	0.06	2.00	YES
					W45-U	0.68	0.99	3.18	31.22	151.85	0.50	1.00	0.59		
					W46-L	0.68	0.99	1.93	44.42	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	34.14	151.85	0.50	1.00	0.72		
					W47-L	0.68	0.99	1.72	39.70	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	29.83	151.85	0.50	1.00	0.56		
													2.07		
05th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	34.00	125.20	0.50	0.15	0.06	2.00	YES
					W1-U	0.68	0.99	3.19	26.47	125.20	0.50	1.00	0.61		
					W2-L	0.68	0.99	1.93	36.71	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	27.12	125.20	0.50	1.00	0.69		
					W3-L	0.68	0.99	1.72	33.84	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	23.79	125.20	0.50	1.00	0.54		
					W4-L	0.68	0.99	0.70	47.56	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	47.35	125.20	0.50	1.00	0.44		
05th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	45.02	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	44.85	66.26	0.50	1.00	0.79		
05th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	42.15	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	41.98	66.49	0.50	1.00	0.73		
05th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	41.81	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	41.22	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.07	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.33	104.32	0.50	1.00	0.92		
05th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	34.72	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	34.49	65.09	0.50	1.00	0.61		
05th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	35.51	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.81	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.27	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.41	121.62	0.50	1.00	0.68		
05th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	29.04	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	28.72	56.77	0.50	1.00	0.59		
05th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.40	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.03	56.45	0.50	1.00	0.54		
05th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.22	119.79	0.50	0.15	0.02	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	29.38	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	32.94	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.97	119.79	0.50	1.00	0.60		
05th	R10	Residential	Bedroom										0.96	2.00	NO
					W16-L	0.68	0.99	0.70	25.27	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.87	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	35.71	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.61	59.49	0.50	1.00	0.36		
05th	R11	Residential	LKD										0.91	1.00	NO
					W18-L	0.68	0.99	0.36	32.16	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.09	116.88	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.70	32.20	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	31.38	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.68	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.74	116.88	0.50	1.00	0.67		
05th	R12	Residential	Bedroom										1.24	2.00	NO
					W21-L	0.68	0.99	0.70	30.28	55.29	0.50	0.15	0.05		
					W21-U	0.68	0.99	1.29	29.92	55.29	0.50	1.00	0.63		
05th	R13	Residential	Bedroom										0.68	1.00	NO
					W22-L	0.68	0.99	0.70	33.84	69.09	0.50	0.15	0.05		
					W22-U	0.68	0.99	1.29	33.50	69.09	0.50	1.00	0.56		
05th	R14	Residential	Bedroom										0.61	1.00	NO
					W23-L	0.68	0.99	0.70	35.27	67.42	0.50	0.15	0.05		
					W23-U	0.68	0.99	1.29	34.94	67.42	0.50	1.00	0.60		
05th	R15	Residential	LKD										0.65	1.00	NO
					W24-L	0.68	0.99	0.70	42.24	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	41.52	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.29	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.47	116.39	0.50	1.00	0.86		
05th	R16	Residential	Bedroom										1.38	2.00	NO
					W26-L	0.68	0.99	0.70	41.93	55.28	0.50	0.15	0.07		
					W26-U	0.68	0.99	1.29	41.63	55.28	0.50	1.00	0.87		
05th	R17	Residential	Bedroom										0.95	1.00	NO
					W27-L	0.68	0.99	0.70	46.86	69.08	0.50	0.15	0.06		
					W27-U	0.68	0.99	1.29	46.65	69.08	0.50	1.00	0.78		
05th	R18	Residential	Bedroom										0.85	1.00	NO
					W28-L	0.68	0.99	0.70	48.45	55.32	0.50	0.15	0.08		
					W28-U	0.68	0.99	1.29	48.26	55.32	0.50	1.00	1.01		
05th	R19	Residential	LKD										1.09	1.00	YES
					W29-L	0.68	0.99	0.70	52.58	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	52.03	117.45	0.50	1.00	0.51		
					W30-L	0.68	0.99	1.36	54.12	117.45	0.50	0.15	0.08		
					W30-U	0.68	0.99	2.52	53.46	117.45	0.50	1.00	1.03		
					W31-L	0.68	0.99	0.36	36.10	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	36.08	117.45	0.50	1.00	0.18		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
05th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	21.14	58.24	0.50	0.15	1.87	2.00	NO
					W32-U	0.68	0.99	0.67	20.93	58.24	0.50	1.00	0.02		
					W33-L	0.68	0.99	0.70	54.12	58.24	0.50	0.15	0.22		
					W33-U	0.68	0.99	1.29	53.96	58.24	0.50	1.00	0.09		
05th	R21		Residential	LKD									1.08		
													1.40	1.00	YES
					W34-L	0.68	0.99	0.70	58.30	117.07	0.50	0.15	0.05		
					W34-U	0.68	0.99	1.29	57.76	117.07	0.50	1.00	0.57		
05th	R22		Residential	Bedroom	W35-L	0.68	0.99	1.36	59.17	117.07	0.50	0.15	0.09		
					W35-U	0.68	0.99	2.52	58.54	117.07	0.50	1.00	1.13		
													1.84	2.00	NO
					W36-L	0.68	0.99	0.70	56.35	59.45	0.50	0.15	0.09		
05th	R23		Residential	Bedroom	W36-U	0.68	0.99	1.29	56.19	59.45	0.50	1.00	1.10		
					W37-L	0.68	0.99	0.70	56.97	59.45	0.50	0.15	0.09		
					W37-U	0.68	0.99	1.29	56.81	59.45	0.50	1.00	1.11		
													2.38	1.00	YES
05th	R24		Residential	LKD	W38-L	0.68	0.99	0.70	58.17	57.18	0.50	0.15	0.10		
					W38-U	0.68	0.99	1.29	58.01	57.18	0.50	1.00	1.18		
													1.27	1.00	YES
					W39-L	0.68	0.99	0.70	62.00	119.55	0.50	0.15	0.05		
05th	R25		Residential	Bedroom	W39-U	0.68	0.99	1.29	61.45	119.55	0.50	1.00	0.60		
					W40-L	0.68	0.99	1.36	62.52	119.55	0.50	0.15	0.10		
					W40-U	0.68	0.99	2.52	61.90	119.55	0.50	1.00	1.17		
													1.91	2.00	NO
05th	R26		Residential	Bedroom	W41-L	0.68	0.99	0.70	59.90	69.12	0.50	0.15	0.08		
					W41-U	0.68	0.99	1.29	59.74	69.12	0.50	1.00	1.00		
					W42-L	0.68	0.99	0.70	60.41	69.12	0.50	0.15	0.08		
					W42-U	0.68	0.99	1.29	60.25	69.12	0.50	1.00	1.01		
05th	R27		Residential	Bedroom									2.18	1.00	YES
					W43-L	0.68	0.99	0.70	61.44	66.25	0.50	0.15	0.09		
					W43-U	0.68	0.99	1.29	61.28	66.25	0.50	1.00	1.07		
													1.16	1.00	YES
05th	R28		Residential	LKD	W44-L	0.68	0.99	0.70	62.19	56.67	0.50	0.15	0.10		
					W44-U	0.68	0.99	1.29	62.03	56.67	0.50	1.00	1.27		
													1.37	1.00	YES
					W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
05th	R28		Residential	LKD	W45-U	0.68	0.99	3.18	32.75	151.85	0.50	1.00	0.62		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	35.67	151.85	0.50	1.00	0.75		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	31.58	151.85	0.50	1.00	0.60		
													2.17	2.00	YES
06th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	34.69	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	26.87	125.20	0.50	1.00	0.61		
					W2-L	0.68	0.99	1.93	37.50	125.20	0.50	0.15	0.08		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W2-U	0.68	0.99	3.57	27.70	125.20	0.50	1.00	0.71		
					W3-L	0.68	0.99	1.72	34.71	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	24.52	125.20	0.50	1.00	0.56		
					W4-L	0.68	0.99	0.70	47.89	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	47.67	125.20	0.50	1.00	0.44		
06th	R2	Residential	Bedroom										2.57	2.00	YES
					W5-L	0.68	0.99	0.70	45.45	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	45.29	66.26	0.50	1.00	0.79		
06th	R3	Residential	Bedroom										0.86	1.00	NO
					W6-L	0.68	0.99	0.70	42.59	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.43	66.49	0.50	1.00	0.74		
06th	R4	Residential	LKD										0.80	1.00	NO
					W7-L	0.68	0.99	0.70	42.22	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.63	104.32	0.50	1.00	0.46		
06th	R5	Residential	Bedroom										0.08		
					W8-L	0.68	0.99	1.36	43.46	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.71	104.32	0.50	1.00	0.93		
06th	R6	Residential	LKD										1.50	2.00	NO
					W9-L	0.68	0.99	0.70	35.09	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.86	65.09	0.50	1.00	0.62		
06th	R7	Residential	Bedroom										0.67	1.00	NO
					W10-L	0.68	0.99	0.70	35.82	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.13	121.62	0.50	1.00	0.34		
06th	R8	Residential	Bedroom										0.06		
					W11-L	0.68	0.99	1.36	37.56	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.69	121.62	0.50	1.00	0.68		
06th	R9	Residential	LKD										1.10	2.00	NO
					W12-L	0.68	0.99	0.70	29.33	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.00	56.77	0.50	1.00	0.59		
06th	R10	Residential	Bedroom										0.64	1.00	NO
					W13-L	0.68	0.99	0.70	26.61	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	26.22	56.45	0.50	1.00	0.54		
06th	R11	Residential	LKD										0.58	1.00	NO
					W14-L	0.68	0.99	0.70	30.42	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.56	119.79	0.50	1.00	0.29		
06th	R12	Residential	Bedroom										0.05		
					W15-L	0.68	0.99	1.36	33.11	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.11	119.79	0.50	1.00	0.61		
06th	R13	Residential	LKD										0.97	2.00	NO
					W16-L	0.68	0.99	0.70	25.44	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.00	59.49	0.50	1.00	0.49		
06th	R14	Residential	Bedroom										0.03		
					W17-L	0.68	0.99	0.36	35.79	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.68	59.49	0.50	1.00	0.36		
06th	R15	Residential	LKD										0.92	1.00	NO
					W18-L	0.68	0.99	0.36	32.25	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.17	116.88	0.50	1.00	0.17		
06th	R16	Residential	Bedroom		W19-L	0.68	0.99	0.70	32.35	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	31.48	116.88	0.50	1.00	0.31		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	1.36	35.83	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.85	116.88	0.50	1.00	0.67		
06th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	30.42	55.29	0.50	0.15	0.05	1.25	2.00
					W21-U	0.68	0.99	1.29	30.02	55.29	0.50	1.00	0.63		
06th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	33.94	69.09	0.50	0.15	0.05	0.68	1.00
					W22-U	0.68	0.99	1.29	33.57	69.09	0.50	1.00	0.56		
06th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	35.36	67.42	0.50	0.15	0.05	0.61	1.00
					W23-U	0.68	0.99	1.29	35.00	67.42	0.50	1.00	0.60		
06th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	42.32	116.39	0.50	0.15	0.03	1.39	2.00
					W24-U	0.68	0.99	1.29	41.58	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.40	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.54	116.39	0.50	1.00	0.87		
06th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	42.06	55.28	0.50	0.15	0.07	0.95	1.00
					W26-U	0.68	0.99	1.29	41.73	55.28	0.50	1.00	0.88		
06th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	47.17	69.08	0.50	0.15	0.06	0.85	1.00
					W27-U	0.68	0.99	1.29	46.93	69.08	0.50	1.00	0.79		
06th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	48.84	55.32	0.50	0.15	0.08	1.10	1.00
					W28-U	0.68	0.99	1.29	48.63	55.32	0.50	1.00	1.02		
06th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	53.03	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	52.45	117.45	0.50	1.00	0.52		
					W30-L	0.68	0.99	1.36	54.59	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	53.90	117.45	0.50	1.00	1.04		
					W31-L	0.68	0.99	0.36	36.45	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	36.55	117.45	0.50	1.00	0.19		
06th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	21.21	58.24	0.50	0.15	0.02	1.89	2.00
					W32-U	0.68	0.99	0.67	21.01	58.24	0.50	1.00	0.22		
					W33-L	0.68	0.99	0.70	54.67	58.24	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.29	54.49	58.24	0.50	1.00	1.09		
06th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	58.88	117.07	0.50	0.15	0.05	1.41	1.00
					W34-U	0.68	0.99	1.29	58.32	117.07	0.50	1.00	0.58		
					W35-L	0.68	0.99	1.36	59.78	117.07	0.50	0.15	0.09		
					W35-U	0.68	0.99	2.52	59.12	117.07	0.50	1.00	1.14		
06th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	56.94	59.45	0.50	0.15	0.09	1.86	2.00
					W36-U	0.68	0.99	1.29	56.76	59.45	0.50	1.00	1.11		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W37-L	0.68	0.99	0.70	57.58	59.45	0.50	0.15	0.09		
					W37-U	0.68	0.99	1.29	57.40	59.45	0.50	1.00	1.12		
06th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	58.80	57.18	0.50	0.15	0.10	2.41	1.00
					W38-U	0.68	0.99	1.29	58.63	57.18	0.50	1.00	1.19		
														1.00	YES
06th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	62.66	119.55	0.50	0.15	0.05	1.29	1.00
					W39-U	0.68	0.99	1.29	62.09	119.55	0.50	1.00	0.60		
					W40-L	0.68	0.99	1.36	63.19	119.55	0.50	0.15	0.10	1.93	2.00
					W40-U	0.68	0.99	2.52	62.54	119.55	0.50	1.00	1.18		
														2.00	NO
06th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	60.55	69.12	0.50	0.15	0.08	2.20	1.00
					W41-U	0.68	0.99	1.29	60.38	69.12	0.50	1.00	1.01		
					W42-L	0.68	0.99	0.70	61.07	69.12	0.50	0.15	0.08	1.00	YES
					W42-U	0.68	0.99	1.29	60.90	69.12	0.50	1.00	1.02		
06th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	62.12	66.25	0.50	0.15	0.09	1.17	1.00
					W43-U	0.68	0.99	1.29	61.95	66.25	0.50	1.00	1.09		
														1.00	YES
06th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	62.89	56.67	0.50	0.15	0.10	1.39	1.00
					W44-U	0.68	0.99	1.29	62.72	56.67	0.50	1.00	1.28		
														1.00	YES
06th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06	2.24	2.00
					W45-U	0.68	0.99	3.18	33.97	151.85	0.50	1.00	0.64		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08	2.00	YES
					W46-U	0.68	0.99	3.57	36.83	151.85	0.50	1.00	0.78		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06	2.00	YES
					W47-U	0.68	0.99	3.20	32.88	151.85	0.50	1.00	0.62		
07th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	35.45	125.20	0.50	0.15	0.07	2.62	2.00
					W1-U	0.68	0.99	3.19	27.23	125.20	0.50	1.00	0.62		
					W2-L	0.68	0.99	1.93	38.36	125.20	0.50	0.15	0.08	1.00	YES
					W2-U	0.68	0.99	3.57	28.28	125.20	0.50	1.00	0.72		
					W3-L	0.68	0.99	1.72	35.63	125.20	0.50	0.15	0.07	1.00	YES
					W3-U	0.68	0.99	3.19	25.25	125.20	0.50	1.00	0.58		
					W4-L	0.68	0.99	0.70	48.23	125.20	0.50	0.15	0.04	1.00	YES
					W4-U	0.68	0.99	1.29	48.01	125.20	0.50	1.00	0.44		
07th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	45.92	66.26	0.50	0.15	0.07	0.87	1.00
					W5-U	0.68	0.99	1.29	45.75	66.26	0.50	1.00	0.80		
														1.00	NO
07th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.08	66.49	0.50	0.15	0.06	0.81	1.00
					W6-U	0.68	0.99	1.29	42.92	66.49	0.50	1.00	0.75		
														1.00	NO
07th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.65	104.32	0.50	0.15	0.04		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W7-U	0.68	0.99	1.29	42.05	104.32	0.50	1.00	0.47	2.00	NO
					W8-L	0.68	0.99	1.36	43.85	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.09	104.32	0.50	1.00	0.93		
07th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	35.47	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	35.22	65.09	0.50	1.00	0.63		
													0.68		
07th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	36.14	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	35.43	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	37.84	121.62	0.50	0.15	0.06		
07th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	29.61	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	29.26	56.77	0.50	1.00	0.60		
													0.65		
07th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.81	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.38	56.45	0.50	1.00	0.54		
													0.59		
07th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.61	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	29.70	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.27	119.79	0.50	0.15	0.05		
07th	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	32.22	119.79	0.50	1.00	0.61	1.00	NO
													0.97		
					W16-L	0.68	0.99	0.70	25.59	59.49	0.50	0.15	0.04		
07th	R11	Residential	LKD		W16-U	0.68	0.99	1.29	25.10	59.49	0.50	1.00	0.49	1.00	NO
					W17-L	0.68	0.99	0.36	35.86	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.74	59.49	0.50	1.00	0.36		
07th	R12	Residential	Bedroom										0.92	2.00	NO
					W18-L	0.68	0.99	0.36	32.32	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.23	116.88	0.50	1.00	0.17		
07th	R13	Residential	Bedroom		W19-L	0.68	0.99	0.70	32.44	116.88	0.50	0.15	0.03	1.00	NO
					W19-U	0.68	0.99	1.29	31.55	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.93	116.88	0.50	0.15	0.06		
07th	R14	Residential	Bedroom		W20-U	0.68	0.99	2.52	34.92	116.88	0.50	1.00	0.68	1.00	NO
													1.25		
					W21-L	0.68	0.99	0.70	30.51	55.29	0.50	0.15	0.05		
07th	R15	Residential	LKD		W21-U	0.68	0.99	1.29	30.08	55.29	0.50	1.00	0.63	1.00	NO
													0.68		
					W22-L	0.68	0.99	0.70	34.00	69.09	0.50	0.15	0.05		
07th	R16	Residential	Bedroom		W22-U	0.68	0.99	1.29	33.59	69.09	0.50	1.00	0.56	1.00	NO
													0.61		
					W23-L	0.68	0.99	0.70	35.40	67.42	0.50	0.15	0.05		
07th	R17	Residential	LKD		W23-U	0.68	0.99	1.29	35.01	67.42	0.50	1.00	0.60	1.00	NO
													0.65		
					W24-L	0.68	0.99	0.70	42.38	116.39	0.50	0.15	0.03		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W24-U	0.68	0.99	1.29	41.60	116.39	0.50	1.00	0.41	2.00	NO
					W25-L	0.68	0.99	1.36	45.47	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.57	116.39	0.50	1.00	0.87		
07th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	42.13	55.28	0.50	0.15	0.07	1.00	NO
					W26-U	0.68	0.99	1.29	41.79	55.28	0.50	1.00	0.88		
													0.95		
07th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	47.43	69.08	0.50	0.15	0.06	1.00	NO
					W27-U	0.68	0.99	1.29	47.15	69.08	0.50	1.00	0.79		
													0.86		
07th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	49.20	55.32	0.50	0.15	0.08	1.00	YES
					W28-U	0.68	0.99	1.29	48.95	55.32	0.50	1.00	1.03		
													1.11		
07th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	53.43	117.45	0.50	0.15	0.04	2.00	NO
					W29-U	0.68	0.99	1.29	52.82	117.45	0.50	1.00	0.52		
					W30-L	0.68	0.99	1.36	55.02	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	54.29	117.45	0.50	1.00	1.05		
					W31-L	0.68	0.99	0.36	37.17	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	37.55	117.45	0.50	1.00	0.19		
07th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	21.32	58.24	0.50	0.15	0.02	1.00	YES
					W32-U	0.68	0.99	0.67	21.11	58.24	0.50	1.00	0.22		
					W33-L	0.68	0.99	0.70	55.18	58.24	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.29	54.98	58.24	0.50	1.00	1.10		
													1.42		
07th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	59.43	117.07	0.50	0.15	0.05	2.00	NO
					W34-U	0.68	0.99	1.29	58.84	117.07	0.50	1.00	0.58		
					W35-L	0.68	0.99	1.36	60.34	117.07	0.50	0.15	0.09		
					W35-U	0.68	0.99	2.52	59.66	117.07	0.50	1.00	1.15		
													1.88		
07th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	57.51	59.45	0.50	0.15	0.09	1.00	YES
					W36-U	0.68	0.99	1.29	57.31	59.45	0.50	1.00	1.12		
					W37-L	0.68	0.99	0.70	58.16	59.45	0.50	0.15	0.09		
					W37-U	0.68	0.99	1.29	57.96	59.45	0.50	1.00	1.13		
													2.43		
07th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	59.41	57.18	0.50	0.15	0.10	1.00	YES
					W38-U	0.68	0.99	1.29	59.20	57.18	0.50	1.00	1.20		
													1.30		
07th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	63.29	119.55	0.50	0.15	0.05	2.00	NO
					W39-U	0.68	0.99	1.29	62.69	119.55	0.50	1.00	0.61		
					W40-L	0.68	0.99	1.36	63.84	119.55	0.50	0.15	0.10		
					W40-U	0.68	0.99	2.52	63.15	119.55	0.50	1.00	1.20		
													1.95		
07th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	61.19	69.12	0.50	0.15	0.08	1.00	
					W41-U	0.68	0.99	1.29	60.99	69.12	0.50	1.00	1.02		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W42-L	0.68	0.99	0.70	61.72	69.12	0.50	0.15	0.08		
					W42-U	0.68	0.99	1.29	61.52	69.12	0.50	1.00	1.03		
07th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	62.79	66.25	0.50	0.15	0.09	2.22	1.00
					W43-U	0.68	0.99	1.29	62.59	66.25	0.50	1.00	1.10		
07th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	63.56	56.67	0.50	0.15	0.11	1.19	1.00
					W44-U	0.68	0.99	1.29	63.36	56.67	0.50	1.00	1.30		
07th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06	1.40	1.00
					W45-U	0.68	0.99	3.18	35.02	151.85	0.50	1.00	0.66		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	37.82	151.85	0.50	1.00	0.80		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	33.96	151.85	0.50	1.00	0.64		
													2.30	2.00	YES
08th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	36.28	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	27.56	125.20	0.50	1.00	0.63		
					W2-L	0.68	0.99	1.93	39.28	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	28.87	125.20	0.50	1.00	0.74		
					W3-L	0.68	0.99	1.72	36.61	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	25.98	125.20	0.50	1.00	0.59		
					W4-L	0.68	0.99	0.70	48.60	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.37	125.20	0.50	1.00	0.45		
													2.67	2.00	YES
08th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.42	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.24	66.26	0.50	1.00	0.81		
													0.88	1.00	NO
08th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.60	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	43.43	66.49	0.50	1.00	0.76		
													0.82	1.00	NO
08th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	43.06	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.44	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	44.23	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.44	104.32	0.50	1.00	0.94		
													1.53	2.00	NO
08th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	35.83	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	35.55	65.09	0.50	1.00	0.63		
													0.69	1.00	NO
08th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	36.44	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.69	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	38.10	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	37.19	121.62	0.50	1.00	0.69		
													1.12	2.00	NO
08th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.86	56.77	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	29.47	56.77	0.50	1.00	0.60	1.00	NO
													0.65		
08th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.98	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.51	56.45	0.50	1.00	0.54		
													0.59	1.00	NO
08th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.74	119.79	0.50	0.15	0.02	1.00	
					W14-U	0.68	0.99	1.29	29.81	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.37	119.79	0.50	0.15	0.05	1.00	
					W15-U	0.68	0.99	2.52	32.30	119.79	0.50	1.00	0.61		
													0.97	2.00	NO
08th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.67	59.49	0.50	0.15	0.04	1.00	
					W16-U	0.68	0.99	1.29	25.15	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	35.91	59.49	0.50	0.15	0.03	1.00	
					W17-U	0.68	0.99	0.67	35.80	59.49	0.50	1.00	0.36		
													0.92	1.00	NO
08th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	32.38	116.88	0.50	0.15	0.01	1.00	
					W18-U	0.68	0.99	0.67	32.28	116.88	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.70	32.49	116.88	0.50	0.15	0.03	1.00	
					W19-U	0.68	0.99	1.29	31.57	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.99	116.88	0.50	0.15	0.06	1.00	
					W20-U	0.68	0.99	2.52	34.95	116.88	0.50	1.00	0.68		
													1.25	2.00	NO
08th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	30.56	55.29	0.50	0.15	0.05	1.00	
					W21-U	0.68	0.99	1.29	30.10	55.29	0.50	1.00	0.63		
													0.68	1.00	NO
08th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	33.98	69.09	0.50	0.15	0.05	1.00	
					W22-U	0.68	0.99	1.29	33.44	69.09	0.50	1.00	0.56		
													0.61	1.00	NO
08th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	35.40	67.42	0.50	0.15	0.05	1.00	
					W23-U	0.68	0.99	1.29	34.90	67.42	0.50	1.00	0.60		
													0.65	1.00	NO
08th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	42.34	116.39	0.50	0.15	0.03	1.00	
					W24-U	0.68	0.99	1.29	41.49	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.47	116.39	0.50	0.15	0.07	1.00	
					W25-U	0.68	0.99	2.52	44.51	116.39	0.50	1.00	0.87		
													1.39	2.00	NO
08th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	42.23	55.28	0.50	0.15	0.07	1.00	
					W26-U	0.68	0.99	1.29	41.86	55.28	0.50	1.00	0.88		
													0.95	1.00	NO
08th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	47.66	69.08	0.50	0.15	0.06	1.00	
					W27-U	0.68	0.99	1.29	47.35	69.08	0.50	1.00	0.80		
													0.86	1.00	NO
08th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	49.51	55.32	0.50	0.15	0.08	1.00	
					W28-U	0.68	0.99	1.29	49.25	55.32	0.50	1.00	1.03		
													1.12	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
08th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	53.79	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	53.16	117.45	0.50	1.00	0.53		
					W30-L	0.68	0.99	1.36	55.40	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	54.66	117.45	0.50	1.00	1.05		
					W31-L	0.68	0.99	0.36	38.83	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	39.96	117.45	0.50	1.00	0.20		
08th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	21.45	58.24	0.50	0.15	0.02		
					W32-U	0.68	0.99	0.67	21.26	58.24	0.50	1.00	0.22		
					W33-L	0.68	0.99	0.70	55.67	58.24	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.29	55.46	58.24	0.50	1.00	1.10		
													1.43	1.00	YES
08th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	59.94	117.07	0.50	0.15	0.05		
					W34-U	0.68	0.99	1.29	59.34	117.07	0.50	1.00	0.59		
					W35-L	0.68	0.99	1.36	60.87	117.07	0.50	0.15	0.10		
					W35-U	0.68	0.99	2.52	60.17	117.07	0.50	1.00	1.16		
													1.89	2.00	NO
08th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	58.04	59.45	0.50	0.15	0.09		
					W36-U	0.68	0.99	1.29	57.83	59.45	0.50	1.00	1.13		
					W37-L	0.68	0.99	0.70	58.70	59.45	0.50	0.15	0.09		
					W37-U	0.68	0.99	1.29	58.49	59.45	0.50	1.00	1.14		
													2.46	1.00	YES
08th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	59.96	57.18	0.50	0.15	0.10		
					W38-U	0.68	0.99	1.29	59.75	57.18	0.50	1.00	1.21		
													1.31	1.00	YES
08th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	63.87	119.55	0.50	0.15	0.05		
					W39-U	0.68	0.99	1.29	63.25	119.55	0.50	1.00	0.61		
					W40-L	0.68	0.99	1.36	64.44	119.55	0.50	0.15	0.10		
					W40-U	0.68	0.99	2.52	63.72	119.55	0.50	1.00	1.21		
													1.97	2.00	NO
08th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	61.77	69.12	0.50	0.15	0.08		
					W41-U	0.68	0.99	1.29	61.55	69.12	0.50	1.00	1.03		
					W42-L	0.68	0.99	0.70	62.31	69.12	0.50	0.15	0.08		
					W42-U	0.68	0.99	1.29	62.08	69.12	0.50	1.00	1.04		
													2.24	1.00	YES
08th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	63.39	66.25	0.50	0.15	0.09		
					W43-U	0.68	0.99	1.29	63.17	66.25	0.50	1.00	1.11		
													1.20	1.00	YES
08th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	64.18	56.67	0.50	0.15	0.11		
					W44-U	0.68	0.99	1.29	63.95	56.67	0.50	1.00	1.31		
													1.42	1.00	YES
08th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	35.95	151.85	0.50	1.00	0.68		
					W46-L	0.68	0.99	1.93	45.00	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	38.68	151.85	0.50	1.00	0.82		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	34.91	151.85	0.50	1.00	0.66		
													2.36	2.00	YES
09th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08			
				W1-U	0.68	0.99	3.19	36.22	125.20	0.50	1.00	0.83			
				W2-L	0.68	0.99	1.93	44.01	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	38.62	125.20	0.50	1.00	0.99			
				W3-L	0.68	0.99	1.72	41.01	125.20	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.19	35.45	125.20	0.50	1.00	0.81			
				W4-L	0.68	0.99	0.70	48.94	125.20	0.50	0.15	0.04			
				W4-U	0.68	0.99	1.29	48.58	125.20	0.50	1.00	0.45			
													3.36	2.00	YES
09th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	46.88	66.26	0.50	0.15	0.07			
				W5-U	0.68	0.99	1.29	46.50	66.26	0.50	1.00	0.81			
													0.88	1.00	NO
09th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	44.06	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	43.63	66.49	0.50	1.00	0.76			
													0.82	1.00	NO
09th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	43.39	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	42.52	104.32	0.50	1.00	0.47			
				W8-L	0.68	0.99	1.36	44.53	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	43.51	104.32	0.50	1.00	0.94			
													1.53	2.00	NO
09th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	36.13	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	35.69	65.09	0.50	1.00	0.64			
													0.69	1.00	NO
09th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	36.68	121.62	0.50	0.15	0.03			
				W10-U	0.68	0.99	1.29	35.87	121.62	0.50	1.00	0.34			
				W11-L	0.68	0.99	1.36	38.31	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	37.35	121.62	0.50	1.00	0.70			
													1.12	2.00	NO
09th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	30.06	56.77	0.50	0.15	0.05			
				W12-U	0.68	0.99	1.29	29.63	56.77	0.50	1.00	0.61			
													0.66	1.00	NO
09th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	27.10	56.45	0.50	0.15	0.05			
				W13-U	0.68	0.99	1.29	26.60	56.45	0.50	1.00	0.55			
													0.59	1.00	NO
09th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	30.85	119.79	0.50	0.15	0.02			
				W14-U	0.68	0.99	1.29	29.88	119.79	0.50	1.00	0.29			
				W15-L	0.68	0.99	1.36	33.45	119.79	0.50	0.15	0.05			
				W15-U	0.68	0.99	2.52	32.34	119.79	0.50	1.00	0.61			
													0.98	2.00	NO
09th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	25.73	59.49	0.50	0.15	0.04			
				W16-U	0.68	0.99	1.29	25.18	59.49	0.50	1.00	0.49			
				W17-L	0.68	0.99	0.36	35.99	59.49	0.50	0.15	0.03			

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-U	0.68	0.99	0.67	35.91	59.49	0.50	1.00	0.36		
													0.92	1.00	NO
09th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	32.42	116.88	0.50	0.15	0.01			
				W18-U	0.68	0.99	0.67	32.32	116.88	0.50	1.00	0.17			
				W19-L	0.68	0.99	0.70	32.51	116.88	0.50	0.15	0.03			
				W19-U	0.68	0.99	1.29	31.57	116.88	0.50	1.00	0.31			
				W20-L	0.68	0.99	1.36	36.01	116.88	0.50	0.15	0.06			
				W20-U	0.68	0.99	2.52	34.95	116.88	0.50	1.00	0.68			
												1.25	2.00	NO	
09th	R12	Residential	Bedroom	W21-L	0.68	0.99	0.70	30.59	55.29	0.50	0.15	0.05			
				W21-U	0.68	0.99	1.29	30.09	55.29	0.50	1.00	0.63			
													0.68	1.00	NO
09th	R13	Residential	Bedroom	W22-L	0.68	0.99	0.70	33.74	69.09	0.50	0.15	0.05			
				W22-U	0.68	0.99	1.29	33.20	69.09	0.50	1.00	0.56			
													0.60	1.00	NO
09th	R14	Residential	Bedroom	W23-L	0.68	0.99	0.70	35.23	67.42	0.50	0.15	0.05			
				W23-U	0.68	0.99	1.29	34.69	67.42	0.50	1.00	0.60			
													0.65	1.00	NO
09th	R15	Residential	LKD	W24-L	0.68	0.99	0.70	42.27	116.39	0.50	0.15	0.03			
				W24-U	0.68	0.99	1.29	41.42	116.39	0.50	1.00	0.41			
				W25-L	0.68	0.99	1.36	45.46	116.39	0.50	0.15	0.07			
				W25-U	0.68	0.99	2.52	44.53	116.39	0.50	1.00	0.87			
													1.38	2.00	NO
09th	R16	Residential	Bedroom	W26-L	0.68	0.99	0.70	42.34	55.28	0.50	0.15	0.07			
				W26-U	0.68	0.99	1.29	41.98	55.28	0.50	1.00	0.88			
													0.95	1.00	NO
09th	R17	Residential	Bedroom	W27-L	0.68	0.99	0.70	47.85	69.08	0.50	0.15	0.07			
				W27-U	0.68	0.99	1.29	47.54	69.08	0.50	1.00	0.80			
													0.86	1.00	NO
09th	R18	Residential	Bedroom	W28-L	0.68	0.99	0.70	49.81	55.32	0.50	0.15	0.08			
				W28-U	0.68	0.99	1.29	49.53	55.32	0.50	1.00	1.04			
													1.12	1.00	YES
09th	R19	Residential	LKD	W29-L	0.68	0.99	0.70	54.13	117.45	0.50	0.15	0.04			
				W29-U	0.68	0.99	1.29	53.49	117.45	0.50	1.00	0.53			
				W30-L	0.68	0.99	1.36	55.77	117.45	0.50	0.15	0.09			
				W30-U	0.68	0.99	2.52	55.00	117.45	0.50	1.00	1.06			
				W31-L	0.68	0.99	0.36	42.63	117.45	0.50	0.15	0.02			
				W31-U	0.68	0.99	0.67	44.76	117.45	0.50	1.00	0.23			
													1.97	2.00	NO
09th	R20	Residential	Bedroom	W32-L	0.68	0.99	0.36	21.63	58.24	0.50	0.15	0.02			
				W32-U	0.68	0.99	0.67	21.47	58.24	0.50	1.00	0.22			
				W33-L	0.68	0.99	0.70	56.15	58.24	0.50	0.15	0.09			
				W33-U	0.68	0.99	1.29	55.93	58.24	0.50	1.00	1.11			
													1.44	1.00	YES
09th	R21	Residential	LKD	W34-L	0.68	0.99	0.70	60.44	117.07	0.50	0.15	0.05			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria	
					W34-U	0.68	0.99	1.29	59.83	117.07	0.50	1.00	0.59			
					W35-L	0.68	0.99	1.36	61.40	117.07	0.50	0.15	0.10			
					W35-U	0.68	0.99	2.52	60.68	117.07	0.50	1.00	1.17			
												1.91	2.00			NO
09th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	58.57	59.45	0.50	0.15	0.09			
					W36-U	0.68	0.99	1.29	58.35	59.45	0.50	1.00	1.14			
					W37-L	0.68	0.99	0.70	59.24	59.45	0.50	0.15	0.09			
					W37-U	0.68	0.99	1.29	59.02	59.45	0.50	1.00	1.15			
													2.48	1.00	YES	
09th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	60.52	57.18	0.50	0.15	0.10			
					W38-U	0.68	0.99	1.29	60.30	57.18	0.50	1.00	1.22			
														1.32	1.00	YES
09th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	64.44	119.55	0.50	0.15	0.05			
					W39-U	0.68	0.99	1.29	63.82	119.55	0.50	1.00	0.62			
					W40-L	0.68	0.99	1.36	65.02	119.55	0.50	0.15	0.10			
					W40-U	0.68	0.99	2.52	64.30	119.55	0.50	1.00	1.22			
														1.99	2.00	NO
09th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	62.34	69.12	0.50	0.15	0.08			
					W41-U	0.68	0.99	1.29	62.12	69.12	0.50	1.00	1.04			
					W42-L	0.68	0.99	0.70	62.88	69.12	0.50	0.15	0.09			
					W42-U	0.68	0.99	1.29	62.65	69.12	0.50	1.00	1.05			
														2.27	1.00	YES
09th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	63.98	66.25	0.50	0.15	0.09			
					W43-U	0.68	0.99	1.29	63.75	66.25	0.50	1.00	1.12			
														1.21	1.00	YES
09th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	64.77	56.67	0.50	0.15	0.11			
					W44-U	0.68	0.99	1.29	64.55	56.67	0.50	1.00	1.32			
														1.43	1.00	YES
09th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	45.19	151.85	0.50	0.15	0.07			
					W45-U	0.68	0.99	3.18	44.74	151.85	0.50	1.00	0.84			
					W46-L	0.68	0.99	1.93	48.77	151.85	0.50	0.15	0.08			
					W46-U	0.68	0.99	3.57	48.55	151.85	0.50	1.00	1.03			
					W47-L	0.68	0.99	1.72	43.47	151.85	0.50	0.15	0.07			
					W47-U	0.68	0.99	3.20	43.73	151.85	0.50	1.00	0.83			
														2.92	2.00	YES
10th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	38.27	125.20	0.50	0.15	0.07			
					W1-U	0.68	0.99	3.19	28.47	125.20	0.50	1.00	0.65			
					W2-L	0.68	0.99	1.93	41.25	125.20	0.50	0.15	0.09			
					W2-U	0.68	0.99	3.57	30.20	125.20	0.50	1.00	0.77			
					W3-L	0.68	0.99	1.72	38.70	125.20	0.50	0.15	0.07			
					W3-U	0.68	0.99	3.19	27.63	125.20	0.50	1.00	0.63			
					W4-L	0.68	0.99	0.70	49.02	125.20	0.50	0.15	0.04			
					W4-U	0.68	0.99	1.29	48.63	125.20	0.50	1.00	0.45			
													2.77	2.00	YES	
10th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.90	66.26	0.50	0.15	0.07			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W5-U	0.68	0.99	1.29	46.49	66.26	0.50	1.00	0.81	1.00	NO
													0.88		
10th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	43.93	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	43.46	66.49	0.50	1.00	0.76		
													0.82	1.00	NO
10th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	43.19	104.32	0.50	0.15	0.04	1.00	
					W7-U	0.68	0.99	1.29	42.28	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	44.33	104.32	0.50	0.15	0.08	1.00	
					W8-U	0.68	0.99	2.52	43.26	104.32	0.50	1.00	0.94		
													1.53	2.00	NO
10th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	36.02	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	35.43	65.09	0.50	1.00	0.63		
													0.68	1.00	NO
10th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	36.68	121.62	0.50	0.15	0.03	1.00	
					W10-U	0.68	0.99	1.29	35.63	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	38.31	121.62	0.50	0.15	0.06	1.00	
					W11-U	0.68	0.99	2.52	37.12	121.62	0.50	1.00	0.69		
													1.12	2.00	NO
10th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	30.04	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	29.34	56.77	0.50	1.00	0.60		
													0.65	1.00	NO
10th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	27.03	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.31	56.45	0.50	1.00	0.54		
													0.59	1.00	NO
10th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.77	119.79	0.50	0.15	0.02	1.00	
					W14-U	0.68	0.99	1.29	29.62	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.36	119.79	0.50	0.15	0.05	1.00	
					W15-U	0.68	0.99	2.52	32.10	119.79	0.50	1.00	0.61		
													0.97	2.00	NO
10th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	25.60	59.49	0.50	0.15	0.04	1.00	NO
					W16-U	0.68	0.99	1.29	24.88	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	36.16	59.49	0.50	0.15	0.03	1.00	NO
					W17-U	0.68	0.99	0.67	36.13	59.49	0.50	1.00	0.37		
													0.92	1.00	NO
10th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	32.40	116.88	0.50	0.15	0.01	1.00	
					W18-U	0.68	0.99	0.67	32.23	116.88	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.70	32.36	116.88	0.50	0.15	0.03	1.00	
					W19-U	0.68	0.99	1.29	31.27	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.86	116.88	0.50	0.15	0.06	1.00	
					W20-U	0.68	0.99	2.52	34.66	116.88	0.50	1.00	0.67		
													1.24	2.00	NO
10th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	30.41	55.29	0.50	0.15	0.05	1.00	NO
					W21-U	0.68	0.99	1.29	29.76	55.29	0.50	1.00	0.62		
													0.68	1.00	NO
10th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	33.59	69.09	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W22-U	0.68	0.99	1.29	33.07	69.09	0.50	1.00	0.56	1.00	NO
													0.60		
10th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	35.12	67.42	0.50	0.15	0.05		
					W23-U	0.68	0.99	1.29	34.66	67.42	0.50	1.00	0.60		
													0.65	1.00	NO
10th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	42.20	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	41.35	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.50	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.53	116.39	0.50	1.00	0.87		
													1.38	2.00	NO
10th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	42.53	55.28	0.50	0.15	0.07		
					W26-U	0.68	0.99	1.29	42.17	55.28	0.50	1.00	0.89		
													0.96	1.00	NO
10th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	48.08	69.08	0.50	0.15	0.07		
					W27-U	0.68	0.99	1.29	47.74	69.08	0.50	1.00	0.80		
													0.87	1.00	NO
10th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	50.13	55.32	0.50	0.15	0.09		
					W28-U	0.68	0.99	1.29	49.83	55.32	0.50	1.00	1.05		
													1.13	1.00	YES
10th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	54.50	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	53.83	117.45	0.50	1.00	0.53		
					W30-L	0.68	0.99	1.36	56.17	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	55.36	117.45	0.50	1.00	1.07		
					W31-L	0.68	0.99	0.36	47.93	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	48.50	117.45	0.50	1.00	0.25		
													2.00	2.00	YES
10th	R20	Residential	Bathroom		W32-L	0.68	0.99	0.70	45.42	49.89	0.50	0.15	0.09		
					W32-U	0.68	0.99	1.19	48.09	49.89	0.50	1.00	1.03		
													1.12	-1.00	NO
10th	R21	Residential	Study		W33-L	0.68	0.99	0.69	53.95	63.55	0.50	0.15	0.08		
					W33-U	0.68	0.99	1.17	59.21	63.55	0.50	1.00	0.98		
					W34-L	0.68	0.99	0.69	52.07	63.55	0.50	0.15	0.08		
					W34-U	0.68	0.99	1.17	57.52	63.55	0.50	1.00	0.96		
													2.09	-1.00	NO
10th	R22	Residential	En Suite		W35-L	0.68	0.99	0.70	52.43	50.60	0.50	0.15	0.10		
					W35-U	0.68	0.99	1.19	58.23	50.60	0.50	1.00	1.23		
													1.33	-1.00	NO
10th	R23	Residential	Bedroom		W36-L	0.68	0.99	0.69	55.85	91.83	0.50	0.15	0.06		
					W36-U	0.68	0.99	1.17	61.49	91.83	0.50	1.00	0.71		
					W37-L	0.68	0.99	0.69	54.36	91.83	0.50	0.15	0.05		
					W37-U	0.68	0.99	1.17	60.04	91.83	0.50	1.00	0.69		
													1.51	1.00	YES
10th	R24	Residential	LKD		W38-L	0.68	0.99	0.70	54.95	228.51	0.50	0.15	0.02		
					W38-U	0.68	0.99	1.19	61.26	228.51	0.50	1.00	0.29		
					W39-L	0.68	0.99	0.70	56.27	228.51	0.50	0.15	0.02		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W39-U	0.68	0.99	1.19	62.86	228.51	0.50	1.00	0.29		
					W40-L	0.68	0.99	1.71	78.70	228.51	0.50	0.15	0.08		
					W40-U	0.68	0.99	2.91	81.15	228.51	0.50	1.00	0.93		
					W41-L	0.68	0.99	1.71	76.40	228.51	0.50	0.15	0.08		
					W41-U	0.68	0.99	2.91	80.35	228.51	0.50	1.00	0.92		
					W42-L	0.68	0.99	1.71	73.90	228.51	0.50	0.15	0.07		
					W42-U	0.68	0.99	2.91	81.07	228.51	0.50	1.00	0.93		
					W43-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03		
					W43-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					W44-L	0.68	0.99	1.71	73.57	228.51	0.50	0.15	0.07		
					W44-U	0.68	0.99	2.91	80.50	228.51	0.50	1.00	0.92		
					W45-L	0.68	0.99	0.70	65.45	228.51	0.50	0.15	0.03		
					W45-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					11th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.27		
W1-U	0.68	0.99	3.19	29.76					125.20	0.50	1.00	0.68			
W2-L	0.68	0.99	1.93	42.22					125.20	0.50	0.15	0.09			
W2-U	0.68	0.99	3.57	31.59					125.20	0.50	1.00	0.81			
W3-L	0.68	0.99	1.72	39.70					125.20	0.50	0.15	0.07			
W3-U	0.68	0.99	3.19	29.19					125.20	0.50	1.00	0.67			
W4-L	0.68	0.99	0.70	49.09					125.20	0.50	0.15	0.04			
W4-U	0.68	0.99	1.29	48.71					125.20	0.50	1.00	0.45			
													2.88	2.00	YES
11th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	46.91	66.26	0.50	0.15	0.07			
				W5-U	0.68	0.99	1.29	46.50	66.26	0.50	1.00	0.81			
													0.88	1.00	NO
11th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	43.83	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	43.38	66.49	0.50	1.00	0.76			
													0.82	1.00	NO
11th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	43.01	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	42.15	104.32	0.50	1.00	0.47			
				W8-L	0.68	0.99	1.36	44.13	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	43.11	104.32	0.50	1.00	0.94			
													1.52	2.00	NO
11th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	35.75	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	35.22	65.09	0.50	1.00	0.63			
													0.68	1.00	NO
11th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	36.37	121.62	0.50	0.15	0.03			
				W10-U	0.68	0.99	1.29	35.34	121.62	0.50	1.00	0.34			
				W11-L	0.68	0.99	1.36	38.00	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	36.80	121.62	0.50	1.00	0.68			
													1.11	2.00	NO
11th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	29.67	56.77	0.50	0.15	0.05			
				W12-U	0.68	0.99	1.29	28.98	56.77	0.50	1.00	0.59			
													0.64	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
11th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.69	56.45	0.50	0.15	0.04	1.00	
					W13-U	0.68	0.99	1.29	25.98	56.45	0.50	1.00	0.53		
													0.58	1.00	NO
11th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.49	119.79	0.50	0.15	0.02	1.00	
					W14-U	0.68	0.99	1.29	29.32	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.10	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.83	119.79	0.50	1.00	0.60		
11th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.29	59.49	0.50	0.15	0.04	1.00	
					W16-U	0.68	0.99	1.29	24.56	59.49	0.50	1.00	0.48		
					W17-L	0.68	0.99	0.36	36.44	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	36.51	59.49	0.50	1.00	0.37		
11th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	32.28	116.88	0.50	0.15	0.01	1.00	
					W18-U	0.68	0.99	0.67	32.11	116.88	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.70	32.08	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	30.98	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.59	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.39	116.88	0.50	1.00	0.67		
													1.23	2.00	NO
11th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	30.11	55.29	0.50	0.15	0.05	1.00	
					W21-U	0.68	0.99	1.29	29.46	55.29	0.50	1.00	0.62		
													0.67	1.00	NO
11th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	33.49	69.09	0.50	0.15	0.05	1.00	
					W22-U	0.68	0.99	1.29	32.97	69.09	0.50	1.00	0.55		
													0.60	1.00	NO
11th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	35.15	67.42	0.50	0.15	0.05	1.00	
					W23-U	0.68	0.99	1.29	34.69	67.42	0.50	1.00	0.60		
													0.65	1.00	NO
11th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	42.20	116.39	0.50	0.15	0.03	1.00	
					W24-U	0.68	0.99	1.29	41.40	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.51	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.58	116.39	0.50	1.00	0.87		
													1.39	2.00	NO
11th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	42.70	55.28	0.50	0.15	0.07	1.00	
					W26-U	0.68	0.99	1.29	42.35	55.28	0.50	1.00	0.89		
													0.96	1.00	NO
11th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	48.26	69.08	0.50	0.15	0.07	1.00	
					W27-U	0.68	0.99	1.29	47.94	69.08	0.50	1.00	0.81		
													0.87	1.00	NO
11th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	50.39	55.32	0.50	0.15	0.09	1.00	
					W28-U	0.68	0.99	1.29	50.09	55.32	0.50	1.00	1.05		
													1.14	1.00	YES
11th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	54.79	117.45	0.50	0.15	0.04	1.00	
					W29-U	0.68	0.99	1.29	54.11	117.45	0.50	1.00	0.53		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W30-L	0.68	0.99	1.36	56.47	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	55.65	117.45	0.50	1.00	1.07		
					W31-L	0.68	0.99	0.36	49.18	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.31	117.45	0.50	1.00	0.25		
12th	R1	Residential	LKD										2.01	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	31.02	125.20	0.50	1.00	0.71		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	32.91	125.20	0.50	1.00	0.84		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	30.63	125.20	0.50	1.00	0.70		
					W4-L	0.68	0.99	0.70	49.18	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.78	125.20	0.50	1.00	0.45		
													2.98	2.00	YES
12th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	46.94	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.50	66.26	0.50	1.00	0.81		
12th	R3	Residential	Bedroom										0.88	1.00	NO
					W6-L	0.68	0.99	0.70	43.81	66.49	0.50	0.15	0.06		
12th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	43.36	66.49	0.50	1.00	0.76		
													0.82	1.00	NO
12th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	42.98	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.11	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	44.08	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.06	104.32	0.50	1.00	0.93		
12th	R5	Residential	Bedroom										1.52	2.00	NO
					W9-L	0.68	0.99	0.70	35.68	65.09	0.50	0.15	0.05		
12th	R6	Residential	LKD		W9-U	0.68	0.99	1.29	35.16	65.09	0.50	1.00	0.63		
													0.68	1.00	NO
12th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	36.21	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.25	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	37.83	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.72	121.62	0.50	1.00	0.68		
12th	R7	Residential	Bedroom										1.10	2.00	NO
					W12-L	0.68	0.99	0.70	29.48	56.77	0.50	0.15	0.05		
12th	R8	Residential	Bedroom		W12-U	0.68	0.99	1.29	28.90	56.77	0.50	1.00	0.59		
													0.64	1.00	NO
12th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.53	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	25.94	56.45	0.50	1.00	0.53		
12th	R9	Residential	LKD										0.58	1.00	NO
					W14-L	0.68	0.99	0.70	30.35	119.79	0.50	0.15	0.02		
12th	R9	Residential	LKD		W14-U	0.68	0.99	1.29	29.30	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	32.98	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.82	119.79	0.50	1.00	0.60		
													0.96	2.00	NO
12th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	25.16	59.49	0.50	0.15	0.04		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	24.56	59.49	0.50	1.00	0.48	1.00	NO
					W17-L	0.68	0.99	0.36	37.05	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	37.34	59.49	0.50	1.00	0.38		
12th	R11	Residential	LKD										0.93	2.00	NO
					W18-L	0.68	0.99	0.36	32.21	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.08	116.88	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.70	32.00	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	31.05	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.53	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.46	116.88	0.50	1.00	0.67		
12th	R12	Residential	Bedroom										1.24	1.00	NO
					W21-L	0.68	0.99	0.70	30.05	55.29	0.50	0.15	0.05		
12th	R13	Residential	Bedroom										0.62	1.00	NO
					W21-U	0.68	0.99	1.29	29.56	55.29	0.50	1.00	0.67		
12th	R14	Residential	Bedroom										0.05	1.00	NO
					W22-L	0.68	0.99	0.70	33.53	69.09	0.50	0.15	0.05		
12th	R15	Residential	LKD										0.56	1.00	NO
					W22-U	0.68	0.99	1.29	33.10	69.09	0.50	1.00	0.60		
12th	R16	Residential	LKD										0.05	1.00	NO
					W23-L	0.68	0.99	0.70	35.27	67.42	0.50	0.15	0.05		
12th	R17	Residential	LKD										0.60	1.00	NO
					W23-U	0.68	0.99	1.29	34.85	67.42	0.50	1.00	0.65		
12th	R18	Residential	LKD		W24-L	0.68	0.99	0.70	42.36	116.39	0.50	0.15	0.03	2.00	NO
					W24-U	0.68	0.99	1.29	41.58	116.39	0.50	1.00	0.41		
					W25-L	0.68	0.99	1.36	45.67	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.77	116.39	0.50	1.00	0.87		
12th	R19	Residential	Bedroom										1.39	1.00	NO
					W26-L	0.68	0.99	0.70	42.92	55.28	0.50	0.15	0.07		
12th	R20	Residential	Bedroom										0.89	1.00	NO
					W26-U	0.68	0.99	1.29	42.57	55.28	0.50	1.00	0.97		
12th	R21	Residential	Bedroom										0.07	1.00	NO
					W27-L	0.68	0.99	0.70	48.51	69.08	0.50	0.15	0.07		
12th	R22	Residential	Bedroom										0.81	1.00	NO
					W27-U	0.68	0.99	1.29	48.20	69.08	0.50	1.00	0.88		
12th	R23	Residential	Bedroom										0.09	1.00	YES
					W28-L	0.68	0.99	0.70	50.67	55.32	0.50	0.15	0.09		
12th	R24	Residential	LKD										1.06	1.00	YES
					W28-U	0.68	0.99	1.29	50.35	55.32	0.50	1.00	1.14		
12th	R25	Residential	LKD		W29-L	0.68	0.99	0.70	55.08	117.45	0.50	0.15	0.04	2.00	YES
					W29-U	0.68	0.99	1.29	54.39	117.45	0.50	1.00	0.54		
					W30-L	0.68	0.99	1.36	56.77	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	55.95	117.45	0.50	1.00	1.08		
					W31-L	0.68	0.99	0.36	49.62	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.48	117.45	0.50	1.00	0.25		
13th	R1	Residential	LKD										2.02	2.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	32.25	125.20	0.50	1.00	0.74		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
13th	R2	Residential	LKD										0.88	2.00	YES
					W2-U	0.68	0.99	3.57	34.20	125.20	0.50	1.00	0.88		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	32.02	125.20	0.50	1.00	0.73		
					W4-L	0.68	0.99	0.70	49.26	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.84	125.20	0.50	1.00	0.45		
13th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	46.94	66.26	0.50	0.15	0.07	3.07	2.00	YES
				W5-U	0.68	0.99	1.29	46.49	66.26	0.50	1.00	0.81			
				0.88	1.00	NO									
13th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	43.79	66.49	0.50	0.15	0.06	0.82	1.00	NO
				W6-U	0.68	0.99	1.29	43.33	66.49	0.50	1.00	0.76			
				0.82	1.00	NO									
13th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	42.95	104.32	0.50	0.15	0.04	1.52	2.00	NO
				W7-U	0.68	0.99	1.29	42.07	104.32	0.50	1.00	0.47			
				W8-L	0.68	0.99	1.36	44.04	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	43.01	104.32	0.50	1.00	0.93			
13th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	35.63	65.09	0.50	0.15	0.05	0.68	1.00	NO
				W9-U	0.68	0.99	1.29	35.09	65.09	0.50	1.00	0.63			
				0.68	1.00	NO									
13th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	36.17	121.62	0.50	0.15	0.03	1.10	2.00	NO
				W10-U	0.68	0.99	1.29	35.20	121.62	0.50	1.00	0.34			
				W11-L	0.68	0.99	1.36	37.80	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	36.68	121.62	0.50	1.00	0.68			
13th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	29.47	56.77	0.50	0.15	0.05	0.64	1.00	NO
				W12-U	0.68	0.99	1.29	28.87	56.77	0.50	1.00	0.59			
				0.64	1.00	NO									
13th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	26.57	56.45	0.50	0.15	0.04	0.58	1.00	NO
				W13-U	0.68	0.99	1.29	25.97	56.45	0.50	1.00	0.53			
				0.58	1.00	NO									
13th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	30.39	119.79	0.50	0.15	0.02	0.96	2.00	NO
				W14-U	0.68	0.99	1.29	29.33	119.79	0.50	1.00	0.28			
				W15-L	0.68	0.99	1.36	33.03	119.79	0.50	0.15	0.05			
				W15-U	0.68	0.99	2.52	31.86	119.79	0.50	1.00	0.60			
13th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	25.25	59.49	0.50	0.15	0.04	0.95	1.00	NO
				W16-U	0.68	0.99	1.29	24.64	59.49	0.50	1.00	0.48			
				W17-L	0.68	0.99	0.36	38.36	59.49	0.50	0.15	0.03			
				W17-U	0.68	0.99	0.67	39.18	59.49	0.50	1.00	0.40			
13th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	32.19	116.88	0.50	0.15	0.01	0.95	1.00	NO
				W18-U	0.68	0.99	0.67	32.07	116.88	0.50	1.00	0.17			
				W19-L	0.68	0.99	0.70	32.15	116.88	0.50	0.15	0.03			
				W19-U	0.68	0.99	1.29	31.19	116.88	0.50	1.00	0.31			
				W20-L	0.68	0.99	1.36	35.67	116.88	0.50	0.15	0.06			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-U	0.68	0.99	2.52	34.61	116.88	0.50	1.00	0.67		
													1.24	2.00	NO
13th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	30.23	55.29	0.50	0.15	0.05		
					W21-U	0.68	0.99	1.29	29.74	55.29	0.50	1.00	0.62		
													0.68	1.00	NO
13th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	33.75	69.09	0.50	0.15	0.05		
					W22-U	0.68	0.99	1.29	33.32	69.09	0.50	1.00	0.56		
													0.61	1.00	NO
13th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	35.48	67.42	0.50	0.15	0.05		
					W23-U	0.68	0.99	1.29	35.08	67.42	0.50	1.00	0.60		
													0.65	1.00	NO
13th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	42.58	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	41.81	116.39	0.50	1.00	0.42		
					W25-L	0.68	0.99	1.36	45.90	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	44.99	116.39	0.50	1.00	0.88		
													1.40	2.00	NO
13th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	43.17	55.28	0.50	0.15	0.07		
					W26-U	0.68	0.99	1.29	42.83	55.28	0.50	1.00	0.90		
													0.97	1.00	NO
13th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	48.78	69.08	0.50	0.15	0.07		
					W27-U	0.68	0.99	1.29	48.45	69.08	0.50	1.00	0.81		
													0.88	1.00	NO
13th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	50.94	55.32	0.50	0.15	0.09		
					W28-U	0.68	0.99	1.29	50.61	55.32	0.50	1.00	1.06		
													1.15	1.00	YES
13th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	55.37	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	54.67	117.45	0.50	1.00	0.54		
					W30-L	0.68	0.99	1.36	57.08	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	56.24	117.45	0.50	1.00	1.08		
					W31-L	0.68	0.99	0.36	49.71	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.60	117.45	0.50	1.00	0.25		
													2.03	2.00	YES
14th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	43.38	125.20	0.50	0.15	0.08		
					W1-U	0.68	0.99	3.19	42.30	125.20	0.50	1.00	0.97		
					W2-L	0.68	0.99	1.93	46.63	125.20	0.50	0.15	0.10		
					W2-U	0.68	0.99	3.57	45.17	125.20	0.50	1.00	1.16		
					W3-L	0.68	0.99	1.72	43.69	125.20	0.50	0.15	0.08		
					W3-U	0.68	0.99	3.19	42.45	125.20	0.50	1.00	0.97		
					W4-L	0.68	0.99	0.70	49.32	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.89	125.20	0.50	1.00	0.45		
													3.84	2.00	YES
14th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.92	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.45	66.26	0.50	1.00	0.81		
													0.88	1.00	NO
14th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.75	66.49	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	43.26	66.49	0.50	1.00	0.75	1.00	NO
					W7-L	0.68	0.99	0.70	42.90	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.00	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	43.99	104.32	0.50	0.15	0.08		
14th	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	42.93	104.32	0.50	1.00	0.93	2.00	NO
					W9-L	0.68	0.99	0.70	35.56	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	35.01	65.09	0.50	1.00	0.62		
													0.68		
14th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	36.13	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	35.14	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	37.77	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.64	121.62	0.50	1.00	0.68		
14th	R7	Residential	Bedroom										1.10	1.00	NO
					W12-L	0.68	0.99	0.70	29.46	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.86	56.77	0.50	1.00	0.59		
													0.64		
14th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.63	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.02	56.45	0.50	1.00	0.53		
													0.58		
14th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.45	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	29.37	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.10	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.91	119.79	0.50	1.00	0.60		
14th	R10	Residential	Bedroom										0.96	1.00	NO
					W16-L	0.68	0.99	0.70	25.37	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.73	59.49	0.50	1.00	0.48		
					W17-L	0.68	0.99	0.36	41.23	59.49	0.50	0.15	0.03		
14th	R11	Residential	LKD		W17-U	0.68	0.99	0.67	42.97	59.49	0.50	1.00	0.43	2.00	NO
													0.99		
					W18-L	0.68	0.99	0.36	32.18	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.06	116.88	0.50	1.00	0.16		
14th	R12	Residential	Bedroom		W19-L	0.68	0.99	0.70	32.34	116.88	0.50	0.15	0.03	1.00	NO
					W19-U	0.68	0.99	1.29	31.38	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	35.85	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	34.78	116.88	0.50	1.00	0.67		
14th	R13	Residential	Bedroom										1.25	2.00	NO
					W21-L	0.68	0.99	0.70	30.45	55.29	0.50	0.15	0.05		
					W21-U	0.68	0.99	1.29	29.96	55.29	0.50	1.00	0.63		
													0.68		
14th	R14	Residential	Bedroom		W22-L	0.68	0.99	0.70	33.99	69.09	0.50	0.15	0.05	1.00	NO
					W22-U	0.68	0.99	1.29	33.56	69.09	0.50	1.00	0.56		
													0.61		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R15	Residential	LKD		W23-U	0.68	0.99	1.29	35.32	67.42	0.50	1.00	0.61	1.00	NO
					W24-L	0.68	0.99	0.70	42.82	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	42.05	116.39	0.50	1.00	0.42		
					W25-L	0.68	0.99	1.36	46.13	116.39	0.50	0.15	0.07		
14th	R16	Residential	Bedroom		W25-U	0.68	0.99	2.52	45.23	116.39	0.50	1.00	0.88	2.00	NO
					W26-L	0.68	0.99	0.70	43.43	55.28	0.50	0.15	0.07		
					W26-U	0.68	0.99	1.29	43.08	55.28	0.50	1.00	0.90		
													0.98		
14th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	49.04	69.08	0.50	0.15	0.07	1.00	NO
					W27-U	0.68	0.99	1.29	48.69	69.08	0.50	1.00	0.82		
													0.88		
14th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	51.20	55.32	0.50	0.15	0.09	1.00	YES
					W28-U	0.68	0.99	1.29	50.86	55.32	0.50	1.00	1.07		
													1.15		
14th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	55.65	117.45	0.50	0.15	0.04	2.00	YES
					W29-U	0.68	0.99	1.29	54.93	117.45	0.50	1.00	0.54		
					W30-L	0.68	0.99	1.36	57.37	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	56.50	117.45	0.50	1.00	1.09		
					W31-L	0.68	0.99	0.36	49.91	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.87	117.45	0.50	1.00	0.26		
													2.04		
15th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.72	125.20	0.50	1.00	0.79		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	36.81	125.20	0.50	1.00	0.94		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	34.80	125.20	0.50	1.00	0.80		
					W4-L	0.68	0.99	0.70	49.38	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.93	125.20	0.50	1.00	0.45		
15th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	46.88	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	46.38	66.26	0.50	1.00	0.81		
													0.88		
15th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	43.68	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	43.17	66.49	0.50	1.00	0.75		
													0.82		
15th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	42.84	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	41.90	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	43.92	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.83	104.32	0.50	1.00	0.93		
													1.51		
15th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	35.47	65.09	0.50	0.15	0.05	1.00	
					W9-U	0.68	0.99	1.29	34.89	65.09	0.50	1.00	0.62		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
15th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	36.08	121.62	0.50	0.15	0.67	1.00	NO
					W10-U	0.68	0.99	1.29	35.07	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.75	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.60	121.62	0.50	1.00	0.68		
													1.10	2.00	NO
15th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.46	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.83	56.77	0.50	1.00	0.59		
													0.64	1.00	NO
15th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.69	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	26.05	56.45	0.50	1.00	0.54		
													0.58	1.00	NO
15th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.51	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.41	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.17	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.97	119.79	0.50	1.00	0.60		
													0.96	2.00	NO
15th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.49	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.86	59.49	0.50	1.00	0.48		
					W17-L	0.68	0.99	0.36	46.65	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	47.67	59.49	0.50	1.00	0.48		
													1.05	1.00	YES
15th	R11		Residential	LKD	W18-L	0.68	0.99	0.46	26.58	151.45	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.93	30.85	151.45	0.50	1.00	0.17		
					W19-L	0.68	0.99	0.46	30.34	151.45	0.50	0.15	0.01		
					W19-U	0.68	0.99	0.93	35.57	151.45	0.50	1.00	0.20		
					W20-L	0.68	0.99	0.46	25.67	151.45	0.50	0.15	0.01		
					W20-U	0.68	0.99	0.93	30.34	151.45	0.50	1.00	0.17		
					W21-L	0.68	0.99	0.70	26.84	151.45	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.42	32.68	151.45	0.50	1.00	0.28		
													0.86	2.00	NO
15th	R12		Residential	Bedroom	W22-L	0.68	0.99	1.04	32.62	61.41	0.50	0.15	0.07		
					W22-U	0.68	0.99	2.11	39.05	61.41	0.50	1.00	1.21		
					W23-L	0.68	0.99	1.04	33.04	61.41	0.50	0.15	0.08		
					W23-U	0.68	0.99	2.11	39.98	61.41	0.50	1.00	1.23		
													2.59	1.00	YES
15th	R13		Residential	Bedroom	W24-L	0.68	0.99	1.04	34.06	95.91	0.50	0.15	0.05		
					W24-U	0.68	0.99	2.11	41.85	95.91	0.50	1.00	0.83		
					W25-L	0.68	0.99	1.04	34.63	95.91	0.50	0.15	0.05		
					W25-U	0.68	0.99	2.11	42.88	95.91	0.50	1.00	0.85		
					W26-L	0.68	0.99	0.70	31.68	95.91	0.50	0.15	0.03		
					W26-U	0.68	0.99	1.42	41.42	95.91	0.50	1.00	0.55		
15th	R14		Residential	Bedroom									2.36	1.00	YES
					W27-L	0.68	0.99	0.46	35.07	84.77	0.50	0.15	0.03		
					W27-U	0.68	0.99	0.93	45.72	84.77	0.50	1.00	0.45		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W28-L	0.68	0.99	0.46	36.95	84.77	0.50	0.15	0.03		
					W28-U	0.68	0.99	0.93	47.84	84.77	0.50	1.00	0.47		
					W29-L	0.68	0.99	0.46	33.32	84.77	0.50	0.15	0.02		
					W29-U	0.68	0.99	0.93	43.97	84.77	0.50	1.00	0.44		
15th	R15	Residential	Bedroom										1.44	1.00	YES
					W30-L	0.68	0.99	0.46	37.45	58.77	0.50	0.15	0.04		
					W30-U	0.68	0.99	0.93	50.53	58.77	0.50	1.00	0.72		
					W31-L	0.68	0.99	0.46	38.84	58.77	0.50	0.15	0.04		
					W31-U	0.68	0.99	0.93	52.17	58.77	0.50	1.00	0.75		
					W32-L	0.68	0.99	0.46	35.28	58.77	0.50	0.15	0.04		
					W32-U	0.68	0.99	0.93	48.42	58.77	0.50	1.00	0.69		
15th	R16	Residential	LKD										2.28	1.00	YES
					W33-L	0.68	0.99	1.04	39.81	137.56	0.50	0.15	0.04		
					W33-U	0.68	0.99	2.11	54.31	137.56	0.50	1.00	0.75		
					W34-L	0.68	0.99	1.04	40.18	137.56	0.50	0.15	0.04		
					W34-U	0.68	0.99	2.11	55.17	137.56	0.50	1.00	0.76		
					W35-L	0.68	0.99	0.70	37.30	137.56	0.50	0.15	0.03		
					W35-U	0.68	0.99	1.42	53.23	137.56	0.50	1.00	0.49		
16th	R1	Residential	LKD										2.11	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	35.73	125.20	0.50	1.00	0.82		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	37.90	125.20	0.50	1.00	0.97		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	35.93	125.20	0.50	1.00	0.82		
16th	R2	Residential	Bedroom										3.34	2.00	YES
					W4-L	0.68	0.99	0.70	49.39	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.92	125.20	0.50	1.00	0.45		
					W5-L	0.68	0.99	0.70	46.79	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.27	66.26	0.50	1.00	0.81		
													0.88	1.00	NO
16th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	43.58	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	43.03	66.49	0.50	1.00	0.75		
													0.81	1.00	NO
16th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	42.71	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.75	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.79	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.68	104.32	0.50	1.00	0.93		
16th	R5	Residential	Bedroom										1.51	2.00	NO
					W9-L	0.68	0.99	0.70	35.35	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.76	65.09	0.50	1.00	0.62		
													0.67	1.00	NO
16th	R6	Residential	LKD												
					W10-L	0.68	0.99	0.70	36.01	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.00	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.71	121.62	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W11-U	0.68	0.99	2.52	36.55	121.62	0.50	1.00	0.68	2.00	NO
													1.10		
16th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.44	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.81	56.77	0.50	1.00	0.59		
16th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.74	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.10	56.45	0.50	1.00	0.54		
16th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.56	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.47	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.24	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.05	119.79	0.50	1.00	0.61		
16th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.61	59.49	0.50	0.15	0.04	2.00	NO
					W16-U	0.68	0.99	1.29	24.98	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	48.58	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	48.67	59.49	0.50	1.00	0.49		
17th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	1.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.79	125.20	0.50	1.00	0.99		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.88	125.20	0.50	1.00	0.84		
					W4-L	0.68	0.99	0.70	49.35	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.85	125.20	0.50	1.00	0.45		
17th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.64	66.26	0.50	0.15	0.07	2.00	YES
					W5-U	0.68	0.99	1.29	46.08	66.26	0.50	1.00	0.81		
17th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.40	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	42.83	66.49	0.50	1.00	0.75		
17th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.55	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.56	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.64	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.52	104.32	0.50	1.00	0.92		
17th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	35.23	65.09	0.50	0.15	0.05	2.00	NO
					W9-U	0.68	0.99	1.29	34.64	65.09	0.50	1.00	0.62		
17th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.95	121.62	0.50	0.15	0.03	1.00	NO
					W10-U	0.68	0.99	1.29	34.94	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.67	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.52	121.62	0.50	1.00	0.68		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
17th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.42	56.77	0.50	0.15	1.10	2.00	NO
					W12-U	0.68	0.99	1.29	28.81	56.77	0.50	1.00	0.05		
17th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.81	56.45	0.50	0.15	0.64	1.00	NO
					W13-U	0.68	0.99	1.29	26.18	56.45	0.50	1.00	0.04		
17th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.63	119.79	0.50	0.15	0.58	1.00	NO
					W14-U	0.68	0.99	1.29	29.54	119.79	0.50	1.00	0.02		
17th	R9		Residential	LKD	W15-L	0.68	0.99	1.36	33.32	119.79	0.50	0.15	0.29		
					W15-U	0.68	0.99	2.52	32.13	119.79	0.50	1.00	0.05		
17th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.74	59.49	0.50	0.15	0.97	2.00	NO
					W16-U	0.68	0.99	1.29	25.12	59.49	0.50	1.00	0.04		
17th	R10		Residential	Bedroom	W17-L	0.68	0.99	0.36	49.07	59.49	0.50	0.15	0.49		
					W17-U	0.68	0.99	0.67	49.13	59.49	0.50	1.00	0.04		
18th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	1.07	1.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.07		
18th	R1		Residential	LKD	W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.84		
					W2-U	0.68	0.99	3.57	38.88	125.20	0.50	1.00	0.09		
18th	R1		Residential	LKD	W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	1.00		
					W3-U	0.68	0.99	3.19	36.99	125.20	0.50	1.00	0.07		
18th	R1		Residential	LKD	W4-L	0.68	0.99	0.70	49.28	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	48.79	125.20	0.50	1.00	0.04		
18th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.44	66.26	0.50	0.15	0.45		
					W5-U	0.68	0.99	1.29	45.89	66.26	0.50	1.00	3.40	2.00	YES
18th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.19	66.49	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.29	42.62	66.49	0.50	1.00	0.80	1.00	NO
18th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.36	104.32	0.50	0.15	0.74		
					W7-U	0.68	0.99	1.29	41.39	104.32	0.50	1.00	0.06		
18th	R5		Residential	Bedroom	W8-L	0.68	0.99	1.36	43.49	104.32	0.50	0.15	0.80	1.00	NO
					W8-U	0.68	0.99	2.52	42.39	104.32	0.50	1.00	0.04		
18th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	35.13	65.09	0.50	0.15	1.49	2.00	NO
					W9-U	0.68	0.99	1.29	34.55	65.09	0.50	1.00	0.05		
18th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.91	121.62	0.50	0.15	0.62		
					W10-U	0.68	0.99	1.29	34.89	121.62	0.50	1.00	0.67	1.00	NO
18th	R6		Residential	LKD	W11-L	0.68	0.99	1.36	37.65	121.62	0.50	0.15	0.03		
					W11-U	0.68	0.99	2.52	36.50	121.62	0.50	1.00	0.33		
18th	R6		Residential	LKD	W11-L	0.68	0.99	1.36	37.65	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.50	121.62	0.50	1.00	0.68		
18th	R6		Residential	LKD	W11-L	0.68	0.99	1.36	37.65	121.62	0.50	0.15	1.10	2.00	NO
					W11-U	0.68	0.99	2.52	36.50	121.62	0.50	1.00	0.03		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
18th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.45	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	28.82	56.77	0.50	1.00	0.59		
18th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.88	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.25	56.45	0.50	1.00	0.54		
18th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.69	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	29.61	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.40	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.21	119.79	0.50	1.00	0.61		
18th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.89	59.49	0.50	0.15	0.04	1.00	YES
					W16-U	0.68	0.99	1.29	25.26	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
19th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.95	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.08	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.21	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.72	125.20	0.50	1.00	0.45		
19th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.26	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	45.73	66.26	0.50	1.00	0.80		
19th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.00	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	42.46	66.49	0.50	1.00	0.74		
19th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.20	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	41.24	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.36	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.25	104.32	0.50	1.00	0.92		
19th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	35.02	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	34.43	65.09	0.50	1.00	0.61		
19th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.84	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.82	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.61	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.45	121.62	0.50	1.00	0.68		
19th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.43	56.77	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	28.79	56.77	0.50	1.00	0.59	1.00	NO
													0.64		
19th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.94	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.29	56.45	0.50	1.00	0.54		
													0.59	1.00	NO
													0.02		
19th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.74	119.79	0.50	0.15	0.29	1.00	NO
					W14-U	0.68	0.99	1.29	29.65	119.79	0.50	1.00	0.05		
					W15-L	0.68	0.99	1.36	33.47	119.79	0.50	0.15	0.61	1.00	NO
					W15-U	0.68	0.99	2.52	32.27	119.79	0.50	1.00	0.97		
													0.04	2.00	NO
													0.49		
19th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	25.99	59.49	0.50	0.15	0.04	1.00	YES
					W16-U	0.68	0.99	1.29	25.35	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04	1.00	YES
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
													1.07	1.00	YES
													0.07		
20th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.84	1.00	NO
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.09		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	1.00	1.00	NO
					W2-U	0.68	0.99	3.57	39.02	125.20	0.50	1.00	0.07		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.85	1.00	YES
					W3-U	0.68	0.99	3.19	37.15	125.20	0.50	1.00	0.04		
					W4-L	0.68	0.99	0.70	49.14	125.20	0.50	0.15	0.45	1.00	YES
					W4-U	0.68	0.99	1.29	48.65	125.20	0.50	1.00	3.41		
20th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	46.11	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	45.57	66.26	0.50	1.00	0.80		
													0.86	1.00	NO
													0.06		
20th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	42.88	66.49	0.50	0.15	0.74	1.00	NO
					W6-U	0.68	0.99	1.29	42.34	66.49	0.50	1.00	0.04		
													0.46	1.00	NO
													0.08		
20th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	42.06	104.32	0.50	0.15	0.91	1.00	NO
					W7-U	0.68	0.99	1.29	41.09	104.32	0.50	1.00	1.48		
					W8-L	0.68	0.99	1.36	43.22	104.32	0.50	0.15	0.05	2.00	NO
					W8-U	0.68	0.99	2.52	42.11	104.32	0.50	1.00	0.61		
20th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	34.89	65.09	0.50	0.15	0.66	1.00	NO
					W9-U	0.68	0.99	1.29	34.30	65.09	0.50	1.00	0.03		
													0.33	1.00	NO
													0.06		
20th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	35.76	121.62	0.50	0.15	0.68	1.00	NO
					W10-U	0.68	0.99	1.29	34.74	121.62	0.50	1.00	1.09		
					W11-L	0.68	0.99	1.36	37.56	121.62	0.50	0.15	0.05	2.00	NO
					W11-U	0.68	0.99	2.52	36.40	121.62	0.50	1.00	0.59		
20th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	29.41	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	28.78	56.77	0.50	1.00	0.59		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
20th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	26.97	56.45	0.50	0.15	0.64	1.00	NO
					W13-U	0.68	0.99	1.29	26.32	56.45	0.50	1.00	0.04		
20th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	30.77	119.79	0.50	0.15	0.59	1.00	NO
					W14-U	0.68	0.99	1.29	29.67	119.79	0.50	1.00	0.02		
					W15-L	0.68	0.99	1.36	33.52	119.79	0.50	0.15	0.29		
					W15-U	0.68	0.99	2.52	32.31	119.79	0.50	1.00	0.05		
													0.61		
20th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	26.08	59.49	0.50	0.15	0.97	2.00	NO
					W16-U	0.68	0.99	1.29	25.44	59.49	0.50	1.00	0.04		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.50		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.04		
													0.50		
21st	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	1.08	1.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.07		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.84		
					W2-U	0.68	0.99	3.57	39.06	125.20	0.50	1.00	0.09		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	1.00		
					W3-U	0.68	0.99	3.19	37.20	125.20	0.50	1.00	0.07		
					W4-L	0.68	0.99	0.70	49.08	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	48.58	125.20	0.50	1.00	0.04		
													0.45		
													3.41	2.00	YES
21st	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	45.96	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	45.40	66.26	0.50	1.00	0.80		
21st	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	42.76	66.49	0.50	0.15	0.86	1.00	NO
					W6-U	0.68	0.99	1.29	42.16	66.49	0.50	1.00	0.06		
21st	R4	Residential	LKD		W7-L	0.68	0.99	0.70	41.91	104.32	0.50	0.15	0.74		
					W7-U	0.68	0.99	1.29	40.88	104.32	0.50	1.00	0.80	1.00	NO
					W8-L	0.68	0.99	1.36	43.08	104.32	0.50	0.15	0.04		
					W8-U	0.68	0.99	2.52	41.91	104.32	0.50	1.00	0.45		
													0.08		
21st	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	34.76	65.09	0.50	0.15	0.91	2.00	NO
					W9-U	0.68	0.99	1.29	34.08	65.09	0.50	1.00	0.05		
21st	R6	Residential	LKD		W10-L	0.68	0.99	0.70	35.67	121.62	0.50	0.15	0.66	1.00	NO
					W10-U	0.68	0.99	1.29	34.56	121.62	0.50	1.00	0.61		
					W11-L	0.68	0.99	1.36	37.50	121.62	0.50	0.15	0.03		
					W11-U	0.68	0.99	2.52	36.25	121.62	0.50	1.00	0.33		
													0.06		
21st	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	29.36	56.77	0.50	0.15	0.67	2.00	NO
					W12-U	0.68	0.99	1.29	28.63	56.77	0.50	1.00	1.09		
													0.05		
													0.59		
													0.63	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
21st	R8	Residential	Bedroom	W13-L	W13-L	0.68	0.99	0.70	26.99	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.25	56.45	0.50	1.00	0.54		
21st	R9	Residential	LKD	W14-L	W14-L	0.68	0.99	0.70	30.80	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	29.62	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	33.57	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.29	119.79	0.50	1.00	0.61		
													0.97		
21st	R10	Residential	Bedroom	W16-L	W16-L	0.68	0.99	0.70	26.17	59.49	0.50	0.15	0.04	1.00	YES
					W16-U	0.68	0.99	1.29	25.42	59.49	0.50	1.00	0.50		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
													1.08		
22nd	R1	Residential	LKD	W1-L	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	48.99	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.49	125.20	0.50	1.00	0.45		
													3.41		
22nd	R2	Residential	Bedroom	W5-L	W5-L	0.68	0.99	0.70	45.76	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	45.20	66.26	0.50	1.00	0.79		
22nd	R3	Residential	Bedroom	W6-L	W6-L	0.68	0.99	0.70	42.45	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	41.84	66.49	0.50	1.00	0.73		
22nd	R4	Residential	LKD	W7-L	W7-L	0.68	0.99	0.70	41.58	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	40.54	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.76	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	41.56	104.32	0.50	1.00	0.90		
													1.47		
22nd	R5	Residential	Bedroom	W9-L	W9-L	0.68	0.99	0.70	34.40	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	33.72	65.09	0.50	1.00	0.60		
22nd	R6	Residential	LKD	W10-L	W10-L	0.68	0.99	0.70	35.35	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.22	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.20	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	35.94	121.62	0.50	1.00	0.67		
													1.08		
22nd	R7	Residential	Bedroom	W12-L	W12-L	0.68	0.99	0.70	29.04	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	28.28	56.77	0.50	1.00	0.58		
22nd	R8	Residential	Bedroom	W13-L	W13-L	0.68	0.99	0.70	26.72	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.25	56.45	0.50	1.00	0.54		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
22nd	R9	Residential	LKD		W13-U	0.68	0.99	1.29	25.94	56.45	0.50	1.00	0.53	1.00	NO
					W14-L	0.68	0.99	0.70	30.56	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.34	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.36	119.79	0.50	0.15	0.05		
22nd	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	32.04	119.79	0.50	1.00	0.61	2.00	NO
					W16-L	0.68	0.99	0.70	25.93	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.14	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
23rd	R1	Residential	LKD		W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50	1.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
23rd	R2	Residential	Bedroom		W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	48.92	125.20	0.50	0.15	0.04		
23rd	R3	Residential	Bedroom		W4-U	0.68	0.99	1.29	48.47	125.20	0.50	1.00	0.45	1.00	NO
					W5-L	0.68	0.99	0.70	45.59	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	45.13	66.26	0.50	1.00	0.79		
					W6-L	0.68	0.99	0.70	42.18	66.49	0.50	0.15	0.06		
23rd	R4	Residential	LKD		W6-U	0.68	0.99	1.29	41.69	66.49	0.50	1.00	0.73	1.00	NO
					W7-L	0.68	0.99	0.70	41.29	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	40.37	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.46	104.32	0.50	0.15	0.07		
23rd	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	41.39	104.32	0.50	1.00	0.90	2.00	NO
					W9-L	0.68	0.99	0.70	34.08	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	33.53	65.09	0.50	1.00	0.60		
					W10-L	0.68	0.99	0.70	35.05	121.62	0.50	0.15	0.03		
23rd	R6	Residential	LKD		W10-U	0.68	0.99	1.29	34.05	121.62	0.50	1.00	0.32	2.00	NO
					W11-L	0.68	0.99	1.36	36.92	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	35.77	121.62	0.50	1.00	0.67		
					W12-L	0.68	0.99	0.70	28.72	56.77	0.50	0.15	0.05		
23rd	R7	Residential	Bedroom		W12-U	0.68	0.99	1.29	28.10	56.77	0.50	1.00	0.57	1.00	NO
					W13-L	0.68	0.99	0.70	26.45	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	25.80	56.45	0.50	1.00	0.53		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
23rd	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.33	119.79	0.50	0.15	0.57	1.00	NO
					W14-U	0.68	0.99	1.29	29.23	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.16	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.94	119.79	0.50	1.00	0.60		
													0.96	2.00	NO
23rd	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.70	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.01	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
													1.07	1.00	YES
24th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
													3.41	2.00	YES
24th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	45.69	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	45.29	66.26	0.50	1.00	0.79		
24th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	42.27	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	41.86	66.49	0.50	1.00	0.73		
24th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.39	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	40.55	104.32	0.50	1.00	0.45		
24th	R5		Residential	Bedroom	W8-L	0.68	0.99	1.36	42.56	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	41.57	104.32	0.50	1.00	0.90		
24th	R6		Residential	Bedroom	W9-L	0.68	0.99	0.70	34.20	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	33.72	65.09	0.50	1.00	0.60		
24th	R7		Residential	LKD	W10-L	0.68	0.99	0.70	35.16	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	34.24	121.62	0.50	1.00	0.33		
24th	R8		Residential	Bedroom	W11-L	0.68	0.99	1.36	37.02	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	35.94	121.62	0.50	1.00	0.67		
24th	R9		Residential	LKD	W12-L	0.68	0.99	0.70	28.84	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.29	56.77	0.50	1.00	0.58		
24th	R10		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.56	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	25.97	56.45	0.50	1.00	0.53		
24th	R11		Residential	LKD	W14-L	0.68	0.99	0.70	30.33	119.79	0.50	0.15	0.57	1.00	NO
					W14-U	0.68	0.99	1.29	29.23	119.79	0.50	1.00	0.28		
24th	R12		Residential	Bedroom	W15-L	0.68	0.99	1.36	33.16	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.94	119.79	0.50	1.00	0.60		
24th	R13		Residential	LKD	W16-L	0.68	0.99	0.70	25.70	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.01	59.49	0.50	1.00	0.49		
24th	R14		Residential	Bedroom	W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
24th	R15		Residential	LKD	W18-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W18-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R16		Residential	Bedroom	W19-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W19-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R17		Residential	LKD	W20-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W20-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R18		Residential	Bedroom	W21-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W21-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R19		Residential	LKD	W22-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W22-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R20		Residential	Bedroom	W23-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W23-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R21		Residential	LKD	W24-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W24-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R22		Residential	Bedroom	W25-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W25-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R23		Residential	LKD	W26-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W26-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R24		Residential	Bedroom	W27-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W27-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R25		Residential	LKD	W28-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W28-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R26		Residential	Bedroom	W29-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R27		Residential	LKD	W30-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W30-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R28		Residential	Bedroom	W31-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W31-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R29		Residential	LKD	W32-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W32-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R30		Residential	Bedroom	W33-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W33-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R31		Residential	LKD	W34-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W34-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R32		Residential	Bedroom	W35-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W35-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R33		Residential	LKD	W36-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W36-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R34		Residential	Bedroom	W37-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W37-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R35		Residential	LKD	W38-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W38-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R36		Residential	Bedroom	W39-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W39-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R37		Residential	LKD	W40-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W40-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R38		Residential	Bedroom	W41-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W41-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R39		Residential	LKD	W42-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W42-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R40		Residential	Bedroom	W43-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W43-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R41		Residential	LKD	W44-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W44-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
24th	R42		Residential	Bedroom	W45-L	0.68	0.99	0.70	49.00	125.20	0.50	0.15	0.04		
					W45-U	0.68	0.99	1.29	48.59	125.20	0.50	1.00	0.45		
24th	R43		Residential	LKD	W46-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W46-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
24th	R44		Residential	Bedroom	W47-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W47-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
24th	R45		Residential	LKD	W48-L										

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
24th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.43	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	29.39	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	33.24	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.08	119.79	0.50	1.00	0.61		
													0.97		
24th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.78	59.49	0.50	0.15	0.04	1.00	YES
					W16-U	0.68	0.99	1.29	25.17	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50		
													1.07		
25th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.13	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.72	125.20	0.50	1.00	0.45		
													3.41		
25th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	45.87	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	45.47	66.26	0.50	1.00	0.80		
25th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	42.46	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	42.07	66.49	0.50	1.00	0.73		
25th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.57	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	40.76	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.74	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	41.78	104.32	0.50	1.00	0.91		
													1.47		
25th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	34.40	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	33.96	65.09	0.50	1.00	0.61		
25th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.36	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.45	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.21	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.15	121.62	0.50	1.00	0.67		
													1.08		
25th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.06	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	28.52	56.77	0.50	1.00	0.58		
25th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.76	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.18	56.45	0.50	1.00	0.54		
25th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.62	119.79	0.50	0.15	0.02	1.00	NO
													0.58		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	29.59	119.79	0.50	1.00	0.29	2.00	NO
					W15-L	0.68	0.99	1.36	33.40	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.25	119.79	0.50	1.00	0.61		
													0.97		
25th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.96	59.49	0.50	0.15	0.04	1.00	YES
					W16-U	0.68	0.99	1.29	25.36	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	49.35	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50		
26th	R1		Residential	LKD									1.07	1.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.28	125.20	0.50	0.15	0.04		
26th	R2		Residential	Bedroom	W4-U	0.68	0.99	1.29	48.89	125.20	0.50	1.00	0.45	1.00	YES
													3.42		
					W5-L	0.68	0.99	0.70	46.08	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	45.70	66.26	0.50	1.00	0.80		
26th	R3		Residential	Bedroom									0.87	1.00	NO
					W6-L	0.68	0.99	0.70	42.69	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.32	66.49	0.50	1.00	0.74		
													0.80		
26th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.81	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	41.01	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	42.98	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.04	104.32	0.50	1.00	0.91		
26th	R5		Residential	Bedroom									1.48	1.00	NO
					W9-L	0.68	0.99	0.70	34.65	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.23	65.09	0.50	1.00	0.61		
													0.66		
26th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.59	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.71	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.43	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.39	121.62	0.50	1.00	0.68		
26th	R7		Residential	Bedroom									1.09	1.00	NO
					W12-L	0.68	0.99	0.70	29.31	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.80	56.77	0.50	1.00	0.59		
													0.64		
26th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.98	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	26.43	56.45	0.50	1.00	0.54		
													0.59		
26th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.83	119.79	0.50	0.15	0.02	1.00	NO
					W14-U	0.68	0.99	1.29	29.82	119.79	0.50	1.00	0.29		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W15-L	0.68	0.99	1.36	33.59	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.45	119.79	0.50	1.00	0.61		
26th	R10	Residential	Bedroom										0.98	2.00	NO
					W16-L	0.68	0.99	0.70	26.17	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.58	59.49	0.50	1.00	0.50		
					W17-L	0.68	0.99	0.36	49.36	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.23	59.49	0.50	1.00	0.50		
													1.08	1.00	YES
27th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.46	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.08	125.20	0.50	1.00	0.45		
													3.42	2.00	YES
27th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	46.33	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	45.98	66.26	0.50	1.00	0.81		
27th	R3	Residential	Bedroom										0.87	1.00	NO
					W6-L	0.68	0.99	0.70	42.97	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.62	66.49	0.50	1.00	0.74		
27th	R4	Residential	LKD										0.80	1.00	NO
					W7-L	0.68	0.99	0.70	42.09	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.32	104.32	0.50	1.00	0.46		
27th	R5	Residential	Bedroom		W8-L	0.68	0.99	1.36	43.26	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.34	104.32	0.50	1.00	0.92		
27th	R6	Residential	LKD										1.49	2.00	NO
					W9-L	0.68	0.99	0.70	34.96	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.56	65.09	0.50	1.00	0.62		
27th	R7	Residential	Bedroom										0.67	1.00	NO
					W10-L	0.68	0.99	0.70	35.88	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.02	121.62	0.50	1.00	0.33		
27th	R8	Residential	Bedroom		W11-L	0.68	0.99	1.36	37.70	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.68	121.62	0.50	1.00	0.68		
27th	R9	Residential	LKD										1.10	2.00	NO
					W12-L	0.68	0.99	0.70	29.60	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.11	56.77	0.50	1.00	0.60		
27th	R8	Residential	Bedroom										0.64	1.00	NO
					W13-L	0.68	0.99	0.70	27.25	56.45	0.50	0.15	0.05		
					W13-U	0.68	0.99	1.29	26.72	56.45	0.50	1.00	0.55		
27th	R9	Residential	LKD										0.59	1.00	NO
					W14-L	0.68	0.99	0.70	31.07	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	30.09	119.79	0.50	1.00	0.29		
27th					W15-L	0.68	0.99	1.36	33.81	119.79	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
27th	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	32.69	119.79	0.50	1.00	0.62	2.00	NO
					W16-L	0.68	0.99	0.70	26.40	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	25.84	59.49	0.50	1.00	0.50		
					W17-L	0.68	0.99	0.36	49.37	59.49	0.50	0.15	0.04		
28th	R1	Residential	LKD		W17-U	0.68	0.99	0.67	49.24	59.49	0.50	1.00	0.50	1.00	YES
28th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
28th	R2	Residential	Bedroom		W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07	2.00	YES
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.68	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.31	125.20	0.50	1.00	0.46		
28th	R2	Residential	Bedroom											1.00	NO
					W5-L	0.68	0.99	0.70	46.63	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.30	66.26	0.50	1.00	0.81		
28th	R3	Residential	Bedroom											1.00	NO
					W6-L	0.68	0.99	0.70	43.30	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.98	66.49	0.50	1.00	0.75		
28th	R4	Residential	LKD											2.00	NO
					W7-L	0.68	0.99	0.70	42.43	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.69	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.60	104.32	0.50	0.15	0.08		
28th	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	42.71	104.32	0.50	1.00	0.93	1.00	NO
28th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	35.33	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	34.95	65.09	0.50	1.00	0.62		
28th	R6	Residential	LKD											2.00	NO
					W10-L	0.68	0.99	0.70	36.21	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.38	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	38.00	121.62	0.50	0.15	0.06		
28th	R7	Residential	Bedroom		W11-U	0.68	0.99	2.52	37.02	121.62	0.50	1.00	0.69	1.00	NO
28th	R7	Residential	Bedroom											1.00	NO
					W12-L	0.68	0.99	0.70	29.95	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.50	56.77	0.50	1.00	0.60		
28th	R8	Residential	Bedroom											1.00	NO
					W13-L	0.68	0.99	0.70	27.57	56.45	0.50	0.15	0.05		
					W13-U	0.68	0.99	1.29	27.07	56.45	0.50	1.00	0.56		
28th	R9	Residential	LKD											1.00	NO
					W14-L	0.68	0.99	0.70	31.36	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	30.40	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	34.06	119.79	0.50	0.15	0.05		
28th	R9	Residential	LKD		W15-U	0.68	0.99	2.52	32.96	119.79	0.50	1.00	0.62		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
28th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	26.66	59.49	0.50	0.15	0.99	2.00	NO
					W16-U	0.68	0.99	1.29	26.12	59.49	0.50	1.00	0.04		
					W17-L	0.68	0.99	0.36	49.40	59.49	0.50	0.15	0.51		
					W17-U	0.68	0.99	0.67	49.26	59.49	0.50	1.00	0.04		
													0.50		
29th	R1		Residential	LKD									1.09	1.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.93	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.59	125.20	0.50	1.00	0.46		
													3.42	2.00	YES
29th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	47.00	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.70	66.26	0.50	1.00	0.82		
29th	R3		Residential	Bedroom									0.88	1.00	NO
					W6-L	0.68	0.99	0.70	43.71	66.49	0.50	0.15	0.06		
29th	R3		Residential	Bedroom	W6-U	0.68	0.99	1.29	43.42	66.49	0.50	1.00	0.76		
													0.82	1.00	NO
29th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.84	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.14	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	44.01	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.16	104.32	0.50	1.00	0.94		
													1.52	2.00	NO
29th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	35.75	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	35.42	65.09	0.50	1.00	0.63		
29th	R6		Residential	LKD									0.68	1.00	NO
					W10-L	0.68	0.99	0.70	36.60	121.62	0.50	0.15	0.03		
29th	R6		Residential	LKD	W10-U	0.68	0.99	1.29	35.81	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	38.37	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	37.42	121.62	0.50	1.00	0.70		
													1.12	2.00	NO
29th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	30.35	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.94	56.77	0.50	1.00	0.61		
29th	R8		Residential	Bedroom									0.66	1.00	NO
					W13-L	0.68	0.99	0.70	27.93	56.45	0.50	0.15	0.05		
29th	R8		Residential	Bedroom	W13-U	0.68	0.99	1.29	27.45	56.45	0.50	1.00	0.56		
													0.61	1.00	NO
29th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	31.67	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	30.74	119.79	0.50	1.00	0.30		
					W15-L	0.68	0.99	1.36	34.34	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	33.27	119.79	0.50	1.00	0.63		
													1.00	2.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria	
29th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	26.97	59.49	0.50	0.15	0.04	1.10	1.00	YES
					W16-U	0.68	0.99	1.29	26.46	59.49	0.50	1.00	0.52			
					W17-L	0.68	0.99	0.36	49.46	59.49	0.50	0.15	0.04			
					W17-U	0.68	0.99	0.67	49.32	59.49	0.50	1.00	0.50			
30th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	3.43	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84			
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09			
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00			
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07			
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85			
					W4-L	0.68	0.99	0.70	50.24	125.20	0.50	0.15	0.04			
					W4-U	0.68	0.99	1.29	49.92	125.20	0.50	1.00	0.46			
30th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	47.44	66.26	0.50	0.15	0.07	0.89	1.00	NO
					W5-U	0.68	0.99	1.29	47.17	66.26	0.50	1.00	0.83			
30th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	44.19	66.49	0.50	0.15	0.06	0.83	1.00	NO
					W6-U	0.68	0.99	1.29	43.93	66.49	0.50	1.00	0.77			
30th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	43.33	104.32	0.50	0.15	0.04	1.54	2.00	NO
					W7-U	0.68	0.99	1.29	42.67	104.32	0.50	1.00	0.47			
					W8-L	0.68	0.99	1.36	44.48	104.32	0.50	0.15	0.08			
					W8-U	0.68	0.99	2.52	43.67	104.32	0.50	1.00	0.95			
30th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	36.26	65.09	0.50	0.15	0.05	0.69	1.00	NO
					W9-U	0.68	0.99	1.29	35.95	65.09	0.50	1.00	0.64			
30th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	37.06	121.62	0.50	0.15	0.03	1.14	2.00	NO
					W10-U	0.68	0.99	1.29	36.29	121.62	0.50	1.00	0.35			
					W11-L	0.68	0.99	1.36	38.80	121.62	0.50	0.15	0.06			
					W11-U	0.68	0.99	2.52	37.88	121.62	0.50	1.00	0.70			
30th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	30.82	56.77	0.50	0.15	0.05	0.67	1.00	NO
					W12-U	0.68	0.99	1.29	30.43	56.77	0.50	1.00	0.62			
30th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	28.33	56.45	0.50	0.15	0.05	0.62	1.00	NO
					W13-U	0.68	0.99	1.29	27.88	56.45	0.50	1.00	0.57			
30th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	32.03	119.79	0.50	0.15	0.03	1.01	2.00	NO
					W14-U	0.68	0.99	1.29	31.14	119.79	0.50	1.00	0.30			
					W15-L	0.68	0.99	1.36	34.65	119.79	0.50	0.15	0.05			
					W15-U	0.68	0.99	2.52	33.61	119.79	0.50	1.00	0.64			
30th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	27.33	59.49	0.50	0.15	0.04			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria	
					W16-U	0.68	0.99	1.29	26.82	59.49	0.50	1.00	0.52	1.11	1.00	YES
					W17-L	0.68	0.99	0.36	49.55	59.49	0.50	0.15	0.04			
					W17-U	0.68	0.99	0.67	49.44	59.49	0.50	1.00	0.50			
31st	R1		Residential	LKD	W1-L	0.68	0.99	1.72	40.58	125.20	0.50	0.15	0.08	3.44	2.00	YES
				W1-U	0.68	0.99	3.19	36.63	125.20	0.50	1.00	0.84				
				W2-L	0.68	0.99	1.93	43.53	125.20	0.50	0.15	0.09				
				W2-U	0.68	0.99	3.57	39.14	125.20	0.50	1.00	1.00				
				W3-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08				
				W3-U	0.68	0.99	3.19	37.26	125.20	0.50	1.00	0.85				
				W4-L	0.68	0.99	0.70	50.59	125.20	0.50	0.15	0.04				
				W4-U	0.68	0.99	1.29	50.29	125.20	0.50	1.00	0.47				
31st	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	47.95	66.26	0.50	0.15	0.07	0.90	1.00	NO
				W5-U	0.68	0.99	1.29	47.72	66.26	0.50	1.00	0.84				
												0.06				
31st	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	44.75	66.49	0.50	0.15	0.78	0.84	1.00	NO
				W6-U	0.68	0.99	1.29	44.53	66.49	0.50	1.00	0.06				
												0.08				
31st	R4		Residential	LKD	W7-L	0.68	0.99	0.70	43.89	104.32	0.50	0.15	0.04	1.56	2.00	NO
				W7-U	0.68	0.99	1.29	43.27	104.32	0.50	1.00	0.48				
				W8-L	0.68	0.99	1.36	45.03	104.32	0.50	0.15	0.08				
				W8-U	0.68	0.99	2.52	44.25	104.32	0.50	1.00	0.96				
												0.05				
31st	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	36.83	65.09	0.50	0.15	0.65	0.70	1.00	NO
				W9-U	0.68	0.99	1.29	36.55	65.09	0.50	1.00	0.03				
												0.35				
31st	R6		Residential	LKD	W10-L	0.68	0.99	0.70	37.58	121.62	0.50	0.15	0.06	1.15	2.00	NO
				W10-U	0.68	0.99	1.29	36.85	121.62	0.50	1.00	0.71				
				W11-L	0.68	0.99	1.36	39.28	121.62	0.50	0.15	0.05				
				W11-U	0.68	0.99	2.52	38.39	121.62	0.50	1.00	0.05				
31st	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	31.33	56.77	0.50	0.15	0.63	0.69	1.00	NO
				W12-U	0.68	0.99	1.29	30.97	56.77	0.50	1.00	0.58				
												0.05				
31st	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	28.78	56.45	0.50	0.15	0.58	0.63	1.00	NO
				W13-U	0.68	0.99	1.29	28.35	56.45	0.50	1.00	0.03				
												0.31				
31st	R9		Residential	LKD	W14-L	0.68	0.99	0.70	32.43	119.79	0.50	0.15	0.05	1.03	2.00	NO
				W14-U	0.68	0.99	1.29	31.55	119.79	0.50	1.00	0.64				
				W15-L	0.68	0.99	1.36	35.01	119.79	0.50	0.15	0.05				
				W15-U	0.68	0.99	2.52	33.98	119.79	0.50	1.00	0.04				
												0.53				
31st	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	27.70	59.49	0.50	0.15	0.04	1.00		
				W16-U	0.68	0.99	1.29	27.22	59.49	0.50	1.00	0.53				

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-L	0.68	0.99	0.36	49.76	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.73	59.49	0.50	1.00	0.50		
													1.12	1.00	YES
32nd	R1	Residential	Bedroom	W1-L	0.68	0.99	0.71	63.31	204.87	0.50	0.15	0.03			
				W1-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44			
				W2-L	0.68	0.99	0.71	62.13	204.87	0.50	0.15	0.03			
				W2-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44			
				W3-L	0.68	0.99	1.51	75.82	204.87	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.07	85.41	204.87	0.50	1.00	1.15			
				W4-L	0.68	0.99	1.51	74.26	204.87	0.50	0.15	0.07			
				W4-U	0.68	0.99	3.07	85.60	204.87	0.50	1.00	1.15			
				W5-L	0.68	0.99	0.46	29.41	204.87	0.50	0.15	0.01			
				W5-U	0.68	0.99	0.93	46.11	204.87	0.50	1.00	0.19			
				W6-L	0.68	0.99	0.46	32.69	204.87	0.50	0.15	0.01			
				W6-U	0.68	0.99	0.93	49.86	204.87	0.50	1.00	0.20			
				W7-L	0.68	0.99	0.46	30.35	204.87	0.50	0.15	0.01			
				W7-U	0.68	0.99	0.93	46.92	204.87	0.50	1.00	0.19			
				W8-L	0.68	0.99	0.70	27.83	204.87	0.50	0.15	0.01			
				W8-U	0.68	0.99	1.42	42.74	204.87	0.50	1.00	0.27			
													4.28	1.00	YES
32nd	R2	Residential	Bedroom	W9-L	0.68	0.99	0.70	26.56	83.23	0.50	0.15	0.03			
				W9-U	0.68	0.99	1.42	38.62	83.23	0.50	1.00	0.59			
				W10-L	0.68	0.99	0.46	26.54	83.23	0.50	0.15	0.02			
				W10-U	0.68	0.99	0.93	36.65	83.23	0.50	1.00	0.37			
				W11-L	0.68	0.99	0.46	30.11	83.23	0.50	0.15	0.02			
				W11-U	0.68	0.99	0.93	40.99	83.23	0.50	1.00	0.41			
				W12-L	0.68	0.99	0.46	26.95	83.23	0.50	0.15	0.02			
				W12-U	0.68	0.99	0.93	36.85	83.23	0.50	1.00	0.37			
													1.84	1.00	YES
32nd	R3	Residential	Bedroom	W13-L	0.68	0.99	0.46	25.49	74.19	0.50	0.15	0.02			
				W13-U	0.68	0.99	0.93	33.40	74.19	0.50	1.00	0.38			
				W14-L	0.68	0.99	0.46	29.17	74.19	0.50	0.15	0.02			
				W14-U	0.68	0.99	0.93	38.03	74.19	0.50	1.00	0.43			
				W15-L	0.68	0.99	0.46	25.47	74.19	0.50	0.15	0.02			
				W15-U	0.68	0.99	0.93	33.02	74.19	0.50	1.00	0.37			
													1.25	1.00	YES
32nd	R4	Residential	Bedroom	W16-L	0.68	0.99	1.04	29.01	134.08	0.50	0.15	0.03			
				W16-U	0.68	0.99	2.11	36.95	134.08	0.50	1.00	0.52			
				W17-L	0.68	0.99	1.04	28.84	134.08	0.50	0.15	0.03			
				W17-U	0.68	0.99	2.11	36.42	134.08	0.50	1.00	0.52			
				W18-L	0.68	0.99	0.70	24.04	134.08	0.50	0.15	0.02			
				W18-U	0.68	0.99	1.42	31.13	134.08	0.50	1.00	0.30			
													1.41	1.00	YES
32nd	R5	Residential	Bedroom	W19-L	0.68	0.99	0.46	24.17	63.41	0.50	0.15	0.02			
				W19-U	0.68	0.99	0.93	30.07	63.41	0.50	1.00	0.40			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	0.46	28.10	63.41	0.50	0.15	0.03		
					W20-U	0.68	0.99	0.93	35.36	63.41	0.50	1.00	0.47		
					W21-L	0.68	0.99	0.46	24.35	63.41	0.50	0.15	0.02		
					W21-U	0.68	0.99	0.93	30.06	63.41	0.50	1.00	0.40		
													1.34	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Mirror Massing
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
Oxygen Towers															
00 GF	R1	Residential	Lobby	W1	0.68	0.99	3.12	30.17	729.43	0.50	1.00	0.12	3.36	-1.00	NO
				W2	0.68	0.99	0.91	27.59	729.43	0.50	1.00	0.03			
				W3	0.68	0.99	4.22	26.83	729.43	0.50	1.00	0.14			
				W4	0.68	0.99	4.22	26.86	729.43	0.50	1.00	0.14			
				W5	0.68	0.99	4.22	27.11	729.43	0.50	1.00	0.14			
				W6	0.68	0.99	4.22	27.53	729.43	0.50	1.00	0.14			
				W7	0.68	0.99	4.22	28.04	729.43	0.50	1.00	0.15			
				W8	0.68	0.99	4.22	28.60	729.43	0.50	1.00	0.15			
				W9	0.68	0.99	4.22	29.20	729.43	0.50	1.00	0.15			
				W10	0.68	0.99	4.22	29.88	729.43	0.50	1.00	0.16			
				W11	0.68	0.99	4.22	30.65	729.43	0.50	1.00	0.16			
				W12	0.68	0.99	4.22	31.59	729.43	0.50	1.00	0.16			
				W13	0.68	0.99	4.22	32.42	729.43	0.50	1.00	0.17			
				W14	0.68	0.99	4.22	33.43	729.43	0.50	1.00	0.17			
				W15	0.68	0.99	4.22	34.35	729.43	0.50	1.00	0.18			
				W16	0.68	0.99	4.22	35.10	729.43	0.50	1.00	0.18			
				W17	0.68	0.99	4.22	34.69	729.43	0.50	1.00	0.18			
				W18	0.68	0.99	4.29	26.75	729.43	0.50	1.00	0.14			
				W19-L	0.68	0.99	0.41	30.07	729.43	0.50	0.15	0.00			
				W19-U	0.68	0.99	1.39	16.12	729.43	0.50	1.00	0.03			
				W20-L	0.68	0.99	0.90	31.87	729.43	0.50	0.15	0.01			
				W20-U	0.68	0.99	1.46	26.82	729.43	0.50	1.00	0.05			
				W21-L	0.68	0.99	0.90	34.91	729.43	0.50	0.15	0.01			
				W21-U	0.68	0.99	1.46	31.76	729.43	0.50	1.00	0.06			
				W22-L	0.68	0.99	0.43	30.15	729.43	0.50	0.15	0.00			
				W22-U	0.68	0.99	1.46	35.80	729.43	0.50	1.00	0.06			
				W23	0.68	0.99	3.17	9.41	729.43	0.50	1.00	0.04			
				W24	0.68	0.99	4.31	41.50	729.43	0.50	1.00	0.22			
				W25	0.68	0.99	1.40	43.10	729.43	0.50	1.00	0.07			
				W26	0.68	0.99	3.12	42.02	729.43	0.50	1.00	0.16			
00 GF	R2	Residential	Office	W27-L	0.68	0.99	0.92	47.59	173.50	0.50	0.15	0.03	1.10	-1.00	NO
				W27-U	0.68	0.99	2.43	40.76	173.50	0.50	1.00	0.51			
				W28-L	0.68	0.99	0.87	50.99	173.50	0.50	0.15	0.03			
				W28-U	0.68	0.99	2.30	43.35	173.50	0.50	1.00	0.52			
01st	R1	Residential	Bedroom	W1-L	0.68	0.99	0.63	32.03	79.58	0.50	0.15	0.03	0.48	1.00	NO
				W1-U	0.68	0.99	1.28	31.12	79.58	0.50	1.00	0.45			
01st	R2	Residential	Bedroom	W2-L	0.68	0.99	0.63	27.03	66.30	0.50	0.15	0.03	0.49	1.00	NO
				W2-U	0.68	0.99	1.28	26.10	66.30	0.50	1.00	0.45			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
01st	R3	Residential	LKD	W3-L	0.68	0.99	0.75	29.69	149.08	0.50	0.15	0.02	0.83	2.00	NO
				W3-U	0.68	0.99	1.51	27.32	149.08	0.50	1.00	0.25			
				W4-L	0.68	0.99	0.75	32.73	149.08	0.50	0.15	0.02			
				W4-U	0.68	0.99	1.51	30.49	149.08	0.50	1.00	0.28			
				W5	0.68	0.99	1.76	24.29	149.08	0.50	1.00	0.26			
01st	R4	Residential	Bedroom	W6-L	0.68	0.99	0.64	41.19	61.38	0.50	0.15	0.06	0.83	1.00	NO
				W6-U	0.68	0.99	1.27	41.26	61.38	0.50	1.00	0.77			
01st	R5	Residential	LKD	W7-L	0.68	0.99	0.75	49.15	110.38	0.50	0.15	0.05	1.22	2.00	NO
				W7-U	0.68	0.99	1.50	48.31	110.38	0.50	1.00	0.59			
				W8-L	0.68	0.99	0.75	44.91	110.38	0.50	0.15	0.04			
				W8-U	0.68	0.99	1.50	44.63	110.38	0.50	1.00	0.55			
01st	R6	Residential	Bedroom	W9-L	0.68	0.99	0.64	44.61	63.77	0.50	0.15	0.06	0.86	1.00	NO
				W9-U	0.68	0.99	1.27	44.87	63.77	0.50	1.00	0.80			
01st	R7	Residential	LKD	W10-L	0.68	0.99	0.75	52.80	120.57	0.50	0.15	0.04	1.21	2.00	NO
				W10-U	0.68	0.99	1.50	51.92	120.57	0.50	1.00	0.58			
				W11-L	0.68	0.99	0.75	48.47	120.57	0.50	0.15	0.04			
				W11-U	0.68	0.99	1.50	48.15	120.57	0.50	1.00	0.54			
01st	R8	Residential	Bedroom	W12-L	0.68	0.99	0.64	47.71	63.77	0.50	0.15	0.06	0.93	1.00	NO
				W12-U	0.68	0.99	1.27	48.06	63.77	0.50	1.00	0.86			
01st	R9	Residential	LKD	W13-L	0.68	0.99	0.75	55.93	120.31	0.50	0.15	0.05	1.29	2.00	NO
				W13-U	0.68	0.99	1.50	55.13	120.31	0.50	1.00	0.62			
				W14-L	0.68	0.99	0.75	51.72	120.31	0.50	0.15	0.04			
				W14-U	0.68	0.99	1.50	51.38	120.31	0.50	1.00	0.58			
01st	R10	Residential	Bedroom	W15-L	0.68	0.99	0.64	51.41	63.92	0.50	0.15	0.07	0.99	1.00	NO
				W15-U	0.68	0.99	1.27	51.73	63.92	0.50	1.00	0.92			
01st	R11	Residential	LKD	W16-L	0.68	0.99	0.75	59.77	121.43	0.50	0.15	0.05	1.37	2.00	NO
				W16-U	0.68	0.99	1.50	58.93	121.43	0.50	1.00	0.66			
				W17-L	0.68	0.99	0.75	55.68	121.43	0.50	0.15	0.05			
				W17-U	0.68	0.99	1.50	55.26	121.43	0.50	1.00	0.61			
01st	R12	Residential	Bedroom	W18-L	0.68	0.99	0.75	61.03	64.74	0.50	0.15	0.10	2.62	1.00	YES
				W18-U	0.68	0.99	1.50	60.15	64.74	0.50	1.00	1.26			
				W19-L	0.68	0.99	0.75	56.96	64.74	0.50	0.15	0.09			
				W19-U	0.68	0.99	1.50	56.39	64.74	0.50	1.00	1.18			
01st	R13	Residential	Bedroom	W20-L	0.68	0.99	0.64	54.93	64.85	0.50	0.15	0.07			
				W20-U	0.68	0.99	1.27	54.92	64.85	0.50	1.00	0.97			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R1		Residential	Bedroom	W1-L	0.68	0.99	0.64	32.26	77.13	0.50	0.15	1.04	1.00	YES
					W1-U	0.68	0.99	1.22	31.28	77.13	0.50	1.00	0.04		
02nd	R2		Residential	LKD	W2-L	0.68	0.99	0.75	33.74	114.20	0.50	0.15	0.48	1.00	NO
					W2-U	0.68	0.99	1.44	31.65	114.20	0.50	1.00	0.03		
					W3-L	0.68	0.99	0.75	36.46	114.20	0.50	0.15	0.36		
					W3-U	0.68	0.99	1.44	34.46	114.20	0.50	1.00	0.03		
													0.39		
02nd	R3		Residential	Bedroom	W4-L	0.68	0.99	0.64	24.26	61.36	0.50	0.15	0.81	2.00	NO
					W4-U	0.68	0.99	1.22	23.28	61.36	0.50	1.00	0.03		
02nd	R4		Residential	LKD	W5-L	0.68	0.99	0.75	27.91	116.39	0.50	0.15	0.45	1.00	NO
					W5-U	0.68	0.99	1.44	25.56	116.39	0.50	1.00	0.02		
					W6-L	0.68	0.99	0.75	30.87	116.39	0.50	0.15	0.28		
					W6-U	0.68	0.99	1.44	28.64	116.39	0.50	1.00	0.03		
													0.32		
02nd	R5		Residential	Bedroom	W7-L	0.68	0.99	0.64	15.45	61.51	0.50	0.15	0.65	2.00	NO
					W7-U	0.68	0.99	1.22	13.94	61.51	0.50	1.00	0.02		
02nd	R6		Residential	LKD	W8-L	0.68	0.99	0.75	22.43	117.52	0.50	0.15	0.27	1.00	NO
					W8-U	0.68	0.99	1.44	19.63	117.52	0.50	1.00	0.02		
					W9-L	0.68	0.99	0.75	25.70	117.52	0.50	0.15	0.22		
					W9-U	0.68	0.99	1.44	23.18	117.52	0.50	1.00	0.02		
													0.25		
02nd	R7		Residential	LKD	W10-L	0.68	0.99	0.75	20.37	115.75	0.50	0.15	0.51	2.00	NO
					W10-U	0.68	0.99	1.44	17.26	115.75	0.50	1.00	0.02		
					W11-L	0.68	0.99	0.75	23.51	115.75	0.50	0.15	0.19		
					W11-U	0.68	0.99	1.44	20.81	115.75	0.50	1.00	0.02		
													0.23		
02nd	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	10.80	62.85	0.50	0.15	0.46	2.00	NO
					W12-U	0.68	0.99	1.22	8.50	62.85	0.50	1.00	0.01		
02nd	R9		Residential	LKD									0.15		
					W13-L	0.68	0.99	0.93	32.39	126.59	0.50	0.15	0.16	1.00	NO
					W13-U	0.68	0.99	1.77	32.52	126.59	0.50	1.00	0.03		
					W14-L	0.68	0.99	1.60	28.09	126.59	0.50	0.15	0.41		
					W14-U	0.68	0.99	3.05	24.45	126.59	0.50	1.00	0.05		
					W15-L	0.68	0.99	0.64	12.92	126.59	0.50	0.15	0.53		
					W15-U	0.68	0.99	1.22	10.30	126.59	0.50	1.00	0.01		
02nd	R10		Residential	Bedroom									0.09		
													1.12	2.00	NO
					W16-L	0.68	0.99	0.64	13.29	65.12	0.50	0.15	0.02		
02nd	R11		Residential	Bedroom	W16-U	0.68	0.99	1.22	10.62	65.12	0.50	1.00	0.18		
					W17-L	0.68	0.99	0.64	15.30	79.27	0.50	0.15	0.20	1.00	NO
					W17-U	0.68	0.99	1.22	12.83	79.27	0.50	1.00	0.02		

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R12		Residential	Bedroom	W18-L	0.68	0.99	0.64	19.76	77.41	0.50	0.15	0.02	1.00	NO
					W18-U	0.68	0.99	1.22	17.71	77.41	0.50	1.00	0.25		
02nd	R13		Residential	LKD	W19-L	0.68	0.99	0.64	22.06	124.30	0.50	0.15	0.02	1.00	NO
					W19-U	0.68	0.99	1.22	20.23	124.30	0.50	1.00	0.18		
					W20-L	0.68	0.99	0.64	24.29	124.30	0.50	0.15	0.02		
					W20-U	0.68	0.99	1.22	22.61	124.30	0.50	1.00	0.20		
													0.41		
02nd	R14		Residential	Bedroom	W21-L	0.68	0.99	0.64	26.72	64.00	0.50	0.15	0.04	1.00	NO
					W21-U	0.68	0.99	1.22	25.22	64.00	0.50	1.00	0.43		
02nd	R15		Residential	Bedroom									0.03	1.00	NO
													0.41		
													0.45		
02nd	R16		Residential	Bedroom	W23-L	0.68	0.99	0.64	34.06	65.31	0.50	0.15	0.04	1.00	NO
					W23-U	0.68	0.99	1.22	33.11	65.31	0.50	1.00	0.55		
													0.60		
02nd	R17		Residential	LKD	W24-L	0.68	0.99	1.70	47.59	125.64	0.50	0.15	0.09	2.00	NO
					W24-U	0.68	0.99	3.24	45.43	125.64	0.50	1.00	1.05		
					W25-L	0.68	0.99	0.93	46.80	125.64	0.50	0.15	0.05		
					W25-U	0.68	0.99	1.77	46.39	125.64	0.50	1.00	0.59		
													1.77		
02nd	R18		Residential	Bedroom	W26-L	0.68	0.99	0.64	45.63	61.31	0.50	0.15	0.06	1.00	NO
					W26-U	0.68	0.99	1.22	45.14	61.31	0.50	1.00	0.80		
													0.87		
02nd	R19		Residential	LKD	W27-L	0.68	0.99	0.75	53.95	110.38	0.50	0.15	0.05	2.00	NO
					W27-U	0.68	0.99	1.44	52.56	110.38	0.50	1.00	0.62		
					W28-L	0.68	0.99	0.75	49.69	110.38	0.50	0.15	0.05		
					W28-U	0.68	0.99	1.44	48.74	110.38	0.50	1.00	0.57		
													1.28		
02nd	R20		Residential	Bedroom	W29-L	0.68	0.99	0.64	49.31	63.77	0.50	0.15	0.07	1.00	NO
					W29-U	0.68	0.99	1.22	49.01	63.77	0.50	1.00	0.84		
													0.91		
02nd	R21		Residential	LKD	W30-L	0.68	0.99	0.75	57.71	120.31	0.50	0.15	0.05	2.00	NO
					W30-U	0.68	0.99	1.44	56.52	120.31	0.50	1.00	0.61		
					W31-L	0.68	0.99	0.75	53.43	120.31	0.50	0.15	0.05		
					W31-U	0.68	0.99	1.44	52.73	120.31	0.50	1.00	0.57		
													1.27		
02nd	R22		Residential	Bedroom	W32-L	0.68	0.99	0.64	52.75	63.77	0.50	0.15	0.07	1.00	NO
					W32-U	0.68	0.99	1.22	52.74	63.77	0.50	1.00	0.90		
													0.97		
02nd	R23		Residential	LKD	W33-L	0.68	0.99	0.75	61.28	120.84	0.50	0.15	0.05	1.00	NO
					W33-U	0.68	0.99	1.44	59.96	120.84	0.50	1.00	0.64		
					W34-L	0.68	0.99	0.75	57.00	120.84	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W34-U	0.68	0.99	1.44	56.02	120.84	0.50	1.00	0.60		
													1.34	2.00	NO
02nd	R24		Residential	Bedroom	W35-L	0.68	0.99	0.64	56.25	63.77	0.50	0.15	0.08		
					W35-U	0.68	0.99	1.22	55.66	63.77	0.50	1.00	0.95		
													1.03	1.00	YES
02nd	R25		Residential	LKD	W36-L	0.68	0.99	0.75	64.59	133.29	0.50	0.15	0.05		
					W36-U	0.68	0.99	1.44	62.80	133.29	0.50	1.00	0.61		
					W37-L	0.68	0.99	0.75	60.36	133.29	0.50	0.15	0.05		
					W37-U	0.68	0.99	1.44	58.94	133.29	0.50	1.00	0.57		
													1.28	2.00	NO
03rd	R1		Residential	LKD	W1-L	0.68	0.99	1.27	28.04	109.18	0.50	0.15	0.04		
					W1-U	0.68	0.99	3.88	22.95	109.18	0.50	1.00	0.73		
					W2-L	0.68	0.99	1.27	27.51	109.18	0.50	0.15	0.04		
					W2-U	0.68	0.99	3.88	22.90	109.18	0.50	1.00	0.73		
					W3-L	0.68	0.99	1.27	23.58	109.18	0.50	0.15	0.04		
					W3-U	0.68	0.99	3.88	21.62	109.18	0.50	1.00	0.69		
					W4-L	0.68	0.99	0.97	15.39	109.18	0.50	0.15	0.02		
					W4-U	0.68	0.99	2.96	19.84	109.18	0.50	1.00	0.48		
					W5-L	0.68	0.99	0.15	2.01	109.18	0.50	0.15	0.00		
					W5-U	0.68	0.99	0.45	7.67	109.18	0.50	1.00	0.03		
					W6-L	0.68	0.99	0.14	5.95	109.18	0.50	0.15	0.00		
					W6-U	0.68	0.99	0.45	6.03	109.18	0.50	1.00	0.02		
					W7-L	0.68	0.99	0.95	23.55	109.18	0.50	0.15	0.03		
					W7-U	0.68	0.99	2.96	38.71	109.18	0.50	1.00	0.94		
					W8-L	0.68	0.99	1.24	34.24	109.18	0.50	0.15	0.05		
					W8-U	0.68	0.99	3.88	38.46	109.18	0.50	1.00	1.23		
					W9-L	0.68	0.99	0.70	34.43	109.18	0.50	0.15	0.03		
					W9-U	0.68	0.99	2.20	37.25	109.18	0.50	1.00	0.67		
													5.78	2.00	YES
03rd	R2		Residential	Bedroom	W10-L	0.68	0.99	0.70	20.69	48.94	0.50	0.15	0.04		
					W10-U	0.68	0.99	2.20	20.68	48.94	0.50	1.00	0.84		
					W11-L	0.68	0.99	1.24	32.76	48.94	0.50	0.15	0.11		
					W11-U	0.68	0.99	3.88	33.59	48.94	0.50	1.00	2.39		
													3.38	1.00	YES
03rd	R3		Residential	Bedroom	W12-L	0.68	0.99	1.24	31.78	56.34	0.50	0.15	0.09		
					W12-U	0.68	0.99	3.88	32.21	56.34	0.50	1.00	1.99		
					W13-L	0.68	0.99	0.70	29.10	56.34	0.50	0.15	0.05		
					W13-U	0.68	0.99	2.20	30.76	56.34	0.50	1.00	1.08		
													3.21	1.00	YES
03rd	R4		Residential	Bedroom	W14-L	0.68	0.99	0.70	12.19	61.36	0.50	0.15	0.02		
					W14-U	0.68	0.99	2.20	8.02	61.36	0.50	1.00	0.26		
					W15-L	0.68	0.99	1.24	28.17	61.36	0.50	0.15	0.08		
					W15-U	0.68	0.99	3.88	27.29	61.36	0.50	1.00	1.55		
													1.90	1.00	YES
03rd	R5		Residential	LKD	W16-L	0.68	0.99	1.24	27.32	142.83	0.50	0.15	0.03		

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	3.88	25.70	142.83	0.50	1.00	0.63		
					W17-L	0.68	0.99	0.70	23.94	142.83	0.50	0.15	0.02		
					W17-U	0.68	0.99	2.20	24.28	142.83	0.50	1.00	0.34		
					W18-L	0.68	0.99	0.70	13.34	142.83	0.50	0.15	0.01		
					W18-U	0.68	0.99	2.20	7.58	142.83	0.50	1.00	0.10		
					W19-L	0.68	0.99	1.24	24.63	142.83	0.50	0.15	0.03		
					W19-U	0.68	0.99	3.88	21.86	142.83	0.50	1.00	0.53		
												1.69	2.00	NO	
03rd	R6	Residential	LKD	W20-L	0.68	0.99	1.24	23.99	137.66	0.50	0.15	0.03			
				W20-U	0.68	0.99	3.88	20.41	137.66	0.50	1.00	0.52			
				W21-L	0.68	0.99	0.70	19.67	137.66	0.50	0.15	0.01			
				W21-U	0.68	0.99	2.19	18.89	137.66	0.50	1.00	0.27			
				W22-L	0.68	0.99	0.70	15.85	137.66	0.50	0.15	0.01			
				W22-U	0.68	0.99	2.20	9.55	137.66	0.50	1.00	0.14			
				W23-L	0.68	0.99	1.24	22.61	137.66	0.50	0.15	0.03			
W23-U	0.68	0.99	3.88	18.21	137.66	0.50	1.00	0.46							
												1.47	2.00	NO	
03rd	R7	Residential	Bedroom	W24-L	0.68	0.99	1.24	22.37	67.96	0.50	0.15	0.06			
				W24-U	0.68	0.99	3.88	17.71	67.96	0.50	1.00	0.91			
				W25-L	0.68	0.99	0.70	17.09	67.96	0.50	0.15	0.02			
				W25-U	0.68	0.99	2.20	14.59	67.96	0.50	1.00	0.42			
												1.41	1.00	YES	
03rd	R8	Residential	Bedroom	W26-L	0.68	0.99	0.98	22.18	68.57	0.50	0.15	0.04			
				W26-U	0.68	0.99	3.16	16.43	68.57	0.50	1.00	0.68			
				W27-L	0.68	0.99	1.21	24.51	68.57	0.50	0.15	0.06			
				W27-U	0.68	0.99	3.90	19.28	68.57	0.50	1.00	0.99			
												1.77	1.00	YES	
03rd	R9	Residential	LKD	W28-L	0.68	0.99	1.21	26.93	142.17	0.50	0.15	0.03			
				W28-U	0.68	0.99	3.90	21.61	142.17	0.50	1.00	0.53			
				W29-L	0.68	0.99	1.21	26.95	142.17	0.50	0.15	0.03			
				W29-U	0.68	0.99	3.90	21.97	142.17	0.50	1.00	0.54			
				W30-L	0.68	0.99	1.21	23.93	142.17	0.50	0.15	0.03			
				W30-U	0.68	0.99	3.90	19.24	142.17	0.50	1.00	0.47			
				W31-L	0.68	0.99	0.45	10.19	142.17	0.50	0.15	0.00			
W31-U	0.68	0.99	1.46	0.94	142.17	0.50	1.00	0.01							
												1.65	2.00	NO	
03rd	R10	Residential	LKD	W32-L	0.68	0.99	0.54	25.32	138.93	0.50	0.15	0.01			
				W32-U	0.68	0.99	1.70	21.52	138.93	0.50	1.00	0.24			
				W33-L	0.68	0.99	1.24	27.78	138.93	0.50	0.15	0.03			
				W33-U	0.68	0.99	3.88	23.95	138.93	0.50	1.00	0.60			
				W34-L	0.68	0.99	1.24	30.36	138.93	0.50	0.15	0.04			
				W34-U	0.68	0.99	3.88	26.63	138.93	0.50	1.00	0.67			
				W35-L	0.68	0.99	1.24	31.41	138.93	0.50	0.15	0.04			
W35-U	0.68	0.99	3.88	27.81	138.93	0.50	1.00	0.70							
												2.32	2.00	YES	

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R11		Residential	Bedroom	W36-L	0.68	0.99	1.24	29.98	62.59	0.50	0.15	0.08	1.00	YES
					W36-U	0.68	0.99	3.88	27.58	62.59	0.50	1.00	1.53		
					W37-L	0.68	0.99	0.58	13.82	62.59	0.50	0.15	0.02		
					W37-U	0.68	0.99	1.83	7.97	62.59	0.50	1.00	0.21		
													1.84		
03rd	R12		Residential	Bedroom	W38-L	0.68	0.99	0.78	33.18	65.95	0.50	0.15	0.05	1.00	YES
					W38-U	0.68	0.99	2.44	31.61	65.95	0.50	1.00	1.05		
					W39-L	0.68	0.99	1.24	34.85	65.95	0.50	0.15	0.09		
					W39-U	0.68	0.99	3.88	33.33	65.95	0.50	1.00	1.76		
													2.95		
03rd	R13		Residential	LKD	W40-L	0.68	0.99	1.24	37.65	141.83	0.50	0.15	0.04	2.00	YES
					W40-U	0.68	0.99	3.88	36.64	141.83	0.50	1.00	0.90		
					W41-L	0.68	0.99	1.24	38.59	141.83	0.50	0.15	0.05		
					W41-U	0.68	0.99	3.88	38.24	141.83	0.50	1.00	0.94		
					W42-L	0.68	0.99	1.24	37.65	141.83	0.50	0.15	0.04		
					W42-U	0.68	0.99	3.88	38.06	141.83	0.50	1.00	0.93		
					W43-L	0.68	0.99	0.70	26.89	141.83	0.50	0.15	0.02		
					W43-U	0.68	0.99	2.20	27.56	141.83	0.50	1.00	0.38		
													3.31		
03rd	R14		Residential	Bedroom	W44-L	0.68	0.99	0.72	43.78	46.04	0.50	0.15	0.09	1.00	YES
					W44-U	0.68	0.99	2.26	45.52	46.04	0.50	1.00	2.01		
					W45-L	0.68	0.99	1.24	45.54	46.04	0.50	0.15	0.17		
					W45-U	0.68	0.99	3.88	46.64	46.04	0.50	1.00	3.53		
													5.80		
03rd	R15		Residential	LKD	W46-L	0.68	0.99	1.24	45.10	89.76	0.50	0.15	0.08	2.00	YES
					W46-U	0.68	0.99	3.88	47.15	89.76	0.50	1.00	1.83		
					W47-L	0.68	0.99	0.72	36.27	89.76	0.50	0.15	0.04		
					W47-U	0.68	0.99	2.26	37.91	89.76	0.50	1.00	0.86		
													2.81		
03rd	R16		Residential	Bedroom	W48-L	0.68	0.99	0.72	46.48	59.61	0.50	0.15	0.08	1.00	YES
					W48-U	0.68	0.99	2.26	49.31	59.61	0.50	1.00	1.68		
					W49-L	0.68	0.99	1.24	48.41	59.61	0.50	0.15	0.14		
					W49-U	0.68	0.99	3.88	50.22	59.61	0.50	1.00	2.93		
													4.83		
03rd	R17		Residential	LKD	W50-L	0.68	0.99	1.24	47.61	83.41	0.50	0.15	0.10	2.00	YES
					W50-U	0.68	0.99	3.88	50.06	83.41	0.50	1.00	2.09		
					W51-L	0.68	0.99	0.72	39.08	83.41	0.50	0.15	0.05		
					W51-U	0.68	0.99	2.26	41.30	83.41	0.50	1.00	1.01		
													3.24		
03rd	R18		Residential	Bedroom	W52-L	0.68	0.99	0.72	48.58	59.27	0.50	0.15	0.08	1.00	YES
					W52-U	0.68	0.99	2.26	52.46	59.27	0.50	1.00	1.80		
					W53-L	0.68	0.99	1.24	50.85	59.27	0.50	0.15	0.14		
					W53-U	0.68	0.99	3.88	53.50	59.27	0.50	1.00	3.14		
													5.17		
03rd	R19		Residential	Bedroom	W54-L	0.68	0.99	1.24	49.83	50.06	0.50	0.15	0.17		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R20	Residential	LKD	W54-U	0.68	0.99	3.88	53.02	50.06	0.50	1.00	3.69			
				W55-L	0.68	0.99	0.72	41.44	50.06	0.50	0.15	0.08			
				W55-U	0.68	0.99	2.26	44.06	50.06	0.50	1.00	1.79			
													5.72	1.00	YES
				W56-L	0.68	0.99	0.70	48.91	103.83	0.50	0.15	0.04			
				W56-U	0.68	0.99	2.20	52.98	103.83	0.50	1.00	1.01			
				W57-L	0.68	0.99	1.24	52.64	103.83	0.50	0.15	0.08			
				W57-U	0.68	0.99	3.88	55.60	103.83	0.50	1.00	1.86			
				W58-L	0.68	0.99	0.75	52.64	103.83	0.50	0.15	0.05			
				W58-U	0.68	0.99	2.34	55.92	103.83	0.50	1.00	1.13			
				W59-L	0.68	0.99	0.14	13.20	103.83	0.50	0.15	0.00			
				W59-U	0.68	0.99	0.45	11.30	103.83	0.50	1.00	0.04			
				W60-L	0.68	0.99	0.17	22.67	103.83	0.50	0.15	0.00			
				W60-U	0.68	0.99	0.51	21.77	103.83	0.50	1.00	0.10			
				W61-L	0.68	0.99	0.97	32.79	103.83	0.50	0.15	0.04			
				W61-U	0.68	0.99	2.96	30.43	103.83	0.50	1.00	0.78			
				W62-L	0.68	0.99	1.27	27.94	103.83	0.50	0.15	0.05			
				W62-U	0.68	0.99	3.88	24.45	103.83	0.50	1.00	0.82			
04th	R1	Residential	LKD	W63-L	0.68	0.99	1.27	25.20	103.83	0.50	0.15	0.04			
				W63-U	0.68	0.99	3.87	22.07	103.83	0.50	1.00	0.74			
				W64-L	0.68	0.99	1.27	25.42	103.83	0.50	0.15	0.04			
				W64-U	0.68	0.99	3.88	22.83	103.83	0.50	1.00	0.77			
													7.61	2.00	YES
				W1-L	0.68	0.99	1.72	33.33	125.20	0.50	0.15	0.06			
				W1-U	0.68	0.99	3.19	25.97	125.20	0.50	1.00	0.59			
				W2-L	0.68	0.99	1.93	35.92	125.20	0.50	0.15	0.07			
				W2-U	0.68	0.99	3.57	26.47	125.20	0.50	1.00	0.68			
				W3-L	0.68	0.99	1.72	32.95	125.20	0.50	0.15	0.06			
				W3-U	0.68	0.99	3.19	22.96	125.20	0.50	1.00	0.53			
				W4-L	0.68	0.99	0.70	46.82	125.20	0.50	0.15	0.04			
				W4-U	0.68	0.99	1.29	46.46	125.20	0.50	1.00	0.43			
													2.46	2.00	YES
				W5-L	0.68	0.99	0.70	43.96	66.26	0.50	0.15	0.06			
				W5-U	0.68	0.99	1.29	43.58	66.26	0.50	1.00	0.76			
													0.83	1.00	NO
04th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	41.31	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	40.92	66.49	0.50	1.00	0.71			
													0.77	1.00	NO
				W7-L	0.68	0.99	0.70	40.87	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	40.08	104.32	0.50	1.00	0.45			
				W8-L	0.68	0.99	1.36	42.11	104.32	0.50	0.15	0.07			
				W8-U	0.68	0.99	2.52	41.17	104.32	0.50	1.00	0.89			
													1.45	2.00	NO
				W9-L	0.68	0.99	0.70	34.62	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	34.20	65.09	0.50	1.00	0.61			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.01	121.62	0.50	0.15	0.66	1.00	NO
					W10-U	0.68	0.99	1.29	34.18	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.05	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.09	121.62	0.50	1.00	0.67		
													1.08	2.00	NO
04th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.13	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.71	56.77	0.50	1.00	0.59		
													0.64	1.00	NO
04th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.42	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	26.04	56.45	0.50	1.00	0.54		
													0.58	1.00	NO
04th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.28	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	29.44	119.79	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.36	32.92	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.98	119.79	0.50	1.00	0.60		
													0.96	2.00	NO
04th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	25.23	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.90	59.49	0.50	1.00	0.49		
					W17-L	0.68	0.99	0.36	33.02	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	32.99	59.49	0.50	1.00	0.33		
													0.89	1.00	NO
04th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	31.40	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.32	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	30.69	116.88	0.50	0.15	0.02		
					W19-U	0.68	0.99	1.29	30.00	116.88	0.50	1.00	0.30		
					W20-L	0.68	0.99	1.36	33.90	116.88	0.50	0.15	0.05		
					W20-U	0.68	0.99	2.52	33.09	116.88	0.50	1.00	0.64		
04th	R12		Residential	Bedroom									1.19	2.00	NO
					W21-L	0.68	0.99	0.70	27.46	55.29	0.50	0.15	0.05		
					W21-U	0.68	0.99	1.29	27.27	55.29	0.50	1.00	0.57		
04th	R13		Residential	Bedroom									0.62	1.00	NO
					W22-L	0.68	0.99	0.70	29.66	69.09	0.50	0.15	0.04		
					W22-U	0.68	0.99	1.29	29.49	69.09	0.50	1.00	0.50		
04th	R14		Residential	Bedroom									0.54	1.00	NO
					W23-L	0.68	0.99	0.70	30.85	67.42	0.50	0.15	0.04		
					W23-U	0.68	0.99	1.29	30.69	67.42	0.50	1.00	0.53		
04th	R15		Residential	LKD									0.57	1.00	NO
					W24-L	0.68	0.99	0.70	37.19	116.39	0.50	0.15	0.03		
					W24-U	0.68	0.99	1.29	36.63	116.39	0.50	1.00	0.37		
					W25-L	0.68	0.99	1.36	40.09	116.39	0.50	0.15	0.06		
					W25-U	0.68	0.99	2.52	39.40	116.39	0.50	1.00	0.77		
04th	R16		Residential	Bedroom									1.22	2.00	NO
					W26-L	0.68	0.99	0.70	36.50	55.28	0.50	0.15	0.06		
					W26-U	0.68	0.99	1.29	36.38	55.28	0.50	1.00	0.76		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	66.82	56.67	0.50	0.15	0.11	1.00	YES
					W44-U	0.68	0.99	1.29	66.74	56.67	0.50	1.00	1.37		
04th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	41.47	151.85	0.50	0.15	0.06	2.00	YES
					W45-U	0.68	0.99	3.18	31.22	151.85	0.50	1.00	0.59		
					W46-L	0.68	0.99	1.93	44.42	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	34.14	151.85	0.50	1.00	0.72		
					W47-L	0.68	0.99	1.72	39.70	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	29.83	151.85	0.50	1.00	0.56		
05th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	34.00	125.20	0.50	0.15	0.06	2.00	YES
					W1-U	0.68	0.99	3.19	26.47	125.20	0.50	1.00	0.61		
					W2-L	0.68	0.99	1.93	36.71	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	27.12	125.20	0.50	1.00	0.69		
					W3-L	0.68	0.99	1.72	33.84	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	23.79	125.20	0.50	1.00	0.54		
					W4-L	0.68	0.99	0.70	47.09	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	46.74	125.20	0.50	1.00	0.43		
												2.52	2.00		
05th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	44.22	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	43.86	66.26	0.50	1.00	0.77		
												0.83	1.00		
05th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	41.57	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	41.19	66.49	0.50	1.00	0.72		
												0.78	1.00		
05th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.19	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	40.42	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.44	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	41.53	104.32	0.50	1.00	0.90		
												1.46	2.00		
05th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	34.95	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	34.56	65.09	0.50	1.00	0.62		
												0.67	1.00		
05th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	35.44	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.65	121.62	0.50	1.00	0.33		
					W11-L	0.68	0.99	1.36	37.51	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.59	121.62	0.50	1.00	0.68		
												1.10	2.00		
05th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	29.65	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	29.29	56.77	0.50	1.00	0.60		
												0.65	1.00		
05th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	27.12	56.45	0.50	0.15	0.05	1.00	NO
					W13-U	0.68	0.99	1.29	26.80	56.45	0.50	1.00	0.55		
												0.60	1.00		
05th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	30.98	119.79	0.50	0.15	0.02		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	30.20	119.79	0.50	1.00	0.29	2.00	NO
					W15-L	0.68	0.99	1.36	33.62	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	32.74	119.79	0.50	1.00	0.62		
05th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	26.12	59.49	0.50	0.15	0.04	1.00	NO
					W16-U	0.68	0.99	1.29	25.86	59.49	0.50	1.00	0.50		
					W17-L	0.68	0.99	0.36	33.26	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	33.20	59.49	0.50	1.00	0.34		
													0.91		
05th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	31.49	116.88	0.50	0.15	0.01	2.00	NO
					W18-U	0.68	0.99	0.67	31.40	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	31.72	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	31.13	116.88	0.50	1.00	0.31		
					W20-L	0.68	0.99	1.36	34.89	116.88	0.50	0.15	0.05		
					W20-U	0.68	0.99	2.52	34.17	116.88	0.50	1.00	0.66		
05th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	28.61	55.29	0.50	0.15	0.05	1.00	NO
					W21-U	0.68	0.99	1.29	28.51	55.29	0.50	1.00	0.60		
													0.65		
05th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	30.79	69.09	0.50	0.15	0.04	1.00	NO
					W22-U	0.68	0.99	1.29	30.71	69.09	0.50	1.00	0.52		
													0.56		
05th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	31.95	67.42	0.50	0.15	0.04	1.00	NO
					W23-U	0.68	0.99	1.29	31.88	67.42	0.50	1.00	0.55		
													0.59		
05th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	38.21	116.39	0.50	0.15	0.03	2.00	NO
					W24-U	0.68	0.99	1.29	37.73	116.39	0.50	1.00	0.38		
					W25-L	0.68	0.99	1.36	41.10	116.39	0.50	0.15	0.06		
					W25-U	0.68	0.99	2.52	40.48	116.39	0.50	1.00	0.79		
													1.26		
05th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	37.55	55.28	0.50	0.15	0.06	1.00	NO
					W26-U	0.68	0.99	1.29	37.50	55.28	0.50	1.00	0.79		
													0.85		
05th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	42.52	69.08	0.50	0.15	0.06	1.00	NO
					W27-U	0.68	0.99	1.29	42.46	69.08	0.50	1.00	0.71		
													0.77		
05th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	45.26	55.32	0.50	0.15	0.08	1.00	YES
					W28-U	0.68	0.99	1.29	45.21	55.32	0.50	1.00	0.95		
													1.03		
05th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	50.33	117.45	0.50	0.15	0.04		
					W29-U	0.68	0.99	1.29	49.90	117.45	0.50	1.00	0.49		
					W30-L	0.68	0.99	1.36	52.41	117.45	0.50	0.15	0.08		
					W30-U	0.68	0.99	2.52	51.84	117.45	0.50	1.00	1.00		
					W31-L	0.68	0.99	0.36	36.10	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	36.08	117.45	0.50	1.00	0.18		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
05th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	22.48	58.24	0.50	0.15	1.81	2.00	NO
					W32-U	0.68	0.99	0.67	22.34	58.24	0.50	1.00	0.02		
					W33-L	0.68	0.99	0.70	56.06	58.24	0.50	0.15	0.23		
					W33-U	0.68	0.99	1.29	56.02	58.24	0.50	1.00	0.09		
05th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	60.89	117.07	0.50	0.15	1.46	1.00	YES
					W34-U	0.68	0.99	1.29	60.46	117.07	0.50	1.00	0.05		
					W35-L	0.68	0.99	1.36	62.23	117.07	0.50	0.15	0.60		
					W35-U	0.68	0.99	2.52	61.65	117.07	0.50	1.00	0.10		
05th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	59.77	59.45	0.50	0.15	1.19	2.00	NO
					W36-U	0.68	0.99	1.29	59.72	59.45	0.50	1.00	0.09		
					W37-L	0.68	0.99	0.70	60.70	59.45	0.50	0.15	1.17		
					W37-U	0.68	0.99	1.29	60.66	59.45	0.50	1.00	0.10		
05th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	62.51	57.18	0.50	0.15	2.54	1.00	YES
					W38-U	0.68	0.99	1.29	62.46	57.18	0.50	1.00	1.18		
													1.27		
													1.37	1.00	YES
05th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	66.69	119.55	0.50	0.15	0.05		
					W39-U	0.68	0.99	1.29	66.23	119.55	0.50	1.00	0.64		
					W40-L	0.68	0.99	1.36	67.70	119.55	0.50	0.15	0.10		
					W40-U	0.68	0.99	2.52	67.08	119.55	0.50	1.00	1.27		
05th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	64.91	69.12	0.50	0.15	2.07	2.00	YES
					W41-U	0.68	0.99	1.29	64.84	69.12	0.50	1.00	0.09		
					W42-L	0.68	0.99	0.70	65.64	69.12	0.50	0.15	1.09		
					W42-U	0.68	0.99	1.29	65.56	69.12	0.50	1.00	0.09		
05th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	66.94	66.25	0.50	0.15	2.37	1.00	YES
					W43-U	0.68	0.99	1.29	66.85	66.25	0.50	1.00	1.10		
													1.17		
													1.27	1.00	YES
05th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	67.79	56.67	0.50	0.15	0.11		
					W44-U	0.68	0.99	1.29	67.69	56.67	0.50	1.00	1.39		
													1.50	1.00	YES
05th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	32.75	151.85	0.50	1.00	0.62		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	35.67	151.85	0.50	1.00	0.75		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	31.58	151.85	0.50	1.00	0.60		
06th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	34.69	125.20	0.50	0.15	2.17	2.00	YES
					W1-U	0.68	0.99	3.19	26.87	125.20	0.50	1.00	0.06		
					W2-L	0.68	0.99	1.93	37.50	125.20	0.50	0.15	0.61		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W2-U	0.68	0.99	3.57	27.70	125.20	0.50	1.00	0.71		
					W3-L	0.68	0.99	1.72	34.71	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	24.52	125.20	0.50	1.00	0.56		
					W4-L	0.68	0.99	0.70	47.37	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	47.02	125.20	0.50	1.00	0.44		
06th	R2		Residential	Bedroom									2.56	2.00	YES
					W5-L	0.68	0.99	0.70	44.49	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	44.14	66.26	0.50	1.00	0.77		
06th	R3		Residential	Bedroom									0.84	1.00	NO
					W6-L	0.68	0.99	0.70	41.85	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	41.48	66.49	0.50	1.00	0.72		
06th	R4		Residential	LKD									0.78	1.00	NO
					W7-L	0.68	0.99	0.70	41.54	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	40.78	104.32	0.50	1.00	0.45		
06th	R5		Residential	Bedroom									0.08		
					W8-L	0.68	0.99	1.36	42.80	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	41.90	104.32	0.50	1.00	0.91		
06th	R6		Residential	LKD									1.48	2.00	NO
					W9-L	0.68	0.99	0.70	35.31	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	34.95	65.09	0.50	1.00	0.62		
06th	R7		Residential	Bedroom									0.67	1.00	NO
					W10-L	0.68	0.99	0.70	35.92	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.16	121.62	0.50	1.00	0.34		
06th	R8		Residential	Bedroom									0.06		
					W11-L	0.68	0.99	1.36	38.02	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	37.11	121.62	0.50	1.00	0.69		
06th	R9		Residential	LKD									1.11	2.00	NO
					W12-L	0.68	0.99	0.70	30.26	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.93	56.77	0.50	1.00	0.61		
06th	R10		Residential	Bedroom									0.66	1.00	NO
					W13-L	0.68	0.99	0.70	27.92	56.45	0.50	0.15	0.05		
					W13-U	0.68	0.99	1.29	27.65	56.45	0.50	1.00	0.57		
06th	R11		Residential	LKD									0.61	1.00	NO
					W14-L	0.68	0.99	0.70	31.76	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	31.06	119.79	0.50	1.00	0.30		
06th	R12		Residential	Bedroom									0.05		
					W15-L	0.68	0.99	1.36	34.40	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	33.57	119.79	0.50	1.00	0.63		
06th	R13		Residential	Bedroom									1.01	2.00	NO
					W16-L	0.68	0.99	0.70	27.13	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	26.95	59.49	0.50	1.00	0.53		
06th	R14		Residential	LKD									0.03		
					W17-L	0.68	0.99	0.36	33.48	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	33.44	59.49	0.50	1.00	0.34		
06th	R15		Residential	Bedroom									0.93	1.00	NO
					W18-L	0.68	0.99	0.36	31.54	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.44	116.88	0.50	1.00	0.16		
06th	R16		Residential	LKD									0.03		
					W19-L	0.68	0.99	0.70	32.89	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	32.40	116.88	0.50	1.00	0.32		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	1.36	36.02	116.88	0.50	0.15	0.06		
					W20-U	0.68	0.99	2.52	35.39	116.88	0.50	1.00	0.69		
06th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	29.90	55.29	0.50	0.15	0.05	1.26	2.00
					W21-U	0.68	0.99	1.29	29.91	55.29	0.50	1.00	0.63		
06th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	32.05	69.09	0.50	0.15	0.04	0.68	1.00
					W22-U	0.68	0.99	1.29	32.08	69.09	0.50	1.00	0.54		
06th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	33.19	67.42	0.50	0.15	0.05	0.58	1.00
					W23-U	0.68	0.99	1.29	33.22	67.42	0.50	1.00	0.57		
06th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	39.37	116.39	0.50	0.15	0.03	1.30	2.00
					W24-U	0.68	0.99	1.29	38.98	116.39	0.50	1.00	0.39		
					W25-L	0.68	0.99	1.36	42.23	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	41.70	116.39	0.50	1.00	0.81		
06th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	38.72	55.28	0.50	0.15	0.07	0.88	1.00
					W26-U	0.68	0.99	1.29	38.75	55.28	0.50	1.00	0.81		
06th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	43.59	69.08	0.50	0.15	0.06	0.79	1.00
					W27-U	0.68	0.99	1.29	43.61	69.08	0.50	1.00	0.73		
06th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	46.30	55.32	0.50	0.15	0.08	1.05	1.00
					W28-U	0.68	0.99	1.29	46.30	55.32	0.50	1.00	0.97		
06th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	51.35	117.45	0.50	0.15	0.04	1.85	2.00
					W29-U	0.68	0.99	1.29	50.96	117.45	0.50	1.00	0.50		
					W30-L	0.68	0.99	1.36	53.44	117.45	0.50	0.15	0.08		
					W30-U	0.68	0.99	2.52	52.91	117.45	0.50	1.00	1.02		
					W31-L	0.68	0.99	0.36	36.45	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	36.55	117.45	0.50	1.00	0.19		
06th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	22.68	58.24	0.50	0.15	0.02	1.48	1.00
					W32-U	0.68	0.99	0.67	22.56	58.24	0.50	1.00	0.23		
					W33-L	0.68	0.99	0.70	57.07	58.24	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.29	57.05	58.24	0.50	1.00	1.14		
06th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	61.92	117.07	0.50	0.15	0.05	1.97	2.00
					W34-U	0.68	0.99	1.29	61.51	117.07	0.50	1.00	0.61		
					W35-L	0.68	0.99	1.36	63.31	117.07	0.50	0.15	0.10		
					W35-U	0.68	0.99	2.52	62.74	117.07	0.50	1.00	1.21		
06th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	60.78	59.45	0.50	0.15	0.10		
					W36-U	0.68	0.99	1.29	60.75	59.45	0.50	1.00	1.19		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W37-L	0.68	0.99	0.70	61.72	59.45	0.50	0.15	0.10		
					W37-U	0.68	0.99	1.29	61.68	59.45	0.50	1.00	1.20		
06th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	63.52	57.18	0.50	0.15	0.10	2.58	1.00
					W38-U	0.68	0.99	1.29	63.48	57.18	0.50	1.00	1.29		
														1.00	YES
06th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	67.73	119.55	0.50	0.15	0.05	1.39	1.00
					W39-U	0.68	0.99	1.29	67.27	119.55	0.50	1.00	0.65		
					W40-L	0.68	0.99	1.36	68.77	119.55	0.50	0.15	0.11	2.10	2.00
					W40-U	0.68	0.99	2.52	68.15	119.55	0.50	1.00	1.29		
														1.00	YES
06th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	65.89	69.12	0.50	0.15	0.09	2.40	1.00
					W41-U	0.68	0.99	1.29	65.83	69.12	0.50	1.00	1.11		
					W42-L	0.68	0.99	0.70	66.61	69.12	0.50	0.15	0.09	1.28	1.00
					W42-U	0.68	0.99	1.29	66.54	69.12	0.50	1.00	1.12		
06th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	67.90	66.25	0.50	0.15	0.10	1.28	1.00
					W43-U	0.68	0.99	1.29	67.81	66.25	0.50	1.00	1.19		
														1.00	YES
06th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	68.74	56.67	0.50	0.15	0.11	1.52	1.00
					W44-U	0.68	0.99	1.29	68.64	56.67	0.50	1.00	1.41		
														1.00	YES
06th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06	2.24	2.00
					W45-U	0.68	0.99	3.18	33.97	151.85	0.50	1.00	0.64		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08	2.61	2.00
					W46-U	0.68	0.99	3.57	36.83	151.85	0.50	1.00	0.78		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06	0.84	1.00
					W47-U	0.68	0.99	3.20	32.88	151.85	0.50	1.00	0.62		
														1.00	YES
07th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	35.45	125.20	0.50	0.15	0.07	2.61	2.00
					W1-U	0.68	0.99	3.19	27.23	125.20	0.50	1.00	0.62		
					W2-L	0.68	0.99	1.93	38.36	125.20	0.50	0.15	0.08	0.84	1.00
					W2-U	0.68	0.99	3.57	28.28	125.20	0.50	1.00	0.72		
					W3-L	0.68	0.99	1.72	35.63	125.20	0.50	0.15	0.07	0.79	1.00
					W3-U	0.68	0.99	3.19	25.25	125.20	0.50	1.00	0.58		
					W4-L	0.68	0.99	0.70	47.65	125.20	0.50	0.15	0.04	0.79	1.00
					W4-U	0.68	0.99	1.29	47.31	125.20	0.50	1.00	0.44		
														1.00	NO
07th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	44.78	66.26	0.50	0.15	0.06	0.84	1.00
					W5-U	0.68	0.99	1.29	44.43	66.26	0.50	1.00	0.78		
														1.00	NO
07th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	42.14	66.49	0.50	0.15	0.06	0.79	1.00
					W6-U	0.68	0.99	1.29	41.78	66.49	0.50	1.00	0.73		
														1.00	NO
07th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.91	104.32	0.50	0.15	0.04		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W7-U	0.68	0.99	1.29	41.17	104.32	0.50	1.00	0.46	2.00	NO
					W8-L	0.68	0.99	1.36	43.18	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.30	104.32	0.50	1.00	0.92		
07th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	35.72	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	35.37	65.09	0.50	1.00	0.63		
													0.68		
07th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	36.45	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	35.71	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	38.56	121.62	0.50	0.15	0.06		
07th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	30.92	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	30.63	56.77	0.50	1.00	0.63		
													0.68		
07th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	28.82	56.45	0.50	0.15	0.05	1.00	NO
					W13-U	0.68	0.99	1.29	28.60	56.45	0.50	1.00	0.59		
													0.64		
07th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	32.64	119.79	0.50	0.15	0.03	2.00	NO
					W14-U	0.68	0.99	1.29	32.00	119.79	0.50	1.00	0.31		
					W15-L	0.68	0.99	1.36	35.28	119.79	0.50	0.15	0.05		
07th	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	34.51	119.79	0.50	1.00	0.65	1.00	NO
													1.04		
					W16-L	0.68	0.99	0.70	28.28	59.49	0.50	0.15	0.04		
07th	R11	Residential	LKD		W16-U	0.68	0.99	1.29	28.18	59.49	0.50	1.00	0.55	1.00	NO
					W17-L	0.68	0.99	0.36	33.73	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	33.69	59.49	0.50	1.00	0.34		
07th	R12	Residential	Bedroom										0.96	1.00	NO
					W18-L	0.68	0.99	0.36	31.58	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.48	116.88	0.50	1.00	0.16		
07th	R13	Residential	Bedroom		W19-L	0.68	0.99	0.70	34.24	116.88	0.50	0.15	0.03	1.00	NO
					W19-U	0.68	0.99	1.29	33.86	116.88	0.50	1.00	0.34		
					W20-L	0.68	0.99	1.36	37.33	116.88	0.50	0.15	0.06		
07th	R14	Residential	Bedroom		W20-U	0.68	0.99	2.52	36.81	116.88	0.50	1.00	0.71	1.00	NO
													1.31		
					W21-L	0.68	0.99	0.70	31.40	55.29	0.50	0.15	0.05		
07th	R15	Residential	LKD		W21-U	0.68	0.99	1.29	31.51	55.29	0.50	1.00	0.66	1.00	NO
													0.71		
					W22-L	0.68	0.99	0.70	33.52	69.09	0.50	0.15	0.05		
07th	R16	Residential	Bedroom		W22-U	0.68	0.99	1.29	33.65	69.09	0.50	1.00	0.57	1.00	NO
													0.61		
					W23-L	0.68	0.99	0.70	34.64	67.42	0.50	0.15	0.05		
07th	R17	Residential	LKD		W23-U	0.68	0.99	1.29	34.78	67.42	0.50	1.00	0.60	1.00	NO
													0.65		
					W24-L	0.68	0.99	0.70	40.71	116.39	0.50	0.15	0.03		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W24-U	0.68	0.99	1.29	40.43	116.39	0.50	1.00	0.40	2.00	NO
					W25-L	0.68	0.99	1.36	43.54	116.39	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.52	43.11	116.39	0.50	1.00	0.84		
07th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	40.06	55.28	0.50	0.15	0.07	1.00	NO
					W26-U	0.68	0.99	1.29	40.18	55.28	0.50	1.00	0.84		
													0.91		
07th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	44.82	69.08	0.50	0.15	0.06	1.00	NO
					W27-U	0.68	0.99	1.29	44.91	69.08	0.50	1.00	0.75		
													0.82		
07th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	47.47	55.32	0.50	0.15	0.08	1.00	YES
					W28-U	0.68	0.99	1.29	47.54	55.32	0.50	1.00	1.00		
													1.08		
07th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	52.48	117.45	0.50	0.15	0.04	2.00	NO
					W29-U	0.68	0.99	1.29	52.15	117.45	0.50	1.00	0.52		
					W30-L	0.68	0.99	1.36	54.58	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	54.10	117.45	0.50	1.00	1.04		
					W31-L	0.68	0.99	0.36	37.17	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	37.55	117.45	0.50	1.00	0.19		
07th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	22.95	58.24	0.50	0.15	0.02	1.00	YES
					W32-U	0.68	0.99	0.67	22.81	58.24	0.50	1.00	0.24		
					W33-L	0.68	0.99	0.70	58.15	58.24	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.29	58.16	58.24	0.50	1.00	1.16		
													1.51		
07th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	63.02	117.07	0.50	0.15	0.05	2.00	YES
					W34-U	0.68	0.99	1.29	62.63	117.07	0.50	1.00	0.62		
					W35-L	0.68	0.99	1.36	64.43	117.07	0.50	0.15	0.10		
					W35-U	0.68	0.99	2.52	63.89	117.07	0.50	1.00	1.24		
													2.01		
07th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	61.84	59.45	0.50	0.15	0.10	1.00	YES
					W36-U	0.68	0.99	1.29	61.83	59.45	0.50	1.00	1.21		
					W37-L	0.68	0.99	0.70	62.77	59.45	0.50	0.15	0.10		
					W37-U	0.68	0.99	1.29	62.75	59.45	0.50	1.00	1.22		
													2.63		
07th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	64.57	57.18	0.50	0.15	0.11	1.00	YES
					W38-U	0.68	0.99	1.29	64.52	57.18	0.50	1.00	1.31		
													1.42		
07th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	68.80	119.55	0.50	0.15	0.05	2.00	YES
					W39-U	0.68	0.99	1.29	68.34	119.55	0.50	1.00	0.66		
					W40-L	0.68	0.99	1.36	69.87	119.55	0.50	0.15	0.11		
					W40-U	0.68	0.99	2.52	69.24	119.55	0.50	1.00	1.31		
													2.14		
07th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	66.90	69.12	0.50	0.15	0.09	1.00	
					W41-U	0.68	0.99	1.29	66.83	69.12	0.50	1.00	1.12		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W42-L	0.68	0.99	0.70	67.61	69.12	0.50	0.15	0.09		
					W42-U	0.68	0.99	1.29	67.52	69.12	0.50	1.00	1.13		
07th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	68.86	66.25	0.50	0.15	0.10	2.44	1.00
					W43-U	0.68	0.99	1.29	68.76	66.25	0.50	1.00	1.20		
07th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	69.68	56.67	0.50	0.15	0.12	1.30	1.00
					W44-U	0.68	0.99	1.29	69.56	56.67	0.50	1.00	1.42		
07th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06	1.54	1.00
					W45-U	0.68	0.99	3.18	35.02	151.85	0.50	1.00	0.66		
					W46-L	0.68	0.99	1.93	44.99	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	37.82	151.85	0.50	1.00	0.80		
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	33.96	151.85	0.50	1.00	0.64		
														2.30	2.00
															YES
08th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	36.28	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	27.56	125.20	0.50	1.00	0.63		
					W2-L	0.68	0.99	1.93	39.28	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	28.87	125.20	0.50	1.00	0.74		
					W3-L	0.68	0.99	1.72	36.61	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	25.98	125.20	0.50	1.00	0.59		
					W4-L	0.68	0.99	0.70	47.95	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	47.61	125.20	0.50	1.00	0.44		
														2.66	2.00
															YES
08th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	45.09	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	44.74	66.26	0.50	1.00	0.78		
														0.85	1.00
															NO
08th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	42.46	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.11	66.49	0.50	1.00	0.73		
														0.79	1.00
															NO
08th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	42.31	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	41.58	104.32	0.50	1.00	0.46		
					W8-L	0.68	0.99	1.36	43.59	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	42.72	104.32	0.50	1.00	0.93		
														1.50	2.00
															NO
08th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	36.18	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	35.84	65.09	0.50	1.00	0.64		
														0.69	1.00
															NO
08th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	37.03	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	36.31	121.62	0.50	1.00	0.35		
					W11-L	0.68	0.99	1.36	39.17	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	38.32	121.62	0.50	1.00	0.71		
														1.15	2.00
															NO
08th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	31.66	56.77	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	31.40	56.77	0.50	1.00	0.64	1.00	NO
													0.69		
08th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	29.82	56.45	0.50	0.15	0.05	1.00	NO
					W13-U	0.68	0.99	1.29	29.66	56.45	0.50	1.00	0.61		
													0.66	1.00	NO
													0.03		
08th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	33.62	119.79	0.50	0.15	0.32	1.00	NO
					W14-U	0.68	0.99	1.29	33.04	119.79	0.50	1.00	0.06		
					W15-L	0.68	0.99	1.36	36.28	119.79	0.50	0.15	0.67	1.00	NO
					W15-U	0.68	0.99	2.52	35.57	119.79	0.50	1.00	1.07		
08th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	29.59	59.49	0.50	0.15	0.05	1.00	NO
					W16-U	0.68	0.99	1.29	29.56	59.49	0.50	1.00	0.58		
					W17-L	0.68	0.99	0.36	33.99	59.49	0.50	0.15	0.03	1.00	NO
					W17-U	0.68	0.99	0.67	33.97	59.49	0.50	1.00	0.34		
													0.99	1.00	NO
													0.01		
08th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	31.63	116.88	0.50	0.15	0.16	1.00	NO
					W18-U	0.68	0.99	0.67	31.53	116.88	0.50	1.00	0.03		
					W19-L	0.68	0.99	0.70	35.80	116.88	0.50	0.15	0.35	1.00	NO
					W19-U	0.68	0.99	1.29	35.55	116.88	0.50	1.00	0.06		
					W20-L	0.68	0.99	1.36	38.85	116.88	0.50	0.15	0.74	1.00	NO
					W20-U	0.68	0.99	2.52	38.46	116.88	0.50	1.00	1.36		
08th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	33.12	55.29	0.50	0.15	0.06	1.00	NO
					W21-U	0.68	0.99	1.29	33.36	55.29	0.50	1.00	0.70		
													0.76	1.00	NO
													0.05		
08th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	35.23	69.09	0.50	0.15	0.60	1.00	NO
					W22-U	0.68	0.99	1.29	35.49	69.09	0.50	1.00	0.64		
													0.05	1.00	NO
													0.63		
08th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	36.33	67.42	0.50	0.15	0.68	1.00	NO
					W23-U	0.68	0.99	1.29	36.60	67.42	0.50	1.00	0.03		
													0.42	1.00	NO
													0.07		
08th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	42.29	116.39	0.50	0.15	0.87	1.00	NO
					W24-U	0.68	0.99	1.29	42.14	116.39	0.50	1.00	1.40		
					W25-L	0.68	0.99	1.36	45.08	116.39	0.50	0.15	0.07	1.00	NO
					W25-U	0.68	0.99	2.52	44.77	116.39	0.50	1.00	0.87		
08th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	41.63	55.28	0.50	0.15	0.07	1.00	NO
					W26-U	0.68	0.99	1.29	41.87	55.28	0.50	1.00	0.88		
													0.95	1.00	NO
													0.06		
08th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	46.23	69.08	0.50	0.15	0.78	1.00	NO
					W27-U	0.68	0.99	1.29	46.41	69.08	0.50	1.00	0.84		
													0.08	1.00	YES
													1.03		
08th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	48.81	55.32	0.50	0.15	1.11	1.00	YES
					W28-U	0.68	0.99	1.29	48.97	55.32	0.50	1.00	1.11		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria			
08th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	53.77	117.45	0.50	0.15	0.04	2.00	NO			
					W29-U	0.68	0.99	1.29	53.52	117.45	0.50	1.00	0.53					
					W30-L	0.68	0.99	1.36	55.86	117.45	0.50	0.15	0.09					
					W30-U	0.68	0.99	2.52	55.47	117.45	0.50	1.00	1.07					
					W31-L	0.68	0.99	0.36	38.83	117.45	0.50	0.15	0.02					
					W31-U	0.68	0.99	0.67	39.96	117.45	0.50	1.00	0.20					
08th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	23.23	58.24	0.50	0.15	0.02	1.00	YES			
					W32-U	0.68	0.99	0.67	23.13	58.24	0.50	1.00	0.24					
					W33-L	0.68	0.99	0.70	59.31	58.24	0.50	0.15	0.10					
					W33-U	0.68	0.99	1.29	59.37	58.24	0.50	1.00	1.18					
08th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	64.18	117.07	0.50	0.15	0.05	2.00	YES			
					W34-U	0.68	0.99	1.29	63.84	117.07	0.50	1.00	0.63					
					W35-L	0.68	0.99	1.36	65.63	117.07	0.50	0.15	0.10					
					W35-U	0.68	0.99	2.52	65.12	117.07	0.50	1.00	1.26					
08th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	62.96	59.45	0.50	0.15	0.10	1.00	YES			
					W36-U	0.68	0.99	1.29	62.98	59.45	0.50	1.00	1.23					
					W37-L	0.68	0.99	0.70	63.87	59.45	0.50	0.15	0.10					
					W37-U	0.68	0.99	1.29	63.88	59.45	0.50	1.00	1.25					
08th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	65.62	57.18	0.50	0.15	0.11	1.00	YES			
					W38-U	0.68	0.99	1.29	65.60	57.18	0.50	1.00	1.33					
08th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	69.88	119.55	0.50	0.15	0.05	2.00	YES			
					W39-U	0.68	0.99	1.29	69.43	119.55	0.50	1.00	0.67					
					W40-L	0.68	0.99	1.36	70.97	119.55	0.50	0.15	0.11					
					W40-U	0.68	0.99	2.52	70.35	119.55	0.50	1.00	1.33					
08th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	67.89	69.12	0.50	0.15	0.09	1.00	YES			
					W41-U	0.68	0.99	1.29	67.82	69.12	0.50	1.00	1.14					
					W42-L	0.68	0.99	0.70	68.58	69.12	0.50	0.15	0.09					
					W42-U	0.68	0.99	1.29	68.49	69.12	0.50	1.00	1.15					
08th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	69.80	66.25	0.50	0.15	0.10	1.00	YES			
					W43-U	0.68	0.99	1.29	69.68	66.25	0.50	1.00	1.22					
08th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	70.58	56.67	0.50	0.15	0.12	1.00	YES			
					W44-U	0.68	0.99	1.29	70.45	56.67	0.50	1.00	1.44					
08th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	42.05	151.85	0.50	0.15	0.06	1.00				
					W45-U	0.68	0.99	3.18	35.95	151.85	0.50	1.00	0.68					
					W46-L	0.68	0.99	1.93	45.00	151.85	0.50	0.15	0.08					
					W46-U	0.68	0.99	3.57	38.68	151.85	0.50	1.00	0.82					

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W47-L	0.68	0.99	1.72	40.30	151.85	0.50	0.15	0.06		
					W47-U	0.68	0.99	3.20	34.91	151.85	0.50	1.00	0.66		
													2.36	2.00	YES
09th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08			
				W1-U	0.68	0.99	3.19	36.22	125.20	0.50	1.00	0.83			
				W2-L	0.68	0.99	1.93	44.01	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	38.62	125.20	0.50	1.00	0.99			
				W3-L	0.68	0.99	1.72	41.01	125.20	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.19	35.45	125.20	0.50	1.00	0.81			
				W4-L	0.68	0.99	0.70	48.27	125.20	0.50	0.15	0.04			
				W4-U	0.68	0.99	1.29	47.94	125.20	0.50	1.00	0.44			
													3.35	2.00	YES
09th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	45.42	66.26	0.50	0.15	0.06			
				W5-U	0.68	0.99	1.29	45.08	66.26	0.50	1.00	0.79			
													0.85	1.00	NO
09th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	42.80	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	42.47	66.49	0.50	1.00	0.74			
													0.80	1.00	NO
09th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	42.74	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	42.04	104.32	0.50	1.00	0.47			
				W8-L	0.68	0.99	1.36	44.04	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	43.19	104.32	0.50	1.00	0.94			
													1.52	2.00	NO
09th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	36.67	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	36.36	65.09	0.50	1.00	0.65			
													0.70	1.00	NO
09th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	37.66	121.62	0.50	0.15	0.03			
				W10-U	0.68	0.99	1.29	36.98	121.62	0.50	1.00	0.35			
				W11-L	0.68	0.99	1.36	39.82	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	39.02	121.62	0.50	1.00	0.73			
													1.17	2.00	NO
09th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	32.46	56.77	0.50	0.15	0.05			
				W12-U	0.68	0.99	1.29	32.25	56.77	0.50	1.00	0.66			
													0.71	1.00	NO
09th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	30.92	56.45	0.50	0.15	0.05			
				W13-U	0.68	0.99	1.29	30.83	56.45	0.50	1.00	0.63			
													0.69	1.00	NO
09th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	34.71	119.79	0.50	0.15	0.03			
				W14-U	0.68	0.99	1.29	34.21	119.79	0.50	1.00	0.33			
				W15-L	0.68	0.99	1.36	37.39	119.79	0.50	0.15	0.06			
				W15-U	0.68	0.99	2.52	36.76	119.79	0.50	1.00	0.69			
													1.11	2.00	NO
09th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	31.04	59.49	0.50	0.15	0.05			
				W16-U	0.68	0.99	1.29	31.11	59.49	0.50	1.00	0.61			
				W17-L	0.68	0.99	0.36	34.30	59.49	0.50	0.15	0.03			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-U	0.68	0.99	0.67	34.32	59.49	0.50	1.00	0.35		
09th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	31.69	116.88	0.50	0.15	0.01	1.03	1.00	YES
				W18-U	0.68	0.99	0.67	31.59	116.88	0.50	1.00	0.16			
				W19-L	0.68	0.99	0.70	37.61	116.88	0.50	0.15	0.03			
				W19-U	0.68	0.99	1.29	37.50	116.88	0.50	1.00	0.37			
				W20-L	0.68	0.99	1.36	40.62	116.88	0.50	0.15	0.06			
				W20-U	0.68	0.99	2.52	40.36	116.88	0.50	1.00	0.78	1.42	2.00	NO
09th	R12	Residential	Bedroom	W21-L	0.68	0.99	0.70	35.08	55.29	0.50	0.15	0.06			
				W21-U	0.68	0.99	1.29	35.46	55.29	0.50	1.00	0.74	0.80	1.00	NO
09th	R13	Residential	Bedroom	W22-L	0.68	0.99	0.70	37.21	69.09	0.50	0.15	0.05			
				W22-U	0.68	0.99	1.29	37.62	69.09	0.50	1.00	0.63	0.68	1.00	NO
09th	R14	Residential	Bedroom	W23-L	0.68	0.99	0.70	38.30	67.42	0.50	0.15	0.05			
				W23-U	0.68	0.99	1.29	38.71	67.42	0.50	1.00	0.67	0.72	1.00	NO
09th	R15	Residential	LKD	W24-L	0.68	0.99	0.70	44.13	116.39	0.50	0.15	0.04			
				W24-U	0.68	0.99	1.29	44.13	116.39	0.50	1.00	0.44			
				W25-L	0.68	0.99	1.36	46.88	116.39	0.50	0.15	0.07			
				W25-U	0.68	0.99	2.52	46.72	116.39	0.50	1.00	0.91	1.46	2.00	NO
09th	R16	Residential	Bedroom	W26-L	0.68	0.99	0.70	43.45	55.28	0.50	0.15	0.07			
				W26-U	0.68	0.99	1.29	43.84	55.28	0.50	1.00	0.92	0.99	1.00	NO
09th	R17	Residential	Bedroom	W27-L	0.68	0.99	0.70	47.86	69.08	0.50	0.15	0.07			
				W27-U	0.68	0.99	1.29	48.17	69.08	0.50	1.00	0.81	0.87	1.00	NO
09th	R18	Residential	Bedroom	W28-L	0.68	0.99	0.70	50.34	55.32	0.50	0.15	0.09			
				W28-U	0.68	0.99	1.29	50.61	55.32	0.50	1.00	1.06	1.15	1.00	YES
09th	R19	Residential	LKD	W29-L	0.68	0.99	0.70	55.24	117.45	0.50	0.15	0.04			
				W29-U	0.68	0.99	1.29	55.09	117.45	0.50	1.00	0.54			
				W30-L	0.68	0.99	1.36	57.33	117.45	0.50	0.15	0.09			
				W30-U	0.68	0.99	2.52	57.02	117.45	0.50	1.00	1.10			
				W31-L	0.68	0.99	0.36	42.63	117.45	0.50	0.15	0.02			
				W31-U	0.68	0.99	0.67	44.76	117.45	0.50	1.00	0.23	2.02	2.00	YES
09th	R20	Residential	Bedroom	W32-L	0.68	0.99	0.36	23.59	58.24	0.50	0.15	0.02			
				W32-U	0.68	0.99	0.67	23.52	58.24	0.50	1.00	0.24			
				W33-L	0.68	0.99	0.70	60.60	58.24	0.50	0.15	0.10			
				W33-U	0.68	0.99	1.29	60.72	58.24	0.50	1.00	1.21	1.57	1.00	YES
09th	R21	Residential	LKD	W34-L	0.68	0.99	0.70	65.47	117.07	0.50	0.15	0.05			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W34-U	0.68	0.99	1.29	65.17	117.07	0.50	1.00	0.65		
					W35-L	0.68	0.99	1.36	66.94	117.07	0.50	0.15	0.10		
					W35-U	0.68	0.99	2.52	66.48	117.07	0.50	1.00	1.29		
09th	R22	Residential	Bedroom										2.09	2.00	YES
					W36-L	0.68	0.99	0.70	64.18	59.45	0.50	0.15	0.10		
					W36-U	0.68	0.99	1.29	64.24	59.45	0.50	1.00	1.25		
					W37-L	0.68	0.99	0.70	65.06	59.45	0.50	0.15	0.10		
					W37-U	0.68	0.99	1.29	65.10	59.45	0.50	1.00	1.27		
09th	R23	Residential	Bedroom										2.73	1.00	YES
					W38-L	0.68	0.99	0.70	66.75	57.18	0.50	0.15	0.11		
					W38-U	0.68	0.99	1.29	66.76	57.18	0.50	1.00	1.35		
09th	R24	Residential	LKD										1.46	1.00	YES
					W39-L	0.68	0.99	0.70	71.02	119.55	0.50	0.15	0.06		
					W39-U	0.68	0.99	1.29	70.59	119.55	0.50	1.00	0.69		
					W40-L	0.68	0.99	1.36	72.12	119.55	0.50	0.15	0.11		
					W40-U	0.68	0.99	2.52	71.52	119.55	0.50	1.00	1.35		
09th	R25	Residential	Bedroom										2.21	2.00	YES
					W41-L	0.68	0.99	0.70	68.92	69.12	0.50	0.15	0.09		
					W41-U	0.68	0.99	1.29	68.87	69.12	0.50	1.00	1.16		
					W42-L	0.68	0.99	0.70	69.58	69.12	0.50	0.15	0.09		
					W42-U	0.68	0.99	1.29	69.51	69.12	0.50	1.00	1.17		
09th	R26	Residential	Bedroom										2.51	1.00	YES
					W43-L	0.68	0.99	0.70	70.74	66.25	0.50	0.15	0.10		
					W43-U	0.68	0.99	1.29	70.64	66.25	0.50	1.00	1.24		
09th	R27	Residential	Bedroom										1.34	1.00	YES
					W44-L	0.68	0.99	0.70	71.48	56.67	0.50	0.15	0.12		
					W44-U	0.68	0.99	1.29	71.37	56.67	0.50	1.00	1.46		
09th	R28	Residential	LKD										1.58	1.00	YES
					W45-L	0.68	0.99	1.72	45.19	151.85	0.50	0.15	0.07		
					W45-U	0.68	0.99	3.18	44.74	151.85	0.50	1.00	0.84		
					W46-L	0.68	0.99	1.93	48.77	151.85	0.50	0.15	0.08		
					W46-U	0.68	0.99	3.57	48.55	151.85	0.50	1.00	1.03		
					W47-L	0.68	0.99	1.72	43.47	151.85	0.50	0.15	0.07		
					W47-U	0.68	0.99	3.20	43.73	151.85	0.50	1.00	0.83		
10th	R1	Residential	LKD										2.92	2.00	YES
					W1-L	0.68	0.99	1.72	38.27	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	28.47	125.20	0.50	1.00	0.65		
					W2-L	0.68	0.99	1.93	41.25	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	30.20	125.20	0.50	1.00	0.77		
					W3-L	0.68	0.99	1.72	38.70	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	27.63	125.20	0.50	1.00	0.63		
					W4-L	0.68	0.99	0.70	48.65	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.33	125.20	0.50	1.00	0.45		
													2.77	2.00	YES
10th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	45.81	66.26	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W5-U	0.68	0.99	1.29	45.49	66.26	0.50	1.00	0.80	1.00	NO
													0.86		
10th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	43.22	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.90	66.49	0.50	1.00	0.75		
													0.81	1.00	NO
10th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	43.27	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.58	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	44.58	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.76	104.32	0.50	1.00	0.95		
													1.54	2.00	NO
10th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	37.28	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	36.99	65.09	0.50	1.00	0.66		
													0.71	1.00	NO
10th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	38.43	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	37.79	121.62	0.50	1.00	0.36		
					W11-L	0.68	0.99	1.36	40.63	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	39.86	121.62	0.50	1.00	0.74		
													1.19	2.00	NO
10th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	33.45	56.77	0.50	0.15	0.06		
					W12-U	0.68	0.99	1.29	33.28	56.77	0.50	1.00	0.68		
													0.74	1.00	NO
10th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	32.28	56.45	0.50	0.15	0.05		
					W13-U	0.68	0.99	1.29	32.25	56.45	0.50	1.00	0.66		
													0.72	1.00	NO
10th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	36.09	119.79	0.50	0.15	0.03		
					W14-U	0.68	0.99	1.29	35.66	119.79	0.50	1.00	0.35		
					W15-L	0.68	0.99	1.36	38.81	119.79	0.50	0.15	0.06		
					W15-U	0.68	0.99	2.52	38.26	119.79	0.50	1.00	0.72		
													1.16	2.00	NO
10th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	32.86	59.49	0.50	0.15	0.05		
					W16-U	0.68	0.99	1.29	33.02	59.49	0.50	1.00	0.64		
					W17-L	0.68	0.99	0.36	34.74	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	34.81	59.49	0.50	1.00	0.35		
													1.08	1.00	YES
10th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	31.75	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.66	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	39.99	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	40.03	116.88	0.50	1.00	0.40		
					W20-L	0.68	0.99	1.36	42.96	116.88	0.50	0.15	0.07		
					W20-U	0.68	0.99	2.52	42.87	116.88	0.50	1.00	0.83		
													1.50	2.00	NO
10th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	37.67	55.29	0.50	0.15	0.06		
					W21-U	0.68	0.99	1.29	38.22	55.29	0.50	1.00	0.80		
													0.87	1.00	NO
10th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	39.85	69.09	0.50	0.15	0.05		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W22-U	0.68	0.99	1.29	40.43	69.09	0.50	1.00	0.68	1.00	NO
													0.73		
10th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	40.92	67.42	0.50	0.15	0.06		
					W23-U	0.68	0.99	1.29	41.50	67.42	0.50	1.00	0.71		
													0.77	1.00	NO
10th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	46.62	116.39	0.50	0.15	0.04		
					W24-U	0.68	0.99	1.29	46.79	116.39	0.50	1.00	0.47		
					W25-L	0.68	0.99	1.36	49.34	116.39	0.50	0.15	0.08		
					W25-U	0.68	0.99	2.52	49.35	116.39	0.50	1.00	0.96		
													1.54	2.00	NO
10th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	45.91	55.28	0.50	0.15	0.08		
					W26-U	0.68	0.99	1.29	46.45	55.28	0.50	1.00	0.98		
													1.05	1.00	YES
10th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	50.07	69.08	0.50	0.15	0.07		
					W27-U	0.68	0.99	1.29	50.52	69.08	0.50	1.00	0.85		
													0.92	1.00	NO
10th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	52.41	55.32	0.50	0.15	0.09		
					W28-U	0.68	0.99	1.29	52.80	55.32	0.50	1.00	1.11		
													1.20	1.00	YES
10th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	57.21	117.45	0.50	0.15	0.05		
					W29-U	0.68	0.99	1.29	57.18	117.45	0.50	1.00	0.56		
					W30-L	0.68	0.99	1.36	59.28	117.45	0.50	0.15	0.09		
					W30-U	0.68	0.99	2.52	59.08	117.45	0.50	1.00	1.14		
					W31-L	0.68	0.99	0.36	47.93	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	48.50	117.45	0.50	1.00	0.25		
													2.11	2.00	YES
10th	R20		Residential	Bathroom	W32-L	0.68	0.99	0.70	48.07	49.89	0.50	0.15	0.09		
					W32-U	0.68	0.99	1.19	50.90	49.89	0.50	1.00	1.09		
													1.18	-1.00	NO
10th	R21		Residential	Study	W33-L	0.68	0.99	0.69	60.15	63.55	0.50	0.15	0.09		
					W33-U	0.68	0.99	1.17	65.81	63.55	0.50	1.00	1.09		
					W34-L	0.68	0.99	0.69	58.62	63.55	0.50	0.15	0.09		
					W34-U	0.68	0.99	1.17	64.30	63.55	0.50	1.00	1.07		
													2.33	-1.00	NO
10th	R22		Residential	En Suite	W35-L	0.68	0.99	0.70	58.69	50.60	0.50	0.15	0.11		
					W35-U	0.68	0.99	1.19	65.05	50.60	0.50	1.00	1.37		
													1.48	-1.00	NO
10th	R23		Residential	Bedroom	W36-L	0.68	0.99	0.69	62.13	91.83	0.50	0.15	0.06		
					W36-U	0.68	0.99	1.17	68.61	91.83	0.50	1.00	0.79		
					W37-L	0.68	0.99	0.69	60.98	91.83	0.50	0.15	0.06		
					W37-U	0.68	0.99	1.17	67.32	91.83	0.50	1.00	0.77		
													1.69	1.00	YES
10th	R24		Residential	LKD	W38-L	0.68	0.99	0.70	61.05	228.51	0.50	0.15	0.03		
					W38-U	0.68	0.99	1.19	68.44	228.51	0.50	1.00	0.32		
					W39-L	0.68	0.99	0.70	62.12	228.51	0.50	0.15	0.03		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W39-U	0.68	0.99	1.19	69.97	228.51	0.50	1.00	0.33		
					W40-L	0.68	0.99	1.71	78.70	228.51	0.50	0.15	0.08		
					W40-U	0.68	0.99	2.91	81.15	228.51	0.50	1.00	0.93		
					W41-L	0.68	0.99	1.71	76.40	228.51	0.50	0.15	0.08		
					W41-U	0.68	0.99	2.91	80.35	228.51	0.50	1.00	0.92		
					W42-L	0.68	0.99	1.71	73.90	228.51	0.50	0.15	0.07		
					W42-U	0.68	0.99	2.91	81.07	228.51	0.50	1.00	0.93		
					W43-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03		
					W43-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					W44-L	0.68	0.99	1.71	73.57	228.51	0.50	0.15	0.07		
					W44-U	0.68	0.99	2.91	80.50	228.51	0.50	1.00	0.92		
					W45-L	0.68	0.99	0.70	65.45	228.51	0.50	0.15	0.03		
					W45-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
						5.49	2.00	YES							
11th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.27	125.20	0.50	0.15	0.07			
				W1-U	0.68	0.99	3.19	29.76	125.20	0.50	1.00	0.68			
				W2-L	0.68	0.99	1.93	42.22	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	31.59	125.20	0.50	1.00	0.81			
				W3-L	0.68	0.99	1.72	39.70	125.20	0.50	0.15	0.07			
				W3-U	0.68	0.99	3.19	29.19	125.20	0.50	1.00	0.67			
				W4-L	0.68	0.99	0.70	49.01	125.20	0.50	0.15	0.04			
				W4-U	0.68	0.99	1.29	48.70	125.20	0.50	1.00	0.45			
	2.88	2.00	YES												
11th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	46.18	66.26	0.50	0.15	0.07			
				W5-U	0.68	0.99	1.29	45.87	66.26	0.50	1.00	0.80			
													0.87	1.00	NO
11th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	43.61	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	43.30	66.49	0.50	1.00	0.76			
													0.82	1.00	NO
11th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	43.77	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	43.10	104.32	0.50	1.00	0.48			
				W8-L	0.68	0.99	1.36	45.10	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	44.29	104.32	0.50	1.00	0.96			
													1.56	2.00	NO
11th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	37.86	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	37.59	65.09	0.50	1.00	0.67			
													0.72	1.00	NO
11th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	39.17	121.62	0.50	0.15	0.03			
				W10-U	0.68	0.99	1.29	38.55	121.62	0.50	1.00	0.37			
				W11-L	0.68	0.99	1.36	41.40	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	40.66	121.62	0.50	1.00	0.76			
													1.22	2.00	NO
11th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	34.39	56.77	0.50	0.15	0.06			
				W12-U	0.68	0.99	1.29	34.25	56.77	0.50	1.00	0.70			
													0.76	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
11th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	33.58	56.45	0.50	0.15	0.06			
					W13-U	0.68	0.99	1.29	33.59	56.45	0.50	1.00	0.69		
11th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	37.43	119.79	0.50	0.15	0.03			
					W14-U	0.68	0.99	1.29	37.05	119.79	0.50	1.00	0.36		
					W15-L	0.68	0.99	1.36	40.18	119.79	0.50	0.15	0.06		
					W15-U	0.68	0.99	2.52	39.70	119.79	0.50	1.00	0.75		
11th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	34.61	59.49	0.50	0.15	0.05			
					W16-U	0.68	0.99	1.29	34.84	59.49	0.50	1.00	0.68		
					W17-L	0.68	0.99	0.36	35.28	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	35.45	59.49	0.50	1.00	0.36		
11th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	31.82	116.88	0.50	0.15	0.01			
					W18-U	0.68	0.99	0.67	31.73	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	42.36	116.88	0.50	0.15	0.03		
					W19-U	0.68	0.99	1.29	42.53	116.88	0.50	1.00	0.42		
					W20-L	0.68	0.99	1.36	45.31	116.88	0.50	0.15	0.07		
					W20-U	0.68	0.99	2.52	45.36	116.88	0.50	1.00	0.88		
11th	R12	Residential	Bedroom	W21-L	0.68	0.99	0.70	40.26	55.29	0.50	0.15	0.07			
					W21-U	0.68	0.99	1.29	40.92	55.29	0.50	1.00	0.86		
11th	R13	Residential	Bedroom	W22-L	0.68	0.99	0.70	42.49	69.09	0.50	0.15	0.06			
					W22-U	0.68	0.99	1.29	43.20	69.09	0.50	1.00	0.73		
11th	R14	Residential	Bedroom	W23-L	0.68	0.99	0.70	43.56	67.42	0.50	0.15	0.06			
					W23-U	0.68	0.99	1.29	44.27	67.42	0.50	1.00	0.76		
11th	R15	Residential	LKD	W24-L	0.68	0.99	0.70	49.16	116.39	0.50	0.15	0.04			
					W24-U	0.68	0.99	1.29	49.46	116.39	0.50	1.00	0.49		
					W25-L	0.68	0.99	1.36	51.84	116.39	0.50	0.15	0.08		
					W25-U	0.68	0.99	2.52	52.00	116.39	0.50	1.00	1.01		
												1.63	2.00	NO	
11th	R16	Residential	Bedroom	W26-L	0.68	0.99	0.70	48.41	55.28	0.50	0.15	0.08			
					W26-U	0.68	0.99	1.29	49.08	55.28	0.50	1.00	1.03		
11th	R17	Residential	Bedroom	W27-L	0.68	0.99	0.70	52.32	69.08	0.50	0.15	0.07			
					W27-U	0.68	0.99	1.29	52.89	69.08	0.50	1.00	0.89		
												0.96	1.00	NO	
11th	R18	Residential	Bedroom	W28-L	0.68	0.99	0.70	54.51	55.32	0.50	0.15	0.09			
					W28-U	0.68	0.99	1.29	55.01	55.32	0.50	1.00	1.15		
												1.25	1.00	YES	
11th	R19	Residential	LKD	W29-L	0.68	0.99	0.70	59.21	117.45	0.50	0.15	0.05			
					W29-U	0.68	0.99	1.29	59.29	117.45	0.50	1.00	0.59		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W30-L	0.68	0.99	1.36	61.25	117.45	0.50	0.15	0.10		
					W30-U	0.68	0.99	2.52	61.15	117.45	0.50	1.00	1.18		
					W31-L	0.68	0.99	0.36	49.18	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.31	117.45	0.50	1.00	0.25		
12th	R1	Residential	LKD										2.18	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	31.02	125.20	0.50	1.00	0.71		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	32.91	125.20	0.50	1.00	0.84		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	30.63	125.20	0.50	1.00	0.70		
					W4-L	0.68	0.99	0.70	49.38	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.08	125.20	0.50	1.00	0.45		
													2.98	2.00	YES
12th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	46.57	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	46.27	66.26	0.50	1.00	0.81		
12th	R3	Residential	Bedroom										0.88	1.00	NO
					W6-L	0.68	0.99	0.70	44.03	66.49	0.50	0.15	0.06		
12th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	43.73	66.49	0.50	1.00	0.76		
													0.83	1.00	NO
12th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	44.29	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	43.63	104.32	0.50	1.00	0.49		
					W8-L	0.68	0.99	1.36	45.64	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	44.85	104.32	0.50	1.00	0.97		
12th	R5	Residential	Bedroom										1.58	2.00	NO
					W9-L	0.68	0.99	0.70	38.47	65.09	0.50	0.15	0.06		
12th	R6	Residential	LKD		W9-U	0.68	0.99	1.29	38.22	65.09	0.50	1.00	0.68		
													0.74	1.00	NO
12th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	39.94	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	39.34	121.62	0.50	1.00	0.38		
					W11-L	0.68	0.99	1.36	42.21	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	41.50	121.62	0.50	1.00	0.77		
12th	R7	Residential	Bedroom										1.24	2.00	NO
					W12-L	0.68	0.99	0.70	35.37	56.77	0.50	0.15	0.06		
12th	R8	Residential	Bedroom		W12-U	0.68	0.99	1.29	35.26	56.77	0.50	1.00	0.72		
													0.78	1.00	NO
12th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	34.93	56.45	0.50	0.15	0.06		
					W13-U	0.68	0.99	1.29	34.98	56.45	0.50	1.00	0.72		
12th	R9	Residential	LKD										0.78	1.00	NO
													0.78	1.00	NO
12th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	38.84	119.79	0.50	0.15	0.03		
					W14-U	0.68	0.99	1.29	38.51	119.79	0.50	1.00	0.37		
					W15-L	0.68	0.99	1.36	41.64	119.79	0.50	0.15	0.06		
					W15-U	0.68	0.99	2.52	41.21	119.79	0.50	1.00	0.78		
12th	R10	Residential	Bedroom										1.25	2.00	NO
					W16-L	0.68	0.99	0.70	36.47	59.49	0.50	0.15	0.06		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	36.75	59.49	0.50	1.00	0.72		
					W17-L	0.68	0.99	0.36	36.14	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	36.55	59.49	0.50	1.00	0.37		
12th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	31.90	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	31.82	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	44.95	116.88	0.50	0.15	0.04		
					W19-U	0.68	0.99	1.29	45.23	116.88	0.50	1.00	0.45		
					W20-L	0.68	0.99	1.36	47.93	116.88	0.50	0.15	0.08		
					W20-U	0.68	0.99	2.52	48.08	116.88	0.50	1.00	0.93		
					1.17	1.00	YES								
12th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	43.09	55.29	0.50	0.15	0.07		
					W21-U	0.68	0.99	1.29	43.86	55.29	0.50	1.00	0.92		
					0.99	1.00	NO								
12th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	45.41	69.09	0.50	0.15	0.06		
					W22-U	0.68	0.99	1.29	46.24	69.09	0.50	1.00	0.78		
					0.84	1.00	NO								
12th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	46.48	67.42	0.50	0.15	0.06		
					W23-U	0.68	0.99	1.29	47.31	67.42	0.50	1.00	0.81		
					0.88	1.00	NO								
12th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	52.01	116.39	0.50	0.15	0.04		
					W24-U	0.68	0.99	1.29	52.45	116.39	0.50	1.00	0.52		
					W25-L	0.68	0.99	1.36	54.68	116.39	0.50	0.15	0.09		
					W25-U	0.68	0.99	2.52	54.98	116.39	0.50	1.00	1.07		
					1.72	2.00	NO								
12th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	51.22	55.28	0.50	0.15	0.09		
					W26-U	0.68	0.99	1.29	52.03	55.28	0.50	1.00	1.09		
					1.18	1.00	YES								
12th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	54.87	69.08	0.50	0.15	0.07		
					W27-U	0.68	0.99	1.29	55.56	69.08	0.50	1.00	0.93		
					1.01	1.00	YES								
12th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	56.89	55.32	0.50	0.15	0.10		
					W28-U	0.68	0.99	1.29	57.51	55.32	0.50	1.00	1.21		
					1.30	1.00	YES								
12th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	61.49	117.45	0.50	0.15	0.05		
					W29-U	0.68	0.99	1.29	61.67	117.45	0.50	1.00	0.61		
					W30-L	0.68	0.99	1.36	63.50	117.45	0.50	0.15	0.10		
					W30-U	0.68	0.99	2.52	63.49	117.45	0.50	1.00	1.22		
					W31-L	0.68	0.99	0.36	49.62	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.48	117.45	0.50	1.00	0.25		
					2.26	2.00	YES								
13th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	32.25	125.20	0.50	1.00	0.74		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	34.20	125.20	0.50	1.00	0.88		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	32.02	125.20	0.50	1.00	0.73		
					W4-L	0.68	0.99	0.70	49.78	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.49	125.20	0.50	1.00	0.46		
13th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	46.99	66.26	0.50	0.15	0.07	3.08	2.00	YES
				W5-U	0.68	0.99	1.29	46.70	66.26	0.50	1.00	0.82			
13th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	44.47	66.49	0.50	0.15	0.06	0.88	1.00	NO
				W6-U	0.68	0.99	1.29	44.19	66.49	0.50	1.00	0.77			
13th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	44.83	104.32	0.50	0.15	0.04	1.60	2.00	NO
				W7-U	0.68	0.99	1.29	44.19	104.32	0.50	1.00	0.49			
				W8-L	0.68	0.99	1.36	46.21	104.32	0.50	0.15	0.08			
				W8-U	0.68	0.99	2.52	45.42	104.32	0.50	1.00	0.99			
13th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	39.11	65.09	0.50	0.15	0.06	0.75	1.00	NO
				W9-U	0.68	0.99	1.29	38.88	65.09	0.50	1.00	0.69			
13th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	40.74	121.62	0.50	0.15	0.03	1.27	2.00	NO
				W10-U	0.68	0.99	1.29	40.16	121.62	0.50	1.00	0.38			
				W11-L	0.68	0.99	1.36	43.05	121.62	0.50	0.15	0.06			
				W11-U	0.68	0.99	2.52	42.36	121.62	0.50	1.00	0.79			
13th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	36.39	56.77	0.50	0.15	0.06	0.80	1.00	NO
				W12-U	0.68	0.99	1.29	36.29	56.77	0.50	1.00	0.74			
13th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	36.33	56.45	0.50	0.15	0.06	0.81	1.00	NO
				W13-U	0.68	0.99	1.29	36.39	56.45	0.50	1.00	0.75			
13th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	40.30	119.79	0.50	0.15	0.03	1.29	2.00	NO
				W14-U	0.68	0.99	1.29	39.99	119.79	0.50	1.00	0.39			
				W15-L	0.68	0.99	1.36	43.17	119.79	0.50	0.15	0.07			
				W15-U	0.68	0.99	2.52	42.76	119.79	0.50	1.00	0.81			
13th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	38.40	59.49	0.50	0.15	0.06	1.24	1.00	YES
				W16-U	0.68	0.99	1.29	38.71	59.49	0.50	1.00	0.76			
				W17-L	0.68	0.99	0.36	37.72	59.49	0.50	0.15	0.03			
				W17-U	0.68	0.99	0.67	38.64	59.49	0.50	1.00	0.39			
13th	R11	Residential	LKD	W18-L	0.68	0.99	0.36	32.00	116.88	0.50	0.15	0.01			
				W18-U	0.68	0.99	0.67	31.92	116.88	0.50	1.00	0.16			
				W19-L	0.68	0.99	0.70	47.72	116.88	0.50	0.15	0.04			
				W19-U	0.68	0.99	1.29	48.05	116.88	0.50	1.00	0.48			
				W20-L	0.68	0.99	1.36	50.74	116.88	0.50	0.15	0.08			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-U	0.68	0.99	2.52	50.95	116.88	0.50	1.00	0.99	2.00	NO
													1.76		
13th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	46.09	55.29	0.50	0.15	0.08	1.00	YES
					W21-U	0.68	0.99	1.29	46.91	55.29	0.50	1.00	0.98		
13th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	48.54	69.09	0.50	0.15	0.07	1.00	NO
					W22-U	0.68	0.99	1.29	49.43	69.09	0.50	1.00	0.83		
13th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	49.62	67.42	0.50	0.15	0.07	1.00	NO
					W23-U	0.68	0.99	1.29	50.52	67.42	0.50	1.00	0.87		
13th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	55.14	116.39	0.50	0.15	0.04	2.00	NO
					W24-U	0.68	0.99	1.29	55.66	116.39	0.50	1.00	0.55		
13th	R16		Residential	Bedroom	W25-L	0.68	0.99	1.36	57.82	116.39	0.50	0.15	0.09	1.00	YES
					W25-U	0.68	0.99	2.52	58.19	116.39	0.50	1.00	1.13		
13th	R17		Residential	Bedroom	W26-L	0.68	0.99	0.70	54.30	55.28	0.50	0.15	0.09	1.00	YES
					W26-U	0.68	0.99	1.29	55.18	55.28	0.50	1.00	1.16		
13th	R18		Residential	Bedroom	W27-L	0.68	0.99	0.70	57.68	69.08	0.50	0.15	0.08	1.00	YES
					W27-U	0.68	0.99	1.29	58.45	69.08	0.50	1.00	0.98		
13th	R19		Residential	LKD	W28-L	0.68	0.99	0.70	59.51	55.32	0.50	0.15	0.10	1.00	YES
					W28-U	0.68	0.99	1.29	60.20	55.32	0.50	1.00	1.26		
13th	R20		Residential	LKD	W29-L	0.68	0.99	0.70	64.02	117.45	0.50	0.15	0.05	2.00	YES
					W29-U	0.68	0.99	1.29	64.26	117.45	0.50	1.00	0.63		
13th	R21		Residential	LKD	W30-L	0.68	0.99	1.36	65.99	117.45	0.50	0.15	0.10	1.00	YES
					W30-U	0.68	0.99	2.52	66.03	117.45	0.50	1.00	1.27		
13th	R22		Residential	LKD	W31-L	0.68	0.99	0.36	49.71	117.45	0.50	0.15	0.02	1.00	YES
					W31-U	0.68	0.99	0.67	49.60	117.45	0.50	1.00	0.25		
14th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	43.38	125.20	0.50	0.15	0.08	2.00	YES
					W1-U	0.68	0.99	3.19	42.30	125.20	0.50	1.00	0.97		
14th	R2		Residential	Bedroom	W2-L	0.68	0.99	1.93	46.63	125.20	0.50	0.15	0.10	1.00	YES
					W2-U	0.68	0.99	3.57	45.17	125.20	0.50	1.00	1.16		
14th	R3		Residential	Bedroom	W3-L	0.68	0.99	1.72	43.69	125.20	0.50	0.15	0.08	1.00	YES
					W3-U	0.68	0.99	3.19	42.45	125.20	0.50	1.00	0.97		
14th	R4		Residential	Bedroom	W4-L	0.68	0.99	0.70	50.19	125.20	0.50	0.15	0.04	1.00	YES
					W4-U	0.68	0.99	1.29	49.91	125.20	0.50	1.00	0.46		
14th	R5		Residential	Bedroom	W5-L	0.68	0.99	0.70	47.43	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	47.15	66.26	0.50	1.00	0.83		
14th	R6		Residential	Bedroom	W6-L	0.68	0.99	0.70	44.94	66.49	0.50	0.15	0.06	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	44.66	66.49	0.50	1.00	0.78	1.00	NO
					W7-L	0.68	0.99	0.70	45.40	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	44.77	104.32	0.50	1.00	0.50		
					W8-L	0.68	0.99	1.36	46.79	104.32	0.50	0.15	0.08		
14th	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	46.03	104.32	0.50	1.00	1.00	2.00	NO
					W9-L	0.68	0.99	0.70	39.77	65.09	0.50	0.15	0.06		
					W9-U	0.68	0.99	1.29	39.55	65.09	0.50	1.00	0.71		
													0.76		
14th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	41.55	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	40.99	121.62	0.50	1.00	0.39		
					W11-L	0.68	0.99	1.36	43.91	121.62	0.50	0.15	0.07		
					W11-U	0.68	0.99	2.52	43.23	121.62	0.50	1.00	0.80		
14th	R7	Residential	Bedroom										1.29	2.00	NO
					W12-L	0.68	0.99	0.70	37.42	56.77	0.50	0.15	0.06		
					W12-U	0.68	0.99	1.29	37.33	56.77	0.50	1.00	0.76		
													0.83		
14th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	37.73	56.45	0.50	0.15	0.06	1.00	NO
					W13-U	0.68	0.99	1.29	37.79	56.45	0.50	1.00	0.78		
													0.84		
14th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	41.76	119.79	0.50	0.15	0.03	2.00	NO
					W14-U	0.68	0.99	1.29	41.47	119.79	0.50	1.00	0.40		
					W15-L	0.68	0.99	1.36	44.70	119.79	0.50	0.15	0.07		
					W15-U	0.68	0.99	2.52	44.30	119.79	0.50	1.00	0.84		
14th	R10	Residential	Bedroom										1.34	2.00	NO
					W16-L	0.68	0.99	0.70	40.33	59.49	0.50	0.15	0.06		
					W16-U	0.68	0.99	1.29	40.62	59.49	0.50	1.00	0.79		
					W17-L	0.68	0.99	0.36	40.83	59.49	0.50	0.15	0.03		
14th	R11	Residential	LKD		W17-U	0.68	0.99	0.67	42.68	59.49	0.50	1.00	0.43	1.00	YES
					W18-L	0.68	0.99	0.36	32.10	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	32.03	116.88	0.50	1.00	0.16		
					W19-L	0.68	0.99	0.70	50.54	116.88	0.50	0.15	0.04		
14th	R12	Residential	Bedroom		W19-U	0.68	0.99	1.29	50.87	116.88	0.50	1.00	0.51	2.00	NO
					W20-L	0.68	0.99	1.36	53.63	116.88	0.50	0.15	0.08		
					W20-U	0.68	0.99	2.52	53.83	116.88	0.50	1.00	1.04		
													1.85		
14th	R13	Residential	Bedroom		W21-L	0.68	0.99	0.70	49.15	55.29	0.50	0.15	0.08	1.00	YES
					W21-U	0.68	0.99	1.29	49.95	55.29	0.50	1.00	1.05		
													1.13		
					W22-L	0.68	0.99	0.70	51.76	69.09	0.50	0.15	0.07		
14th	R14	Residential	Bedroom		W22-U	0.68	0.99	1.29	52.63	69.09	0.50	1.00	0.88	1.00	NO
													0.95		
					W23-L	0.68	0.99	0.70	52.87	67.42	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R15	Residential	LKD		W23-U	0.68	0.99	1.29	53.76	67.42	0.50	1.00	0.93	1.00	YES
					W24-L	0.68	0.99	0.70	58.41	116.39	0.50	0.15	0.05		
					W24-U	0.68	0.99	1.29	58.93	116.39	0.50	1.00	0.59		
					W25-L	0.68	0.99	1.36	61.11	116.39	0.50	0.15	0.10		
14th	R16	Residential	Bedroom		W25-U	0.68	0.99	2.52	61.50	116.39	0.50	1.00	1.20	2.00	NO
					W26-L	0.68	0.99	0.70	57.51	55.28	0.50	0.15	0.10		
					W26-U	0.68	0.99	1.29	58.39	55.28	0.50	1.00	1.23		
14th	R17	Residential	Bedroom											1.00	YES
					W27-L	0.68	0.99	0.70	60.62	69.08	0.50	0.15	0.08		
					W27-U	0.68	0.99	1.29	61.38	69.08	0.50	1.00	1.03		
14th	R18	Residential	Bedroom											1.00	YES
					W28-L	0.68	0.99	0.70	62.26	55.32	0.50	0.15	0.11		
					W28-U	0.68	0.99	1.29	62.94	55.32	0.50	1.00	1.32		
14th	R19	Residential	LKD											1.00	YES
					W29-L	0.68	0.99	0.70	66.68	117.45	0.50	0.15	0.05		
					W29-U	0.68	0.99	1.29	66.89	117.45	0.50	1.00	0.66		
15th	R1	Residential	LKD		W30-L	0.68	0.99	1.36	68.61	117.45	0.50	0.15	0.11	2.00	YES
					W30-U	0.68	0.99	2.52	68.63	117.45	0.50	1.00	1.32		
					W31-L	0.68	0.99	0.36	49.91	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	49.87	117.45	0.50	1.00	0.26		
15th	R2	Residential	LKD											2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	34.72	125.20	0.50	1.00	0.79		
15th	R3	Residential	Bedroom		W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09	1.00	NO
					W2-U	0.68	0.99	3.57	36.81	125.20	0.50	1.00	0.94		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	34.80	125.20	0.50	1.00	0.80		
15th	R4	Residential	LKD		W4-L	0.68	0.99	0.70	50.70	125.20	0.50	0.15	0.04	1.00	NO
					W4-U	0.68	0.99	1.29	50.42	125.20	0.50	1.00	0.47		
15th	R5	Residential	Bedroom		W5-L	0.68	0.99	0.70	47.96	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	47.69	66.26	0.50	1.00	0.84		
15th	R6	Residential	Bedroom											1.00	NO
					W6-L	0.68	0.99	0.70	45.51	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	45.24	66.49	0.50	1.00	0.79		
15th	R7	Residential	LKD											1.00	NO
					W7-L	0.68	0.99	0.70	46.08	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	45.45	104.32	0.50	1.00	0.51		
15th	R8	Residential	Bedroom		W8-L	0.68	0.99	1.36	47.50	104.32	0.50	0.15	0.08	2.00	NO
					W8-U	0.68	0.99	2.52	46.73	104.32	0.50	1.00	1.01		
15th	R9	Residential	Bedroom		W9-L	0.68	0.99	0.70	40.55	65.09	0.50	0.15	0.06	1.00	
					W9-U	0.68	0.99	1.29	40.33	65.09	0.50	1.00	0.72		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
15th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	42.50	121.62	0.50	0.15	0.78	1.00	NO
					W10-U	0.68	0.99	1.29	41.93	121.62	0.50	1.00	0.03		
					W11-L	0.68	0.99	1.36	44.90	121.62	0.50	0.15	0.40		
					W11-U	0.68	0.99	2.52	44.21	121.62	0.50	1.00	0.07		
													0.82		
15th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	38.60	56.77	0.50	0.15	1.32	2.00	NO
					W12-U	0.68	0.99	1.29	38.49	56.77	0.50	1.00	0.06		
													0.79		
													0.85	1.00	NO
													0.07		
15th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	39.29	56.45	0.50	0.15	0.87	1.00	NO
					W13-U	0.68	0.99	1.29	39.30	56.45	0.50	1.00	0.81		
													0.07		
													0.87	1.00	NO
													0.07		
15th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	43.39	119.79	0.50	0.15	1.39	2.00	NO
					W14-U	0.68	0.99	1.29	43.05	119.79	0.50	1.00	0.42		
					W15-L	0.68	0.99	1.36	46.38	119.79	0.50	0.15	0.07		
					W15-U	0.68	0.99	2.52	45.90	119.79	0.50	1.00	0.87		
													1.39	2.00	NO
15th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	42.34	59.49	0.50	0.15	0.07		
					W16-U	0.68	0.99	1.29	42.42	59.49	0.50	1.00	0.83		
					W17-L	0.68	0.99	0.36	46.50	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	47.59	59.49	0.50	1.00	0.48		
													1.41	1.00	YES
15th	R11		Residential	LKD	W18-L	0.68	0.99	0.46	39.51	151.45	0.50	0.15	0.02		
					W18-U	0.68	0.99	0.93	52.73	151.45	0.50	1.00	0.29		
					W19-L	0.68	0.99	0.46	42.45	151.45	0.50	0.15	0.02		
					W19-U	0.68	0.99	0.93	56.48	151.45	0.50	1.00	0.31		
					W20-L	0.68	0.99	0.46	38.77	151.45	0.50	0.15	0.02		
					W20-U	0.68	0.99	0.93	52.35	151.45	0.50	1.00	0.29		
					W21-L	0.68	0.99	0.70	39.61	151.45	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.42	54.29	151.45	0.50	1.00	0.46		
													1.43	2.00	NO
15th	R12		Residential	Bedroom	W22-L	0.68	0.99	1.04	44.08	61.41	0.50	0.15	0.10		
					W22-U	0.68	0.99	2.11	59.67	61.41	0.50	1.00	1.84		
					W23-L	0.68	0.99	1.04	44.34	61.41	0.50	0.15	0.10		
					W23-U	0.68	0.99	2.11	60.44	61.41	0.50	1.00	1.87		
													3.91	1.00	YES
15th	R13		Residential	Bedroom	W24-L	0.68	0.99	1.04	44.93	95.91	0.50	0.15	0.07		
					W24-U	0.68	0.99	2.11	61.77	95.91	0.50	1.00	1.22		
					W25-L	0.68	0.99	1.04	45.21	95.91	0.50	0.15	0.07		
					W25-U	0.68	0.99	2.11	62.46	95.91	0.50	1.00	1.24		
					W26-L	0.68	0.99	0.70	42.23	95.91	0.50	0.15	0.04		
					W26-U	0.68	0.99	1.42	60.40	95.91	0.50	1.00	0.80		
15th	R14		Residential	Bedroom									3.43	1.00	YES
					W27-L	0.68	0.99	0.46	44.31	84.77	0.50	0.15	0.03		
					W27-U	0.68	0.99	0.93	63.26	84.77	0.50	1.00	0.63		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W28-L	0.68	0.99	0.46	46.36	84.77	0.50	0.15	0.03		
					W28-U	0.68	0.99	0.93	65.63	84.77	0.50	1.00	0.65		
					W29-L	0.68	0.99	0.46	43.07	84.77	0.50	0.15	0.03		
					W29-U	0.68	0.99	0.93	61.58	84.77	0.50	1.00	0.61		
15th	R15	Residential	Bedroom										1.98	1.00	YES
					W30-L	0.68	0.99	0.46	45.53	58.77	0.50	0.15	0.05		
					W30-U	0.68	0.99	0.93	65.92	58.77	0.50	1.00	0.94		
					W31-L	0.68	0.99	0.46	47.35	58.77	0.50	0.15	0.05		
					W31-U	0.68	0.99	0.93	67.98	58.77	0.50	1.00	0.97		
					W32-L	0.68	0.99	0.46	44.06	58.77	0.50	0.15	0.05		
					W32-U	0.68	0.99	0.93	63.77	58.77	0.50	1.00	0.91		
15th	R16	Residential	LKD										2.97	1.00	YES
					W33-L	0.68	0.99	1.04	48.04	137.56	0.50	0.15	0.05		
					W33-U	0.68	0.99	2.11	69.40	137.56	0.50	1.00	0.96		
					W34-L	0.68	0.99	1.04	48.31	137.56	0.50	0.15	0.05		
					W34-U	0.68	0.99	2.11	70.01	137.56	0.50	1.00	0.97		
					W35-L	0.68	0.99	0.70	45.34	137.56	0.50	0.15	0.03		
					W35-U	0.68	0.99	1.42	67.46	137.56	0.50	1.00	0.63		
16th	R1	Residential	LKD										2.68	2.00	YES
					W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	35.73	125.20	0.50	1.00	0.82		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	37.90	125.20	0.50	1.00	0.97		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	35.93	125.20	0.50	1.00	0.82		
16th	R2	Residential	Bedroom										3.36	2.00	YES
					W4-L	0.68	0.99	0.70	51.16	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	50.87	125.20	0.50	1.00	0.47		
					W5-L	0.68	0.99	0.70	48.44	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	48.16	66.26	0.50	1.00	0.84		
													0.91	1.00	NO
16th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	46.01	66.49	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.29	45.73	66.49	0.50	1.00	0.80		
													0.86	1.00	NO
16th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	46.67	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	46.01	104.32	0.50	1.00	0.51		
					W8-L	0.68	0.99	1.36	48.11	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	47.30	104.32	0.50	1.00	1.03		
16th	R5	Residential	Bedroom										1.66	2.00	NO
					W9-L	0.68	0.99	0.70	41.23	65.09	0.50	0.15	0.06		
					W9-U	0.68	0.99	1.29	40.96	65.09	0.50	1.00	0.73		
													0.79	1.00	NO
16th	R6	Residential	LKD												
					W10-L	0.68	0.99	0.70	43.28	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	42.64	121.62	0.50	1.00	0.41		
					W11-L	0.68	0.99	1.36	45.71	121.62	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W11-U	0.68	0.99	2.52	44.93	121.62	0.50	1.00	0.84	2.00	NO
													1.35		
16th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	39.56	56.77	0.50	0.15	0.07	1.00	NO
					W12-U	0.68	0.99	1.29	39.33	56.77	0.50	1.00	0.80		
16th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	40.49	56.45	0.50	0.15	0.07	1.00	NO
					W13-U	0.68	0.99	1.29	40.31	56.45	0.50	1.00	0.83		
													0.90	1.00	NO
16th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	44.64	119.79	0.50	0.15	0.04		
					W14-U	0.68	0.99	1.29	44.08	119.79	0.50	1.00	0.43		
					W15-L	0.68	0.99	1.36	47.63	119.79	0.50	0.15	0.07		
					W15-U	0.68	0.99	2.52	46.93	119.79	0.50	1.00	0.89		
													1.42	2.00	NO
16th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	43.63	59.49	0.50	0.15	0.07		
					W16-U	0.68	0.99	1.29	43.47	59.49	0.50	1.00	0.85		
					W17-L	0.68	0.99	0.36	48.57	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	48.67	59.49	0.50	1.00	0.49		
													1.45	1.00	YES
17th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.79	125.20	0.50	1.00	0.99		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.88	125.20	0.50	1.00	0.84		
					W4-L	0.68	0.99	0.70	51.55	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	51.26	125.20	0.50	1.00	0.48		
													3.42	2.00	YES
17th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	48.85	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	48.57	66.26	0.50	1.00	0.85		
													0.92	1.00	NO
17th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	46.44	66.49	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.29	46.16	66.49	0.50	1.00	0.81		
													0.87	1.00	NO
17th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	47.12	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	46.45	104.32	0.50	1.00	0.52		
					W8-L	0.68	0.99	1.36	48.56	104.32	0.50	0.15	0.09		
					W8-U	0.68	0.99	2.52	47.75	104.32	0.50	1.00	1.04		
													1.68	2.00	NO
17th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	41.73	65.09	0.50	0.15	0.06		
					W9-U	0.68	0.99	1.29	41.44	65.09	0.50	1.00	0.74		
													0.80	1.00	NO
17th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	43.79	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	43.12	121.62	0.50	1.00	0.41		
					W11-L	0.68	0.99	1.36	46.21	121.62	0.50	0.15	0.07		
					W11-U	0.68	0.99	2.52	45.39	121.62	0.50	1.00	0.84		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
17th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	40.11	56.77	0.50	0.15	1.36	2.00	NO
					W12-U	0.68	0.99	1.29	39.83	56.77	0.50	1.00	0.07		
17th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	41.08	56.45	0.50	0.15	0.88	1.00	NO
					W13-U	0.68	0.99	1.29	40.79	56.45	0.50	1.00	0.07		
17th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	45.21	119.79	0.50	0.15	0.91	1.00	NO
					W14-U	0.68	0.99	1.29	44.54	119.79	0.50	1.00	0.04		
17th	R9		Residential	LKD	W15-L	0.68	0.99	1.36	48.20	119.79	0.50	0.15	0.43		
					W15-U	0.68	0.99	2.52	47.39	119.79	0.50	1.00	0.07		
17th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	1.44	2.00	NO
					W16-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.90		
17th	R10		Residential	Bedroom	W17-L	0.68	0.99	0.36	49.07	59.49	0.50	0.15	0.07		
					W17-U	0.68	0.99	0.67	49.13	59.49	0.50	1.00	0.86		
18th	R1		Residential	LKD	W16-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	1.46	1.00	YES
					W16-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R1		Residential	LKD	W17-L	0.68	0.99	0.36	49.07	59.49	0.50	0.15	0.86		
					W17-U	0.68	0.99	0.67	49.13	59.49	0.50	1.00	0.04		
18th	R1		Residential	LKD	W18-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.50		
					W18-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R2		Residential	Bedroom	W19-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.48		
					W19-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R2		Residential	Bedroom	W20-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.86		
					W20-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R3		Residential	Bedroom	W21-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.93	1.00	NO
					W21-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R3		Residential	Bedroom	W22-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.81		
					W22-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R4		Residential	LKD	W23-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.88	1.00	NO
					W23-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		
18th	R4		Residential	LKD	W24-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.04		
					W24-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.52		
18th	R5		Residential	Bedroom	W25-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.09		
					W25-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	1.05		
18th	R5		Residential	Bedroom	W26-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	1.70	2.00	NO
					W26-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.06		
18th	R6		Residential	LKD	W27-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.75		
					W27-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.81	1.00	NO
18th	R6		Residential	LKD	W28-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.03		
					W28-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.42		
18th	R6		Residential	LKD	W29-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	0.07		
					W29-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.86		
18th	R6		Residential	LKD	W30-L	0.68	0.99	0.70	44.22	59.49	0.50	0.15	1.38	2.00	NO
					W30-U	0.68	0.99	1.29	43.95	59.49	0.50	1.00	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
18th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	40.65	56.77	0.50	0.15	0.07	1.00	
					W12-U	0.68	0.99	1.29	40.41	56.77	0.50	1.00	0.83		
18th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	41.61	56.45	0.50	0.15	0.07	1.00	
					W13-U	0.68	0.99	1.29	41.37	56.45	0.50	1.00	0.85		
18th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	45.72	119.79	0.50	0.15	0.04	2.00	NO
					W14-U	0.68	0.99	1.29	45.09	119.79	0.50	1.00	0.44		
					W15-L	0.68	0.99	1.36	48.70	119.79	0.50	0.15	0.07		
					W15-U	0.68	0.99	2.52	47.92	119.79	0.50	1.00	0.91		
18th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	44.74	59.49	0.50	0.15	0.07	1.00	
					W16-U	0.68	0.99	1.29	44.49	59.49	0.50	1.00	0.87		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
19th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.95	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.08	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	52.46	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	52.22	125.20	0.50	1.00	0.48		
19th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	49.82	66.26	0.50	0.15	0.07	1.00	
					W5-U	0.68	0.99	1.29	49.59	66.26	0.50	1.00	0.87		
19th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	47.45	66.49	0.50	0.15	0.07	1.00	
					W6-U	0.68	0.99	1.29	47.24	66.49	0.50	1.00	0.82		
19th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	48.17	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	47.58	104.32	0.50	1.00	0.53		
					W8-L	0.68	0.99	1.36	49.62	104.32	0.50	0.15	0.09		
					W8-U	0.68	0.99	2.52	48.89	104.32	0.50	1.00	1.06		
19th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	42.86	65.09	0.50	0.15	0.06	1.00	
					W9-U	0.68	0.99	1.29	42.66	65.09	0.50	1.00	0.76		
19th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	44.92	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	44.34	121.62	0.50	1.00	0.42		
					W11-L	0.68	0.99	1.36	47.32	121.62	0.50	0.15	0.07		
					W11-U	0.68	0.99	2.52	46.59	121.62	0.50	1.00	0.87		
19th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	41.29	56.77	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	41.10	56.77	0.50	1.00	0.84	1.00	NO
													0.91		
19th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	42.23	56.45	0.50	0.15	0.07	1.00	NO
					W13-U	0.68	0.99	1.29	42.04	56.45	0.50	1.00	0.86		
													0.93	1.00	NO
													0.04		
19th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	46.31	119.79	0.50	0.15	0.44	1.00	
					W14-U	0.68	0.99	1.29	45.72	119.79	0.50	1.00	0.08		
					W15-L	0.68	0.99	1.36	49.27	119.79	0.50	0.15	0.92	1.00	
					W15-U	0.68	0.99	2.52	48.54	119.79	0.50	1.00	1.47		
													2.00	NO	
													0.07		
19th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	45.32	59.49	0.50	0.15	0.88	1.00	
					W16-U	0.68	0.99	1.29	45.13	59.49	0.50	1.00	0.04		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.50	1.00	
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	1.49		
													1.00	YES	
													0.07		
20th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.84	1.00	
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.09		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	1.00	1.00	
					W2-U	0.68	0.99	3.57	39.02	125.20	0.50	1.00	0.07		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.85	1.00	
					W3-U	0.68	0.99	3.19	37.15	125.20	0.50	1.00	0.04		
					W4-L	0.68	0.99	0.70	53.03	125.20	0.50	0.15	0.49	1.00	
					W4-U	0.68	0.99	1.29	52.84	125.20	0.50	1.00	3.45		
													2.00	YES	
													0.07		
20th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	50.43	66.26	0.50	0.15	0.88	1.00	NO
					W5-U	0.68	0.99	1.29	50.26	66.26	0.50	1.00	0.95		
													1.00	NO	
													0.07		
20th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	48.11	66.49	0.50	0.15	0.84	1.00	NO
					W6-U	0.68	0.99	1.29	47.95	66.49	0.50	1.00	0.90		
													1.00	NO	
													0.04		
20th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	48.85	104.32	0.50	0.15	0.54	1.00	
					W7-U	0.68	0.99	1.29	48.31	104.32	0.50	1.00	0.09		
					W8-L	0.68	0.99	1.36	50.31	104.32	0.50	0.15	1.08	1.00	
					W8-U	0.68	0.99	2.52	49.64	104.32	0.50	1.00	1.75		
													2.00	NO	
													0.06		
20th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	43.59	65.09	0.50	0.15	0.77	1.00	NO
					W9-U	0.68	0.99	1.29	43.45	65.09	0.50	1.00	0.84		
													1.00	NO	
													0.04		
20th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	45.65	121.62	0.50	0.15	0.43	1.00	
					W10-U	0.68	0.99	1.29	45.13	121.62	0.50	1.00	0.07		
					W11-L	0.68	0.99	1.36	48.04	121.62	0.50	0.15	0.88	1.00	
					W11-U	0.68	0.99	2.52	47.37	121.62	0.50	1.00	1.42		
													2.00	NO	
													0.07		
20th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	42.05	56.77	0.50	0.15	0.86	1.00	
					W12-U	0.68	0.99	1.29	41.92	56.77	0.50	1.00			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
													0.93	1.00	NO
20th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	42.97	56.45	0.50	0.15	0.07		
					W13-U	0.68	0.99	1.29	42.83	56.45	0.50	1.00	0.88		
													0.95	1.00	NO
20th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	47.01	119.79	0.50	0.15	0.04		
					W14-U	0.68	0.99	1.29	46.48	119.79	0.50	1.00	0.45		
					W15-L	0.68	0.99	1.36	49.96	119.79	0.50	0.15	0.08		
					W15-U	0.68	0.99	2.52	49.28	119.79	0.50	1.00	0.93		
20th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	46.02	59.49	0.50	0.15	0.07		
					W16-U	0.68	0.99	1.29	45.87	59.49	0.50	1.00	0.89		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
21st	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.06	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.20	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	53.71	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	53.59	125.20	0.50	1.00	0.50		
21st	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	51.16	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	51.05	66.26	0.50	1.00	0.89		
													0.97	1.00	NO
21st	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	48.88	66.49	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.29	48.79	66.49	0.50	1.00	0.85		
													0.92	1.00	NO
21st	R4		Residential	LKD	W7-L	0.68	0.99	0.70	49.66	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	49.20	104.32	0.50	1.00	0.55		
					W8-L	0.68	0.99	1.36	51.14	104.32	0.50	0.15	0.09		
					W8-U	0.68	0.99	2.52	50.53	104.32	0.50	1.00	1.10		
21st	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	44.46	65.09	0.50	0.15	0.06		
					W9-U	0.68	0.99	1.29	44.40	65.09	0.50	1.00	0.79		
													0.86	1.00	NO
21st	R6		Residential	LKD	W10-L	0.68	0.99	0.70	46.53	121.62	0.50	0.15	0.04		
					W10-U	0.68	0.99	1.29	46.09	121.62	0.50	1.00	0.44		
					W11-L	0.68	0.99	1.36	48.91	121.62	0.50	0.15	0.07		
					W11-U	0.68	0.99	2.52	48.31	121.62	0.50	1.00	0.90		
21st	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	42.96	56.77	0.50	0.15	0.07		
					W12-U	0.68	0.99	1.29	42.91	56.77	0.50	1.00	0.88		
													0.95	1.00	NO

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
21st	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	43.85	56.45	0.50	0.15	0.07	1.00	
					W13-U	0.68	0.99	1.29	43.78	56.45	0.50	1.00	0.90		
21st	R9		Residential	LKD	W14-L	0.68	0.99	0.70	47.85	119.79	0.50	0.15	0.04	2.00	NO
					W14-U	0.68	0.99	1.29	47.39	119.79	0.50	1.00	0.46		
					W15-L	0.68	0.99	1.36	50.78	119.79	0.50	0.15	0.08		
					W15-U	0.68	0.99	2.52	50.18	119.79	0.50	1.00	0.95		
21st	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	46.85	59.49	0.50	0.15	0.07	1.00	
					W16-U	0.68	0.99	1.29	46.77	59.49	0.50	1.00	0.91		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
22nd	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	54.55	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	54.48	125.20	0.50	1.00	0.50		
22nd	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	52.05	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	52.01	66.26	0.50	1.00	0.91		
22nd	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	49.83	66.49	0.50	0.15	0.07	1.00	
					W6-U	0.68	0.99	1.29	49.81	66.49	0.50	1.00	0.87		
22nd	R4		Residential	LKD	W7-L	0.68	0.99	0.70	50.65	104.32	0.50	0.15	0.05	2.00	NO
					W7-U	0.68	0.99	1.29	50.27	104.32	0.50	1.00	0.56		
					W8-L	0.68	0.99	1.36	52.14	104.32	0.50	0.15	0.09		
					W8-U	0.68	0.99	2.52	51.62	104.32	0.50	1.00	1.12		
22nd	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	45.52	65.09	0.50	0.15	0.07	1.00	NO
					W9-U	0.68	0.99	1.29	45.55	65.09	0.50	1.00	0.81		
22nd	R6		Residential	LKD	W10-L	0.68	0.99	0.70	47.60	121.62	0.50	0.15	0.04	2.00	NO
					W10-U	0.68	0.99	1.29	47.25	121.62	0.50	1.00	0.45		
					W11-L	0.68	0.99	1.36	49.96	121.62	0.50	0.15	0.08		
					W11-U	0.68	0.99	2.52	49.45	121.62	0.50	1.00	0.92		
22nd	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	44.06	56.77	0.50	0.15	0.07	1.00	NO
					W12-U	0.68	0.99	1.29	44.09	56.77	0.50	1.00	0.90		
22nd	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	44.91	56.45	0.50	0.15	0.07		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
22nd	R9	Residential	LKD		W13-U	0.68	0.99	1.29	44.94	56.45	0.50	1.00	0.92	1.00	YES
					W14-L	0.68	0.99	0.70	48.86	119.79	0.50	0.15	0.04		
					W14-U	0.68	0.99	1.29	48.49	119.79	0.50	1.00	0.47		
					W15-L	0.68	0.99	1.36	51.78	119.79	0.50	0.15	0.08		
22nd	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	51.26	119.79	0.50	1.00	0.97	2.00	NO
					W16-L	0.68	0.99	0.70	47.83	59.49	0.50	0.15	0.08		
					W16-U	0.68	0.99	1.29	47.83	59.49	0.50	1.00	0.93		
					W17-L	0.68	0.99	0.36	49.33	59.49	0.50	0.15	0.04		
23rd	R1	Residential	LKD		W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50	1.00	YES
					W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
23rd	R2	Residential	Bedroom		W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	1.00	2.00	YES
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	55.54	125.20	0.50	0.15	0.04		
23rd	R3	Residential	Bedroom		W4-U	0.68	0.99	1.29	55.55	125.20	0.50	1.00	0.51	1.00	YES
					W5-L	0.68	0.99	0.70	53.11	66.26	0.50	0.15	0.08		
					W5-U	0.68	0.99	1.29	53.16	66.26	0.50	1.00	0.93		
					W6-L	0.68	0.99	0.70	50.95	66.49	0.50	0.15	0.07		
23rd	R4	Residential	LKD		W6-U	0.68	0.99	1.29	51.03	66.49	0.50	1.00	0.89	1.00	NO
					W7-L	0.68	0.99	0.70	51.83	104.32	0.50	0.15	0.05		
					W7-U	0.68	0.99	1.29	51.56	104.32	0.50	1.00	0.57		
					W8-L	0.68	0.99	1.36	53.34	104.32	0.50	0.15	0.09		
23rd	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	52.93	104.32	0.50	1.00	1.15	2.00	NO
					W9-L	0.68	0.99	0.70	46.78	65.09	0.50	0.15	0.07		
					W9-U	0.68	0.99	1.29	46.92	65.09	0.50	1.00	0.84		
					W10-L	0.68	0.99	0.70	48.88	121.62	0.50	0.15	0.04		
23rd	R6	Residential	LKD		W10-U	0.68	0.99	1.29	48.64	121.62	0.50	1.00	0.46	2.00	NO
					W11-L	0.68	0.99	1.36	51.21	121.62	0.50	0.15	0.08		
					W11-U	0.68	0.99	2.52	50.82	121.62	0.50	1.00	0.95		
					W12-L	0.68	0.99	0.70	45.35	56.77	0.50	0.15	0.08		
23rd	R7	Residential	Bedroom		W12-U	0.68	0.99	1.29	45.51	56.77	0.50	1.00	0.93	1.00	YES
					W13-L	0.68	0.99	0.70	46.17	56.45	0.50	0.15	0.08		
					W13-U	0.68	0.99	1.29	46.30	56.45	0.50	1.00	0.95		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
23rd	R9		Residential	LKD	W14-L	0.68	0.99	0.70	50.08	119.79	0.50	0.15	1.03	1.00	YES
					W14-U	0.68	0.99	1.29	49.81	119.79	0.50	1.00	0.48		
					W15-L	0.68	0.99	1.36	52.97	119.79	0.50	0.15	0.08		
					W15-U	0.68	0.99	2.52	52.54	119.79	0.50	1.00	0.99		
													1.60	2.00	NO
23rd	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	49.00	59.49	0.50	0.15	0.08		
					W16-U	0.68	0.99	1.29	49.09	59.49	0.50	1.00	0.96		
					W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.21	59.49	0.50	1.00	0.50		
													1.57	1.00	YES
24th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	56.73	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	56.84	125.20	0.50	1.00	0.53		
													3.50	2.00	YES
24th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	54.40	66.26	0.50	0.15	0.08		
					W5-U	0.68	0.99	1.29	54.55	66.26	0.50	1.00	0.96		
24th	R3		Residential	Bedroom									1.03	1.00	YES
					W6-L	0.68	0.99	0.70	52.32	66.49	0.50	0.15	0.07		
					W6-U	0.68	0.99	1.29	52.52	66.49	0.50	1.00	0.92		
24th	R4		Residential	LKD									0.99	1.00	NO
					W7-L	0.68	0.99	0.70	53.28	104.32	0.50	0.15	0.05		
					W7-U	0.68	0.99	1.29	53.13	104.32	0.50	1.00	0.59		
					W8-L	0.68	0.99	1.36	54.82	104.32	0.50	0.15	0.10		
					W8-U	0.68	0.99	2.52	54.54	104.32	0.50	1.00	1.18		
24th	R5		Residential	Bedroom									1.92	2.00	NO
					W9-L	0.68	0.99	0.70	48.32	65.09	0.50	0.15	0.07		
					W9-U	0.68	0.99	1.29	48.59	65.09	0.50	1.00	0.87		
24th	R6		Residential	LKD									0.94	1.00	NO
					W10-L	0.68	0.99	0.70	50.44	121.62	0.50	0.15	0.04		
					W10-U	0.68	0.99	1.29	50.34	121.62	0.50	1.00	0.48		
					W11-L	0.68	0.99	1.36	52.75	121.62	0.50	0.15	0.08		
					W11-U	0.68	0.99	2.52	52.51	121.62	0.50	1.00	0.98		
24th	R7		Residential	Bedroom									1.58	2.00	NO
					W12-L	0.68	0.99	0.70	46.94	56.77	0.50	0.15	0.08		
					W12-U	0.68	0.99	1.29	47.23	56.77	0.50	1.00	0.97		
24th	R8		Residential	Bedroom									1.04	1.00	YES
					W13-L	0.68	0.99	0.70	47.70	56.45	0.50	0.15	0.08		
					W13-U	0.68	0.99	1.29	47.97	56.45	0.50	1.00	0.99		
													1.07	1.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
24th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	51.55	119.79	0.50	0.15	0.04		
					W14-U	0.68	0.99	1.29	51.41	119.79	0.50	1.00	0.50		
					W15-L	0.68	0.99	1.36	54.41	119.79	0.50	0.15	0.08		
					W15-U	0.68	0.99	2.52	54.11	119.79	0.50	1.00	1.02		
								1.64	2.00	NO					
24th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	50.39	59.49	0.50	0.15	0.08		
					W16-U	0.68	0.99	1.29	50.60	59.49	0.50	1.00	0.99		
					W17-L	0.68	0.99	0.36	49.34	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50		
								1.60	1.00	YES					
25th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	58.17	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	58.39	125.20	0.50	1.00	0.54		
								3.51	2.00	YES					
25th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	55.95	66.26	0.50	0.15	0.08		
					W5-U	0.68	0.99	1.29	56.23	66.26	0.50	1.00	0.98		
													1.06	1.00	YES
25th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	53.98	66.49	0.50	0.15	0.08		
					W6-U	0.68	0.99	1.29	54.31	66.49	0.50	1.00	0.95		
													1.02	1.00	YES
25th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	55.04	104.32	0.50	0.15	0.05		
					W7-U	0.68	0.99	1.29	55.04	104.32	0.50	1.00	0.61		
					W8-L	0.68	0.99	1.36	56.62	104.32	0.50	0.15	0.10		
					W8-U	0.68	0.99	2.52	56.49	104.32	0.50	1.00	1.23		
													1.99	2.00	NO
25th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	50.18	65.09	0.50	0.15	0.07		
					W9-U	0.68	0.99	1.29	50.60	65.09	0.50	1.00	0.90		
													0.97	1.00	NO
25th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	52.33	121.62	0.50	0.15	0.04		
					W10-U	0.68	0.99	1.29	52.39	121.62	0.50	1.00	0.50		
					W11-L	0.68	0.99	1.36	54.63	121.62	0.50	0.15	0.08		
					W11-U	0.68	0.99	2.52	54.54	121.62	0.50	1.00	1.02		
													1.64	2.00	NO
25th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	48.86	56.77	0.50	0.15	0.08		
					W12-U	0.68	0.99	1.29	49.30	56.77	0.50	1.00	1.01		
													1.09	1.00	YES
25th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	49.54	56.45	0.50	0.15	0.08		
					W13-U	0.68	0.99	1.29	49.96	56.45	0.50	1.00	1.03		
													1.11	1.00	YES
25th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	53.33	119.79	0.50	0.15	0.04		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	53.33	119.79	0.50	1.00	0.52	2.00	NO
					W15-L	0.68	0.99	1.36	56.16	119.79	0.50	0.15	0.09		
					W15-U	0.68	0.99	2.52	56.00	119.79	0.50	1.00	1.06		
25th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	52.07	59.49	0.50	0.15	0.08	1.00	YES
					W16-U	0.68	0.99	1.29	52.40	59.49	0.50	1.00	1.02		
					W17-L	0.68	0.99	0.36	49.35	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.22	59.49	0.50	1.00	0.50		
													1.64		
26th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	59.89	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	60.24	125.20	0.50	1.00	0.56		
													3.53		
26th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	57.81	66.26	0.50	0.15	0.08	1.00	YES
					W5-U	0.68	0.99	1.29	58.23	66.26	0.50	1.00	1.02		
26th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	55.96	66.49	0.50	0.15	0.08	1.00	YES
					W6-U	0.68	0.99	1.29	56.44	66.49	0.50	1.00	0.99		
													1.06		
26th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	57.15	104.32	0.50	0.15	0.05	2.00	YES
					W7-U	0.68	0.99	1.29	57.32	104.32	0.50	1.00	0.64		
					W8-L	0.68	0.99	1.36	58.79	104.32	0.50	0.15	0.10		
					W8-U	0.68	0.99	2.52	58.84	104.32	0.50	1.00	1.28		
26th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	52.40	65.09	0.50	0.15	0.08	1.00	YES
					W9-U	0.68	0.99	1.29	53.00	65.09	0.50	1.00	0.94		
													1.02		
26th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	54.60	121.62	0.50	0.15	0.04	2.00	NO
					W10-U	0.68	0.99	1.29	54.84	121.62	0.50	1.00	0.52		
					W11-L	0.68	0.99	1.36	56.89	121.62	0.50	0.15	0.09		
					W11-U	0.68	0.99	2.52	56.98	121.62	0.50	1.00	1.06		
26th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	51.14	56.77	0.50	0.15	0.08	1.00	YES
					W12-U	0.68	0.99	1.29	51.76	56.77	0.50	1.00	1.06		
													1.14		
26th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	51.74	56.45	0.50	0.15	0.09	1.00	YES
					W13-U	0.68	0.99	1.29	52.32	56.45	0.50	1.00	1.08		
26th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	55.46	119.79	0.50	0.15	0.04	1.00	
					W14-U	0.68	0.99	1.29	55.63	119.79	0.50	1.00	0.54		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W15-L	0.68	0.99	1.36	58.26	119.79	0.50	0.15	0.09		
					W15-U	0.68	0.99	2.52	58.27	119.79	0.50	1.00	1.10		
26th	R10	Residential	Bedroom										1.77	2.00	NO
					W16-L	0.68	0.99	0.70	54.05	59.49	0.50	0.15	0.09		
					W16-U	0.68	0.99	1.29	54.53	59.49	0.50	1.00	1.06		
					W17-L	0.68	0.99	0.36	49.36	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.23	59.49	0.50	1.00	0.50		
													1.69	1.00	YES
27th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	61.92	125.20	0.50	0.15	0.05		
					W4-U	0.68	0.99	1.29	62.40	125.20	0.50	1.00	0.58		
27th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	60.02	66.26	0.50	0.15	0.09		
					W5-U	0.68	0.99	1.29	60.59	66.26	0.50	1.00	1.06		
27th	R3	Residential	Bedroom										1.15	1.00	YES
					W6-L	0.68	0.99	0.70	58.32	66.49	0.50	0.15	0.08		
27th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	58.97	66.49	0.50	1.00	1.03		
													1.11	1.00	YES
27th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	59.69	104.32	0.50	0.15	0.05		
					W7-U	0.68	0.99	1.29	60.04	104.32	0.50	1.00	0.67		
					W8-L	0.68	0.99	1.36	61.41	104.32	0.50	0.15	0.11		
					W8-U	0.68	0.99	2.52	61.64	104.32	0.50	1.00	1.34		
27th	R5	Residential	Bedroom										2.17	2.00	YES
					W9-L	0.68	0.99	0.70	55.05	65.09	0.50	0.15	0.08		
27th	R6	Residential	LKD		W9-U	0.68	0.99	1.29	55.84	65.09	0.50	1.00	1.00		
													1.07	1.00	YES
27th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	57.31	121.62	0.50	0.15	0.04		
					W10-U	0.68	0.99	1.29	57.75	121.62	0.50	1.00	0.55		
					W11-L	0.68	0.99	1.36	59.61	121.62	0.50	0.15	0.09		
					W11-U	0.68	0.99	2.52	59.90	121.62	0.50	1.00	1.11		
27th	R7	Residential	Bedroom										1.80	2.00	NO
					W12-L	0.68	0.99	0.70	53.85	56.77	0.50	0.15	0.09		
27th	R8	Residential	Bedroom		W12-U	0.68	0.99	1.29	54.67	56.77	0.50	1.00	1.12		
													1.21	1.00	YES
27th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	54.34	56.45	0.50	0.15	0.09		
					W13-U	0.68	0.99	1.29	55.11	56.45	0.50	1.00	1.13		
27th	R9	Residential	LKD										1.22	1.00	YES
					W14-L	0.68	0.99	0.70	58.00	119.79	0.50	0.15	0.05		
27th					W14-U	0.68	0.99	1.29	58.36	119.79	0.50	1.00	0.57		
					W15-L	0.68	0.99	1.36	60.77	119.79	0.50	0.15	0.09		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W15-U	0.68	0.99	2.52	60.95	119.79	0.50	1.00	1.15		
													1.86	2.00	NO
27th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	56.40	59.49	0.50	0.15	0.09		
					W16-U	0.68	0.99	1.29	57.04	59.49	0.50	1.00	1.11		
					W17-L	0.68	0.99	0.36	49.37	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.24	59.49	0.50	1.00	0.50		
													1.74	1.00	YES
28th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	64.30	125.20	0.50	0.15	0.05		
					W4-U	0.68	0.99	1.29	64.91	125.20	0.50	1.00	0.60		
													3.58	2.00	YES
28th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	62.61	66.26	0.50	0.15	0.09		
					W5-U	0.68	0.99	1.29	63.32	66.26	0.50	1.00	1.11		
													1.20	1.00	YES
28th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	61.09	66.49	0.50	0.15	0.09		
					W6-U	0.68	0.99	1.29	61.90	66.49	0.50	1.00	1.08		
													1.17	1.00	YES
28th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	62.68	104.32	0.50	0.15	0.06		
					W7-U	0.68	0.99	1.29	63.21	104.32	0.50	1.00	0.70		
					W8-L	0.68	0.99	1.36	64.51	104.32	0.50	0.15	0.11		
					W8-U	0.68	0.99	2.52	64.93	104.32	0.50	1.00	1.41		
													2.28	2.00	YES
28th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	58.15	65.09	0.50	0.15	0.08		
					W9-U	0.68	0.99	1.29	59.12	65.09	0.50	1.00	1.05		
													1.14	1.00	YES
28th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	60.51	121.62	0.50	0.15	0.05		
					W10-U	0.68	0.99	1.29	61.14	121.62	0.50	1.00	0.58		
					W11-L	0.68	0.99	1.36	62.83	121.62	0.50	0.15	0.09		
					W11-U	0.68	0.99	2.52	63.31	121.62	0.50	1.00	1.18		
													1.90	2.00	NO
28th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	57.01	56.77	0.50	0.15	0.09		
					W12-U	0.68	0.99	1.29	58.02	56.77	0.50	1.00	1.19		
													1.28	1.00	YES
28th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	57.39	56.45	0.50	0.15	0.10		
					W13-U	0.68	0.99	1.29	58.34	56.45	0.50	1.00	1.20		
													1.29	1.00	YES
28th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	60.99	119.79	0.50	0.15	0.05		
					W14-U	0.68	0.99	1.29	61.53	119.79	0.50	1.00	0.60		
					W15-L	0.68	0.99	1.36	63.75	119.79	0.50	0.15	0.10		
					W15-U	0.68	0.99	2.52	64.11	119.79	0.50	1.00	1.21		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
28th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	59.14	59.49	0.50	0.15	1.95	2.00	NO
					W16-U	0.68	0.99	1.29	59.95	59.49	0.50	1.00	0.09		
					W17-L	0.68	0.99	0.36	49.40	59.49	0.50	0.15	1.17		
					W17-U	0.68	0.99	0.67	49.26	59.49	0.50	1.00	0.04		
													0.50		
29th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	1.80	1.00	YES
					W1-U	0.68	0.99	3.19	36.54	125.20	0.50	1.00	0.07		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.84		
					W2-U	0.68	0.99	3.57	39.07	125.20	0.50	1.00	0.09		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	1.00		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.07		
					W4-L	0.68	0.99	0.70	67.00	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	67.73	125.20	0.50	1.00	0.05		
													0.63		
													3.60	2.00	YES
29th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	65.56	66.26	0.50	0.15	0.09		
					W5-U	0.68	0.99	1.29	66.42	66.26	0.50	1.00	1.16		
29th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	64.26	66.49	0.50	0.15	1.26	1.00	YES
					W6-U	0.68	0.99	1.29	65.22	66.49	0.50	1.00	0.09		
29th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	66.15	104.32	0.50	0.15	1.14		
					W7-U	0.68	0.99	1.29	66.84	104.32	0.50	1.00	1.23	1.00	YES
					W8-L	0.68	0.99	1.36	68.13	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	68.70	104.32	0.50	1.00	0.74		
													0.12		
29th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	61.70	65.09	0.50	0.15	1.49		
					W9-U	0.68	0.99	1.29	62.84	65.09	0.50	1.00	2.41	2.00	YES
29th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	64.21	121.62	0.50	0.15	0.09		
					W10-U	0.68	0.99	1.29	65.02	121.62	0.50	1.00	1.12		
					W11-L	0.68	0.99	1.36	66.59	121.62	0.50	0.15	1.21	1.00	YES
					W11-U	0.68	0.99	2.52	67.25	121.62	0.50	1.00	0.05		
													0.62		
29th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	60.64	56.77	0.50	0.15	0.10		
					W12-U	0.68	0.99	1.29	61.82	56.77	0.50	1.00	1.27		
29th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	60.88	56.45	0.50	0.15	1.36	1.00	YES
					W13-U	0.68	0.99	1.29	62.00	56.45	0.50	1.00	0.10		
29th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	64.46	119.79	0.50	0.15	1.38	1.00	YES
					W14-U	0.68	0.99	1.29	65.17	119.79	0.50	1.00	1.27		
					W15-L	0.68	0.99	1.36	67.22	119.79	0.50	0.15	0.10		
					W15-U	0.68	0.99	2.52	67.75	119.79	0.50	1.00	1.28		
													2.06	2.00	YES

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
29th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	62.29	59.49	0.50	0.15	0.10	1.00	YES
					W16-U	0.68	0.99	1.29	63.25	59.49	0.50	1.00	1.23		
					W17-L	0.68	0.99	0.36	49.46	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.32	59.49	0.50	1.00	0.50		
													1.87		
30th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	36.55	125.20	0.50	1.00	0.84		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	39.08	125.20	0.50	1.00	1.00		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.22	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	69.97	125.20	0.50	0.15	0.05		
					W4-U	0.68	0.99	1.29	70.75	125.20	0.50	1.00	0.66		
													3.63		
30th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	68.83	66.26	0.50	0.15	0.10	1.00	YES
					W5-U	0.68	0.99	1.29	69.75	66.26	0.50	1.00	1.22		
30th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	67.78	66.49	0.50	0.15	0.10	1.00	YES
					W6-U	0.68	0.99	1.29	68.82	66.49	0.50	1.00	1.20		
													1.30		
30th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	70.03	104.32	0.50	0.15	0.06	2.00	YES
					W7-U	0.68	0.99	1.29	70.82	104.32	0.50	1.00	0.79		
					W8-L	0.68	0.99	1.36	72.19	104.32	0.50	0.15	0.13		
					W8-U	0.68	0.99	2.52	72.88	104.32	0.50	1.00	1.58		
													2.56		
30th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	65.65	65.09	0.50	0.15	0.09	1.00	YES
					W9-U	0.68	0.99	1.29	66.90	65.09	0.50	1.00	1.19		
													1.29		
30th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	68.36	121.62	0.50	0.15	0.05	2.00	YES
					W10-U	0.68	0.99	1.29	69.29	121.62	0.50	1.00	0.66		
					W11-L	0.68	0.99	1.36	70.83	121.62	0.50	0.15	0.11		
					W11-U	0.68	0.99	2.52	71.61	121.62	0.50	1.00	1.33		
													2.15		
30th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	64.69	56.77	0.50	0.15	0.11	1.00	YES
					W12-U	0.68	0.99	1.29	65.99	56.77	0.50	1.00	1.35		
													1.46		
30th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	64.78	56.45	0.50	0.15	0.11	1.00	YES
					W13-U	0.68	0.99	1.29	66.03	56.45	0.50	1.00	1.36		
													1.46		
30th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	68.38	119.79	0.50	0.15	0.05	2.00	YES
					W14-U	0.68	0.99	1.29	69.21	119.79	0.50	1.00	0.67		
					W15-L	0.68	0.99	1.36	71.15	119.79	0.50	0.15	0.11		
					W15-U	0.68	0.99	2.52	71.81	119.79	0.50	1.00	1.36		
													2.19		
30th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	65.82	59.49	0.50	0.15	0.10		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	66.90	59.49	0.50	1.00	1.31		
					W17-L	0.68	0.99	0.36	49.55	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	49.44	59.49	0.50	1.00	0.50		
													1.95	1.00	YES
31st	R1	Residential	LKD	W1-L	0.68	0.99	1.72	40.58	125.20	0.50	0.15	0.08			
				W1-U	0.68	0.99	3.19	36.63	125.20	0.50	1.00	0.84			
				W2-L	0.68	0.99	1.93	43.53	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	39.14	125.20	0.50	1.00	1.00			
				W3-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.19	37.26	125.20	0.50	1.00	0.85			
				W4-L	0.68	0.99	0.70	73.04	125.20	0.50	0.15	0.05			
				W4-U	0.68	0.99	1.29	73.81	125.20	0.50	1.00	0.68			
													3.67	2.00	YES
31st	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	72.24	66.26	0.50	0.15	0.10			
				W5-U	0.68	0.99	1.29	73.16	66.26	0.50	1.00	1.28			
													1.38	1.00	YES
31st	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	71.48	66.49	0.50	0.15	0.10			
				W6-U	0.68	0.99	1.29	72.53	66.49	0.50	1.00	1.27			
													1.37	1.00	YES
31st	R4	Residential	LKD	W7-L	0.68	0.99	0.70	74.19	104.32	0.50	0.15	0.07			
				W7-U	0.68	0.99	1.29	75.00	104.32	0.50	1.00	0.83			
				W8-L	0.68	0.99	1.36	76.63	104.32	0.50	0.15	0.13			
				W8-U	0.68	0.99	2.52	77.34	104.32	0.50	1.00	1.68			
													2.71	2.00	YES
31st	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	69.84	65.09	0.50	0.15	0.10			
				W9-U	0.68	0.99	1.29	71.13	65.09	0.50	1.00	1.27			
													1.37	1.00	YES
31st	R6	Residential	LKD	W10-L	0.68	0.99	0.70	72.83	121.62	0.50	0.15	0.06			
				W10-U	0.68	0.99	1.29	73.80	121.62	0.50	1.00	0.70			
				W11-L	0.68	0.99	1.36	75.46	121.62	0.50	0.15	0.11			
				W11-U	0.68	0.99	2.52	76.30	121.62	0.50	1.00	1.42			
													2.29	2.00	YES
31st	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	69.01	56.77	0.50	0.15	0.11			
				W12-U	0.68	0.99	1.29	70.36	56.77	0.50	1.00	1.44			
													1.55	1.00	YES
31st	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	68.97	56.45	0.50	0.15	0.11			
				W13-U	0.68	0.99	1.29	70.28	56.45	0.50	1.00	1.44			
													1.56	1.00	YES
31st	R9	Residential	LKD	W14-L	0.68	0.99	0.70	72.63	119.79	0.50	0.15	0.06			
				W14-U	0.68	0.99	1.29	73.52	119.79	0.50	1.00	0.71			
				W15-L	0.68	0.99	1.36	75.49	119.79	0.50	0.15	0.12			
				W15-U	0.68	0.99	2.52	76.20	119.79	0.50	1.00	1.44			
													2.32	2.00	YES
31st	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	69.64	59.49	0.50	0.15	0.11			
				W16-U	0.68	0.99	1.29	70.78	59.49	0.50	1.00	1.38			

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-L	0.68	0.99	0.36	49.76	59.49	0.50	0.15	0.04	1.00	YES
					W17-U	0.68	0.99	0.67	49.73	59.49	0.50	1.00	0.50		
32nd	R1		Residential	Bedroom	W1-L	0.68	0.99	0.71	63.31	204.87	0.50	0.15	0.03	2.03	
					W1-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44		
					W2-L	0.68	0.99	0.71	62.13	204.87	0.50	0.15	0.03		
					W2-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44		
					W3-L	0.68	0.99	1.51	75.84	204.87	0.50	0.15	0.08		
					W3-U	0.68	0.99	3.07	85.50	204.87	0.50	1.00	1.15		
					W4-L	0.68	0.99	1.51	74.26	204.87	0.50	0.15	0.07		
					W4-U	0.68	0.99	3.07	85.60	204.87	0.50	1.00	1.15		
					W5-L	0.68	0.99	0.46	40.16	204.87	0.50	0.15	0.01		
					W5-U	0.68	0.99	0.93	76.82	204.87	0.50	1.00	0.31		
					W6-L	0.68	0.99	0.46	43.05	204.87	0.50	0.15	0.01		
					W6-U	0.68	0.99	0.93	82.17	204.87	0.50	1.00	0.34		
					W7-L	0.68	0.99	0.46	40.16	204.87	0.50	0.15	0.01		
					W7-U	0.68	0.99	0.93	76.71	204.87	0.50	1.00	0.31		
					W8-L	0.68	0.99	0.70	39.85	204.87	0.50	0.15	0.02		
					W8-U	0.68	0.99	1.42	77.13	204.87	0.50	1.00	0.48		
													4.89	1.00	YES
32nd	R2		Residential	Bedroom	W9-L	0.68	0.99	0.70	39.85	83.23	0.50	0.15	0.04	1.00	YES
					W9-U	0.68	0.99	1.42	76.75	83.23	0.50	1.00	1.18		
					W10-L	0.68	0.99	0.46	40.16	83.23	0.50	0.15	0.03		
					W10-U	0.68	0.99	0.93	75.95	83.23	0.50	1.00	0.77		
					W11-L	0.68	0.99	0.46	43.05	83.23	0.50	0.15	0.03		
					W11-U	0.68	0.99	0.93	81.25	83.23	0.50	1.00	0.82		
					W12-L	0.68	0.99	0.46	40.16	83.23	0.50	0.15	0.03		
					W12-U	0.68	0.99	0.93	75.87	83.23	0.50	1.00	0.77		
													3.66	1.00	YES
32nd	R3		Residential	Bedroom	W13-L	0.68	0.99	0.46	40.16	74.19	0.50	0.15	0.03	1.00	YES
					W13-U	0.68	0.99	0.93	75.67	74.19	0.50	1.00	0.86		
					W14-L	0.68	0.99	0.46	43.05	74.19	0.50	0.15	0.04		
					W14-U	0.68	0.99	0.93	80.95	74.19	0.50	1.00	0.92		
					W15-L	0.68	0.99	0.46	40.16	74.19	0.50	0.15	0.03		
					W15-U	0.68	0.99	0.93	75.63	74.19	0.50	1.00	0.86		
													2.73	1.00	YES
32nd	R4		Residential	Bedroom	W16-L	0.68	0.99	1.04	43.20	134.08	0.50	0.15	0.05	1.00	YES
					W16-U	0.68	0.99	2.11	80.87	134.08	0.50	1.00	1.14		
					W17-L	0.68	0.99	1.04	43.20	134.08	0.50	0.15	0.05		
					W17-U	0.68	0.99	2.11	80.85	134.08	0.50	1.00	1.14		
					W18-L	0.68	0.99	0.70	39.85	134.08	0.50	0.15	0.03		
					W18-U	0.68	0.99	1.42	76.21	134.08	0.50	1.00	0.72		
													3.13	1.00	YES
32nd	R5		Residential	Bedroom	W19-L	0.68	0.99	0.46	40.04	63.41	0.50	0.15	0.04	1.00	
					W19-U	0.68	0.99	0.93	75.56	63.41	0.50	1.00	1.00		

Project Name: Stocktons, 140 Great Ancoats Street, Manchester M4 6DU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	0.46	42.94	63.41	0.50	0.15	0.04		
					W20-U	0.68	0.99	0.93	80.88	63.41	0.50	1.00	1.07		
					W21-L	0.68	0.99	0.46	40.16	63.41	0.50	0.15	0.04		
					W21-U	0.68	0.99	0.93	75.60	63.41	0.50	1.00	1.00		
													3.19	1.00	YES

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
Oxygen Towers															
00 GF	R1	Residential	Lobby	W1	0.68	0.99	3.12	24.11	729.43	0.50	1.00	0.09	1.58	-1.00	NO
				W2	0.68	0.99	0.91	13.35	729.43	0.50	1.00	0.01			
				W3	0.68	0.99	4.22	11.76	729.43	0.50	1.00	0.06			
				W4	0.68	0.99	4.22	11.08	729.43	0.50	1.00	0.06			
				W5	0.68	0.99	4.22	10.91	729.43	0.50	1.00	0.06			
				W6	0.68	0.99	4.22	10.91	729.43	0.50	1.00	0.06			
				W7	0.68	0.99	4.22	10.79	729.43	0.50	1.00	0.06			
				W8	0.68	0.99	4.22	10.73	729.43	0.50	1.00	0.06			
				W9	0.68	0.99	4.22	10.75	729.43	0.50	1.00	0.06			
				W10	0.68	0.99	4.22	10.63	729.43	0.50	1.00	0.06			
				W11	0.68	0.99	4.22	10.65	729.43	0.50	1.00	0.06			
				W12	0.68	0.99	4.22	11.85	729.43	0.50	1.00	0.06			
				W13	0.68	0.99	4.22	13.63	729.43	0.50	1.00	0.07			
				W14	0.68	0.99	4.22	15.49	729.43	0.50	1.00	0.08			
				W15	0.68	0.99	4.22	17.89	729.43	0.50	1.00	0.09			
				W16	0.68	0.99	4.22	19.74	729.43	0.50	1.00	0.10			
				W17	0.68	0.99	4.22	20.42	729.43	0.50	1.00	0.11			
				W18	0.68	0.99	4.29	20.87	729.43	0.50	1.00	0.11			
				W19-L	0.68	0.99	0.41	17.74	729.43	0.50	0.15	0.00			
				W19-U	0.68	0.99	1.39	12.92	729.43	0.50	1.00	0.02			
				W20-L	0.68	0.99	0.90	19.68	729.43	0.50	0.15	0.00			
				W20-U	0.68	0.99	1.46	17.35	729.43	0.50	1.00	0.03			
				W21-L	0.68	0.99	0.90	20.14	729.43	0.50	0.15	0.00			
				W21-U	0.68	0.99	1.46	17.08	729.43	0.50	1.00	0.03			
				W22-L	0.68	0.99	0.43	19.76	729.43	0.50	0.15	0.00			
				W22-U	0.68	0.99	1.46	11.73	729.43	0.50	1.00	0.02			
				W23	0.68	0.99	3.17	4.85	729.43	0.50	1.00	0.02			
				W24	0.68	0.99	4.31	21.11	729.43	0.50	1.00	0.11			
				W25	0.68	0.99	1.40	22.18	729.43	0.50	1.00	0.04			
				W26	0.68	0.99	3.12	14.21	729.43	0.50	1.00	0.05			
00 GF	R2	Residential	Office	W27-L	0.68	0.99	0.92	3.75	173.50	0.50	0.15	0.00	0.01	-1.00	NO
				W27-U	0.68	0.99	2.43	0.00	173.50	0.50	1.00	0.00			
				W28-L	0.68	0.99	0.87	4.08	173.50	0.50	0.15	0.00			
				W28-U	0.68	0.99	2.30	0.00	173.50	0.50	1.00	0.00			
01st	R1	Residential	Bedroom	W1-L	0.68	0.99	0.63	24.15	79.58	0.50	0.15	0.03	0.36	1.00	NO
				W1-U	0.68	0.99	1.28	23.48	79.58	0.50	1.00	0.34			
01st	R2	Residential	Bedroom	W2-L	0.68	0.99	0.63	20.73	66.30	0.50	0.15	0.03	0.37	1.00	NO
				W2-U	0.68	0.99	1.28	20.11	66.30	0.50	1.00	0.35			

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
01st	R3		Residential	LKD	W3-L	0.68	0.99	0.75	19.34	149.08	0.50	0.15	0.01		
					W3-U	0.68	0.99	1.51	18.23	149.08	0.50	1.00	0.17		
					W4-L	0.68	0.99	0.75	22.11	149.08	0.50	0.15	0.01		
					W4-U	0.68	0.99	1.51	19.86	149.08	0.50	1.00	0.18		
					W5	0.68	0.99	1.76	15.77	149.08	0.50	1.00	0.17		
								0.54	2.00	NO					
01st	R4	Residential	Bedroom	W6-L	0.68	0.99	0.64	21.79	61.38	0.50	0.15	0.03			
				W6-U	0.68	0.99	1.27	21.25	61.38	0.50	1.00	0.40			
							0.43	1.00	NO						
01st	R5	Residential	LKD	W7-L	0.68	0.99	0.75	22.30	110.38	0.50	0.15	0.02			
				W7-U	0.68	0.99	1.50	21.44	110.38	0.50	1.00	0.26			
				W8-L	0.68	0.99	0.75	22.45	110.38	0.50	0.15	0.02			
				W8-U	0.68	0.99	1.50	21.81	110.38	0.50	1.00	0.27			
							0.57	2.00	NO						
01st	R6	Residential	Bedroom	W9-L	0.68	0.99	0.64	16.73	63.77	0.50	0.15	0.02			
				W9-U	0.68	0.99	1.27	16.16	63.77	0.50	1.00	0.29			
							0.31	1.00	NO						
01st	R7	Residential	LKD	W10-L	0.68	0.99	0.75	11.62	120.57	0.50	0.15	0.01			
				W10-U	0.68	0.99	1.50	10.18	120.57	0.50	1.00	0.11			
				W11-L	0.68	0.99	0.75	10.28	120.57	0.50	0.15	0.01			
				W11-U	0.68	0.99	1.50	9.50	120.57	0.50	1.00	0.11			
							0.24	2.00	NO						
01st	R8	Residential	Bedroom	W12-L	0.68	0.99	0.64	7.51	63.77	0.50	0.15	0.01			
				W12-U	0.68	0.99	1.27	6.89	63.77	0.50	1.00	0.12			
							0.13	1.00	NO						
01st	R9	Residential	LKD	W13-L	0.68	0.99	0.75	7.56	120.31	0.50	0.15	0.01			
				W13-U	0.68	0.99	1.50	4.77	120.31	0.50	1.00	0.05			
				W14-L	0.68	0.99	0.75	4.38	120.31	0.50	0.15	0.00			
				W14-U	0.68	0.99	1.50	3.76	120.31	0.50	1.00	0.04			
							0.11	2.00	NO						
01st	R10	Residential	Bedroom	W15-L	0.68	0.99	0.64	1.91	63.92	0.50	0.15	0.00			
				W15-U	0.68	0.99	1.27	0.00	63.92	0.50	1.00	0.00			
							0.00	1.00	NO						
01st	R11	Residential	LKD	W16-L	0.68	0.99	0.75	6.72	121.43	0.50	0.15	0.01			
				W16-U	0.68	0.99	1.50	1.92	121.43	0.50	1.00	0.02			
				W17-L	0.68	0.99	0.75	4.67	121.43	0.50	0.15	0.00			
				W17-U	0.68	0.99	1.50	2.02	121.43	0.50	1.00	0.02			
							0.05	2.00	NO						
01st	R12	Residential	Bedroom	W18-L	0.68	0.99	0.75	7.20	64.74	0.50	0.15	0.01			
				W18-U	0.68	0.99	1.50	2.52	64.74	0.50	1.00	0.05			
				W19-L	0.68	0.99	0.75	5.64	64.74	0.50	0.15	0.01			
				W19-U	0.68	0.99	1.50	2.70	64.74	0.50	1.00	0.06			
							0.13	1.00	NO						
01st	R13	Residential	Bedroom	W20-L	0.68	0.99	0.64	5.76	64.85	0.50	0.15	0.01			
				W20-U	0.68	0.99	1.27	3.24	64.85	0.50	1.00	0.06			

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R1		Residential	Bedroom	W1-L	0.68	0.99	0.64	25.08	77.13	0.50	0.15	0.06	1.00	NO
					W1-U	0.68	0.99	1.22	24.55	77.13	0.50	1.00	0.03		
02nd	R2		Residential	LKD	W2-L	0.68	0.99	0.75	22.93	114.20	0.50	0.15	0.38	1.00	NO
					W2-U	0.68	0.99	1.44	22.02	114.20	0.50	1.00	0.02		
					W3-L	0.68	0.99	0.75	25.63	114.20	0.50	0.15	0.25		
					W3-U	0.68	0.99	1.44	23.78	114.20	0.50	1.00	0.02		
													0.27		
02nd	R3		Residential	Bedroom	W4-L	0.68	0.99	0.64	19.44	61.36	0.50	0.15	0.56	2.00	NO
					W4-U	0.68	0.99	1.22	18.99	61.36	0.50	1.00	0.03		
02nd	R4		Residential	LKD	W5-L	0.68	0.99	0.75	18.03	116.39	0.50	0.15	0.37	1.00	NO
					W5-U	0.68	0.99	1.44	17.04	116.39	0.50	1.00	0.03		
					W6-L	0.68	0.99	0.75	21.15	116.39	0.50	0.15	0.19		
					W6-U	0.68	0.99	1.44	19.11	116.39	0.50	1.00	0.02		
													0.21		
02nd	R5		Residential	Bedroom	W7-L	0.68	0.99	0.64	12.71	61.51	0.50	0.15	0.44	2.00	NO
					W7-U	0.68	0.99	1.22	12.45	61.51	0.50	1.00	0.02		
02nd	R6		Residential	LKD	W8-L	0.68	0.99	0.75	11.47	117.52	0.50	0.15	0.24	1.00	NO
					W8-U	0.68	0.99	1.44	10.42	117.52	0.50	1.00	0.01		
					W9-L	0.68	0.99	0.75	15.70	117.52	0.50	0.15	0.11		
					W9-U	0.68	0.99	1.44	13.30	117.52	0.50	1.00	0.01		
													0.15		
02nd	R7		Residential	LKD	W10-L	0.68	0.99	0.75	8.16	115.75	0.50	0.15	0.28	2.00	NO
					W10-U	0.68	0.99	1.44	6.80	115.75	0.50	1.00	0.01		
					W11-L	0.68	0.99	0.75	13.34	115.75	0.50	0.15	0.08		
					W11-U	0.68	0.99	1.44	10.81	115.75	0.50	1.00	0.01		
													0.12		
02nd	R8		Residential	Bedroom	W12-L	0.68	0.99	0.64	1.29	62.85	0.50	0.15	0.22	2.00	NO
					W12-U	0.68	0.99	1.22	1.38	62.85	0.50	1.00	0.00		
02nd	R9		Residential	LKD									0.02		
													0.03	1.00	NO
					W13-L	0.68	0.99	0.93	26.63	126.59	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.77	27.04	126.59	0.50	1.00	0.34		
					W14-L	0.68	0.99	1.60	13.67	126.59	0.50	0.15	0.02		
					W14-U	0.68	0.99	3.05	10.11	126.59	0.50	1.00	0.22		
					W15-L	0.68	0.99	0.64	4.36	126.59	0.50	0.15	0.00		
02nd	R10		Residential	Bedroom	W15-U	0.68	0.99	1.22	2.22	126.59	0.50	1.00	0.02		
													0.63	2.00	NO
					W16-L	0.68	0.99	0.64	5.03	65.12	0.50	0.15	0.01		
					W16-U	0.68	0.99	1.22	2.55	65.12	0.50	1.00	0.04		
													0.05	1.00	NO
02nd	R11		Residential	Bedroom	W17-L	0.68	0.99	0.64	5.50	79.27	0.50	0.15	0.01		
					W17-U	0.68	0.99	1.22	2.89	79.27	0.50	1.00	0.04		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
02nd	R12		Residential	Bedroom	W18-L	0.68	0.99	0.64	6.33	77.41	0.50	0.15	0.05	1.00	NO
					W18-U	0.68	0.99	1.22	3.29	77.41	0.50	1.00	0.05		
02nd	R13		Residential	LKD	W19-L	0.68	0.99	0.64	6.67	124.30	0.50	0.15	0.00	1.00	NO
					W19-U	0.68	0.99	1.22	3.51	124.30	0.50	1.00	0.03		
					W20-L	0.68	0.99	0.64	10.60	124.30	0.50	0.15	0.01		
					W20-U	0.68	0.99	1.22	9.08	124.30	0.50	1.00	0.08		
													0.12	2.00	NO
02nd	R14		Residential	Bedroom	W21-L	0.68	0.99	0.64	13.35	64.00	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.22	12.05	64.00	0.50	1.00	0.21		
02nd	R15		Residential	Bedroom	W22-L	0.68	0.99	0.64	19.05	80.34	0.50	0.15	0.02	1.00	NO
					W22-U	0.68	0.99	1.22	18.16	80.34	0.50	1.00	0.25		
02nd	R16		Residential	Bedroom	W23-L	0.68	0.99	0.64	19.93	65.31	0.50	0.15	0.03	1.00	NO
					W23-U	0.68	0.99	1.22	19.14	65.31	0.50	1.00	0.32		
													0.35	1.00	NO
					W24-L	0.68	0.99	1.70	22.11	125.64	0.50	0.15	0.04		
					W24-U	0.68	0.99	3.24	20.83	125.64	0.50	1.00	0.48		
02nd	R17		Residential	LKD	W25-L	0.68	0.99	0.93	18.25	125.64	0.50	0.15	0.02		
					W25-U	0.68	0.99	1.77	18.73	125.64	0.50	1.00	0.24		
													0.78	2.00	NO
					W26-L	0.68	0.99	0.64	22.15	61.31	0.50	0.15	0.03		
					W26-U	0.68	0.99	1.22	21.66	61.31	0.50	1.00	0.39		
02nd	R18		Residential	Bedroom									0.42	1.00	NO
					W27-L	0.68	0.99	0.75	22.71	110.38	0.50	0.15	0.02		
					W27-U	0.68	0.99	1.44	21.87	110.38	0.50	1.00	0.26		
					W28-L	0.68	0.99	0.75	22.82	110.38	0.50	0.15	0.02		
					W28-U	0.68	0.99	1.44	22.25	110.38	0.50	1.00	0.26		
02nd	R19		Residential	LKD									0.56	2.00	NO
					W29-L	0.68	0.99	0.64	17.12	63.77	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.22	16.60	63.77	0.50	1.00	0.28		
													0.31	1.00	NO
					W30-L	0.68	0.99	0.75	12.12	120.31	0.50	0.15	0.01		
02nd	R20		Residential	Bedroom	W30-U	0.68	0.99	1.44	10.62	120.31	0.50	1.00	0.11		
					W31-L	0.68	0.99	0.75	10.64	120.31	0.50	0.15	0.01		
					W31-U	0.68	0.99	1.44	9.98	120.31	0.50	1.00	0.11		
													0.24	2.00	NO
					W32-L	0.68	0.99	0.64	7.84	63.77	0.50	0.15	0.01		
02nd	R21		Residential	Bedroom	W32-U	0.68	0.99	1.22	7.24	63.77	0.50	1.00	0.12		
													0.13	1.00	NO
02nd	R22		Residential	LKD	W33-L	0.68	0.99	0.75	8.01	120.84	0.50	0.15	0.01		
					W33-U	0.68	0.99	1.44	5.12	120.84	0.50	1.00	0.05		
					W34-L	0.68	0.99	0.75	4.75	120.84	0.50	0.15	0.00		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W34-U	0.68	0.99	1.44	3.94	120.84	0.50	1.00	0.04	2.00	NO
													0.11		
02nd	R24		Residential	Bedroom	W35-L	0.68	0.99	0.64	2.17	63.77	0.50	0.15	0.00	1.00	NO
					W35-U	0.68	0.99	1.22	0.00	63.77	0.50	1.00	0.00		
													0.00	1.00	NO
													0.01		
02nd	R25		Residential	LKD	W36-L	0.68	0.99	0.75	7.18	133.29	0.50	0.15	0.03	1.00	NO
					W36-U	0.68	0.99	1.44	2.62	133.29	0.50	1.00	0.00		
					W37-L	0.68	0.99	0.75	5.07	133.29	0.50	0.15	0.00	1.00	NO
					W37-U	0.68	0.99	1.44	2.61	133.29	0.50	1.00	0.03		
													0.06	2.00	NO
													0.03		
03rd	R1		Residential	LKD	W1-L	0.68	0.99	1.27	21.74	109.18	0.50	0.15	0.42	1.00	YES
					W1-U	0.68	0.99	3.88	13.31	109.18	0.50	1.00	0.04		
					W2-L	0.68	0.99	1.27	23.13	109.18	0.50	0.15	0.44	1.00	YES
					W2-U	0.68	0.99	3.88	13.85	109.18	0.50	1.00	0.04		
					W3-L	0.68	0.99	1.27	22.38	109.18	0.50	0.15	0.45	1.00	YES
					W3-U	0.68	0.99	3.88	14.04	109.18	0.50	1.00	0.02		
					W4-L	0.68	0.99	0.97	15.39	109.18	0.50	0.15	0.40	1.00	YES
					W4-U	0.68	0.99	2.96	16.23	109.18	0.50	1.00	0.00		
					W5-L	0.68	0.99	0.15	2.01	109.18	0.50	0.15	0.03	1.00	YES
					W5-U	0.68	0.99	0.45	7.67	109.18	0.50	1.00	0.00		
					W6-L	0.68	0.99	0.14	5.95	109.18	0.50	0.15	0.02	1.00	YES
					W6-U	0.68	0.99	0.45	6.03	109.18	0.50	1.00	0.03		
					W7-L	0.68	0.99	0.95	21.46	109.18	0.50	0.15	0.70	1.00	YES
					W7-U	0.68	0.99	2.96	28.70	109.18	0.50	1.00	0.05		
					W8-L	0.68	0.99	1.24	30.70	109.18	0.50	0.15	0.89	1.00	YES
					W8-U	0.68	0.99	3.88	28.02	109.18	0.50	1.00	0.03		
					W9-L	0.68	0.99	0.70	30.16	109.18	0.50	0.15	0.49	1.00	YES
					W9-U	0.68	0.99	2.20	26.87	109.18	0.50	1.00	4.06		
03rd	R2		Residential	Bedroom	W10-L	0.68	0.99	0.70	20.47	48.94	0.50	0.15	0.04	1.00	YES
					W10-U	0.68	0.99	2.20	19.03	48.94	0.50	1.00	0.77		
					W11-L	0.68	0.99	1.24	26.16	48.94	0.50	0.15	0.09	1.00	YES
					W11-U	0.68	0.99	3.88	23.08	48.94	0.50	1.00	1.64		
													2.54	1.00	YES
													0.08		
03rd	R3		Residential	Bedroom	W12-L	0.68	0.99	1.24	26.19	56.34	0.50	0.15	1.37	1.00	YES
					W12-U	0.68	0.99	3.88	22.22	56.34	0.50	1.00	0.04		
					W13-L	0.68	0.99	0.70	24.53	56.34	0.50	0.15	0.73	1.00	YES
					W13-U	0.68	0.99	2.20	20.86	56.34	0.50	1.00	2.22		
03rd	R4		Residential	Bedroom	W14-L	0.68	0.99	0.70	10.02	61.36	0.50	0.15	0.02	1.00	YES
					W14-U	0.68	0.99	2.20	9.10	61.36	0.50	1.00	0.29		
					W15-L	0.68	0.99	1.24	20.32	61.36	0.50	0.15	0.06	1.00	YES
					W15-U	0.68	0.99	3.88	17.50	61.36	0.50	1.00	0.99		
													1.36	1.00	YES
													0.02		
03rd	R5		Residential	LKD	W16-L	0.68	0.99	1.24	20.92	142.83	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	3.88	16.84	142.83	0.50	1.00	0.41		
					W17-L	0.68	0.99	0.70	19.25	142.83	0.50	0.15	0.01		
					W17-U	0.68	0.99	2.20	15.58	142.83	0.50	1.00	0.22		
					W18-L	0.68	0.99	0.70	0.18	142.83	0.50	0.15	0.00		
					W18-U	0.68	0.99	2.20	0.79	142.83	0.50	1.00	0.01		
					W19-L	0.68	0.99	1.24	14.76	142.83	0.50	0.15	0.02		
					W19-U	0.68	0.99	3.88	12.26	142.83	0.50	1.00	0.30		
													0.99	2.00	NO
03rd	R6	Residential	LKD	W20-L	0.68	0.99	1.24	15.97	137.66	0.50	0.15	0.02			
				W20-U	0.68	0.99	3.88	11.93	137.66	0.50	1.00	0.30			
				W21-L	0.68	0.99	0.70	13.97	137.66	0.50	0.15	0.01			
				W21-U	0.68	0.99	2.19	10.42	137.66	0.50	1.00	0.15			
				W22-L	0.68	0.99	0.70	1.23	137.66	0.50	0.15	0.00			
				W22-U	0.68	0.99	2.20	0.00	137.66	0.50	1.00	0.00			
				W23-L	0.68	0.99	1.24	9.80	137.66	0.50	0.15	0.01			
W23-U	0.68	0.99	3.88	7.28	137.66	0.50	1.00	0.18							
													0.68	2.00	NO
03rd	R7	Residential	Bedroom	W24-L	0.68	0.99	1.24	11.92	67.96	0.50	0.15	0.03			
				W24-U	0.68	0.99	3.88	7.74	67.96	0.50	1.00	0.40			
				W25-L	0.68	0.99	0.70	10.12	67.96	0.50	0.15	0.01			
				W25-U	0.68	0.99	2.20	6.41	67.96	0.50	1.00	0.19			
													0.63	1.00	NO
03rd	R8	Residential	Bedroom	W26-L	0.68	0.99	0.98	3.14	68.57	0.50	0.15	0.01			
				W26-U	0.68	0.99	3.16	0.00	68.57	0.50	1.00	0.00			
				W27-L	0.68	0.99	1.21	5.40	68.57	0.50	0.15	0.01			
				W27-U	0.68	0.99	3.90	1.26	68.57	0.50	1.00	0.06			
													0.08	1.00	NO
03rd	R9	Residential	LKD	W28-L	0.68	0.99	1.21	9.07	142.17	0.50	0.15	0.01			
				W28-U	0.68	0.99	3.90	4.64	142.17	0.50	1.00	0.11			
				W29-L	0.68	0.99	1.21	9.23	142.17	0.50	0.15	0.01			
				W29-U	0.68	0.99	3.90	5.10	142.17	0.50	1.00	0.13			
				W30-L	0.68	0.99	1.21	9.19	142.17	0.50	0.15	0.01			
				W30-U	0.68	0.99	3.90	4.89	142.17	0.50	1.00	0.12			
				W31-L	0.68	0.99	0.45	2.03	142.17	0.50	0.15	0.00			
W31-U	0.68	0.99	1.46	0.00	142.17	0.50	1.00	0.00							
													0.39	2.00	NO
03rd	R10	Residential	LKD	W32-L	0.68	0.99	0.54	3.89	138.93	0.50	0.15	0.00			
				W32-U	0.68	0.99	1.70	0.00	138.93	0.50	1.00	0.00			
				W33-L	0.68	0.99	1.24	4.02	138.93	0.50	0.15	0.00			
				W33-U	0.68	0.99	3.88	0.00	138.93	0.50	1.00	0.00			
				W34-L	0.68	0.99	1.24	7.99	138.93	0.50	0.15	0.01			
				W34-U	0.68	0.99	3.88	4.65	138.93	0.50	1.00	0.12			
				W35-L	0.68	0.99	1.24	10.52	138.93	0.50	0.15	0.01			
W35-U	0.68	0.99	3.88	8.20	138.93	0.50	1.00	0.21							
													0.35	2.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R11		Residential	Bedroom	W36-L	0.68	0.99	1.24	12.91	62.59	0.50	0.15	0.03		
					W36-U	0.68	0.99	3.88	10.95	62.59	0.50	1.00	0.61		
					W37-L	0.68	0.99	0.58	12.72	62.59	0.50	0.15	0.02		
					W37-U	0.68	0.99	1.83	12.61	62.59	0.50	1.00	0.33		
					0.99			1.00	NO						
03rd	R12		Residential	Bedroom	W38-L	0.68	0.99	0.78	14.37	65.95	0.50	0.15	0.02		
					W38-U	0.68	0.99	2.44	15.04	65.95	0.50	1.00	0.50		
					W39-L	0.68	0.99	1.24	15.56	65.95	0.50	0.15	0.04		
					W39-U	0.68	0.99	3.88	16.29	65.95	0.50	1.00	0.86		
					1.42			1.00	YES						
03rd	R13		Residential	LKD	W40-L	0.68	0.99	1.24	17.92	141.83	0.50	0.15	0.02		
					W40-U	0.68	0.99	3.88	17.81	141.83	0.50	1.00	0.44		
					W41-L	0.68	0.99	1.24	18.60	141.83	0.50	0.15	0.02		
					W41-U	0.68	0.99	3.88	18.37	141.83	0.50	1.00	0.45		
					W42-L	0.68	0.99	1.24	19.05	141.83	0.50	0.15	0.02		
					W42-U	0.68	0.99	3.88	18.92	141.83	0.50	1.00	0.46		
					W43-L	0.68	0.99	0.70	18.15	141.83	0.50	0.15	0.01		
					W43-U	0.68	0.99	2.20	18.50	141.83	0.50	1.00	0.26		
1.69			2.00	NO											
03rd	R14		Residential	Bedroom	W44-L	0.68	0.99	0.72	19.21	46.04	0.50	0.15	0.04		
					W44-U	0.68	0.99	2.26	19.52	46.04	0.50	1.00	0.86		
					W45-L	0.68	0.99	1.24	19.46	46.04	0.50	0.15	0.07		
					W45-U	0.68	0.99	3.88	19.96	46.04	0.50	1.00	1.51		
2.48			1.00	YES											
03rd	R15		Residential	LKD	W46-L	0.68	0.99	1.24	20.15	89.76	0.50	0.15	0.04		
					W46-U	0.68	0.99	3.88	20.32	89.76	0.50	1.00	0.79		
					W47-L	0.68	0.99	0.72	18.74	89.76	0.50	0.15	0.02		
					W47-U	0.68	0.99	2.26	19.26	89.76	0.50	1.00	0.44		
1.28			2.00	NO											
03rd	R16		Residential	Bedroom	W48-L	0.68	0.99	0.72	16.58	59.61	0.50	0.15	0.03		
					W48-U	0.68	0.99	2.26	16.25	59.61	0.50	1.00	0.55		
					W49-L	0.68	0.99	1.24	14.46	59.61	0.50	0.15	0.04		
					W49-U	0.68	0.99	3.88	13.17	59.61	0.50	1.00	0.77		
1.39			1.00	YES											
03rd	R17		Residential	LKD	W50-L	0.68	0.99	1.24	11.28	83.41	0.50	0.15	0.02		
					W50-U	0.68	0.99	3.88	8.32	83.41	0.50	1.00	0.35		
					W51-L	0.68	0.99	0.72	9.61	83.41	0.50	0.15	0.01		
					W51-U	0.68	0.99	2.26	7.02	83.41	0.50	1.00	0.17		
0.55			2.00	NO											
03rd	R18		Residential	Bedroom	W52-L	0.68	0.99	0.72	7.19	59.27	0.50	0.15	0.01		
					W52-U	0.68	0.99	2.26	4.98	59.27	0.50	1.00	0.17		
					W53-L	0.68	0.99	1.24	8.11	59.27	0.50	0.15	0.02		
					W53-U	0.68	0.99	3.88	5.64	59.27	0.50	1.00	0.33		
0.54			1.00	NO											
03rd	R19		Residential	Bedroom	W54-L	0.68	0.99	1.24	6.82	50.06	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
03rd	R20	Residential	LKD	W54-U	0.68	0.99	3.88	3.99	50.06	50.06	0.50	1.00	0.28	1.00	NO
				W55-L	0.68	0.99	0.72	4.26	50.06	50.06	0.50	0.15	0.01		
				W55-U	0.68	0.99	2.26	3.00	50.06	50.06	0.50	1.00	0.12		
													0.43		
				W56-L	0.68	0.99	0.70	3.07	103.83	103.83	0.50	0.15	0.00		
				W56-U	0.68	0.99	2.20	0.00	103.83	103.83	0.50	1.00	0.00		
				W57-L	0.68	0.99	1.24	3.64	103.83	103.83	0.50	0.15	0.01		
				W57-U	0.68	0.99	3.88	1.05	103.83	103.83	0.50	1.00	0.04		
				W58-L	0.68	0.99	0.75	3.58	103.83	103.83	0.50	0.15	0.00		
				W58-U	0.68	0.99	2.34	1.51	103.83	103.83	0.50	1.00	0.03		
				W59-L	0.68	0.99	0.14	13.20	103.83	103.83	0.50	0.15	0.00		
				W59-U	0.68	0.99	0.45	11.30	103.83	103.83	0.50	1.00	0.04		
				W60-L	0.68	0.99	0.17	9.96	103.83	103.83	0.50	0.15	0.00		
				W60-U	0.68	0.99	0.51	7.80	103.83	103.83	0.50	1.00	0.03		
				W61-L	0.68	0.99	0.97	14.06	103.83	103.83	0.50	0.15	0.02		
				W61-U	0.68	0.99	2.96	12.83	103.83	103.83	0.50	1.00	0.33		
				W62-L	0.68	0.99	1.27	15.26	103.83	103.83	0.50	0.15	0.03		
				W62-U	0.68	0.99	3.88	13.14	103.83	103.83	0.50	1.00	0.44		
				W63-L	0.68	0.99	1.27	17.30	103.83	103.83	0.50	0.15	0.03		
				W63-U	0.68	0.99	3.87	14.33	103.83	103.83	0.50	1.00	0.48		
				W64-L	0.68	0.99	1.27	20.24	103.83	103.83	0.50	0.15	0.03		
				W64-U	0.68	0.99	3.88	17.09	103.83	103.83	0.50	1.00	0.57		
													2.09	2.00	YES
04th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	28.72	125.20	125.20	0.50	0.15	0.05	2.00	NO
				W1-U	0.68	0.99	3.19	17.11	125.20	125.20	0.50	1.00	0.39		
				W2-L	0.68	0.99	1.93	31.74	125.20	125.20	0.50	0.15	0.07		
				W2-U	0.68	0.99	3.57	17.91	125.20	125.20	0.50	1.00	0.46		
				W3-L	0.68	0.99	1.72	32.43	125.20	125.20	0.50	0.15	0.06		
				W3-U	0.68	0.99	3.19	18.13	125.20	125.20	0.50	1.00	0.42		
				W4-L	0.68	0.99	0.70	36.05	125.20	125.20	0.50	0.15	0.03		
				W4-U	0.68	0.99	1.29	36.02	125.20	125.20	0.50	1.00	0.33		
													1.81		
													0.64	1.00	NO
04th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	33.71	66.26	66.26	0.50	0.15	0.05	1.00	NO
				W5-U	0.68	0.99	1.29	33.72	66.26	66.26	0.50	1.00	0.59		
													0.64	1.00	NO
04th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	30.98	66.49	66.49	0.50	0.15	0.04	1.00	NO
				W6-U	0.68	0.99	1.29	30.99	66.49	66.49	0.50	1.00	0.54		
													0.58	1.00	NO
04th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	28.47	104.32	104.32	0.50	0.15	0.03	2.00	NO
				W7-U	0.68	0.99	1.29	27.92	104.32	104.32	0.50	1.00	0.31		
				W8-L	0.68	0.99	1.36	30.43	104.32	104.32	0.50	0.15	0.05		
				W8-U	0.68	0.99	2.52	29.70	104.32	104.32	0.50	1.00	0.64		
													1.03	2.00	NO
04th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	24.57	65.09	65.09	0.50	0.15	0.04	1.00	
				W9-U	0.68	0.99	1.29	24.44	65.09	65.09	0.50	1.00	0.44		

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	22.65	121.62	0.50	0.15	0.47	1.00	NO
					W10-U	0.68	0.99	1.29	21.82	121.62	0.50	1.00	0.21		
					W11-L	0.68	0.99	1.36	25.24	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	24.26	121.62	0.50	1.00	0.45		
04th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	18.83	56.77	0.50	0.15	0.72	2.00	NO
					W12-U	0.68	0.99	1.29	18.49	56.77	0.50	1.00	0.38		
													0.41	1.00	NO
													0.02		
04th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	14.84	56.45	0.50	0.15	0.32	1.00	NO
					W13-U	0.68	0.99	1.29	14.32	56.45	0.50	1.00	0.29		
													0.01		
													0.13		
04th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	14.89	119.79	0.50	0.15	0.50	2.00	NO
					W14-U	0.68	0.99	1.29	13.38	119.79	0.50	1.00	0.13		
					W15-L	0.68	0.99	1.36	18.82	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	17.34	119.79	0.50	1.00	0.33		
04th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	11.19	59.49	0.50	0.15	0.37	1.00	NO
					W16-U	0.68	0.99	1.29	10.46	59.49	0.50	1.00	0.20		
					W17-L	0.68	0.99	0.36	14.00	59.49	0.50	0.15	0.01		
					W17-U	0.68	0.99	0.67	13.90	59.49	0.50	1.00	0.14		
04th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	25.63	116.88	0.50	0.15	0.52	2.00	NO
					W18-U	0.68	0.99	0.67	25.61	116.88	0.50	1.00	0.13		
					W19-L	0.68	0.99	0.70	10.85	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	8.69	116.88	0.50	1.00	0.09		
					W20-L	0.68	0.99	1.36	15.36	116.88	0.50	0.15	0.02		
					W20-U	0.68	0.99	2.52	13.39	116.88	0.50	1.00	0.26		
04th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	8.67	55.29	0.50	0.15	0.17	1.00	NO
					W21-U	0.68	0.99	1.29	7.52	55.29	0.50	1.00	0.16		
													0.01		
													0.12		
04th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	8.48	69.09	0.50	0.15	0.13	1.00	NO
					W22-U	0.68	0.99	1.29	7.27	69.09	0.50	1.00	0.13		
													0.01		
													0.09		
04th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	8.50	67.42	0.50	0.15	0.14	1.00	NO
					W23-U	0.68	0.99	1.29	7.31	67.42	0.50	1.00	0.13		
													0.01		
													0.27		
04th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	11.54	116.39	0.50	0.15	0.40	2.00	NO
					W24-U	0.68	0.99	1.29	9.50	116.39	0.50	1.00	0.09		
					W25-L	0.68	0.99	1.36	16.05	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	14.07	116.39	0.50	1.00	0.27		
04th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	13.03	55.28	0.50	0.15	0.02		
					W26-U	0.68	0.99	1.29	12.08	55.28	0.50	1.00	0.25		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	19.90	69.08	0.50	0.15	0.28	1.00	NO
					W27-U	0.68	0.99	1.29	19.32	69.08	0.50	1.00	0.03		
04th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	21.25	55.32	0.50	0.15	0.35	1.00	NO
					W28-U	0.68	0.99	1.29	20.77	55.32	0.50	1.00	0.04		
04th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	23.00	117.45	0.50	0.15	0.47	1.00	NO
					W29-U	0.68	0.99	1.29	21.97	117.45	0.50	1.00	0.02		
04th	R19		Residential	LKD	W30-L	0.68	0.99	1.36	24.78	117.45	0.50	0.15	0.22		
					W30-U	0.68	0.99	2.52	23.63	117.45	0.50	1.00	0.04		
04th	R19		Residential	LKD	W31-L	0.68	0.99	0.36	16.25	117.45	0.50	0.15	0.46		
					W31-U	0.68	0.99	0.67	16.24	117.45	0.50	1.00	0.01		
04th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	19.57	58.24	0.50	0.15	0.08		
					W32-U	0.68	0.99	0.67	19.40	58.24	0.50	1.00	0.02		
04th	R20		Residential	Bedroom	W33-L	0.68	0.99	0.70	23.53	58.24	0.50	0.15	0.20		
					W33-U	0.68	0.99	1.29	23.08	58.24	0.50	1.00	0.04		
04th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	25.17	117.07	0.50	0.15	0.46		
					W34-U	0.68	0.99	1.29	24.19	117.07	0.50	1.00	0.02		
04th	R21		Residential	LKD	W35-L	0.68	0.99	1.36	25.69	117.07	0.50	0.15	0.24		
					W35-U	0.68	0.99	2.52	24.59	117.07	0.50	1.00	0.04		
04th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	19.91	59.45	0.50	0.15	0.48		
					W36-U	0.68	0.99	1.29	19.32	59.45	0.50	1.00	0.78	2.00	NO
04th	R22		Residential	Bedroom	W37-L	0.68	0.99	0.70	16.52	59.45	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.29	15.77	59.45	0.50	1.00	0.38		
04th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	12.19	57.18	0.50	0.15	0.03		
					W38-U	0.68	0.99	1.29	11.17	57.18	0.50	1.00	0.74	1.00	NO
04th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	13.95	119.55	0.50	0.15	0.02		
					W39-U	0.68	0.99	1.29	11.99	119.55	0.50	1.00	0.23		
04th	R24		Residential	LKD	W40-L	0.68	0.99	1.36	13.93	119.55	0.50	0.15	0.25	1.00	NO
					W40-U	0.68	0.99	2.52	11.73	119.55	0.50	1.00	0.01		
04th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	9.62	69.12	0.50	0.15	0.12		
					W41-U	0.68	0.99	1.29	8.20	69.12	0.50	1.00	0.22		
04th	R25		Residential	Bedroom	W42-L	0.68	0.99	0.70	8.69	69.12	0.50	0.15	0.37	2.00	NO
					W42-U	0.68	0.99	1.29	6.99	69.12	0.50	1.00	0.01		
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	8.36	66.25	0.50	0.15	0.14		
					W43-U	0.68	0.99	1.29	6.43	66.25	0.50	1.00	0.28	1.00	NO
04th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	8.36	66.25	0.50	0.15	0.11		
					W43-U	0.68	0.99	1.29	6.43	66.25	0.50	1.00	0.12	1.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
04th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	8.71	56.67	0.50	0.15	0.01	1.00	
					W44-U	0.68	0.99	1.29	6.97	56.67	0.50	1.00	0.14		
04th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	35.96	151.85	0.50	0.15	0.05	2.00	NO
					W45-U	0.68	0.99	3.18	24.74	151.85	0.50	1.00	0.47		
					W46-L	0.68	0.99	1.93	35.74	151.85	0.50	0.15	0.06		
					W46-U	0.68	0.99	3.57	24.50	151.85	0.50	1.00	0.52		
					W47-L	0.68	0.99	1.72	30.22	151.85	0.50	0.15	0.05		
					W47-U	0.68	0.99	3.20	18.87	151.85	0.50	1.00	0.36		
05th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	29.67	125.20	0.50	0.15	0.05	2.00	NO
					W1-U	0.68	0.99	3.19	18.25	125.20	0.50	1.00	0.42		
					W2-L	0.68	0.99	1.93	32.75	125.20	0.50	0.15	0.07		
					W2-U	0.68	0.99	3.57	19.23	125.20	0.50	1.00	0.49		
					W3-L	0.68	0.99	1.72	33.43	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	19.55	125.20	0.50	1.00	0.45		
					W4-L	0.68	0.99	0.70	36.92	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	36.91	125.20	0.50	1.00	0.34		
05th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	34.70	66.26	0.50	0.15	0.05	1.00	NO
					W5-U	0.68	0.99	1.29	34.73	66.26	0.50	1.00	0.61		
05th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	32.00	66.49	0.50	0.15	0.05	1.00	NO
					W6-U	0.68	0.99	1.29	32.02	66.49	0.50	1.00	0.56		
05th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	29.46	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	28.94	104.32	0.50	1.00	0.32		
					W8-L	0.68	0.99	1.36	31.36	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	30.67	104.32	0.50	1.00	0.67		
05th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	25.41	65.09	0.50	0.15	0.04	1.00	NO
					W9-U	0.68	0.99	1.29	25.30	65.09	0.50	1.00	0.45		
05th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	23.41	121.62	0.50	0.15	0.02	2.00	NO
					W10-U	0.68	0.99	1.29	22.62	121.62	0.50	1.00	0.22		
					W11-L	0.68	0.99	1.36	25.95	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	24.99	121.62	0.50	1.00	0.47		
05th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	19.51	56.77	0.50	0.15	0.03	1.00	NO
					W12-U	0.68	0.99	1.29	19.19	56.77	0.50	1.00	0.39		
05th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	15.44	56.45	0.50	0.15	0.03	1.00	NO
					W13-U	0.68	0.99	1.29	14.94	56.45	0.50	1.00	0.31		
05th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	15.48	119.79	0.50	0.15	0.01		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	14.01	119.79	0.50	1.00	0.14	2.00	NO
					W15-L	0.68	0.99	1.36	19.34	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	17.89	119.79	0.50	1.00	0.34		
05th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	11.60	59.49	0.50	0.15	0.02	1.00	NO
					W16-U	0.68	0.99	1.29	10.84	59.49	0.50	1.00	0.21		
					W17-L	0.68	0.99	0.36	14.41	59.49	0.50	0.15	0.01		
					W17-U	0.68	0.99	0.67	14.27	59.49	0.50	1.00	0.14		
													0.39		
05th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	25.91	116.88	0.50	0.15	0.01	2.00	NO
					W18-U	0.68	0.99	0.67	25.89	116.88	0.50	1.00	0.13		
					W19-L	0.68	0.99	0.70	11.15	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	8.99	116.88	0.50	1.00	0.09		
					W20-L	0.68	0.99	1.36	15.66	116.88	0.50	0.15	0.02		
					W20-U	0.68	0.99	2.52	13.67	116.88	0.50	1.00	0.26		
05th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	8.92	55.29	0.50	0.15	0.02	1.00	NO
					W21-U	0.68	0.99	1.29	7.77	55.29	0.50	1.00	0.16		
													0.18		
05th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	8.75	69.09	0.50	0.15	0.01	1.00	NO
					W22-U	0.68	0.99	1.29	7.54	69.09	0.50	1.00	0.13		
													0.14		
05th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	8.81	67.42	0.50	0.15	0.01	1.00	NO
					W23-U	0.68	0.99	1.29	7.63	67.42	0.50	1.00	0.13		
													0.14		
05th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	11.83	116.39	0.50	0.15	0.01	2.00	NO
					W24-U	0.68	0.99	1.29	9.81	116.39	0.50	1.00	0.10		
					W25-L	0.68	0.99	1.36	16.20	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	14.21	116.39	0.50	1.00	0.28		
													0.41		
05th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	12.90	55.28	0.50	0.15	0.02	1.00	NO
					W26-U	0.68	0.99	1.29	11.90	55.28	0.50	1.00	0.25		
													0.27		
05th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	20.03	69.08	0.50	0.15	0.03	1.00	NO
					W27-U	0.68	0.99	1.29	19.44	69.08	0.50	1.00	0.33		
													0.35		
05th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	21.50	55.32	0.50	0.15	0.04	1.00	NO
					W28-U	0.68	0.99	1.29	21.02	55.32	0.50	1.00	0.44		
													0.48		
05th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	23.34	117.45	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.29	22.31	117.45	0.50	1.00	0.22		
					W30-L	0.68	0.99	1.36	25.14	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	23.99	117.45	0.50	1.00	0.46		
					W31-L	0.68	0.99	0.36	16.96	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	17.05	117.45	0.50	1.00	0.09		

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria		
05th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	19.75	58.24	0.50	0.15	0.02	2.00	NO		
					W32-U	0.68	0.99	0.67	19.54	58.24	0.50	1.00	0.20				
					W33-L	0.68	0.99	0.70	23.90	58.24	0.50	0.15	0.04				
					W33-U	0.68	0.99	1.29	23.44	58.24	0.50	1.00	0.47				
05th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	25.60	117.07	0.50	0.15	0.02	1.00	NO		
					W34-U	0.68	0.99	1.29	24.62	117.07	0.50	1.00	0.24				
					W35-L	0.68	0.99	1.36	26.12	117.07	0.50	0.15	0.04				
					W35-U	0.68	0.99	2.52	25.01	117.07	0.50	1.00	0.48				
05th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	20.29	59.45	0.50	0.15	0.03	2.00	NO		
					W36-U	0.68	0.99	1.29	19.71	59.45	0.50	1.00	0.38				
					W37-L	0.68	0.99	0.70	16.98	59.45	0.50	0.15	0.03				
					W37-U	0.68	0.99	1.29	16.22	59.45	0.50	1.00	0.32				
05th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	12.63	57.18	0.50	0.15	0.02	1.00	NO		
					W38-U	0.68	0.99	1.29	11.60	57.18	0.50	1.00	0.24				
05th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	14.43	119.55	0.50	0.15	0.01	1.00	NO		
					W39-U	0.68	0.99	1.29	12.50	119.55	0.50	1.00	0.12				
					W40-L	0.68	0.99	1.36	14.35	119.55	0.50	0.15	0.02				
					W40-U	0.68	0.99	2.52	12.18	119.55	0.50	1.00	0.23				
05th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	10.00	69.12	0.50	0.15	0.01	1.00	NO		
					W41-U	0.68	0.99	1.29	8.57	69.12	0.50	1.00	0.14				
					W42-L	0.68	0.99	0.70	9.03	69.12	0.50	0.15	0.01				
					W42-U	0.68	0.99	1.29	7.41	69.12	0.50	1.00	0.12				
05th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	8.67	66.25	0.50	0.15	0.01	1.00	NO		
					W43-U	0.68	0.99	1.29	6.88	66.25	0.50	1.00	0.12				
05th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	9.06	56.67	0.50	0.15	0.02	1.00	NO		
					W44-U	0.68	0.99	1.29	7.40	56.67	0.50	1.00	0.15				
05th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	36.71	151.85	0.50	0.15	0.06	2.00	NO		
					W45-U	0.68	0.99	3.18	26.49	151.85	0.50	1.00	0.50				
					W46-L	0.68	0.99	1.93	36.52	151.85	0.50	0.15	0.06				
					W46-U	0.68	0.99	3.57	26.34	151.85	0.50	1.00	0.56				
					W47-L	0.68	0.99	1.72	31.09	151.85	0.50	0.15	0.05				
					W47-U	0.68	0.99	3.20	21.23	151.85	0.50	1.00	0.40				
06th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	30.65	125.20	0.50	0.15	0.06	2.00	NO		
					W1-U	0.68	0.99	3.19	19.33	125.20	0.50	1.00	0.44				
					W2-L	0.68	0.99	1.93	33.73	125.20	0.50	0.15	0.07				

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W2-U	0.68	0.99	3.57	20.49	125.20	0.50	1.00	0.52		
					W3-L	0.68	0.99	1.72	34.38	125.20	0.50	0.15	0.06		
					W3-U	0.68	0.99	3.19	20.88	125.20	0.50	1.00	0.48		
					W4-L	0.68	0.99	0.70	37.84	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	37.82	125.20	0.50	1.00	0.35		
06th	R2		Residential	Bedroom									2.01	2.00	YES
					W5-L	0.68	0.99	0.70	35.73	66.26	0.50	0.15	0.05		
					W5-U	0.68	0.99	1.29	35.77	66.26	0.50	1.00	0.63		
06th	R3		Residential	Bedroom									0.68	1.00	NO
					W6-L	0.68	0.99	0.70	33.06	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	33.11	66.49	0.50	1.00	0.58		
06th	R4		Residential	LKD									0.62	1.00	NO
					W7-L	0.68	0.99	0.70	30.50	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	30.01	104.32	0.50	1.00	0.33		
06th	R5		Residential	Bedroom									0.03		
					W8-L	0.68	0.99	1.36	32.33	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	31.67	104.32	0.50	1.00	0.69		
06th	R6		Residential	LKD									1.11	2.00	NO
					W9-L	0.68	0.99	0.70	26.29	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	26.19	65.09	0.50	1.00	0.47		
06th	R7		Residential	Bedroom									0.50	1.00	NO
					W10-L	0.68	0.99	0.70	24.20	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	23.43	121.62	0.50	1.00	0.22		
06th	R8		Residential	Bedroom									0.04		
					W11-L	0.68	0.99	1.36	26.68	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	25.73	121.62	0.50	1.00	0.48		
06th	R9		Residential	LKD									0.76	2.00	NO
					W12-L	0.68	0.99	0.70	20.20	56.77	0.50	0.15	0.03		
					W12-U	0.68	0.99	1.29	19.88	56.77	0.50	1.00	0.41		
06th	R10		Residential	Bedroom									0.44	1.00	NO
					W13-L	0.68	0.99	0.70	16.04	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	15.53	56.45	0.50	1.00	0.32		
06th	R11		Residential	LKD									0.35	1.00	NO
					W14-L	0.68	0.99	0.70	16.09	119.79	0.50	0.15	0.01		
					W14-U	0.68	0.99	1.29	14.65	119.79	0.50	1.00	0.14		
06th	R12		Residential	Bedroom									0.03		
					W15-L	0.68	0.99	1.36	19.86	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	18.42	119.79	0.50	1.00	0.35		
06th	R13		Residential	LKD									0.53	2.00	NO
					W16-L	0.68	0.99	0.70	12.03	59.49	0.50	0.15	0.02		
					W16-U	0.68	0.99	1.29	11.23	59.49	0.50	1.00	0.22		
06th	R14		Residential	Bedroom									0.01		
					W17-L	0.68	0.99	0.36	14.82	59.49	0.50	0.15	0.01		
					W17-U	0.68	0.99	0.67	14.71	59.49	0.50	1.00	0.15		
06th	R15		Residential	LKD									0.40	1.00	NO
					W18-L	0.68	0.99	0.36	26.18	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	26.15	116.88	0.50	1.00	0.13		
06th	R16		Residential	Bedroom									0.01		
					W19-L	0.68	0.99	0.70	11.50	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	9.32	116.88	0.50	1.00	0.09		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	1.36	16.00	116.88	0.50	0.15	0.03		
					W20-U	0.68	0.99	2.52	13.99	116.88	0.50	1.00	0.27		
06th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	9.21	55.29	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.29	8.04	55.29	0.50	1.00	0.17		
													0.18	1.00	NO
06th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	9.03	69.09	0.50	0.15	0.01		
					W22-U	0.68	0.99	1.29	7.84	69.09	0.50	1.00	0.13		
													0.14	1.00	NO
06th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	9.11	67.42	0.50	0.15	0.01		
					W23-U	0.68	0.99	1.29	7.99	67.42	0.50	1.00	0.14		
													0.15	1.00	NO
06th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	12.16	116.39	0.50	0.15	0.01		
					W24-U	0.68	0.99	1.29	10.20	116.39	0.50	1.00	0.10		
					W25-L	0.68	0.99	1.36	16.36	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	14.37	116.39	0.50	1.00	0.28		
													0.42	2.00	NO
06th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	12.73	55.28	0.50	0.15	0.02		
					W26-U	0.68	0.99	1.29	11.68	55.28	0.50	1.00	0.25		
													0.27	1.00	NO
06th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	20.18	69.08	0.50	0.15	0.03		
					W27-U	0.68	0.99	1.29	19.58	69.08	0.50	1.00	0.33		
													0.36	1.00	NO
06th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	21.78	55.32	0.50	0.15	0.04		
					W28-U	0.68	0.99	1.29	21.28	55.32	0.50	1.00	0.45		
													0.48	1.00	NO
06th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	23.71	117.45	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.29	22.68	117.45	0.50	1.00	0.22		
					W30-L	0.68	0.99	1.36	25.52	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	24.36	117.45	0.50	1.00	0.47		
					W31-L	0.68	0.99	0.36	17.91	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	18.21	117.45	0.50	1.00	0.09		
													0.85	2.00	NO
06th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	19.90	58.24	0.50	0.15	0.02		
					W32-U	0.68	0.99	0.67	19.71	58.24	0.50	1.00	0.20		
					W33-L	0.68	0.99	0.70	24.28	58.24	0.50	0.15	0.04		
					W33-U	0.68	0.99	1.29	23.83	58.24	0.50	1.00	0.47		
													0.73	1.00	NO
06th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	26.05	117.07	0.50	0.15	0.02		
					W34-U	0.68	0.99	1.29	25.08	117.07	0.50	1.00	0.25		
					W35-L	0.68	0.99	1.36	26.56	117.07	0.50	0.15	0.04		
					W35-U	0.68	0.99	2.52	25.46	117.07	0.50	1.00	0.49		
													0.80	2.00	NO
06th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	20.70	59.45	0.50	0.15	0.03		
					W36-U	0.68	0.99	1.29	20.14	59.45	0.50	1.00	0.39		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W37-L	0.68	0.99	0.70	17.43	59.45	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.29	16.73	59.45	0.50	1.00	0.33		
06th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	13.10	57.18	0.50	0.15	0.02		
					W38-U	0.68	0.99	1.29	12.11	57.18	0.50	1.00	0.25		
													0.78	1.00	NO
06th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	14.94	119.55	0.50	0.15	0.01		
					W39-U	0.68	0.99	1.29	13.07	119.55	0.50	1.00	0.13		
													0.02		
													0.24		
													0.40	2.00	NO
06th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	10.35	69.12	0.50	0.15	0.01		
					W41-U	0.68	0.99	1.29	9.03	69.12	0.50	1.00	0.15		
													0.01		
													0.13		
													0.31	1.00	NO
06th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	9.04	66.25	0.50	0.15	0.01		
					W43-U	0.68	0.99	1.29	7.39	66.25	0.50	1.00	0.13		
													0.14	1.00	NO
06th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	9.45	56.67	0.50	0.15	0.02		
					W44-U	0.68	0.99	1.29	7.95	56.67	0.50	1.00	0.16		
													0.18	1.00	NO
06th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	36.83	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	27.92	151.85	0.50	1.00	0.53		
													0.06		
													0.59		
													0.05		
													0.43		
													1.71	2.00	NO
07th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	31.63	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	20.31	125.20	0.50	1.00	0.46		
													0.07		
													0.56		
													0.07		
													0.51		
													0.03		
													0.36		
													2.11	2.00	YES
07th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	36.80	66.26	0.50	0.15	0.05		
					W5-U	0.68	0.99	1.29	36.84	66.26	0.50	1.00	0.65		
													0.70	1.00	NO
07th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	34.17	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	34.22	66.49	0.50	1.00	0.60		
													0.65	1.00	NO
07th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	31.55	104.32	0.50	0.15	0.03		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria		
					W7-U	0.68	0.99	1.29	31.07	104.32	0.50	1.00	0.35				
					W8-L	0.68	0.99	1.36	33.32	104.32	0.50	0.15	0.06				
					W8-U	0.68	0.99	2.52	32.65	104.32	0.50	1.00	0.71				
07th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	27.18	65.09	0.50	0.15	0.04		2.00	NO		
				W9-U	0.68	0.99	1.29	27.06	65.09	0.50	1.00	0.48					
												0.52				1.00	
07th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	24.99	121.62	0.50	0.15	0.02		2.00	NO		
				W10-U	0.68	0.99	1.29	24.21	121.62	0.50	1.00	0.23					
				W11-L	0.68	0.99	1.36	27.41	121.62	0.50	0.15	0.04					
07th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	20.87	56.77	0.50	0.15	0.03		1.00	NO		
				W12-U	0.68	0.99	1.29	20.52	56.77	0.50	1.00	0.42					
												0.45				1.00	
07th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	16.65	56.45	0.50	0.15	0.03		1.00	NO		
				W13-U	0.68	0.99	1.29	16.09	56.45	0.50	1.00	0.33					
												0.36				1.00	
07th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	16.73	119.79	0.50	0.15	0.01		2.00	NO		
				W14-U	0.68	0.99	1.29	15.26	119.79	0.50	1.00	0.15					
				W15-L	0.68	0.99	1.36	20.40	119.79	0.50	0.15	0.03					
07th	R10	Residential	Bedroom	W15-U	0.68	0.99	2.52	18.94	119.79	0.50	1.00	0.36		2.00	NO		
												0.55				2.00	
				W16-L	0.68	0.99	0.70	12.47	59.49	0.50	0.15	0.02					
07th	R11	Residential	LKD	W16-U	0.68	0.99	1.29	11.58	59.49	0.50	1.00	0.23		1.00	NO		
				W17-L	0.68	0.99	0.36	15.28	59.49	0.50	0.15	0.01					
				W17-U	0.68	0.99	0.67	15.20	59.49	0.50	1.00	0.15					
07th	R12	Residential	Bedroom	W18-L	0.68	0.99	0.36	26.44	116.88	0.50	0.15	0.01		2.00	NO		
				W18-U	0.68	0.99	0.67	26.41	116.88	0.50	1.00	0.14					
				W19-L	0.68	0.99	0.70	11.82	116.88	0.50	0.15	0.01					
07th	R13	Residential	Bedroom	W19-U	0.68	0.99	1.29	9.68	116.88	0.50	1.00	0.10		1.00	NO		
				W20-L	0.68	0.99	1.36	16.32	116.88	0.50	0.15	0.03					
				W20-U	0.68	0.99	2.52	14.32	116.88	0.50	1.00	0.28					
07th	R14	Residential	Bedroom	W21-L	0.68	0.99	0.70	9.49	55.29	0.50	0.15	0.02		1.00	NO		
				W21-U	0.68	0.99	1.29	8.30	55.29	0.50	1.00	0.17					
												0.19				1.00	
07th	R15	Residential	LKD	W22-L	0.68	0.99	0.70	9.29	69.09	0.50	0.15	0.01		1.00	NO		
				W22-U	0.68	0.99	1.29	8.11	69.09	0.50	1.00	0.14					
												0.15				1.00	
07th	R16	Residential	Bedroom	W23-L	0.68	0.99	0.70	9.43	67.42	0.50	0.15	0.01		1.00	NO		
				W23-U	0.68	0.99	1.29	8.29	67.42	0.50	1.00	0.14					
												0.16				1.00	
07th	R17	Residential	LKD	W24-L	0.68	0.99	0.70	12.62	116.39	0.50	0.15	0.01					

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W24-U	0.68	0.99	1.29	10.66	116.39	0.50	1.00	0.11	2.00	NO
					W25-L	0.68	0.99	1.36	16.59	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	14.60	116.39	0.50	1.00	0.28		
07th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	12.56	55.28	0.50	0.15	0.02	1.00	NO
					W26-U	0.68	0.99	1.29	11.52	55.28	0.50	1.00	0.24		
													0.26		
07th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	20.34	69.08	0.50	0.15	0.03	1.00	NO
					W27-U	0.68	0.99	1.29	19.73	69.08	0.50	1.00	0.33		
													0.36		
07th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	22.06	55.32	0.50	0.15	0.04	1.00	NO
					W28-U	0.68	0.99	1.29	21.55	55.32	0.50	1.00	0.45		
													0.49		
07th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	24.09	117.45	0.50	0.15	0.02	2.00	NO
					W29-U	0.68	0.99	1.29	23.06	117.45	0.50	1.00	0.23		
					W30-L	0.68	0.99	1.36	25.90	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	24.75	117.45	0.50	1.00	0.48		
					W31-L	0.68	0.99	0.36	19.46	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	20.23	117.45	0.50	1.00	0.10		
													0.88		
07th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	20.09	58.24	0.50	0.15	0.02	1.00	NO
					W32-U	0.68	0.99	0.67	19.89	58.24	0.50	1.00	0.21		
					W33-L	0.68	0.99	0.70	24.67	58.24	0.50	0.15	0.04		
					W33-U	0.68	0.99	1.29	24.22	58.24	0.50	1.00	0.48		
													0.74		
07th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	26.53	117.07	0.50	0.15	0.02	2.00	NO
					W34-U	0.68	0.99	1.29	25.57	117.07	0.50	1.00	0.25		
					W35-L	0.68	0.99	1.36	27.04	117.07	0.50	0.15	0.04		
					W35-U	0.68	0.99	2.52	25.94	117.07	0.50	1.00	0.50		
													0.82		
07th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	21.16	59.45	0.50	0.15	0.03	1.00	NO
					W36-U	0.68	0.99	1.29	20.59	59.45	0.50	1.00	0.40		
					W37-L	0.68	0.99	0.70	17.96	59.45	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.29	17.26	59.45	0.50	1.00	0.34		
													0.80		
07th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	13.62	57.18	0.50	0.15	0.02	1.00	NO
					W38-U	0.68	0.99	1.29	12.66	57.18	0.50	1.00	0.26		
													0.28		
07th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	15.49	119.55	0.50	0.15	0.01	2.00	NO
					W39-U	0.68	0.99	1.29	13.67	119.55	0.50	1.00	0.13		
					W40-L	0.68	0.99	1.36	15.34	119.55	0.50	0.15	0.02		
					W40-U	0.68	0.99	2.52	13.23	119.55	0.50	1.00	0.25		
													0.42		
07th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	10.80	69.12	0.50	0.15	0.01	1.00	
					W41-U	0.68	0.99	1.29	9.54	69.12	0.50	1.00	0.16		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W42-L	0.68	0.99	0.70	9.89	69.12	0.50	0.15	0.01		
					W42-U	0.68	0.99	1.29	8.42	69.12	0.50	1.00	0.14		
					0.33	1.00	NO								
07th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	9.48	66.25	0.50	0.15	0.01		
					W43-U	0.68	0.99	1.29	7.96	66.25	0.50	1.00	0.14		
					0.15	1.00	NO								
07th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	9.94	56.67	0.50	0.15	0.02		
					W44-U	0.68	0.99	1.29	8.46	56.67	0.50	1.00	0.17		
					0.19	1.00	NO								
07th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	36.95	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	29.21	151.85	0.50	1.00	0.55		
					W46-L	0.68	0.99	1.93	36.78	151.85	0.50	0.15	0.06		
					W46-U	0.68	0.99	3.57	29.13	151.85	0.50	1.00	0.62		
					W47-L	0.68	0.99	1.72	31.40	151.85	0.50	0.15	0.05		
					W47-U	0.68	0.99	3.20	24.48	151.85	0.50	1.00	0.46		
					1.80	2.00	NO								
					0.37										
08th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	32.63	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	21.24	125.20	0.50	1.00	0.49		
					W2-L	0.68	0.99	1.93	35.72	125.20	0.50	0.15	0.07		
					W2-U	0.68	0.99	3.57	22.89	125.20	0.50	1.00	0.59		
					W3-L	0.68	0.99	1.72	36.32	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	23.33	125.20	0.50	1.00	0.53		
					W4-L	0.68	0.99	0.70	39.71	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	39.70	125.20	0.50	1.00	0.37		
					2.21	2.00	YES								
08th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	37.90	66.26	0.50	0.15	0.05		
					W5-U	0.68	0.99	1.29	37.94	66.26	0.50	1.00	0.66		
					0.72	1.00	NO								
08th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	35.31	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	35.34	66.49	0.50	1.00	0.62		
					0.67	1.00	NO								
08th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	32.54	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	31.90	104.32	0.50	1.00	0.35		
					W8-L	0.68	0.99	1.36	34.21	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	33.35	104.32	0.50	1.00	0.72		
					1.17	2.00	NO								
08th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	27.88	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	27.50	65.09	0.50	1.00	0.49		
					0.53	1.00	NO								
08th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	25.51	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	24.50	121.62	0.50	1.00	0.23		
					W11-L	0.68	0.99	1.36	27.87	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	26.72	121.62	0.50	1.00	0.50		
					0.79	2.00	NO								
08th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	21.23	56.77	0.50	0.15	0.04		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	20.64	56.77	0.50	1.00	0.42	1.00	NO
													0.46		
08th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	17.08	56.45	0.50	0.15	0.03	1.00	NO
					W13-U	0.68	0.99	1.29	16.31	56.45	0.50	1.00	0.34		
													0.36	1.00	NO
													0.01		
08th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	17.22	119.79	0.50	0.15	0.15	1.00	NO
					W14-U	0.68	0.99	1.29	15.61	119.79	0.50	1.00	0.15		
					W15-L	0.68	0.99	1.36	20.83	119.79	0.50	0.15	0.03	1.00	NO
					W15-U	0.68	0.99	2.52	19.26	119.79	0.50	1.00	0.36		
													0.56	2.00	NO
													0.02		
08th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	12.78	59.49	0.50	0.15	0.23	1.00	NO
					W16-U	0.68	0.99	1.29	11.77	59.49	0.50	1.00	0.01		
					W17-L	0.68	0.99	0.36	15.76	59.49	0.50	0.15	0.16	1.00	NO
					W17-U	0.68	0.99	0.67	15.72	59.49	0.50	1.00	0.42		
													0.01	1.00	NO
													0.14		
08th	R11	Residential	LKD		W18-L	0.68	0.99	0.36	26.69	116.88	0.50	0.15	0.01	1.00	NO
					W18-U	0.68	0.99	0.67	26.66	116.88	0.50	1.00	0.14		
					W19-L	0.68	0.99	0.70	12.14	116.88	0.50	0.15	0.01	1.00	NO
					W19-U	0.68	0.99	1.29	10.05	116.88	0.50	1.00	0.10		
					W20-L	0.68	0.99	1.36	16.66	116.88	0.50	0.15	0.03	1.00	NO
					W20-U	0.68	0.99	2.52	14.68	116.88	0.50	1.00	0.28		
													0.57	2.00	NO
													0.02		
08th	R12	Residential	Bedroom		W21-L	0.68	0.99	0.70	9.79	55.29	0.50	0.15	0.18	1.00	NO
					W21-U	0.68	0.99	1.29	8.57	55.29	0.50	1.00	0.20		
													0.01	1.00	NO
													0.14		
08th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	9.58	69.09	0.50	0.15	0.15	1.00	NO
					W22-U	0.68	0.99	1.29	8.37	69.09	0.50	1.00	0.15		
													0.01	1.00	NO
													0.15		
08th	R14	Residential	Bedroom		W23-L	0.68	0.99	0.70	9.81	67.42	0.50	0.15	0.01	1.00	NO
					W23-U	0.68	0.99	1.29	8.60	67.42	0.50	1.00	0.15		
													0.16	1.00	NO
													0.01		
08th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	12.99	116.39	0.50	0.15	0.11	1.00	NO
					W24-U	0.68	0.99	1.29	10.93	116.39	0.50	1.00	0.03		
					W25-L	0.68	0.99	1.36	16.80	116.39	0.50	0.15	0.29	1.00	NO
					W25-U	0.68	0.99	2.52	14.76	116.39	0.50	1.00	0.43		
													0.02	1.00	NO
													0.24		
08th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	12.56	55.28	0.50	0.15	0.03	1.00	NO
					W26-U	0.68	0.99	1.29	11.49	55.28	0.50	1.00	0.33		
													0.36	1.00	NO
													0.04		
08th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	20.51	69.08	0.50	0.15	0.46	1.00	NO
					W27-U	0.68	0.99	1.29	19.89	69.08	0.50	1.00	0.50		
													1.00	1.00	NO
													0.50		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
08th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	24.48	117.45	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.29	23.46	117.45	0.50	1.00	0.23		
					W30-L	0.68	0.99	1.36	26.30	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	25.15	117.45	0.50	1.00	0.48		
					W31-L	0.68	0.99	0.36	22.38	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	24.13	117.45	0.50	1.00	0.12		
													0.91	2.00	NO
08th	R20		Residential	Bedroom	W32-L	0.68	0.99	0.36	20.29	58.24	0.50	0.15	0.02		
					W32-U	0.68	0.99	0.67	20.12	58.24	0.50	1.00	0.21		
					W33-L	0.68	0.99	0.70	25.09	58.24	0.50	0.15	0.04		
					W33-U	0.68	0.99	1.29	24.64	58.24	0.50	1.00	0.49		
													0.76	1.00	NO
08th	R21		Residential	LKD	W34-L	0.68	0.99	0.70	27.01	117.07	0.50	0.15	0.02		
					W34-U	0.68	0.99	1.29	26.06	117.07	0.50	1.00	0.26		
					W35-L	0.68	0.99	1.36	27.51	117.07	0.50	0.15	0.04		
					W35-U	0.68	0.99	2.52	26.42	117.07	0.50	1.00	0.51		
													0.83	2.00	NO
08th	R22		Residential	Bedroom	W36-L	0.68	0.99	0.70	21.59	59.45	0.50	0.15	0.03		
					W36-U	0.68	0.99	1.29	21.05	59.45	0.50	1.00	0.41		
					W37-L	0.68	0.99	0.70	18.44	59.45	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.29	17.78	59.45	0.50	1.00	0.35		
													0.82	1.00	NO
08th	R23		Residential	Bedroom	W38-L	0.68	0.99	0.70	14.13	57.18	0.50	0.15	0.02		
					W38-U	0.68	0.99	1.29	13.21	57.18	0.50	1.00	0.27		
													0.29	1.00	NO
08th	R24		Residential	LKD	W39-L	0.68	0.99	0.70	16.04	119.55	0.50	0.15	0.01		
					W39-U	0.68	0.99	1.29	14.27	119.55	0.50	1.00	0.14		
					W40-L	0.68	0.99	1.36	15.82	119.55	0.50	0.15	0.02		
					W40-U	0.68	0.99	2.52	13.77	119.55	0.50	1.00	0.26		
													0.44	2.00	NO
08th	R25		Residential	Bedroom	W41-L	0.68	0.99	0.70	11.20	69.12	0.50	0.15	0.02		
					W41-U	0.68	0.99	1.29	10.03	69.12	0.50	1.00	0.17		
					W42-L	0.68	0.99	0.70	10.28	69.12	0.50	0.15	0.01		
					W42-U	0.68	0.99	1.29	8.90	69.12	0.50	1.00	0.15		
													0.35	1.00	NO
08th	R26		Residential	Bedroom	W43-L	0.68	0.99	0.70	9.90	66.25	0.50	0.15	0.01		
					W43-U	0.68	0.99	1.29	8.42	66.25	0.50	1.00	0.15		
													0.16	1.00	NO
08th	R27		Residential	Bedroom	W44-L	0.68	0.99	0.70	10.33	56.67	0.50	0.15	0.02		
					W44-U	0.68	0.99	1.29	8.96	56.67	0.50	1.00	0.18		
													0.20	1.00	NO
08th	R28		Residential	LKD	W45-L	0.68	0.99	1.72	37.06	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	30.38	151.85	0.50	1.00	0.57		
					W46-L	0.68	0.99	1.93	36.90	151.85	0.50	0.15	0.06		
					W46-U	0.68	0.99	3.57	30.33	151.85	0.50	1.00	0.64		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria					
					W47-L	0.68	0.99	1.72	31.54	151.85	0.50	0.15	0.05							
					W47-U	0.68	0.99	3.20	25.84	151.85	0.50	1.00	0.49							
													1.87	2.00	NO					
09th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	36.79	125.20	0.50	0.15	0.07								
				W1-U	0.68	0.99	3.19	30.32	125.20	0.50	1.00	0.69								
				W2-L	0.68	0.99	1.93	40.11	125.20	0.50	0.15	0.08								
				W2-U	0.68	0.99	3.57	32.98	125.20	0.50	1.00	0.84								
				W3-L	0.68	0.99	1.72	40.73	125.20	0.50	0.15	0.08								
				W3-U	0.68	0.99	3.19	33.56	125.20	0.50	1.00	0.77								
				W4-L	0.68	0.99	0.70	40.63	125.20	0.50	0.15	0.03								
				W4-U	0.68	0.99	1.29	40.46	125.20	0.50	1.00	0.38								
																		2.94	2.00	YES
09th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	38.95	66.26	0.50	0.15	0.06								
				W5-U	0.68	0.99	1.29	38.77	66.26	0.50	1.00	0.68								
													0.73	1.00	NO					
09th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	36.34	66.49	0.50	0.15	0.05								
				W6-U	0.68	0.99	1.29	36.09	66.49	0.50	1.00	0.63								
													0.68	1.00	NO					
09th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	33.15	104.32	0.50	0.15	0.03								
				W7-U	0.68	0.99	1.29	32.39	104.32	0.50	1.00	0.36								
				W8-L	0.68	0.99	1.36	34.70	104.32	0.50	0.15	0.06								
				W8-U	0.68	0.99	2.52	33.79	104.32	0.50	1.00	0.73								
																		1.18	2.00	NO
				09th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	28.17			65.09	0.50	0.15	0.04		
								W9-U	0.68	0.99	1.29	27.77			65.09	0.50	1.00	0.50		
																			0.54	1.00
09th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	25.75	121.62	0.50	0.15	0.02								
				W10-U	0.68	0.99	1.29	24.73	121.62	0.50	1.00	0.24								
				W11-L	0.68	0.99	1.36	28.11	121.62	0.50	0.15	0.04								
				W11-U	0.68	0.99	2.52	26.94	121.62	0.50	1.00	0.50								
																		0.80	2.00	NO
				09th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	21.33			56.77	0.50	0.15	0.04		
								W12-U	0.68	0.99	1.29	20.71			56.77	0.50	1.00	0.42		
																			0.46	1.00
09th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	17.17	56.45	0.50	0.15	0.03								
				W13-U	0.68	0.99	1.29	16.33	56.45	0.50	1.00	0.34								
													0.36	1.00	NO					
09th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	17.39	119.79	0.50	0.15	0.01								
				W14-U	0.68	0.99	1.29	15.72	119.79	0.50	1.00	0.15								
				W15-L	0.68	0.99	1.36	21.01	119.79	0.50	0.15	0.03								
				W15-U	0.68	0.99	2.52	19.40	119.79	0.50	1.00	0.37								
																		0.56	2.00	NO
				09th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	12.85			59.49	0.50	0.15	0.02		
								W16-U	0.68	0.99	1.29	11.79			59.49	0.50	1.00	0.23		
								W17-L	0.68	0.99	0.36	16.34			59.49	0.50	0.15	0.01		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria	
09th	R11	Residential	LKD		W17-U	0.68	0.99	0.67	16.37	59.49	0.50	1.00	0.17	1.00	NO	
																0.43
					W18-L	0.68	0.99	0.36	26.92	116.88	0.50	0.15	0.01			
					W18-U	0.68	0.99	0.67	26.89	116.88	0.50	1.00	0.14			
					W19-L	0.68	0.99	0.70	12.47	116.88	0.50	0.15	0.01			
					W19-U	0.68	0.99	1.29	10.38	116.88	0.50	1.00	0.10			
09th	R12	Residential	Bedroom		W20-L	0.68	0.99	1.36	17.02	116.88	0.50	0.15	0.03	2.00	NO	
					W20-U	0.68	0.99	2.52	15.05	116.88	0.50	1.00	0.29			
																0.58
					W21-L	0.68	0.99	0.70	10.10	55.29	0.50	0.15	0.02			
					W21-U	0.68	0.99	1.29	8.88	55.29	0.50	1.00	0.19			
																0.20
09th	R13	Residential	Bedroom		W22-L	0.68	0.99	0.70	9.93	69.09	0.50	0.15	0.01	1.00	NO	
					W22-U	0.68	0.99	1.29	8.67	69.09	0.50	1.00	0.15			
																0.16
					W23-L	0.68	0.99	0.70	10.14	67.42	0.50	0.15	0.01			
					W23-U	0.68	0.99	1.29	8.90	67.42	0.50	1.00	0.15			
																0.17
09th	R15	Residential	LKD		W24-L	0.68	0.99	0.70	13.34	116.39	0.50	0.15	0.01	2.00	NO	
					W24-U	0.68	0.99	1.29	11.34	116.39	0.50	1.00	0.11			
					W25-L	0.68	0.99	1.36	17.09	116.39	0.50	0.15	0.03			
					W25-U	0.68	0.99	2.52	15.14	116.39	0.50	1.00	0.29			
																0.45
																0.02
09th	R16	Residential	Bedroom		W26-L	0.68	0.99	0.70	12.69	55.28	0.50	0.15	0.02	1.00	NO	
					W26-U	0.68	0.99	1.29	11.67	55.28	0.50	1.00	0.24			
																0.27
					W27-L	0.68	0.99	0.70	20.70	69.08	0.50	0.15	0.03			
					W27-U	0.68	0.99	1.29	20.09	69.08	0.50	1.00	0.34			
																0.37
09th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	22.66	55.32	0.50	0.15	0.04	1.00	NO	
					W28-U	0.68	0.99	1.29	22.15	55.32	0.50	1.00	0.46			
																0.50
					W29-L	0.68	0.99	0.70	24.89	117.45	0.50	0.15	0.02			
					W29-U	0.68	0.99	1.29	23.89	117.45	0.50	1.00	0.24			
					W30-L	0.68	0.99	1.36	26.72	117.45	0.50	0.15	0.04			
09th	R19	Residential	LKD		W30-U	0.68	0.99	2.52	25.57	117.45	0.50	1.00	0.49	2.00	NO	
					W31-L	0.68	0.99	0.36	27.92	117.45	0.50	0.15	0.01			
					W31-U	0.68	0.99	0.67	30.77	117.45	0.50	1.00	0.16			
																0.96
					W32-L	0.68	0.99	0.36	20.55	58.24	0.50	0.15	0.02			
					W32-U	0.68	0.99	0.67	20.42	58.24	0.50	1.00	0.21			
09th	R20	Residential	Bedroom		W33-L	0.68	0.99	0.70	25.51	58.24	0.50	0.15	0.04	1.00	NO	
					W33-U	0.68	0.99	1.29	25.07	58.24	0.50	1.00	0.50			
																0.77
																0.02
					W34-L	0.68	0.99	0.70	27.52	117.07	0.50	0.15	0.02			
																0.02

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W34-U	0.68	0.99	1.29	26.59	117.07	0.50	1.00	0.26	2.00	NO
					W35-L	0.68	0.99	1.36	28.02	117.07	0.50	0.15	0.04		
					W35-U	0.68	0.99	2.52	26.93	117.07	0.50	1.00	0.52		
09th	R22	Residential	Bedroom										0.85	1.00	NO
					W36-L	0.68	0.99	0.70	22.05	59.45	0.50	0.15	0.03		
					W36-U	0.68	0.99	1.29	21.52	59.45	0.50	1.00	0.42		
					W37-L	0.68	0.99	0.70	18.97	59.45	0.50	0.15	0.03		
					W37-U	0.68	0.99	1.29	18.33	59.45	0.50	1.00	0.36		
09th	R23	Residential	Bedroom										0.84	1.00	NO
					W38-L	0.68	0.99	0.70	14.69	57.18	0.50	0.15	0.02		
					W38-U	0.68	0.99	1.29	13.79	57.18	0.50	1.00	0.28		
09th	R24	Residential	LKD										0.30	1.00	NO
					W39-L	0.68	0.99	0.70	16.63	119.55	0.50	0.15	0.01		
					W39-U	0.68	0.99	1.29	14.96	119.55	0.50	1.00	0.15		
					W40-L	0.68	0.99	1.36	16.37	119.55	0.50	0.15	0.03		
					W40-U	0.68	0.99	2.52	14.38	119.55	0.50	1.00	0.27		
09th	R25	Residential	Bedroom										0.46	2.00	NO
					W41-L	0.68	0.99	0.70	11.66	69.12	0.50	0.15	0.02		
					W41-U	0.68	0.99	1.29	10.52	69.12	0.50	1.00	0.18		
					W42-L	0.68	0.99	0.70	10.71	69.12	0.50	0.15	0.01		
					W42-U	0.68	0.99	1.29	9.44	69.12	0.50	1.00	0.16		
09th	R26	Residential	Bedroom										0.37	1.00	NO
					W43-L	0.68	0.99	0.70	10.32	66.25	0.50	0.15	0.01		
					W43-U	0.68	0.99	1.29	8.95	66.25	0.50	1.00	0.16		
09th	R27	Residential	Bedroom										0.17	1.00	NO
					W44-L	0.68	0.99	0.70	10.79	56.67	0.50	0.15	0.02		
					W44-U	0.68	0.99	1.29	9.54	56.67	0.50	1.00	0.20		
09th	R28	Residential	LKD										0.21	1.00	NO
					W45-L	0.68	0.99	1.72	40.20	151.85	0.50	0.15	0.06		
					W45-U	0.68	0.99	3.18	38.76	151.85	0.50	1.00	0.73		
					W46-L	0.68	0.99	1.93	39.96	151.85	0.50	0.15	0.07		
					W46-U	0.68	0.99	3.57	38.73	151.85	0.50	1.00	0.82		
					W47-L	0.68	0.99	1.72	33.92	151.85	0.50	0.15	0.05		
					W47-U	0.68	0.99	3.20	33.28	151.85	0.50	1.00	0.63		
10th	R1	Residential	LKD										2.36	2.00	YES
					W1-L	0.68	0.99	1.72	34.89	125.20	0.50	0.15	0.06		
					W1-U	0.68	0.99	3.19	23.39	125.20	0.50	1.00	0.54		
					W2-L	0.68	0.99	1.93	37.82	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	25.39	125.20	0.50	1.00	0.65		
					W3-L	0.68	0.99	1.72	38.42	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	25.88	125.20	0.50	1.00	0.59		
					W4-L	0.68	0.99	0.70	41.32	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	41.14	125.20	0.50	1.00	0.38		
													2.40		
10th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	39.59	66.26	0.50	0.15	0.06		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W5-U	0.68	0.99	1.29	39.37	66.26	0.50	1.00	0.69	1.00	NO
													0.75		
10th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	36.81	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	36.53	66.49	0.50	1.00	0.64		
													0.69	1.00	NO
10th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	33.61	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	32.82	104.32	0.50	1.00	0.37		
					W8-L	0.68	0.99	1.36	35.16	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	34.23	104.32	0.50	1.00	0.74		
													1.20	2.00	NO
10th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	28.51	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	28.11	65.09	0.50	1.00	0.50		
													0.54	1.00	NO
10th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	26.06	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	25.09	121.62	0.50	1.00	0.24		
					W11-L	0.68	0.99	1.36	28.42	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	27.30	121.62	0.50	1.00	0.51		
													0.81	2.00	NO
10th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	21.51	56.77	0.50	0.15	0.04		
					W12-U	0.68	0.99	1.29	20.96	56.77	0.50	1.00	0.43		
													0.46	1.00	NO
10th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	17.29	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	16.50	56.45	0.50	1.00	0.34		
													0.37	1.00	NO
10th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	17.57	119.79	0.50	0.15	0.01		
					W14-U	0.68	0.99	1.29	15.96	119.79	0.50	1.00	0.15		
					W15-L	0.68	0.99	1.36	21.20	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	19.64	119.79	0.50	1.00	0.37		
													0.57	2.00	NO
10th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	12.94	59.49	0.50	0.15	0.02		
					W16-U	0.68	0.99	1.29	11.91	59.49	0.50	1.00	0.23		
					W17-L	0.68	0.99	0.36	17.16	59.49	0.50	0.15	0.01		
					W17-U	0.68	0.99	0.67	17.27	59.49	0.50	1.00	0.17		
													0.44	1.00	NO
10th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	27.20	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	27.18	116.88	0.50	1.00	0.14		
					W19-L	0.68	0.99	0.70	12.90	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	10.82	116.88	0.50	1.00	0.11		
					W20-L	0.68	0.99	1.36	17.42	116.88	0.50	0.15	0.03		
					W20-U	0.68	0.99	2.52	15.47	116.88	0.50	1.00	0.30		
													0.60	2.00	NO
10th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	10.44	55.29	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.29	9.25	55.29	0.50	1.00	0.19		
													0.21	1.00	NO
10th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	10.27	69.09	0.50	0.15	0.01		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W22-U	0.68	0.99	1.29	9.03	69.09	0.50	1.00	0.15	1.00	NO
													0.17		
10th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	10.43	67.42	0.50	0.15	0.01		
					W23-U	0.68	0.99	1.29	9.20	67.42	0.50	1.00	0.16		
													0.17	1.00	NO
10th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	13.78	116.39	0.50	0.15	0.01		
					W24-U	0.68	0.99	1.29	11.81	116.39	0.50	1.00	0.12		
					W25-L	0.68	0.99	1.36	17.56	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	15.64	116.39	0.50	1.00	0.30		
													0.46	2.00	NO
10th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	13.08	55.28	0.50	0.15	0.02		
					W26-U	0.68	0.99	1.29	12.14	55.28	0.50	1.00	0.25		
													0.28	1.00	NO
10th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	20.98	69.08	0.50	0.15	0.03		
					W27-U	0.68	0.99	1.29	20.36	69.08	0.50	1.00	0.34		
													0.37	1.00	NO
10th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	23.05	55.32	0.50	0.15	0.04		
					W28-U	0.68	0.99	1.29	22.53	55.32	0.50	1.00	0.47		
													0.51	1.00	NO
10th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	25.39	117.45	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.29	24.39	117.45	0.50	1.00	0.24		
					W30-L	0.68	0.99	1.36	27.23	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	26.09	117.45	0.50	1.00	0.50		
					W31-L	0.68	0.99	0.36	34.76	117.45	0.50	0.15	0.01		
					W31-U	0.68	0.99	0.67	35.53	117.45	0.50	1.00	0.18		
													1.00	2.00	NO
10th	R20		Residential	Bathroom	W32-L	0.68	0.99	0.70	25.64	49.89	0.50	0.15	0.05		
					W32-U	0.68	0.99	1.19	24.55	49.89	0.50	1.00	0.53		
													0.57	-1.00	NO
10th	R21		Residential	Study	W33-L	0.68	0.99	0.69	26.72	63.55	0.50	0.15	0.04		
					W33-U	0.68	0.99	1.17	26.36	63.55	0.50	1.00	0.44		
					W34-L	0.68	0.99	0.69	25.13	63.55	0.50	0.15	0.04		
					W34-U	0.68	0.99	1.17	25.13	63.55	0.50	1.00	0.42		
													0.93	-1.00	NO
10th	R22		Residential	En Suite	W35-L	0.68	0.99	0.70	21.81	50.60	0.50	0.15	0.04		
					W35-U	0.68	0.99	1.19	21.23	50.60	0.50	1.00	0.45		
													0.49	-1.00	NO
10th	R23		Residential	Bedroom	W36-L	0.68	0.99	0.69	21.16	91.83	0.50	0.15	0.02		
					W36-U	0.68	0.99	1.17	18.52	91.83	0.50	1.00	0.21		
					W37-L	0.68	0.99	0.69	19.89	91.83	0.50	0.15	0.02		
					W37-U	0.68	0.99	1.17	17.19	91.83	0.50	1.00	0.20		
													0.45	1.00	NO
10th	R24		Residential	LKD	W38-L	0.68	0.99	0.70	15.42	228.51	0.50	0.15	0.01		
					W38-U	0.68	0.99	1.19	12.69	228.51	0.50	1.00	0.06		
					W39-L	0.68	0.99	0.70	13.58	228.51	0.50	0.15	0.01		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W39-U	0.68	0.99	1.19	10.42	228.51	0.50	1.00	0.05		
					W40-L	0.68	0.99	1.71	61.22	228.51	0.50	0.15	0.06		
					W40-U	0.68	0.99	2.91	62.04	228.51	0.50	1.00	0.71		
					W41-L	0.68	0.99	1.71	59.12	228.51	0.50	0.15	0.06		
					W41-U	0.68	0.99	2.91	62.01	228.51	0.50	1.00	0.71		
					W42-L	0.68	0.99	1.71	60.75	228.51	0.50	0.15	0.06		
					W42-U	0.68	0.99	2.91	64.79	228.51	0.50	1.00	0.74		
					W43-L	0.68	0.99	0.70	65.44	228.51	0.50	0.15	0.03		
					W43-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					W44-L	0.68	0.99	1.71	60.89	228.51	0.50	0.15	0.06		
					W44-U	0.68	0.99	2.91	64.40	228.51	0.50	1.00	0.74		
					W45-L	0.68	0.99	0.70	65.45	228.51	0.50	0.15	0.03		
					W45-U	0.68	0.99	1.19	77.97	228.51	0.50	1.00	0.36		
					11th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	35.98		
W1-U	0.68	0.99	3.19	25.34	125.20	0.50	1.00	0.58							
W2-L	0.68	0.99	1.93	38.85	125.20	0.50	0.15	0.08							
W2-U	0.68	0.99	3.57	27.35	125.20	0.50	1.00	0.70							
W3-L	0.68	0.99	1.72	39.43	125.20	0.50	0.15	0.07							
W3-U	0.68	0.99	3.19	27.83	125.20	0.50	1.00	0.64							
W4-L	0.68	0.99	0.70	41.94	125.20	0.50	0.15	0.03							
W4-U	0.68	0.99	1.29	41.77	125.20	0.50	1.00	0.39							
11th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	40.14	66.26	0.50	0.15	0.06			
W5-U	0.68	0.99	1.29	39.93	66.26	0.50	1.00	0.70							
11th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	37.25	66.49	0.50	0.15	0.05			
W6-U	0.68	0.99	1.29	37.00	66.49	0.50	1.00	0.65							
11th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	34.04	104.32	0.50	0.15	0.03			
W7-U	0.68	0.99	1.29	33.31	104.32	0.50	1.00	0.37							
W8-L	0.68	0.99	1.36	35.65	104.32	0.50	0.15	0.06							
W8-U	0.68	0.99	2.52	34.76	104.32	0.50	1.00	0.75							
11th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	28.94	65.09	0.50	0.15	0.04			
W9-U	0.68	0.99	1.29	28.57	65.09	0.50	1.00	0.51							
11th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	26.51	121.62	0.50	0.15	0.02			
W10-U	0.68	0.99	1.29	25.53	121.62	0.50	1.00	0.24							
W11-L	0.68	0.99	1.36	28.85	121.62	0.50	0.15	0.04							
W11-U	0.68	0.99	2.52	27.73	121.62	0.50	1.00	0.52							
11th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	21.84	56.77	0.50	0.15	0.04			
W12-U	0.68	0.99	1.29	21.28	56.77	0.50	1.00	0.44							
													0.47	1.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
11th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	17.57	56.45	0.50	0.15	0.03	1.00	
					W13-U	0.68	0.99	1.29	16.82	56.45	0.50	1.00	0.35		
11th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	17.91	119.79	0.50	0.15	0.01	2.00	NO
					W14-U	0.68	0.99	1.29	16.34	119.79	0.50	1.00	0.16		
					W15-L	0.68	0.99	1.36	21.51	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	20.00	119.79	0.50	1.00	0.38		
													0.58		
11th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	13.20	59.49	0.50	0.15	0.02	1.00	NO
					W16-U	0.68	0.99	1.29	12.23	59.49	0.50	1.00	0.24		
					W17-L	0.68	0.99	0.36	18.11	59.49	0.50	0.15	0.01		
					W17-U	0.68	0.99	0.67	18.40	59.49	0.50	1.00	0.19		
													0.46		
11th	R11		Residential	LKD	W18-L	0.68	0.99	0.36	27.47	116.88	0.50	0.15	0.01	2.00	NO
					W18-U	0.68	0.99	0.67	27.45	116.88	0.50	1.00	0.14		
					W19-L	0.68	0.99	0.70	13.30	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	11.25	116.88	0.50	1.00	0.11		
					W20-L	0.68	0.99	1.36	17.80	116.88	0.50	0.15	0.03		
					W20-U	0.68	0.99	2.52	15.88	116.88	0.50	1.00	0.31		
													0.61		
11th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	10.76	55.29	0.50	0.15	0.02	1.00	NO
					W21-U	0.68	0.99	1.29	9.59	55.29	0.50	1.00	0.20		
11th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	10.57	69.09	0.50	0.15	0.01	1.00	NO
					W22-U	0.68	0.99	1.29	9.36	69.09	0.50	1.00	0.16		
11th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	10.73	67.42	0.50	0.15	0.01	1.00	NO
					W23-U	0.68	0.99	1.29	9.55	67.42	0.50	1.00	0.16		
11th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	14.20	116.39	0.50	0.15	0.01	2.00	NO
					W24-U	0.68	0.99	1.29	12.30	116.39	0.50	1.00	0.12		
					W25-L	0.68	0.99	1.36	18.00	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	16.16	116.39	0.50	1.00	0.31		
													0.48		
11th	R16		Residential	Bedroom	W26-L	0.68	0.99	0.70	13.54	55.28	0.50	0.15	0.02	1.00	NO
					W26-U	0.68	0.99	1.29	12.69	55.28	0.50	1.00	0.27		
11th	R17		Residential	Bedroom	W27-L	0.68	0.99	0.70	21.27	69.08	0.50	0.15	0.03	1.00	NO
					W27-U	0.68	0.99	1.29	20.73	69.08	0.50	1.00	0.35		
11th	R18		Residential	Bedroom	W28-L	0.68	0.99	0.70	23.41	55.32	0.50	0.15	0.04	1.00	NO
					W28-U	0.68	0.99	1.29	22.93	55.32	0.50	1.00	0.48		
11th	R19		Residential	LKD	W29-L	0.68	0.99	0.70	25.86	117.45	0.50	0.15	0.02	1.00	
					W29-U	0.68	0.99	1.29	24.88	117.45	0.50	1.00	0.25		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W30-L	0.68	0.99	1.36	27.70	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	26.57	117.45	0.50	1.00	0.51		
					W31-L	0.68	0.99	0.36	36.47	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	36.73	117.45	0.50	1.00	0.19		
12th	R1	Residential	LKD										1.02	2.00	NO
					W1-L	0.68	0.99	1.72	36.57	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	27.20	125.20	0.50	1.00	0.62		
					W2-L	0.68	0.99	1.93	39.41	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	29.18	125.20	0.50	1.00	0.75		
					W3-L	0.68	0.99	1.72	39.97	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	29.62	125.20	0.50	1.00	0.68		
					W4-L	0.68	0.99	0.70	42.57	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	42.37	125.20	0.50	1.00	0.39		
12th	R2	Residential	Bedroom										2.70	2.00	YES
					W5-L	0.68	0.99	0.70	40.69	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	40.45	66.26	0.50	1.00	0.71		
													0.77	1.00	NO
12th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	37.77	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	37.50	66.49	0.50	1.00	0.65		
													0.71	1.00	NO
					W7-L	0.68	0.99	0.70	34.59	104.32	0.50	0.15	0.03		
12th	R4	Residential	LKD		W7-U	0.68	0.99	1.29	33.85	104.32	0.50	1.00	0.38		
					W8-L	0.68	0.99	1.36	36.19	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	35.29	104.32	0.50	1.00	0.77		
													1.24	2.00	NO
12th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	29.39	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	29.00	65.09	0.50	1.00	0.52		
													0.56	1.00	NO
					W10-L	0.68	0.99	0.70	26.94	121.62	0.50	0.15	0.02		
12th	R6	Residential	LKD		W10-U	0.68	0.99	1.29	25.96	121.62	0.50	1.00	0.25		
					W11-L	0.68	0.99	1.36	29.27	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	28.14	121.62	0.50	1.00	0.52		
													0.84	2.00	NO
12th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	22.17	56.77	0.50	0.15	0.04		
					W12-U	0.68	0.99	1.29	21.60	56.77	0.50	1.00	0.44		
													0.48	1.00	NO
					W13-L	0.68	0.99	0.70	17.89	56.45	0.50	0.15	0.03		
12th	R8	Residential	Bedroom		W13-U	0.68	0.99	1.29	17.14	56.45	0.50	1.00	0.35		
													0.38	1.00	NO
12th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	18.29	119.79	0.50	0.15	0.01		
					W14-U	0.68	0.99	1.29	16.76	119.79	0.50	1.00	0.16		
					W15-L	0.68	0.99	1.36	21.88	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	20.38	119.79	0.50	1.00	0.39		
													0.60	2.00	NO
					W16-L	0.68	0.99	0.70	13.56	59.49	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	12.59	59.49	0.50	1.00	0.25	1.00	NO
					W17-L	0.68	0.99	0.36	19.56	59.49	0.50	0.15	0.02		
					W17-U	0.68	0.99	0.67	20.22	59.49	0.50	1.00	0.20		
12th	R11	Residential	LKD										0.49	2.00	NO
					W18-L	0.68	0.99	0.36	27.74	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	27.71	116.88	0.50	1.00	0.14		
					W19-L	0.68	0.99	0.70	13.71	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	11.68	116.88	0.50	1.00	0.12		
					W20-L	0.68	0.99	1.36	18.18	116.88	0.50	0.15	0.03		
					W20-U	0.68	0.99	2.52	16.28	116.88	0.50	1.00	0.32		
12th	R12	Residential	Bedroom										0.62	1.00	NO
					W21-L	0.68	0.99	0.70	11.08	55.29	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.29	9.93	55.29	0.50	1.00	0.21		
12th	R13	Residential	Bedroom										0.23	1.00	NO
					W22-L	0.68	0.99	0.70	10.91	69.09	0.50	0.15	0.01		
					W22-U	0.68	0.99	1.29	9.75	69.09	0.50	1.00	0.16		
12th	R14	Residential	Bedroom										0.18	1.00	NO
					W23-L	0.68	0.99	0.70	11.10	67.42	0.50	0.15	0.02		
					W23-U	0.68	0.99	1.29	9.97	67.42	0.50	1.00	0.17		
12th	R15	Residential	LKD										0.19	2.00	NO
					W24-L	0.68	0.99	0.70	14.74	116.39	0.50	0.15	0.01		
					W24-U	0.68	0.99	1.29	12.90	116.39	0.50	1.00	0.13		
					W25-L	0.68	0.99	1.36	18.54	116.39	0.50	0.15	0.03		
					W25-U	0.68	0.99	2.52	16.80	116.39	0.50	1.00	0.33		
12th	R16	Residential	Bedroom										0.50	2.00	NO
					W26-L	0.68	0.99	0.70	14.18	55.28	0.50	0.15	0.02		
					W26-U	0.68	0.99	1.29	13.39	55.28	0.50	1.00	0.28		
12th	R17	Residential	Bedroom										0.31	1.00	NO
					W27-L	0.68	0.99	0.70	21.73	69.08	0.50	0.15	0.03		
					W27-U	0.68	0.99	1.29	21.22	69.08	0.50	1.00	0.36		
12th	R18	Residential	Bedroom										0.39	1.00	NO
					W28-L	0.68	0.99	0.70	23.86	55.32	0.50	0.15	0.04		
					W28-U	0.68	0.99	1.29	23.38	55.32	0.50	1.00	0.49		
12th	R19	Residential	LKD										0.53	2.00	NO
					W29-L	0.68	0.99	0.70	26.36	117.45	0.50	0.15	0.02		
					W29-U	0.68	0.99	1.29	25.38	117.45	0.50	1.00	0.25		
					W30-L	0.68	0.99	1.36	28.20	117.45	0.50	0.15	0.04		
					W30-U	0.68	0.99	2.52	27.08	117.45	0.50	1.00	0.52		
					W31-L	0.68	0.99	0.36	37.24	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	37.21	117.45	0.50	1.00	0.19		
13th	R1	Residential	LKD										1.04	2.00	NO
					W1-L	0.68	0.99	1.72	36.61	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	28.96	125.20	0.50	1.00	0.66		
					W2-L	0.68	0.99	1.93	39.45	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	30.93	125.20	0.50	1.00	0.79		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W3-L	0.68	0.99	1.72	39.98	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	31.33	125.20	0.50	1.00	0.72		
					W4-L	0.68	0.99	0.70	43.18	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	42.96	125.20	0.50	1.00	0.40		
13th	R2		Residential	Bedroom									2.83	2.00	YES
					W5-L	0.68	0.99	0.70	41.22	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	40.95	66.26	0.50	1.00	0.72		
													0.78	1.00	NO
13th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	38.27	66.49	0.50	0.15	0.05		
					W6-U	0.68	0.99	1.29	37.99	66.49	0.50	1.00	0.66		
													0.72	1.00	NO
13th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	35.12	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	34.37	104.32	0.50	1.00	0.38		
					W8-L	0.68	0.99	1.36	36.70	104.32	0.50	0.15	0.06		
					W8-U	0.68	0.99	2.52	35.79	104.32	0.50	1.00	0.78		
13th	R5		Residential	Bedroom									1.25	2.00	NO
					W9-L	0.68	0.99	0.70	29.81	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	29.40	65.09	0.50	1.00	0.52		
													0.57	1.00	NO
13th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	27.36	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	26.37	121.62	0.50	1.00	0.25		
					W11-L	0.68	0.99	1.36	29.69	121.62	0.50	0.15	0.04		
					W11-U	0.68	0.99	2.52	28.55	121.62	0.50	1.00	0.53		
13th	R7		Residential	Bedroom									0.85	2.00	NO
					W12-L	0.68	0.99	0.70	22.50	56.77	0.50	0.15	0.04		
					W12-U	0.68	0.99	1.29	21.93	56.77	0.50	1.00	0.45		
													0.49	1.00	NO
13th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	18.22	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	17.47	56.45	0.50	1.00	0.36		
													0.39	1.00	NO
13th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	18.68	119.79	0.50	0.15	0.01		
					W14-U	0.68	0.99	1.29	17.20	119.79	0.50	1.00	0.17		
					W15-L	0.68	0.99	1.36	22.26	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	20.79	119.79	0.50	1.00	0.39		
13th	R10		Residential	Bedroom									0.61	2.00	NO
					W16-L	0.68	0.99	0.70	13.95	59.49	0.50	0.15	0.02		
					W16-U	0.68	0.99	1.29	12.99	59.49	0.50	1.00	0.25		
					W17-L	0.68	0.99	0.36	22.02	59.49	0.50	0.15	0.02		
13th	R11		Residential	LKD	W17-U	0.68	0.99	0.67	23.36	59.49	0.50	1.00	0.24		
													0.53	1.00	NO
					W18-L	0.68	0.99	0.36	27.99	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	27.96	116.88	0.50	1.00	0.14		
					W19-L	0.68	0.99	0.70	14.14	116.88	0.50	0.15	0.01		
					W19-U	0.68	0.99	1.29	12.12	116.88	0.50	1.00	0.12		
13th	R11		Residential	LKD	W20-L	0.68	0.99	1.36	18.56	116.88	0.50	0.15	0.03		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-U	0.68	0.99	2.52	16.71	116.88	0.50	1.00	0.32		
13th	R12		Residential	Bedroom	W21-L	0.68	0.99	0.70	11.45	55.29	0.50	0.15	0.02	2.00	NO
					W21-U	0.68	0.99	1.29	10.33	55.29	0.50	1.00	0.22		
13th	R13		Residential	Bedroom	W22-L	0.68	0.99	0.70	11.33	69.09	0.50	0.15	0.02	1.00	NO
					W22-U	0.68	0.99	1.29	10.22	69.09	0.50	1.00	0.17		
13th	R14		Residential	Bedroom	W23-L	0.68	0.99	0.70	11.53	67.42	0.50	0.15	0.02	1.00	NO
					W23-U	0.68	0.99	1.29	10.42	67.42	0.50	1.00	0.18		
13th	R15		Residential	LKD	W24-L	0.68	0.99	0.70	15.36	116.39	0.50	0.15	0.01	2.00	NO
					W24-U	0.68	0.99	1.29	13.55	116.39	0.50	1.00	0.14		
13th	R16		Residential	Bedroom	W25-L	0.68	0.99	1.36	19.17	116.39	0.50	0.15	0.03	1.00	NO
					W25-U	0.68	0.99	2.52	17.49	116.39	0.50	1.00	0.34		
13th	R17		Residential	Bedroom	W26-L	0.68	0.99	0.70	14.98	55.28	0.50	0.15	0.03	1.00	NO
					W26-U	0.68	0.99	1.29	14.21	55.28	0.50	1.00	0.30		
13th	R18		Residential	Bedroom	W27-L	0.68	0.99	0.70	22.23	69.08	0.50	0.15	0.03	1.00	NO
					W27-U	0.68	0.99	1.29	21.73	69.08	0.50	1.00	0.37		
13th	R19		Residential	Bedroom	W28-L	0.68	0.99	0.70	24.31	55.32	0.50	0.15	0.04	1.00	NO
					W28-U	0.68	0.99	1.29	23.85	55.32	0.50	1.00	0.50		
13th	R20		Residential	LKD	W29-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W29-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R21		Residential	LKD	W30-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W30-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R22		Residential	LKD	W31-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W31-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R23		Residential	LKD	W32-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W32-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R24		Residential	LKD	W33-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W33-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R25		Residential	LKD	W34-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W34-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R26		Residential	LKD	W35-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W35-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R27		Residential	LKD	W36-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W36-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R28		Residential	LKD	W37-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W37-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R29		Residential	LKD	W38-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W38-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R30		Residential	LKD	W39-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W39-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R31		Residential	LKD	W40-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W40-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R32		Residential	LKD	W41-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W41-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R33		Residential	LKD	W42-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W42-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R34		Residential	LKD	W43-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W43-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R35		Residential	LKD	W44-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W44-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R36		Residential	LKD	W45-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W45-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R37		Residential	LKD	W46-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W46-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R38		Residential	LKD	W47-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W47-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R39		Residential	LKD	W48-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W48-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R40		Residential	LKD	W49-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W49-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R41		Residential	LKD	W50-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W50-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R42		Residential	LKD	W51-L	0.68	0.99	1.36	28.72	117.45	0.50	0.15	0.04	1.00	NO
					W51-U	0.68	0.99	2.52	27.61	117.45	0.50	1.00	0.53		
13th	R43		Residential	LKD	W52-L	0.68	0.99	0.36	37.64	117.45	0.50	0.15	0.02	1.00	NO
					W52-U	0.68	0.99	0.67	37.64	117.45	0.50	1.00	0.19		
13th	R44		Residential	LKD	W53-L	0.68	0.99	0.70	26.87	117.45	0.50	0.15	0.02	2.00	NO
					W53-U	0.68	0.99	1.29	25.92	117.45	0.50	1.00	0.26		
13th	R45				W54-L	0.68	0.99	0.70	11.45	55.29	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R4	Residential	LKD		W6-U	0.68	0.99	1.29	38.42	66.49	0.50	1.00	0.67	1.00	NO
					W7-L	0.68	0.99	0.70	35.62	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	34.85	104.32	0.50	1.00	0.39		
					W8-L	0.68	0.99	1.36	37.20	104.32	0.50	0.15	0.07		
14th	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	36.27	104.32	0.50	1.00	0.79	2.00	NO
													1.27		
					W9-L	0.68	0.99	0.70	30.22	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	29.78	65.09	0.50	1.00	0.53		
14th	R6	Residential	LKD										0.57	1.00	NO
					W10-L	0.68	0.99	0.70	27.78	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	26.79	121.62	0.50	1.00	0.26		
					W11-L	0.68	0.99	1.36	30.10	121.62	0.50	0.15	0.05		
14th	R7	Residential	Bedroom		W11-U	0.68	0.99	2.52	28.97	121.62	0.50	1.00	0.54	2.00	NO
													0.86		
					W12-L	0.68	0.99	0.70	22.84	56.77	0.50	0.15	0.04		
					W12-U	0.68	0.99	1.29	22.26	56.77	0.50	1.00	0.46		
14th	R8	Residential	Bedroom										0.49	1.00	NO
					W13-L	0.68	0.99	0.70	18.58	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	17.83	56.45	0.50	1.00	0.37		
													0.40		
14th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	19.12	119.79	0.50	0.15	0.01	2.00	NO
					W14-U	0.68	0.99	1.29	17.63	119.79	0.50	1.00	0.17		
					W15-L	0.68	0.99	1.36	22.66	119.79	0.50	0.15	0.03		
					W15-U	0.68	0.99	2.52	21.20	119.79	0.50	1.00	0.40		
14th	R10	Residential	Bedroom										0.62	1.00	NO
					W16-L	0.68	0.99	0.70	14.39	59.49	0.50	0.15	0.02		
					W16-U	0.68	0.99	1.29	13.39	59.49	0.50	1.00	0.26		
					W17-L	0.68	0.99	0.36	26.41	59.49	0.50	0.15	0.02		
14th	R11	Residential	LKD		W17-U	0.68	0.99	0.67	28.85	59.49	0.50	1.00	0.29	1.00	NO
													0.60		
					W18-L	0.68	0.99	0.36	28.23	116.88	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.67	28.22	116.88	0.50	1.00	0.15		
14th	R12	Residential	Bedroom		W19-L	0.68	0.99	0.70	14.63	116.88	0.50	0.15	0.01	2.00	NO
					W19-U	0.68	0.99	1.29	12.66	116.88	0.50	1.00	0.13		
					W20-L	0.68	0.99	1.36	19.02	116.88	0.50	0.15	0.03		
					W20-U	0.68	0.99	2.52	17.20	116.88	0.50	1.00	0.33		
14th	R13	Residential	Bedroom										0.66	1.00	NO
					W21-L	0.68	0.99	0.70	11.90	55.29	0.50	0.15	0.02		
					W21-U	0.68	0.99	1.29	10.75	55.29	0.50	1.00	0.23		
													0.25		
14th	R14	Residential	Bedroom		W22-L	0.68	0.99	0.70	11.77	69.09	0.50	0.15	0.02	1.00	NO
					W22-U	0.68	0.99	1.29	10.63	69.09	0.50	1.00	0.18		
													0.19		
					W23-L	0.68	0.99	0.70	11.97	67.42	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
14th	R15	Residential	LKD		W23-U	0.68	0.99	1.29	10.84	67.42	0.50	1.00	0.19	1.00	NO
					W24-L	0.68	0.99	0.70	15.96	116.39	0.50	0.15	0.01		
					W24-U	0.68	0.99	1.29	14.23	116.39	0.50	1.00	0.14		
					W25-L	0.68	0.99	1.36	19.81	116.39	0.50	0.15	0.03		
14th	R16	Residential	Bedroom		W25-U	0.68	0.99	2.52	18.20	116.39	0.50	1.00	0.35	2.00	NO
					W26-L	0.68	0.99	0.70	15.77	55.28	0.50	0.15	0.03		
					W26-U	0.68	0.99	1.29	15.11	55.28	0.50	1.00	0.32		
													0.34		
14th	R17	Residential	Bedroom		W27-L	0.68	0.99	0.70	22.76	69.08	0.50	0.15	0.03	1.00	NO
					W27-U	0.68	0.99	1.29	22.28	69.08	0.50	1.00	0.37		
													0.41		
14th	R18	Residential	Bedroom		W28-L	0.68	0.99	0.70	24.80	55.32	0.50	0.15	0.04	1.00	NO
					W28-U	0.68	0.99	1.29	24.35	55.32	0.50	1.00	0.51		
													0.55		
14th	R19	Residential	LKD		W29-L	0.68	0.99	0.70	27.42	117.45	0.50	0.15	0.02	2.00	NO
					W29-U	0.68	0.99	1.29	26.49	117.45	0.50	1.00	0.26		
					W30-L	0.68	0.99	1.36	29.26	117.45	0.50	0.15	0.05		
					W30-U	0.68	0.99	2.52	28.15	117.45	0.50	1.00	0.54		
					W31-L	0.68	0.99	0.36	38.17	117.45	0.50	0.15	0.02		
					W31-U	0.68	0.99	0.67	38.26	117.45	0.50	1.00	0.20		
													1.08		
15th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	36.76	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	32.25	125.20	0.50	1.00	0.74		
					W2-L	0.68	0.99	1.93	39.60	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	34.22	125.20	0.50	1.00	0.88		
					W3-L	0.68	0.99	1.72	40.01	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	34.56	125.20	0.50	1.00	0.79		
					W4-L	0.68	0.99	0.70	44.34	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	43.97	125.20	0.50	1.00	0.41		
15th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	42.18	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	41.75	66.26	0.50	1.00	0.73		
													0.79		
15th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	39.18	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	38.73	66.49	0.50	1.00	0.68		
													0.73		
15th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	36.12	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	35.21	104.32	0.50	1.00	0.39		
					W8-L	0.68	0.99	1.36	37.70	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	36.63	104.32	0.50	1.00	0.79		
													1.29		
15th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	30.63	65.09	0.50	0.15	0.04	1.00	
					W9-U	0.68	0.99	1.29	30.08	65.09	0.50	1.00	0.54		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
15th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	28.25	121.62	0.50	0.15	0.58	1.00	NO
					W10-U	0.68	0.99	1.29	27.18	121.62	0.50	1.00	0.02		
					W11-L	0.68	0.99	1.36	30.56	121.62	0.50	0.15	0.26		
					W11-U	0.68	0.99	2.52	29.34	121.62	0.50	1.00	0.05		
15th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	23.22	56.77	0.50	0.15	0.87	2.00	NO
					W12-U	0.68	0.99	1.29	22.58	56.77	0.50	1.00	0.04		
													0.46		
													0.50	1.00	NO
15th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	18.98	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	18.19	56.45	0.50	1.00	0.37		
													0.41	1.00	NO
													0.02		
15th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	19.60	119.79	0.50	0.15	0.18		
					W14-U	0.68	0.99	1.29	18.12	119.79	0.50	1.00	0.04		
					W15-L	0.68	0.99	1.36	23.11	119.79	0.50	0.15	0.41		
					W15-U	0.68	0.99	2.52	21.64	119.79	0.50	1.00	0.64	2.00	NO
15th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	14.88	59.49	0.50	0.15	0.02		
					W16-U	0.68	0.99	1.29	13.88	59.49	0.50	1.00	0.27		
					W17-L	0.68	0.99	0.36	33.59	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	34.92	59.49	0.50	1.00	0.35		
15th	R11		Residential	LKD	W18-L	0.68	0.99	0.46	14.22	151.45	0.50	0.15	0.01		
					W18-U	0.68	0.99	0.93	11.74	151.45	0.50	1.00	0.07		
					W19-L	0.68	0.99	0.46	18.96	151.45	0.50	0.15	0.01		
					W19-U	0.68	0.99	0.93	17.70	151.45	0.50	1.00	0.10		
15th	R12		Residential	Bedroom	W20-L	0.68	0.99	0.46	17.65	151.45	0.50	0.15	0.01		
					W20-U	0.68	0.99	0.93	16.75	151.45	0.50	1.00	0.09		
					W21-L	0.68	0.99	0.70	14.41	151.45	0.50	0.15	0.01		
					W21-U	0.68	0.99	1.42	12.72	151.45	0.50	1.00	0.11		
15th	R13		Residential	Bedroom	W22-L	0.68	0.99	1.04	19.07	61.41	0.50	0.15	0.39	2.00	NO
					W22-U	0.68	0.99	2.11	16.97	61.41	0.50	1.00	0.04		
					W23-L	0.68	0.99	1.04	19.42	61.41	0.50	0.15	0.52		
					W23-U	0.68	0.99	2.11	17.65	61.41	0.50	1.00	0.04		
15th	R14		Residential	Bedroom	W24-L	0.68	0.99	1.04	19.13	95.91	0.50	0.15	1.16	1.00	YES
					W24-U	0.68	0.99	2.11	16.98	95.91	0.50	1.00	0.03		
					W25-L	0.68	0.99	1.04	19.84	95.91	0.50	0.15	0.34		
					W25-U	0.68	0.99	2.11	18.04	95.91	0.50	1.00	0.03		
15th	R15		Residential	Bedroom	W26-L	0.68	0.99	0.70	15.95	95.91	0.50	0.15	0.36		
					W26-U	0.68	0.99	1.42	14.59	95.91	0.50	1.00	0.02		
													0.19		
													0.96	1.00	NO
15th	R16		Residential	Bedroom	W27-L	0.68	0.99	0.46	18.97	84.77	0.50	0.15	0.01		
					W27-U	0.68	0.99	0.93	17.51	84.77	0.50	1.00	0.17		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria					
					W28-L	0.68	0.99	0.46	21.53	84.77	0.50	0.15	0.02							
					W28-U	0.68	0.99	0.93	20.71	84.77	0.50	1.00	0.21							
					W29-L	0.68	0.99	0.46	20.84	84.77	0.50	0.15	0.02							
					W29-U	0.68	0.99	0.93	20.77	84.77	0.50	1.00	0.21							
15th	R15	Residential	Bedroom										0.63	1.00	NO					
					W30-L	0.68	0.99	0.46	21.29	58.77	0.50	0.15	0.02							
					W30-U	0.68	0.99	0.93	23.29	58.77	0.50	1.00	0.33							
					W31-L	0.68	0.99	0.46	23.03	58.77	0.50	0.15	0.02							
					W31-U	0.68	0.99	0.93	25.15	58.77	0.50	1.00	0.36							
					W32-L	0.68	0.99	0.46	22.22	58.77	0.50	0.15	0.02							
					W32-U	0.68	0.99	0.93	25.21	58.77	0.50	1.00	0.36							
15th	R16	Residential	LKD										1.12	1.00	YES					
					W33-L	0.68	0.99	1.04	23.64	137.56	0.50	0.15	0.02							
					W33-U	0.68	0.99	2.11	26.99	137.56	0.50	1.00	0.37							
					W34-L	0.68	0.99	1.04	24.17	137.56	0.50	0.15	0.02							
					W34-U	0.68	0.99	2.11	28.05	137.56	0.50	1.00	0.39							
					W35-L	0.68	0.99	0.70	20.82	137.56	0.50	0.15	0.01							
					W35-U	0.68	0.99	1.42	25.94	137.56	0.50	1.00	0.24							
16th	R1	Residential	LKD										1.06	2.00	NO					
					W1-L	0.68	0.99	1.72	36.86	125.20	0.50	0.15	0.07							
					W1-U	0.68	0.99	3.19	33.30	125.20	0.50	1.00	0.76							
					W2-L	0.68	0.99	1.93	39.70	125.20	0.50	0.15	0.08							
					W2-U	0.68	0.99	3.57	35.34	125.20	0.50	1.00	0.91							
					W3-L	0.68	0.99	1.72	40.03	125.20	0.50	0.15	0.07							
					W3-U	0.68	0.99	3.19	35.70	125.20	0.50	1.00	0.82							
16th	R2	Residential	Bedroom										0.41							
					W4-L	0.68	0.99	0.70	44.56	125.20	0.50	0.15	0.03							
					W4-U	0.68	0.99	1.29	44.17	125.20	0.50	1.00	0.41							
					16th	R2	Residential	Bedroom										3.15	2.00	YES
										W5-L	0.68	0.99	0.70	42.29	66.26	0.50	0.15	0.06		
										W5-U	0.68	0.99	1.29	41.83	66.26	0.50	1.00	0.73		
																		0.79	1.00	NO
16th	R3	Residential	Bedroom							W6-L	0.68	0.99	0.70	39.27	66.49	0.50	0.15	0.06		
										W6-U	0.68	0.99	1.29	38.78	66.49	0.50	1.00	0.68		
																		0.73	1.00	NO
16th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	36.25	104.32	0.50	0.15	0.03							
					W7-U	0.68	0.99	1.29	35.30	104.32	0.50	1.00	0.39							
					W8-L	0.68	0.99	1.36	37.81	104.32	0.50	0.15	0.07							
					W8-U	0.68	0.99	2.52	36.70	104.32	0.50	1.00	0.80							
16th	R5	Residential	Bedroom										1.29	2.00	NO					
					W9-L	0.68	0.99	0.70	30.71	65.09	0.50	0.15	0.04							
					W9-U	0.68	0.99	1.29	30.13	65.09	0.50	1.00	0.54							
													0.58	1.00	NO					
16th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	28.46	121.62	0.50	0.15	0.02							
					W10-U	0.68	0.99	1.29	27.38	121.62	0.50	1.00	0.26							
					W11-L	0.68	0.99	1.36	30.77	121.62	0.50	0.15	0.05							

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W11-U	0.68	0.99	2.52	29.55	121.62	0.50	1.00	0.55	2.00	NO
													0.88		
16th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	23.43	56.77	0.50	0.15	0.04	1.00	NO
					W12-U	0.68	0.99	1.29	22.78	56.77	0.50	1.00	0.47		
16th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	19.26	56.45	0.50	0.15	0.03	1.00	NO
					W13-U	0.68	0.99	1.29	18.49	56.45	0.50	1.00	0.38		
16th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	20.00	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	18.56	119.79	0.50	1.00	0.18		
					W15-L	0.68	0.99	1.36	23.46	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	22.01	119.79	0.50	1.00	0.42		
16th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	15.30	59.49	0.50	0.15	0.02	1.00	NO
					W16-U	0.68	0.99	1.29	14.34	59.49	0.50	1.00	0.28		
					W17-L	0.68	0.99	0.36	36.17	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	36.42	59.49	0.50	1.00	0.37		
17th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	36.99	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	39.83	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	36.26	125.20	0.50	1.00	0.93		
					W3-L	0.68	0.99	1.72	40.05	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.65	125.20	0.50	1.00	0.84		
					W4-L	0.68	0.99	0.70	44.73	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	44.31	125.20	0.50	1.00	0.41		
17th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.33	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	41.85	66.26	0.50	1.00	0.73		
17th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.28	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	38.77	66.49	0.50	1.00	0.68		
17th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.32	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	35.37	104.32	0.50	1.00	0.39		
					W8-L	0.68	0.99	1.36	37.88	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	36.78	104.32	0.50	1.00	0.80		
17th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	30.78	65.09	0.50	0.15	0.04	1.00	NO
					W9-U	0.68	0.99	1.29	30.21	65.09	0.50	1.00	0.54		
17th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	28.68	121.62	0.50	0.15	0.02	1.00	NO
					W10-U	0.68	0.99	1.29	27.61	121.62	0.50	1.00	0.26		
					W11-L	0.68	0.99	1.36	30.98	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	29.77	121.62	0.50	1.00	0.55		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
17th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	23.64	56.77	0.50	0.15	0.89	2.00	NO
					W12-U	0.68	0.99	1.29	23.02	56.77	0.50	1.00	0.04		
17th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	19.59	56.45	0.50	0.15	0.51	1.00	NO
					W13-U	0.68	0.99	1.29	18.85	56.45	0.50	1.00	0.03		
17th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	20.42	119.79	0.50	0.15	0.42	1.00	NO
					W14-U	0.68	0.99	1.29	19.03	119.79	0.50	1.00	0.39		
17th	R9		Residential	LKD	W15-L	0.68	0.99	1.36	23.83	119.79	0.50	0.15	0.02		
					W15-U	0.68	0.99	2.52	22.40	119.79	0.50	1.00	0.18		
17th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	15.76	59.49	0.50	0.15	0.66	2.00	NO
					W16-U	0.68	0.99	1.29	14.89	59.49	0.50	1.00	0.02		
17th	R10		Residential	Bedroom	W17-L	0.68	0.99	0.36	37.08	59.49	0.50	0.15	0.29		
					W17-U	0.68	0.99	0.67	37.31	59.49	0.50	1.00	0.03		
17th	R10		Residential	Bedroom	W17-L	0.68	0.99	0.36	37.08	59.49	0.50	0.15	0.38		
					W17-U	0.68	0.99	0.67	37.31	59.49	0.50	1.00	0.03		
18th	R1		Residential	LKD	W16-L	0.68	0.99	0.70	15.76	59.49	0.50	0.15	0.72	1.00	NO
					W16-U	0.68	0.99	1.29	14.89	59.49	0.50	1.00	0.02		
18th	R1		Residential	LKD	W17-L	0.68	0.99	0.36	37.08	59.49	0.50	0.15	0.29		
					W17-U	0.68	0.99	0.67	37.31	59.49	0.50	1.00	0.03		
18th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	37.18	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
18th	R1		Residential	LKD	W2-L	0.68	0.99	1.93	40.02	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	36.36	125.20	0.50	1.00	0.93		
18th	R1		Residential	LKD	W3-L	0.68	0.99	1.72	40.07	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.76	125.20	0.50	1.00	0.84		
18th	R1		Residential	LKD	W4-L	0.68	0.99	0.70	44.88	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	44.48	125.20	0.50	1.00	0.41		
18th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.35	66.26	0.50	0.15	3.23	2.00	YES
					W5-U	0.68	0.99	1.29	41.87	66.26	0.50	1.00	0.06		
18th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.35	66.26	0.50	0.15	0.73		
					W5-U	0.68	0.99	1.29	41.87	66.26	0.50	1.00	0.06		
18th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.27	66.49	0.50	0.15	0.79	1.00	NO
					W6-U	0.68	0.99	1.29	38.76	66.49	0.50	1.00	0.68		
18th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.27	66.49	0.50	0.15	0.73	1.00	NO
					W6-U	0.68	0.99	1.29	38.76	66.49	0.50	1.00	0.68		
18th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.40	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	35.47	104.32	0.50	1.00	0.39		
18th	R4		Residential	LKD	W8-L	0.68	0.99	1.36	37.97	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	36.89	104.32	0.50	1.00	0.80		
18th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	30.88	65.09	0.50	0.15	1.29	2.00	NO
					W9-U	0.68	0.99	1.29	30.33	65.09	0.50	1.00	0.04		
18th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	30.88	65.09	0.50	0.15	0.54		
					W9-U	0.68	0.99	1.29	30.33	65.09	0.50	1.00	0.04		
18th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	28.94	121.62	0.50	0.15	0.59	1.00	NO
					W10-U	0.68	0.99	1.29	27.88	121.62	0.50	1.00	0.02		
18th	R6		Residential	LKD	W11-L	0.68	0.99	1.36	31.22	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	30.03	121.62	0.50	1.00	0.56		
18th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	28.94	121.62	0.50	0.15	0.89	2.00	NO
					W10-U	0.68	0.99	1.29	27.88	121.62	0.50	1.00	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
18th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	23.91	56.77	0.50	0.15	0.04	1.00	NO
					W12-U	0.68	0.99	1.29	23.29	56.77	0.50	1.00	0.48		
18th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	19.94	56.45	0.50	0.15	0.03	1.00	NO
					W13-U	0.68	0.99	1.29	19.22	56.45	0.50	1.00	0.40		
18th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	20.86	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	19.52	119.79	0.50	1.00	0.19		
					W15-L	0.68	0.99	1.36	24.21	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	22.83	119.79	0.50	1.00	0.43		
18th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	16.33	59.49	0.50	0.15	0.03	1.00	NO
					W16-U	0.68	0.99	1.29	15.47	59.49	0.50	1.00	0.30		
					W17-L	0.68	0.99	0.36	37.75	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	37.78	59.49	0.50	1.00	0.38		
19th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	37.42	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	40.27	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	36.43	125.20	0.50	1.00	0.93		
					W3-L	0.68	0.99	1.72	40.08	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.85	125.20	0.50	1.00	0.84		
					W4-L	0.68	0.99	0.70	45.05	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	44.65	125.20	0.50	1.00	0.41		
19th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.39	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	41.94	66.26	0.50	1.00	0.73		
19th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.29	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	38.83	66.49	0.50	1.00	0.68		
19th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.52	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	35.61	104.32	0.50	1.00	0.40		
					W8-L	0.68	0.99	1.36	38.10	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	37.02	104.32	0.50	1.00	0.80		
19th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	30.99	65.09	0.50	0.15	0.04	1.00	NO
					W9-U	0.68	0.99	1.29	30.43	65.09	0.50	1.00	0.54		
19th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	29.18	121.62	0.50	0.15	0.02	2.00	NO
					W10-U	0.68	0.99	1.29	28.14	121.62	0.50	1.00	0.27		
					W11-L	0.68	0.99	1.36	31.46	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	30.28	121.62	0.50	1.00	0.56		
19th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	24.15	56.77	0.50	0.15	0.04		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W12-U	0.68	0.99	1.29	23.54	56.77	0.50	1.00	0.48	1.00	NO
													0.52		
19th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	20.29	56.45	0.50	0.15	0.03		
					W13-U	0.68	0.99	1.29	19.57	56.45	0.50	1.00	0.40		
													0.44	1.00	NO
19th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	21.31	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	20.01	119.79	0.50	1.00	0.19		
					W15-L	0.68	0.99	1.36	24.62	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	23.25	119.79	0.50	1.00	0.44		
													0.69	2.00	NO
19th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	16.85	59.49	0.50	0.15	0.03		
					W16-U	0.68	0.99	1.29	16.02	59.49	0.50	1.00	0.31		
					W17-L	0.68	0.99	0.36	38.14	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	38.17	59.49	0.50	1.00	0.39		
													0.76	1.00	NO
20th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	37.69	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	40.54	125.20	0.50	0.15	0.08		
					W2-U	0.68	0.99	3.57	36.50	125.20	0.50	1.00	0.93		
					W3-L	0.68	0.99	1.72	40.11	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.93	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	45.23	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	44.84	125.20	0.50	1.00	0.42		
													3.24	2.00	YES
20th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.47	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	42.02	66.26	0.50	1.00	0.74		
													0.80	1.00	NO
20th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.41	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	38.95	66.49	0.50	1.00	0.68		
													0.74	1.00	NO
20th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.67	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	35.77	104.32	0.50	1.00	0.40		
					W8-L	0.68	0.99	1.36	38.24	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	37.17	104.32	0.50	1.00	0.81		
													1.30	2.00	NO
20th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	31.09	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	30.54	65.09	0.50	1.00	0.54		
													0.59	1.00	NO
20th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	29.44	121.62	0.50	0.15	0.02		
					W10-U	0.68	0.99	1.29	28.42	121.62	0.50	1.00	0.27		
					W11-L	0.68	0.99	1.36	31.71	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	30.56	121.62	0.50	1.00	0.57		
													0.91	2.00	NO
20th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	24.40	56.77	0.50	0.15	0.04		
					W12-U	0.68	0.99	1.29	23.81	56.77	0.50	1.00	0.49		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
20th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	20.63	56.45	0.50	0.15	0.53	1.00	NO
					W13-U	0.68	0.99	1.29	19.95	56.45	0.50	1.00	0.03		
20th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	21.77	119.79	0.50	0.15	0.44	1.00	NO
					W14-U	0.68	0.99	1.29	20.50	119.79	0.50	1.00	0.02		
					W15-L	0.68	0.99	1.36	25.03	119.79	0.50	0.15	0.20		
					W15-U	0.68	0.99	2.52	23.69	119.79	0.50	1.00	0.04		
													0.45		
20th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	17.39	59.49	0.50	0.15	0.70	2.00	NO
					W16-U	0.68	0.99	1.29	16.60	59.49	0.50	1.00	0.03		
					W17-L	0.68	0.99	0.36	38.55	59.49	0.50	0.15	0.32		
					W17-U	0.68	0.99	0.67	38.60	59.49	0.50	1.00	0.03		
													0.39		
21st	R1		Residential	LKD	W1-L	0.68	0.99	1.72	37.97	125.20	0.50	0.15	0.77	1.00	NO
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.07		
					W2-L	0.68	0.99	1.93	40.83	125.20	0.50	0.15	0.78		
					W2-U	0.68	0.99	3.57	36.54	125.20	0.50	1.00	0.08		
					W3-L	0.68	0.99	1.72	40.13	125.20	0.50	0.15	0.94		
					W3-U	0.68	0.99	3.19	36.98	125.20	0.50	1.00	0.07		
					W4-L	0.68	0.99	0.70	45.44	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	45.05	125.20	0.50	1.00	0.03		
													0.42		
													3.24	2.00	YES
21st	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.57	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	42.11	66.26	0.50	1.00	0.74		
21st	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.53	66.49	0.50	0.15	0.80	1.00	NO
					W6-U	0.68	0.99	1.29	39.02	66.49	0.50	1.00	0.06		
21st	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.85	104.32	0.50	0.15	0.74	1.00	NO
					W7-U	0.68	0.99	1.29	35.89	104.32	0.50	1.00	0.03		
					W8-L	0.68	0.99	1.36	38.39	104.32	0.50	0.15	0.40		
					W8-U	0.68	0.99	2.52	37.28	104.32	0.50	1.00	0.07		
													0.81		
21st	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	31.20	65.09	0.50	0.15	1.31	2.00	NO
					W9-U	0.68	0.99	1.29	30.59	65.09	0.50	1.00	0.05		
21st	R6		Residential	LKD	W10-L	0.68	0.99	0.70	29.71	121.62	0.50	0.15	0.55		
					W10-U	0.68	0.99	1.29	28.62	121.62	0.50	1.00	0.59	1.00	NO
					W11-L	0.68	0.99	1.36	31.97	121.62	0.50	0.15	0.02		
					W11-U	0.68	0.99	2.52	30.75	121.62	0.50	1.00	0.27		
													0.05		
21st	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	24.65	56.77	0.50	0.15	0.57		
					W12-U	0.68	0.99	1.29	23.98	56.77	0.50	1.00	0.92	2.00	NO
													0.04		
													0.49		
													0.53	1.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
21st	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	20.99	56.45	0.50	0.15	0.03	1.00	NO
					W13-U	0.68	0.99	1.29	20.26	56.45	0.50	1.00	0.42		
21st	R9		Residential	LKD	W14-L	0.68	0.99	0.70	22.24	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	20.97	119.79	0.50	1.00	0.20		
					W15-L	0.68	0.99	1.36	25.47	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	24.11	119.79	0.50	1.00	0.46		
21st	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	17.96	59.49	0.50	0.15	0.03	1.00	NO
					W16-U	0.68	0.99	1.29	17.15	59.49	0.50	1.00	0.33		
					W17-L	0.68	0.99	0.36	38.99	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	39.04	59.49	0.50	1.00	0.39		
22nd	R1		Residential	LKD	W1-L	0.68	0.99	1.72	38.26	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	41.13	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	36.56	125.20	0.50	1.00	0.94		
					W3-L	0.68	0.99	1.72	40.15	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.00	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	45.63	125.20	0.50	0.15	0.03		
					W4-U	0.68	0.99	1.29	45.25	125.20	0.50	1.00	0.42		
22nd	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	42.64	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	42.18	66.26	0.50	1.00	0.74		
22nd	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.48	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	38.95	66.49	0.50	1.00	0.68		
22nd	R4		Residential	LKD	W7-L	0.68	0.99	0.70	36.87	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	35.92	104.32	0.50	1.00	0.40		
					W8-L	0.68	0.99	1.36	38.40	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	37.29	104.32	0.50	1.00	0.81		
22nd	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	31.13	65.09	0.50	0.15	0.04	1.00	NO
					W9-U	0.68	0.99	1.29	30.52	65.09	0.50	1.00	0.54		
22nd	R6		Residential	LKD	W10-L	0.68	0.99	0.70	29.79	121.62	0.50	0.15	0.02	2.00	NO
					W10-U	0.68	0.99	1.29	28.71	121.62	0.50	1.00	0.27		
					W11-L	0.68	0.99	1.36	32.04	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	30.83	121.62	0.50	1.00	0.57		
22nd	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	24.69	56.77	0.50	0.15	0.04	1.00	NO
					W12-U	0.68	0.99	1.29	24.01	56.77	0.50	1.00	0.49		
22nd	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	21.15	56.45	0.50	0.15	0.04		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
22nd	R9	Residential	LKD		W13-U	0.68	0.99	1.29	20.41	56.45	0.50	1.00	0.42	1.00	NO
					W14-L	0.68	0.99	0.70	22.56	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	21.30	119.79	0.50	1.00	0.21		
					W15-L	0.68	0.99	1.36	25.76	119.79	0.50	0.15	0.04		
22nd	R10	Residential	Bedroom		W15-U	0.68	0.99	2.52	24.40	119.79	0.50	1.00	0.46	2.00	NO
					W16-L	0.68	0.99	0.70	18.32	59.49	0.50	0.15	0.03		
					W16-U	0.68	0.99	1.29	17.53	59.49	0.50	1.00	0.34		
					W17-L	0.68	0.99	0.36	39.45	59.49	0.50	0.15	0.03		
23rd	R1	Residential	LKD		W17-U	0.68	0.99	0.67	39.52	59.49	0.50	1.00	0.40	1.00	NO
					W1-L	0.68	0.99	1.72	38.56	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	34.15	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	41.44	125.20	0.50	0.15	0.09		
23rd	R2	Residential	Bedroom		W2-U	0.68	0.99	3.57	36.56	125.20	0.50	1.00	0.94	2.00	YES
					W3-L	0.68	0.99	1.72	40.17	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	36.99	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	45.85	125.20	0.50	0.15	0.03		
23rd	R3	Residential	Bedroom		W4-U	0.68	0.99	1.29	45.52	125.20	0.50	1.00	0.42	1.00	NO
					W5-L	0.68	0.99	0.70	42.74	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	42.39	66.26	0.50	1.00	0.74		
					W6-L	0.68	0.99	0.70	39.47	66.49	0.50	0.15	0.06		
23rd	R4	Residential	LKD		W6-U	0.68	0.99	1.29	39.08	66.49	0.50	1.00	0.68	1.00	NO
					W7-L	0.68	0.99	0.70	36.95	104.32	0.50	0.15	0.03		
					W7-U	0.68	0.99	1.29	36.14	104.32	0.50	1.00	0.40		
					W8-L	0.68	0.99	1.36	38.46	104.32	0.50	0.15	0.07		
23rd	R5	Residential	Bedroom		W8-U	0.68	0.99	2.52	37.48	104.32	0.50	1.00	0.81	2.00	NO
					W9-L	0.68	0.99	0.70	31.11	65.09	0.50	0.15	0.04		
					W9-U	0.68	0.99	1.29	30.65	65.09	0.50	1.00	0.55		
					W10-L	0.68	0.99	0.70	29.93	121.62	0.50	0.15	0.02		
23rd	R6	Residential	LKD		W10-U	0.68	0.99	1.29	28.99	121.62	0.50	1.00	0.28	2.00	NO
					W11-L	0.68	0.99	1.36	32.16	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	31.07	121.62	0.50	1.00	0.58		
					W12-L	0.68	0.99	0.70	24.75	56.77	0.50	0.15	0.04		
23rd	R7	Residential	Bedroom		W12-U	0.68	0.99	1.29	24.21	56.77	0.50	1.00	0.49	1.00	NO
					W13-L	0.68	0.99	0.70	21.34	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	20.76	56.45	0.50	1.00	0.43		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
23rd	R9		Residential	LKD	W14-L	0.68	0.99	0.70	22.93	119.79	0.50	0.15	0.46	1.00	NO
					W14-U	0.68	0.99	1.29	21.82	119.79	0.50	1.00	0.02		
					W15-L	0.68	0.99	1.36	26.10	119.79	0.50	0.15	0.21		
					W15-U	0.68	0.99	2.52	24.86	119.79	0.50	1.00	0.04		
													0.47		
23rd	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	18.74	59.49	0.50	0.15	0.74	2.00	NO
					W16-U	0.68	0.99	1.29	18.05	59.49	0.50	1.00	0.03		
					W17-L	0.68	0.99	0.36	39.94	59.49	0.50	0.15	0.35		
					W17-U	0.68	0.99	0.67	40.02	59.49	0.50	1.00	0.03		
													0.40		
24th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	38.87	125.20	0.50	0.15	0.82	1.00	NO
					W1-U	0.68	0.99	3.19	34.20	125.20	0.50	1.00	0.07		
					W2-L	0.68	0.99	1.93	41.76	125.20	0.50	0.15	0.78		
					W2-U	0.68	0.99	3.57	36.62	125.20	0.50	1.00	0.09		
					W3-L	0.68	0.99	1.72	40.19	125.20	0.50	0.15	0.94		
					W3-U	0.68	0.99	3.19	37.02	125.20	0.50	1.00	0.07		
					W4-L	0.68	0.99	0.70	46.24	125.20	0.50	0.15	0.85		
					W4-U	0.68	0.99	1.29	45.95	125.20	0.50	1.00	0.03		
													0.43		
													3.26	2.00	YES
24th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	43.13	66.26	0.50	0.15	0.06		
					W5-U	0.68	0.99	1.29	42.84	66.26	0.50	1.00	0.75		
24th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	39.84	66.49	0.50	0.15	0.81	1.00	NO
					W6-U	0.68	0.99	1.29	39.54	66.49	0.50	1.00	0.06		
24th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	37.44	104.32	0.50	0.15	0.69		
					W7-U	0.68	0.99	1.29	36.71	104.32	0.50	1.00	0.75	1.00	NO
					W8-L	0.68	0.99	1.36	38.92	104.32	0.50	0.15	0.03		
					W8-U	0.68	0.99	2.52	38.03	104.32	0.50	1.00	0.41		
													0.07		
24th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	31.53	65.09	0.50	0.15	0.83		
					W9-U	0.68	0.99	1.29	31.16	65.09	0.50	1.00	1.34	2.00	NO
24th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	30.48	121.62	0.50	0.15	0.05		
					W10-U	0.68	0.99	1.29	29.63	121.62	0.50	1.00	0.56		
					W11-L	0.68	0.99	1.36	32.65	121.62	0.50	0.15	0.60	1.00	NO
					W11-U	0.68	0.99	2.52	31.65	121.62	0.50	1.00	0.02		
													0.28		
24th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	25.24	56.77	0.50	0.15	0.94	2.00	NO
					W12-U	0.68	0.99	1.29	24.79	56.77	0.50	1.00	0.04		
24th	R8		Residential	Bedroom									0.51		
													0.55	1.00	NO
					W13-L	0.68	0.99	0.70	21.91	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	21.40	56.45	0.50	1.00	0.44		
													0.48	1.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
24th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	23.61	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	22.58	119.79	0.50	1.00	0.22		
					W15-L	0.68	0.99	1.36	26.70	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	25.53	119.79	0.50	1.00	0.48		
													0.76		
24th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	19.35	59.49	0.50	0.15	0.03	1.00	NO
					W16-U	0.68	0.99	1.29	18.76	59.49	0.50	1.00	0.37		
					W17-L	0.68	0.99	0.36	40.46	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	40.55	59.49	0.50	1.00	0.41		
													0.84		
25th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.19	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.31	125.20	0.50	1.00	0.78		
					W2-L	0.68	0.99	1.93	42.09	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	36.73	125.20	0.50	1.00	0.94		
					W3-L	0.68	0.99	1.72	40.21	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.05	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	46.69	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	46.41	125.20	0.50	1.00	0.43		
													3.27		
25th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	43.60	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	43.32	66.26	0.50	1.00	0.76		
25th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	40.32	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	40.03	66.49	0.50	1.00	0.70		
25th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	38.02	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	37.33	104.32	0.50	1.00	0.42		
					W8-L	0.68	0.99	1.36	39.46	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	38.61	104.32	0.50	1.00	0.84		
													1.36		
25th	R5		Residential	Bedroom	W9-L	0.68	0.99	0.70	32.05	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	31.70	65.09	0.50	1.00	0.57		
25th	R6		Residential	LKD	W10-L	0.68	0.99	0.70	31.14	121.62	0.50	0.15	0.02	2.00	NO
					W10-U	0.68	0.99	1.29	30.32	121.62	0.50	1.00	0.29		
					W11-L	0.68	0.99	1.36	33.25	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	32.27	121.62	0.50	1.00	0.60		
													0.96		
25th	R7		Residential	Bedroom	W12-L	0.68	0.99	0.70	25.83	56.77	0.50	0.15	0.04	1.00	NO
					W12-U	0.68	0.99	1.29	25.41	56.77	0.50	1.00	0.52		
25th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	22.55	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	22.08	56.45	0.50	1.00	0.45		
													0.49		
25th	R9		Residential	LKD	W14-L	0.68	0.99	0.70	24.37	119.79	0.50	0.15	0.02		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W14-U	0.68	0.99	1.29	23.39	119.79	0.50	1.00	0.23	2.00	NO
					W15-L	0.68	0.99	1.36	27.38	119.79	0.50	0.15	0.04		
					W15-U	0.68	0.99	2.52	26.26	119.79	0.50	1.00	0.50		
25th	R10	Residential	Bedroom		W16-L	0.68	0.99	0.70	20.06	59.49	0.50	0.15	0.03	1.00	NO
					W16-U	0.68	0.99	1.29	19.50	59.49	0.50	1.00	0.38		
					W17-L	0.68	0.99	0.36	41.01	59.49	0.50	0.15	0.03		
					W17-U	0.68	0.99	0.67	41.11	59.49	0.50	1.00	0.42		
													0.86		
26th	R1	Residential	LKD		W1-L	0.68	0.99	1.72	39.47	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	34.48	125.20	0.50	1.00	0.79		
					W2-L	0.68	0.99	1.93	42.38	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	36.91	125.20	0.50	1.00	0.95		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.07	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	47.16	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	46.89	125.20	0.50	1.00	0.43		
													3.29		
26th	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	44.11	66.26	0.50	0.15	0.06	1.00	NO
					W5-U	0.68	0.99	1.29	43.85	66.26	0.50	1.00	0.77		
26th	R3	Residential	Bedroom		W6-L	0.68	0.99	0.70	40.83	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	40.57	66.49	0.50	1.00	0.71		
													0.77		
26th	R4	Residential	LKD		W7-L	0.68	0.99	0.70	38.65	104.32	0.50	0.15	0.03	2.00	NO
					W7-U	0.68	0.99	1.29	37.99	104.32	0.50	1.00	0.42		
					W8-L	0.68	0.99	1.36	40.06	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	39.24	104.32	0.50	1.00	0.85		
													1.38		
26th	R5	Residential	Bedroom		W9-L	0.68	0.99	0.70	32.60	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	32.29	65.09	0.50	1.00	0.58		
													0.62		
26th	R6	Residential	LKD		W10-L	0.68	0.99	0.70	31.82	121.62	0.50	0.15	0.02	2.00	NO
					W10-U	0.68	0.99	1.29	31.06	121.62	0.50	1.00	0.30		
					W11-L	0.68	0.99	1.36	33.88	121.62	0.50	0.15	0.05		
					W11-U	0.68	0.99	2.52	32.94	121.62	0.50	1.00	0.61		
													0.98		
26th	R7	Residential	Bedroom		W12-L	0.68	0.99	0.70	26.46	56.77	0.50	0.15	0.04	1.00	NO
					W12-U	0.68	0.99	1.29	26.06	56.77	0.50	1.00	0.53		
													0.58		
26th	R8	Residential	Bedroom		W13-L	0.68	0.99	0.70	23.22	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	22.77	56.45	0.50	1.00	0.47		
													0.51		
26th	R9	Residential	LKD		W14-L	0.68	0.99	0.70	25.17	119.79	0.50	0.15	0.02	1.00	
					W14-U	0.68	0.99	1.29	24.22	119.79	0.50	1.00	0.23		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria		
					W15-L	0.68	0.99	1.36	28.10	119.79	0.50	0.15	0.04	2.00	NO		
					W15-U	0.68	0.99	2.52	27.00	119.79	0.50	1.00	0.51				
26th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	20.79	59.49	0.50	0.15	0.03	0.81	2.00	NO		
				W16-U	0.68	0.99	1.29	20.24	59.49	0.50	1.00	0.39					
				W17-L	0.68	0.99	0.36	41.60	59.49	0.50	0.15	0.03					
				W17-U	0.68	0.99	0.67	41.71	59.49	0.50	1.00	0.42					
												0.88	1.00	NO			
27th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.68	125.20	0.50	0.15	0.07	3.31	2.00	YES		
				W1-U	0.68	0.99	3.19	34.79	125.20	0.50	1.00	0.80					
				W2-L	0.68	0.99	1.93	42.60	125.20	0.50	0.15	0.09					
				W2-U	0.68	0.99	3.57	37.23	125.20	0.50	1.00	0.95					
				W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07					
				W3-U	0.68	0.99	3.19	37.10	125.20	0.50	1.00	0.85					
				W4-L	0.68	0.99	0.70	47.66	125.20	0.50	0.15	0.04					
				W4-U	0.68	0.99	1.29	47.41	125.20	0.50	1.00	0.44					
27th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	44.66	66.26	0.50	0.15	0.06	0.84	1.00	NO		
				W5-U	0.68	0.99	1.29	44.43	66.26	0.50	1.00	0.78					
27th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	41.40	66.49	0.50	0.15	0.06	0.78	1.00	NO		
				W6-U	0.68	0.99	1.29	41.16	66.49	0.50	1.00	0.72					
27th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	39.32	104.32	0.50	0.15	0.04	1.40	2.00	NO		
				W7-U	0.68	0.99	1.29	38.69	104.32	0.50	1.00	0.43					
				W8-L	0.68	0.99	1.36	40.70	104.32	0.50	0.15	0.07					
				W8-U	0.68	0.99	2.52	39.91	104.32	0.50	1.00	0.87					
27th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	33.21	65.09	0.50	0.15	0.05	0.63	1.00	NO		
				W9-U	0.68	0.99	1.29	32.93	65.09	0.50	1.00	0.59					
27th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	32.55	121.62	0.50	0.15	0.03	1.01	2.00	NO		
				W10-U	0.68	0.99	1.29	31.82	121.62	0.50	1.00	0.30					
				W11-L	0.68	0.99	1.36	34.54	121.62	0.50	0.15	0.05					
				W11-U	0.68	0.99	2.52	33.64	121.62	0.50	1.00	0.63					
27th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	27.12	56.77	0.50	0.15	0.04	0.59	1.00	NO		
				W12-U	0.68	0.99	1.29	26.75	56.77	0.50	1.00	0.55					
27th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	23.90	56.45	0.50	0.15	0.04	0.52	1.00	NO		
				W13-U	0.68	0.99	1.29	23.48	56.45	0.50	1.00	0.48					
27th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	25.95	119.79	0.50	0.15	0.02					
				W14-U	0.68	0.99	1.29	25.05	119.79	0.50	1.00	0.24					
				W15-L	0.68	0.99	1.36	28.82	119.79	0.50	0.15	0.04					

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W15-U	0.68	0.99	2.52	27.75	119.79	0.50	1.00	0.52		
27th	R10	Residential	Bedroom	W16-L	0.68	0.99	0.70	21.47	59.49	0.50	0.15	0.03	0.83	2.00	NO
				W16-U	0.68	0.99	1.29	20.98	59.49	0.50	1.00	0.41			
				W17-L	0.68	0.99	0.36	42.22	59.49	0.50	0.15	0.03			
				W17-U	0.68	0.99	0.67	42.34	59.49	0.50	1.00	0.43			
													0.91	1.00	NO
28th	R1	Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07			
				W1-U	0.68	0.99	3.19	35.13	125.20	0.50	1.00	0.80			
				W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09			
				W2-U	0.68	0.99	3.57	37.58	125.20	0.50	1.00	0.96			
				W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07			
				W3-U	0.68	0.99	3.19	37.12	125.20	0.50	1.00	0.85			
				W4-L	0.68	0.99	0.70	48.19	125.20	0.50	0.15	0.04			
				W4-U	0.68	0.99	1.29	47.96	125.20	0.50	1.00	0.44			
														3.33	2.00
28th	R2	Residential	Bedroom	W5-L	0.68	0.99	0.70	45.26	66.26	0.50	0.15	0.06			
				W5-U	0.68	0.99	1.29	45.05	66.26	0.50	1.00	0.79			
													0.85	1.00	NO
28th	R3	Residential	Bedroom	W6-L	0.68	0.99	0.70	42.02	66.49	0.50	0.15	0.06			
				W6-U	0.68	0.99	1.29	41.81	66.49	0.50	1.00	0.73			
													0.79	1.00	NO
28th	R4	Residential	LKD	W7-L	0.68	0.99	0.70	40.06	104.32	0.50	0.15	0.04			
				W7-U	0.68	0.99	1.29	39.46	104.32	0.50	1.00	0.44			
				W8-L	0.68	0.99	1.36	41.40	104.32	0.50	0.15	0.07			
				W8-U	0.68	0.99	2.52	40.64	104.32	0.50	1.00	0.88			
													1.43	2.00	NO
28th	R5	Residential	Bedroom	W9-L	0.68	0.99	0.70	33.88	65.09	0.50	0.15	0.05			
				W9-U	0.68	0.99	1.29	33.61	65.09	0.50	1.00	0.60			
													0.65	1.00	NO
28th	R6	Residential	LKD	W10-L	0.68	0.99	0.70	33.32	121.62	0.50	0.15	0.03			
				W10-U	0.68	0.99	1.29	32.63	121.62	0.50	1.00	0.31			
				W11-L	0.68	0.99	1.36	35.25	121.62	0.50	0.15	0.05			
				W11-U	0.68	0.99	2.52	34.39	121.62	0.50	1.00	0.64			
													1.03	2.00	NO
28th	R7	Residential	Bedroom	W12-L	0.68	0.99	0.70	27.83	56.77	0.50	0.15	0.05			
				W12-U	0.68	0.99	1.29	27.50	56.77	0.50	1.00	0.56			
													0.61	1.00	NO
28th	R8	Residential	Bedroom	W13-L	0.68	0.99	0.70	24.63	56.45	0.50	0.15	0.04			
				W13-U	0.68	0.99	1.29	24.25	56.45	0.50	1.00	0.50			
													0.54	1.00	NO
28th	R9	Residential	LKD	W14-L	0.68	0.99	0.70	26.79	119.79	0.50	0.15	0.02			
				W14-U	0.68	0.99	1.29	25.94	119.79	0.50	1.00	0.25			
				W15-L	0.68	0.99	1.36	29.57	119.79	0.50	0.15	0.05			
				W15-U	0.68	0.99	2.52	28.56	119.79	0.50	1.00	0.54			

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
28th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	22.21	59.49	0.50	0.15	0.86	2.00	NO
					W16-U	0.68	0.99	1.29	21.77	59.49	0.50	1.00	0.42		
					W17-L	0.68	0.99	0.36	42.88	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	43.00	59.49	0.50	1.00	0.43		
													0.93	1.00	NO
29th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.79	125.20	0.50	0.15	0.07		
					W1-U	0.68	0.99	3.19	35.45	125.20	0.50	1.00	0.81		
					W2-L	0.68	0.99	1.93	42.72	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	37.92	125.20	0.50	1.00	0.97		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.14	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	48.76	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	48.55	125.20	0.50	1.00	0.45		
													3.36	2.00	YES
29th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	45.92	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	45.74	66.26	0.50	1.00	0.80		
29th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	42.70	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	42.51	66.49	0.50	1.00	0.74		
29th	R4		Residential	LKD									0.87	1.00	NO
					W7-L	0.68	0.99	0.70	40.85	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	40.28	104.32	0.50	1.00	0.45		
					W8-L	0.68	0.99	1.36	42.17	104.32	0.50	0.15	0.07		
					W8-U	0.68	0.99	2.52	41.44	104.32	0.50	1.00	0.90		
29th	R5		Residential	Bedroom									1.46	2.00	NO
					W9-L	0.68	0.99	0.70	34.58	65.09	0.50	0.15	0.05		
29th	R6		Residential	LKD	W9-U	0.68	0.99	1.29	34.36	65.09	0.50	1.00	0.61		
													0.66	1.00	NO
					W10-L	0.68	0.99	0.70	34.15	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	33.49	121.62	0.50	1.00	0.32		
					W11-L	0.68	0.99	1.36	36.01	121.62	0.50	0.15	0.05		
29th	R7		Residential	Bedroom	W11-U	0.68	0.99	2.52	35.19	121.62	0.50	1.00	0.65		
													1.06	2.00	NO
					W12-L	0.68	0.99	0.70	28.59	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	28.29	56.77	0.50	1.00	0.58		
													0.63	1.00	NO
29th	R8		Residential	Bedroom	W13-L	0.68	0.99	0.70	25.40	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	25.04	56.45	0.50	1.00	0.51		
29th	R9		Residential	LKD									0.56	1.00	NO
					W14-L	0.68	0.99	0.70	27.67	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	26.86	119.79	0.50	1.00	0.26		
					W15-L	0.68	0.99	1.36	30.39	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	29.44	119.79	0.50	1.00	0.56		
29th													0.88	2.00	NO

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
29th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	23.00	59.49	0.50	0.15	0.04	1.00	NO
					W16-U	0.68	0.99	1.29	22.63	59.49	0.50	1.00	0.44		
					W17-L	0.68	0.99	0.36	43.57	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	43.69	59.49	0.50	1.00	0.44		
													0.96		
30th	R1		Residential	LKD	W1-L	0.68	0.99	1.72	39.80	125.20	0.50	0.15	0.07	2.00	YES
					W1-U	0.68	0.99	3.19	35.77	125.20	0.50	1.00	0.82		
					W2-L	0.68	0.99	1.93	42.73	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.26	125.20	0.50	1.00	0.98		
					W3-L	0.68	0.99	1.72	40.22	125.20	0.50	0.15	0.07		
					W3-U	0.68	0.99	3.19	37.17	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	49.37	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.17	125.20	0.50	1.00	0.46		
30th	R2		Residential	Bedroom	W5-L	0.68	0.99	0.70	46.64	66.26	0.50	0.15	0.07	1.00	NO
					W5-U	0.68	0.99	1.29	46.49	66.26	0.50	1.00	0.81		
30th	R3		Residential	Bedroom	W6-L	0.68	0.99	0.70	43.43	66.49	0.50	0.15	0.06	1.00	NO
					W6-U	0.68	0.99	1.29	43.28	66.49	0.50	1.00	0.76		
30th	R4		Residential	LKD	W7-L	0.68	0.99	0.70	41.70	104.32	0.50	0.15	0.04	2.00	NO
					W7-U	0.68	0.99	1.29	41.17	104.32	0.50	1.00	0.46		
30th	R5		Residential	Bedroom	W8-L	0.68	0.99	1.36	42.98	104.32	0.50	0.15	0.08	1.00	NO
					W8-U	0.68	0.99	2.52	42.28	104.32	0.50	1.00	0.92		
30th	R6		Residential	LKD	W9-L	0.68	0.99	0.70	35.35	65.09	0.50	0.15	0.05	1.00	NO
					W9-U	0.68	0.99	1.29	35.14	65.09	0.50	1.00	0.63		
30th	R7		Residential	Bedroom	W10-L	0.68	0.99	0.70	35.01	121.62	0.50	0.15	0.03	2.00	NO
					W10-U	0.68	0.99	1.29	34.38	121.62	0.50	1.00	0.33		
30th	R8		Residential	Bedroom	W11-L	0.68	0.99	1.36	36.82	121.62	0.50	0.15	0.06	1.00	NO
					W11-U	0.68	0.99	2.52	36.02	121.62	0.50	1.00	0.67		
30th	R9		Residential	LKD	W12-L	0.68	0.99	0.70	29.38	56.77	0.50	0.15	0.05	1.00	NO
					W12-U	0.68	0.99	1.29	29.10	56.77	0.50	1.00	0.59		
30th	R10		Residential	Bedroom	W13-L	0.68	0.99	0.70	26.19	56.45	0.50	0.15	0.04	1.00	NO
					W13-U	0.68	0.99	1.29	25.87	56.45	0.50	1.00	0.53		
30th	R10		Residential	Bedroom	W14-L	0.68	0.99	0.70	28.58	119.79	0.50	0.15	0.02	2.00	NO
					W14-U	0.68	0.99	1.29	27.83	119.79	0.50	1.00	0.27		
30th	R10		Residential	Bedroom	W15-L	0.68	0.99	1.36	31.25	119.79	0.50	0.15	0.05	1.00	NO
					W15-U	0.68	0.99	2.52	30.34	119.79	0.50	1.00	0.57		
30th	R10		Residential	Bedroom	W16-L	0.68	0.99	0.70	23.87	59.49	0.50	0.15	0.04	1.00	NO
					W16-U	0.68	0.99	1.29	23.63	59.49	0.50	1.00	0.44		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W16-U	0.68	0.99	1.29	23.51	59.49	0.50	1.00	0.46		
					W17-L	0.68	0.99	0.36	44.29	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	44.44	59.49	0.50	1.00	0.45		
31st	R1	Residential	LKD										0.98	1.00	NO
					W1-L	0.68	0.99	1.72	40.58	125.20	0.50	0.15	0.08		
					W1-U	0.68	0.99	3.19	36.15	125.20	0.50	1.00	0.83		
					W2-L	0.68	0.99	1.93	43.53	125.20	0.50	0.15	0.09		
					W2-U	0.68	0.99	3.57	38.63	125.20	0.50	1.00	0.99		
					W3-L	0.68	0.99	1.72	40.71	125.20	0.50	0.15	0.08		
					W3-U	0.68	0.99	3.19	37.23	125.20	0.50	1.00	0.85		
					W4-L	0.68	0.99	0.70	50.02	125.20	0.50	0.15	0.04		
					W4-U	0.68	0.99	1.29	49.83	125.20	0.50	1.00	0.46		
													3.41	2.00	YES
31st	R2	Residential	Bedroom		W5-L	0.68	0.99	0.70	47.42	66.26	0.50	0.15	0.07		
					W5-U	0.68	0.99	1.29	47.29	66.26	0.50	1.00	0.83		
31st	R3	Residential	Bedroom										0.90	1.00	NO
					W6-L	0.68	0.99	0.70	44.24	66.49	0.50	0.15	0.06		
					W6-U	0.68	0.99	1.29	44.12	66.49	0.50	1.00	0.77		
31st	R4	Residential	LKD										0.83	1.00	NO
					W7-L	0.68	0.99	0.70	42.61	104.32	0.50	0.15	0.04		
					W7-U	0.68	0.99	1.29	42.12	104.32	0.50	1.00	0.47		
					W8-L	0.68	0.99	1.36	43.84	104.32	0.50	0.15	0.08		
					W8-U	0.68	0.99	2.52	43.18	104.32	0.50	1.00	0.94		
31st	R5	Residential	Bedroom										1.52	2.00	NO
					W9-L	0.68	0.99	0.70	36.16	65.09	0.50	0.15	0.05		
					W9-U	0.68	0.99	1.29	35.99	65.09	0.50	1.00	0.64		
31st	R6	Residential	LKD										0.69	1.00	NO
					W10-L	0.68	0.99	0.70	35.91	121.62	0.50	0.15	0.03		
					W10-U	0.68	0.99	1.29	35.31	121.62	0.50	1.00	0.34		
					W11-L	0.68	0.99	1.36	37.66	121.62	0.50	0.15	0.06		
					W11-U	0.68	0.99	2.52	36.89	121.62	0.50	1.00	0.69		
31st	R7	Residential	Bedroom										1.11	2.00	NO
					W12-L	0.68	0.99	0.70	30.20	56.77	0.50	0.15	0.05		
					W12-U	0.68	0.99	1.29	29.95	56.77	0.50	1.00	0.61		
31st	R8	Residential	Bedroom										0.66	1.00	NO
					W13-L	0.68	0.99	0.70	27.02	56.45	0.50	0.15	0.04		
					W13-U	0.68	0.99	1.29	26.72	56.45	0.50	1.00	0.55		
31st	R9	Residential	LKD										0.59	1.00	NO
					W14-L	0.68	0.99	0.70	29.53	119.79	0.50	0.15	0.02		
					W14-U	0.68	0.99	1.29	28.80	119.79	0.50	1.00	0.28		
					W15-L	0.68	0.99	1.36	32.12	119.79	0.50	0.15	0.05		
					W15-U	0.68	0.99	2.52	31.25	119.79	0.50	1.00	0.59		
31st	R10	Residential	Bedroom										0.94	2.00	NO
					W16-L	0.68	0.99	0.70	24.73	59.49	0.50	0.15	0.04		
					W16-U	0.68	0.99	1.29	24.41	59.49	0.50	1.00	0.48		

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
 Project No.: EKA251101
 Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
 Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W17-L	0.68	0.99	0.36	45.14	59.49	0.50	0.15	0.04		
					W17-U	0.68	0.99	0.67	45.38	59.49	0.50	1.00	0.46		
													1.01	1.00	YES
32nd	R1	Residential	Bedroom	W1-L	0.68	0.99	0.71	63.31	204.87	0.50	0.15	0.03			
				W1-U	0.68	0.99	1.45	68.93	204.87	0.50	1.00	0.44			
				W2-L	0.68	0.99	0.71	62.13	204.87	0.50	0.15	0.03			
				W2-U	0.68	0.99	1.45	68.79	204.87	0.50	1.00	0.44			
				W3-L	0.68	0.99	1.51	75.82	204.87	0.50	0.15	0.08			
				W3-U	0.68	0.99	3.07	85.21	204.87	0.50	1.00	1.15			
				W4-L	0.68	0.99	1.51	74.26	204.87	0.50	0.15	0.07			
				W4-U	0.68	0.99	3.07	85.39	204.87	0.50	1.00	1.15			
				W5-L	0.68	0.99	0.46	29.41	204.87	0.50	0.15	0.01			
				W5-U	0.68	0.99	0.93	45.41	204.87	0.50	1.00	0.19			
				W6-L	0.68	0.99	0.46	32.69	204.87	0.50	0.15	0.01			
				W6-U	0.68	0.99	0.93	49.19	204.87	0.50	1.00	0.20			
				W7-L	0.68	0.99	0.46	30.35	204.87	0.50	0.15	0.01			
				W7-U	0.68	0.99	0.93	46.79	204.87	0.50	1.00	0.19			
				W8-L	0.68	0.99	0.70	27.83	204.87	0.50	0.15	0.01			
				W8-U	0.68	0.99	1.42	42.36	204.87	0.50	1.00	0.26			
													4.26	1.00	YES
32nd	R2	Residential	Bedroom	W9-L	0.68	0.99	0.70	26.56	83.23	0.50	0.15	0.03			
				W9-U	0.68	0.99	1.42	38.09	83.23	0.50	1.00	0.58			
				W10-L	0.68	0.99	0.46	26.54	83.23	0.50	0.15	0.02			
				W10-U	0.68	0.99	0.93	35.52	83.23	0.50	1.00	0.36			
				W11-L	0.68	0.99	0.46	30.11	83.23	0.50	0.15	0.02			
				W11-U	0.68	0.99	0.93	39.90	83.23	0.50	1.00	0.40			
				W12-L	0.68	0.99	0.46	26.95	83.23	0.50	0.15	0.02			
				W12-U	0.68	0.99	0.93	36.71	83.23	0.50	1.00	0.37			
													1.81	1.00	YES
32nd	R3	Residential	Bedroom	W13-L	0.68	0.99	0.46	25.49	74.19	0.50	0.15	0.02			
				W13-U	0.68	0.99	0.93	31.91	74.19	0.50	1.00	0.36			
				W14-L	0.68	0.99	0.46	29.17	74.19	0.50	0.15	0.02			
				W14-U	0.68	0.99	0.93	36.60	74.19	0.50	1.00	0.41			
				W15-L	0.68	0.99	0.46	25.47	74.19	0.50	0.15	0.02			
				W15-U	0.68	0.99	0.93	32.76	74.19	0.50	1.00	0.37			
													1.21	1.00	YES
32nd	R4	Residential	Bedroom	W16-L	0.68	0.99	1.04	29.01	134.08	0.50	0.15	0.03			
				W16-U	0.68	0.99	2.11	35.26	134.08	0.50	1.00	0.50			
				W17-L	0.68	0.99	1.04	28.84	134.08	0.50	0.15	0.03			
				W17-U	0.68	0.99	2.11	34.74	134.08	0.50	1.00	0.49			
				W18-L	0.68	0.99	0.70	24.04	134.08	0.50	0.15	0.02			
				W18-U	0.68	0.99	1.42	29.32	134.08	0.50	1.00	0.28			
													1.35	1.00	YES
32nd	R5	Residential	Bedroom	W19-L	0.68	0.99	0.46	24.17	63.41	0.50	0.15	0.02			
				W19-U	0.68	0.99	0.93	27.29	63.41	0.50	1.00	0.36			

Project Name: Oxygen Towers, Store Street, Manchester M1 2FU
Project No.: EKA251101
Report Title: Average Daylight Analysis - Proposed + Emerging Context + Updated SRF East Village Scheme
Date: 13/01/2026

Floor Ref	Room Ref	Room Attribute	Property Type	Room Use	Window Ref	Glass Transmittance	Maintenance Factor	Glazed Area	Clear Sky Angle Proposed	Room Surface Area	Average Surface Reflectance	Below Working Plane Factor	ADF Proposed	Req'd Value	Meets BRE Criteria
					W20-L	0.68	0.99	0.46	28.10	63.41	0.50	0.15	0.03		
					W20-U	0.68	0.99	0.93	32.74	63.41	0.50	1.00	0.43		
					W21-L	0.68	0.99	0.46	24.35	63.41	0.50	0.15	0.02		
					W21-U	0.68	0.99	0.93	28.69	63.41	0.50	1.00	0.38		
													1.25	1.00	YES