



PRESSURE AND FLOW REQUIRED
FLOW:- 279 LITRES / MINUTE
PRESSURE :- 6.2 BAR

PLEASE NOTE: COMMUNAL CORRIDORS HAVE BEEN TREATED AS STERILE AREAS AND THEREFORE ONLY 2 HEADS HAVE BEEN CALCULATED. IF THIS IS DEEMED UNACCEPTABLE THE AUTHORITY HAVING JURISDICTION NEED TO INFORM US IMMEDIATELY AS THE CALCULATIONS WOULD THEREFORE NOT BE SUITABLE AND WOULD HAVE TO BE RE-CALCULATED.



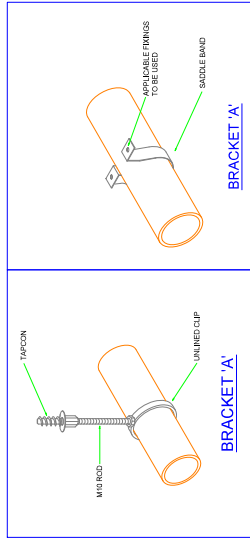


HANGER TYPE

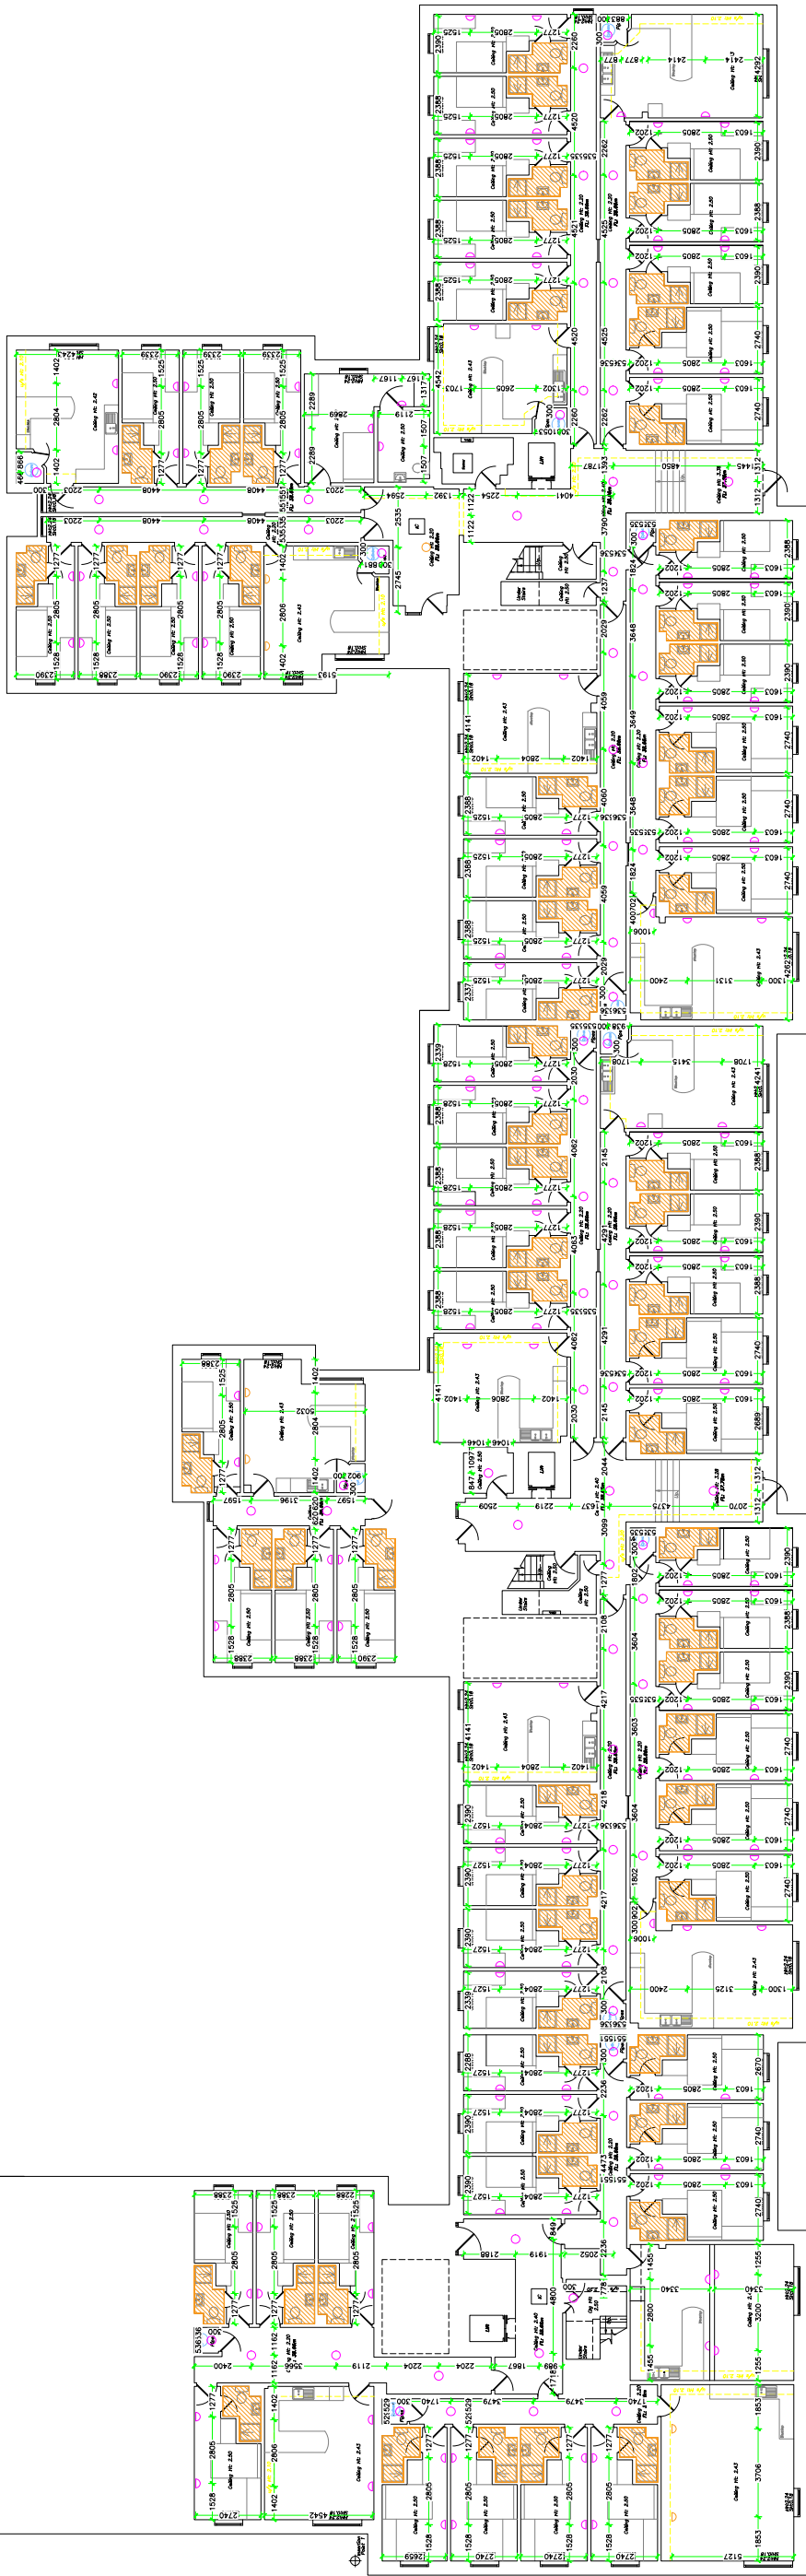


GROUND FLOOR - SPACING LAYOUT

[illegible]

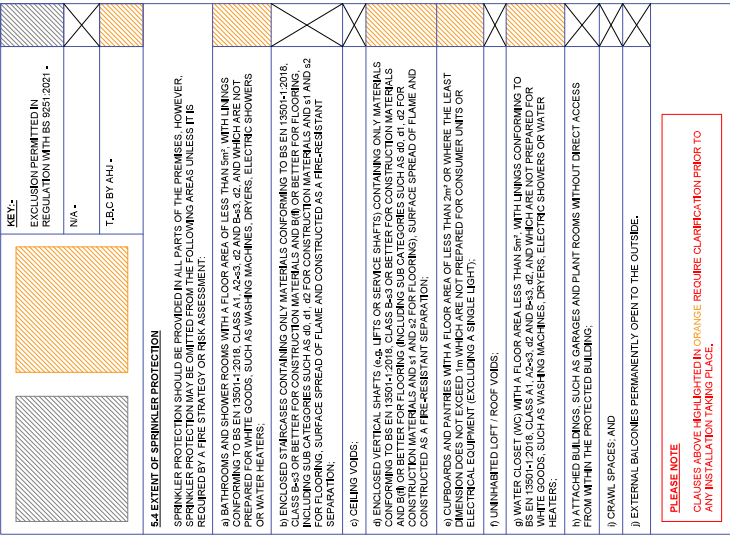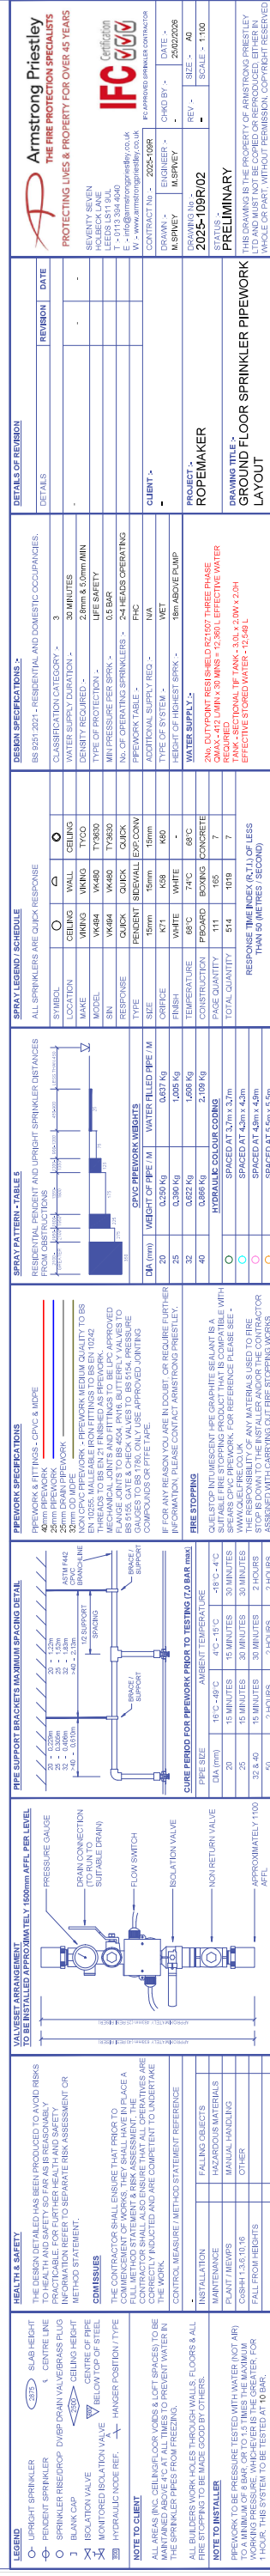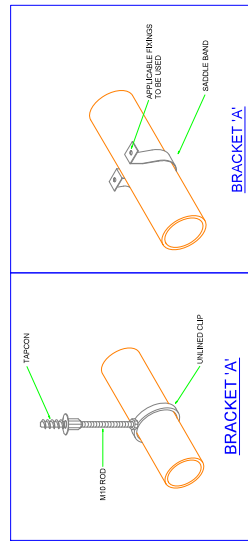

SCHEDULE OF VALVESETS PER FLOOR		
VALVESET #	25mm VALVESET	40mm VALVESET
GROUND FLOOR	3	1
FLOOR 01	4	-
FLOOR 02	4	-
FLOOR 03	4	-
FLOOR 04	4	-
FLOOR 05	2	-

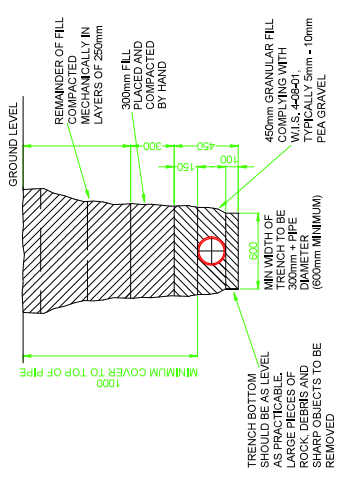

PLEASE NOTE
CLAUSES ABOVE HIGHLIGHTED IN ORANGE REQUIRE CLARIFICATION PRIOR TO
SIGNING THESE AGREEMENTS. DO NOT SIGN UNLESS YOU HAVE BEEN ADVISED BY THE CONTRACT MANAGER.