


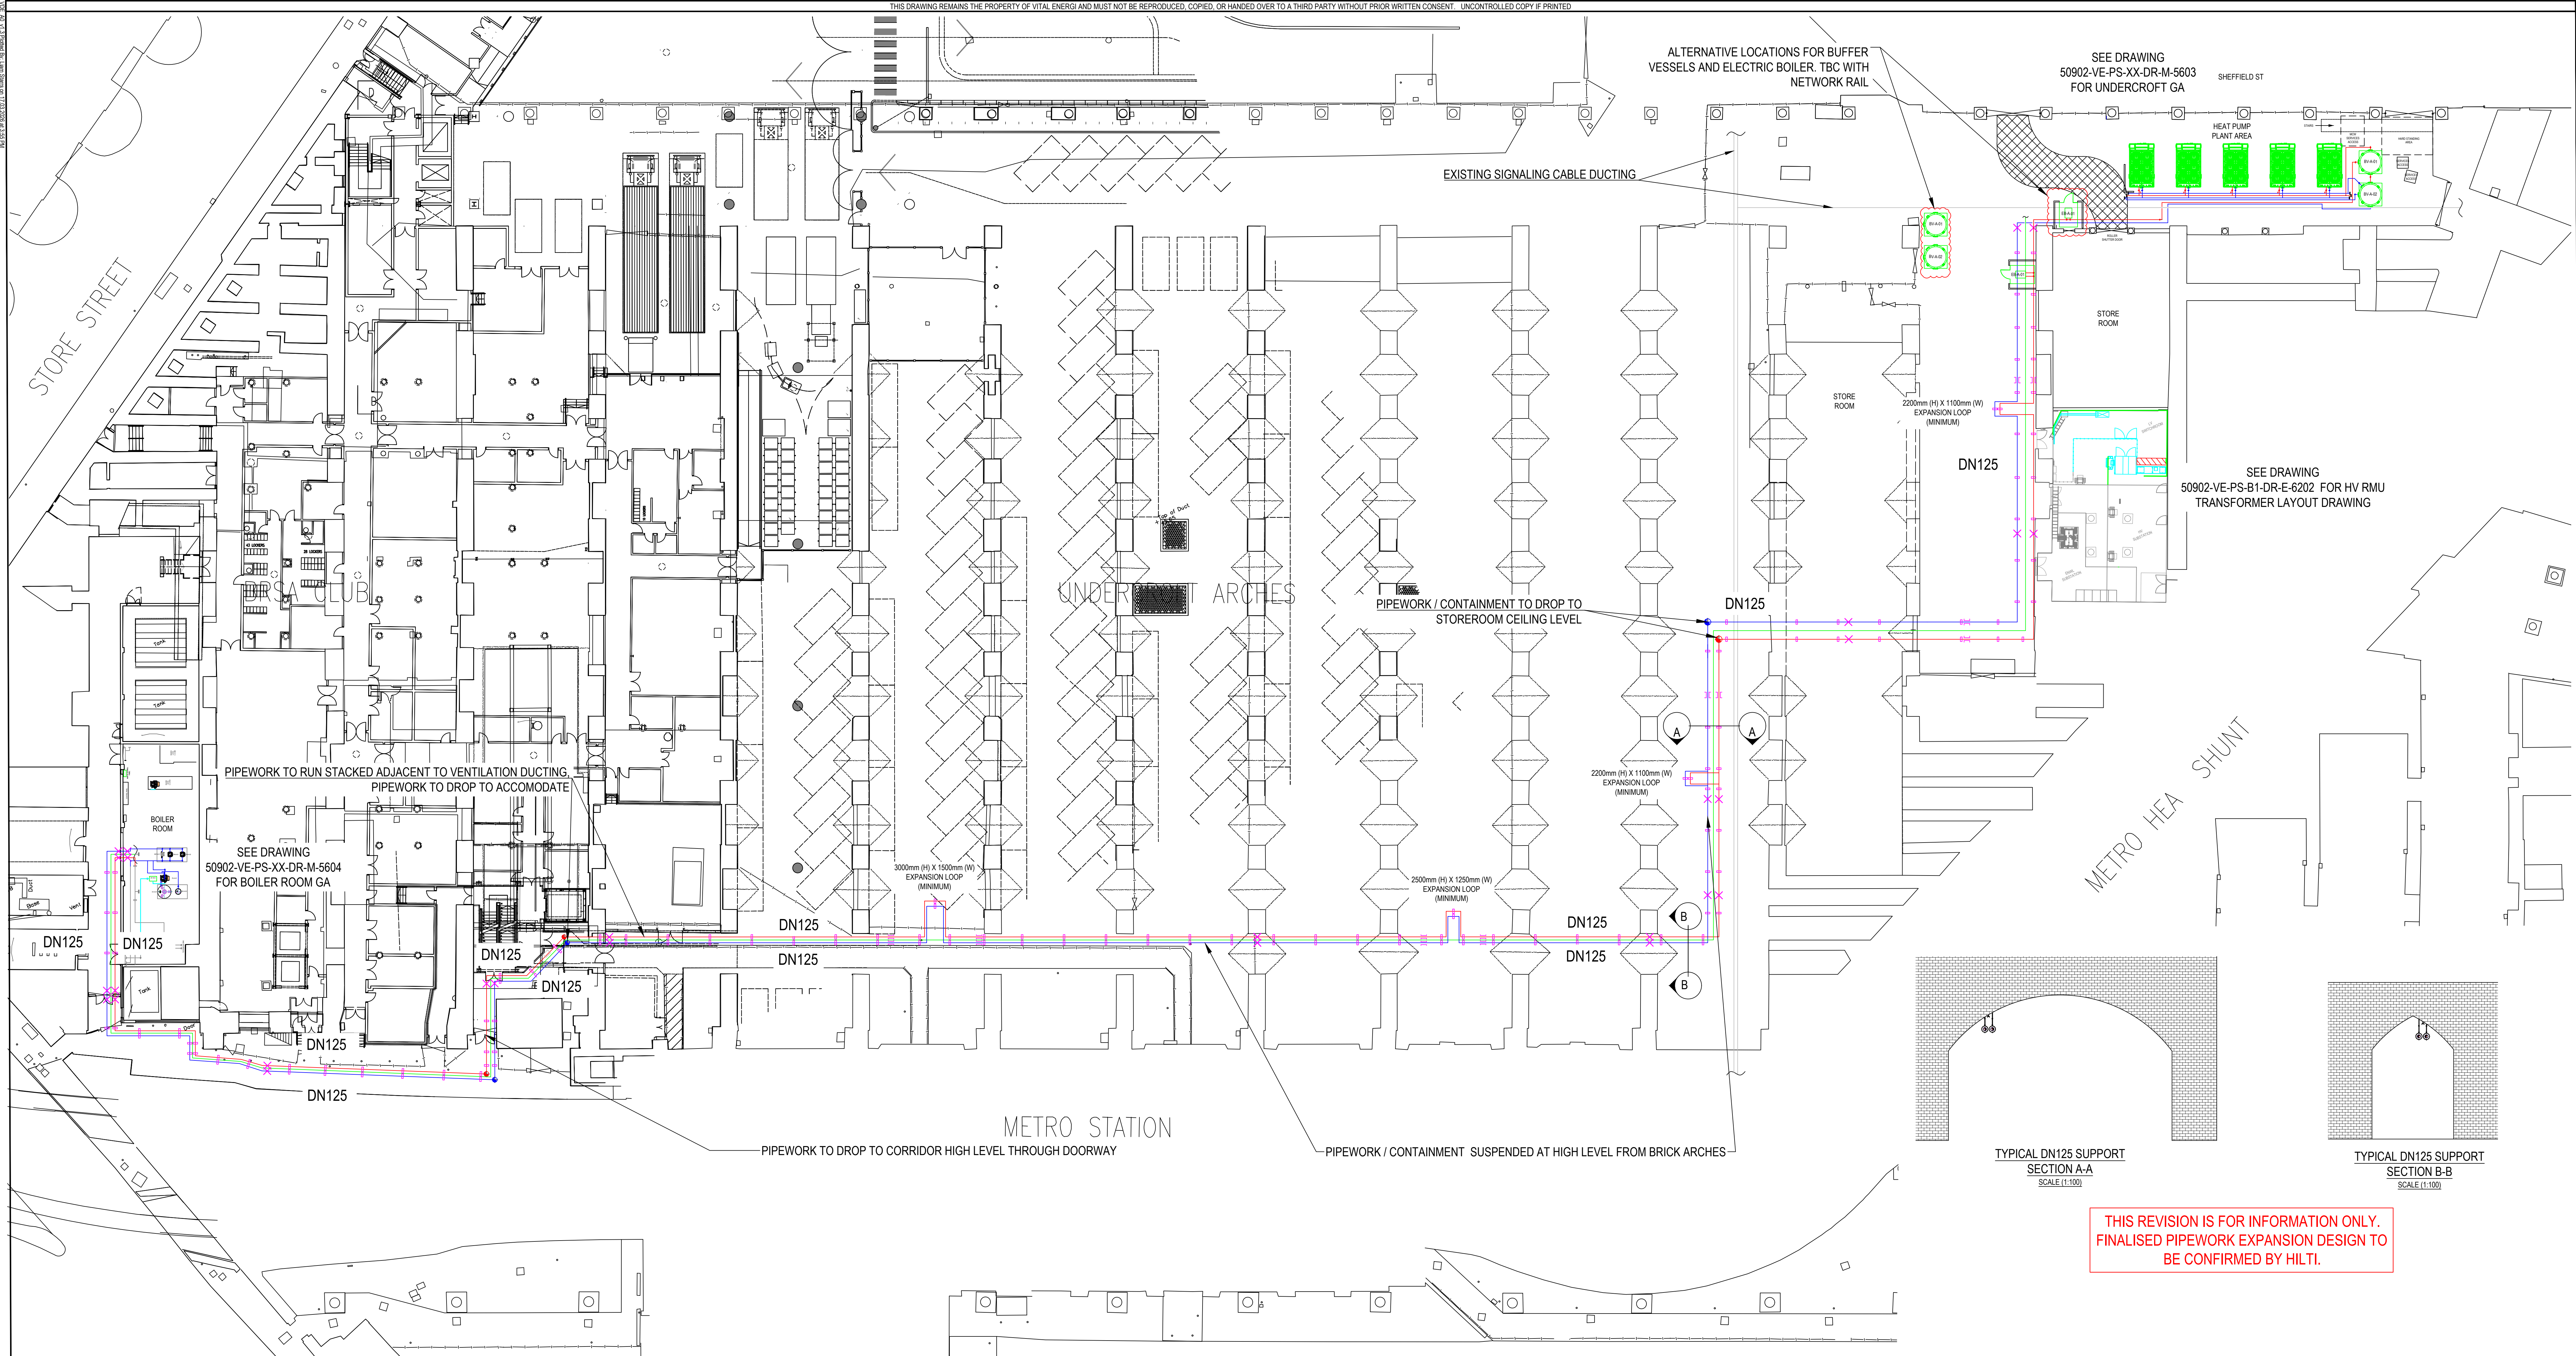


NOTES:

- APPROX 280M DN125 PIPEWORK LENGTH FROM UNDERCROFT PLANT ENCLOSURE TO BOILER ROOM.
- FIXING DETAIL TBD. PIPEWORK TO BE MOUNTED AT HIGH LEVEL.
- COMMUNICATION DATA CABLE TO BE ROUTED ALONGSIDE PIPEWORK TO ENABLE CONTROLS LINK BETWEEN PLANT AREAS AND ENGINEERING HEAD END.
- STRUCTURAL ANALYSIS REQUIRED FOR MOUNTING SYSTEMS WITH RELEVANT PULL TESTING AS REQUIRED.
- ROUTE IS CURRENTLY INDICATIVE AND SUBJECT TO FINAL CONFIRMATIONS ON SITE. SPECIFIC ROUTE SUBJECT TO 3D MODEL.
- TRACE HEATING REQUIRED IN CAR PARK / STOREROOM / EXTERNAL UNDERCROFT AREAS.
- ANCHOR, SUPPORT AND GUIDES SHOWN ARE INDICATIVE ONLY. EXACT LOCATIONS TBC.
- LOCATION OF BUFFER VESSELS AND ELECTRIC BOILER TBC. BOTH POTENTIAL LOCATIONS ARE SHOWN.
- UPDATED PIPE ROUTE HAS BEEN SHOWN. ROUTE SHOWN ON 50902-VE-PS-XX-DR-M-5604 P3 - UNDERCROFT PROPOSED PIPEWORK ROUTE GA HAS BEEN UPDATED.


TO BE READ IN CONJUNCTION WITH:

- 50902-VE-PS-XX-DR-M-5603 - PROPOSED UNDERCROFT GA
- 50902-VE-PS-XX-DR-M-5605 - BOILER ROOM GA
- 50902-VE-PS-XX-DR-M-5601 - PROPOSED BOILER ROOM STRIP-OUT GA
- 50902-VE-PS-XX-SC-M-5601 - PROPOSED BOILER ROOM STRIP-OUT P&ID
- 50902-VE-PS-XX-SC-M-5603 - PROPOSED UNDERCROFT P&ID
- 50902-VE-PS-XX-SC-M-5602 - PROPOSED BOILER ROOM P&ID
- 50902-VE-PS-XX-SH-M-5601 - PICCADILLY STATION SITE WIDE EQUIPMENT SCHEDULE

KEY:

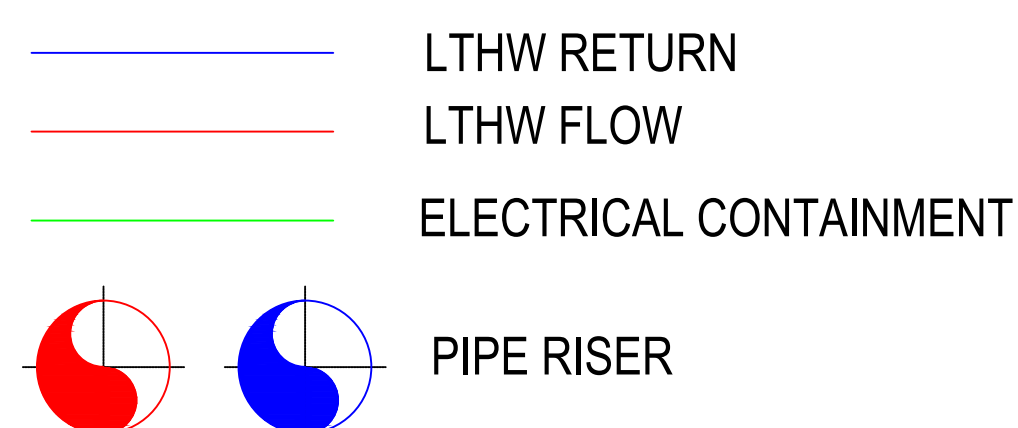

THIS REVISION IS FOR INFORMATION ONLY.
FINALISED PIPEWORK EXPANSION DESIGN TO
BE CONFIRMED BY HILTI.



ISSUED FOR INFORMATION

VITAL
ENERGI

Project: NETWORK RAIL DECARBONISATION				
Title: SITE WIDE EQUIPMENT GA				
DATE	17.03.2025	SCALE	1:200	SHEET
STAGE APPROVAL				A0
S4				4
50902-VE-PS-SW-DR-M-5601				P1

P1	17.03.25	ISSUED FOR APPROVAL	LS	CS	TR
REV	DATE	DESCRIPTION	DRW	CHK	APP

Vital Energi, Century House, Roman Road, Blackburn, Lancashire, BB1 2LD
Tel: +44 (0)1254 296 000 Fax: +44 (0)1254 296 000