




EXISTING FRONT ELEVATION

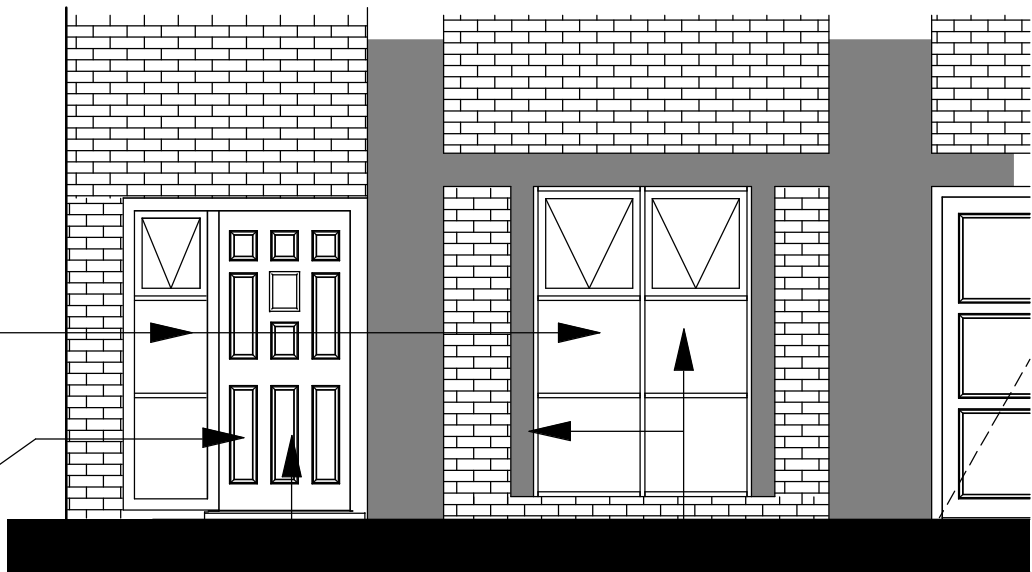

PROPOSED FRONT ELEVATION

SAFETY GLAZING
All glazing in critical locations to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1:2011 and Part K (Part N in Wales) of the current Building Regulations, i.e. within 1500mm above floor level in doors and side panels within 300mm of door opening and within 800mm above floor level in windows

NEW AND REPLACEMENT DOORS
New and replacement doors to achieve a U-Value of 1.80W/m²K. Glazed areas to be double glazed with 16mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K (Part N in Wales) of the current Building Regulations

New door & window feature.

Stone feature around proposed new window to mirror front elevation features.

Supply and install new structural elements such as new beams, roof structure, floor structure, bearings, and padstones in accordance with the Structural Engineer's calculations and details. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance as agreed with Building Control. All fire protection to be installed as detailed by specialist

UPGRADING EXISTING SOLID FLOOR
To meet min U value required of 0.25 W/m²K
The existing solid floor slab must be checked for stability and be free from defects as required by Building Control. The existing floor will need upgrading to ensure adequate damp protection and to prevent heat loss. Provide 1200 gauge polythene DPM or 3 coats RIW over existing concrete slab (if required). DPM to be lapped in with DPC in walls. Floor to be insulated over slab and DPM with min 75mm thick Celotex GA4000, 25mm Celotex insulation to continue around floor perimeters to avoid thermal bridging.
A VCL should be laid over the insulation boards and turned up 100mm at room perimeters behind the skirting, all joints to be lapped 150mm and sealed. Finish with 65mm sand/cement finishing screed with light mesh reinforcement. Care should be taken to ensure any existing airbricks for the main house are not obstructed by this work. If so, they should be extended through the new floor to external air. Where drain runs pass under floor provide A142 mesh 1.0m wide and min 50mm concrete cover over length of drain. A lesser provision may be appropriate where meeting such a standard would create significant problems in relation to adjoining floor level.

15. C2. CONDENSATION
Walls, floors and roof of the building to be designed and constructed so that their structural and thermal performance will not be adversely affected by interstitial condensation, surface condensation or mould growth. Account to be taken of the building's form and orientation in relation to topography, prevailing winds, sunlight and over-shadowing, and the rate at which humidity is generated. Materials with the highest vapour resistance should be located on the warm side of a thermal element. VCLs to be provided where necessary. The junctions between elements are designed to Accredited Construction Details or guidance of BRE IP17/01] and BS 5250:2021 Management of moisture in buildings to be followed.

GENERAL NOTES:

- NOTICE OF COMMENCEMENT**
A notice of commencement is to be submitted to Building Control within 5 days of work being regarded as commenced, under regulation 16 of The Building Regulations etc. (Amendment) (England) Regulations 2010.


Work will be deemed to have commenced when the build has progressed to at least one of the following:

For complex buildings – Foundations are constructed, and the structure of the lowest floor level is complete.
For new buildings and horizontal extensions - Sub surface structure of the building or the extension including all foundations and the structure of the ground floor level is completed.
For all other works – constructed 15% of the overall work.


NOTICE OF COMPLETION
A Notice of Completion to be given to Building Control not more than 5 days after the work has been completed. The notice to contain the following information:
• The name, address, telephone number and (if available) email address of the client, principal contractor, and principal designer.
• A statement from the applicant to say that the works have been completed and complies with all the applicable regulations to the best of their knowledge.
• A statement from both the principal contractor and principal designer to confirm they have fulfilled their duties under Part 2A (duty holders and competence).
- THERMAL BRIDGING**
Care shall be taken to limit the occurrence of thermal bridging in the insulation layers caused by gaps within the thermal element, (i.e. around windows and door openings).
- MATERIALS AND WORKMANSHIP**
All works are to be carried out in a workmanlike manner. All materials and workmanship must comply with Regulation 7 of the Building Regulations, all relevant British Standards, European Standards, Agreement Certificates, Product Certification of Schemes (Kite Marks) etc. Products conforming to a European technical standard or harmonised European product should have a CE marking.
The latest edition of the British Standard (including any amendments) applies to any undated references within these specifications.
- EXISTING STRUCTURE**
Existing structure including foundations, floor, beams, walls, roof and lintels are to be exposed and checked for adequacy prior to commencement of work and as required by Building Control.
- BEAMS AND STRUCTURE**
Engineer's Structural calculations and details are to be provided for all beams, roof, lintels, joists, bearings, padstones and any other load bearing elements before works commence on site. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance, as agreed with Building Control. All fire protection to be installed as detailed by specialist manufacturer.
- SMOKE DETECTION**
Provide a linked smoke alarm detection system to BS EN 14604 and BS 5839-6:2019 to at least a Grade D2 (Grade A for large house) category LD2 standard. System to be mains powered with battery back up. Smoke detectors to be provided to:
- Each hallway and landing
- Every principal living room (as required by Building Control)
An interlinked heat detector to be provided in the kitchen.
In hallways exceeding 7.5m in length, no point within the hallway should exceed 7.5m from the nearest detector and no bedroom door should be further than 3m from the nearest smoke alarm. If ceiling mounted detectors to be 300mm from the walls and light fittings.
- ELECTRICAL**
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a Competent Person registered under a Competent Person Self Certification Scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.
- STEEL LINTELS**
Lintel and lintel installation to be in accordance with BS 5977-1 Lintels. Method of assessment of load and BS EN 845-2 Specification for ancillary components for masonry.
Lintel to be galvanised steel, powder coated lintel, such as Catnic, with a built-in damp-proof course.
The lintel to be wide enough to provide adequate support to the walling above, to be installed with a nominal 150 mm bearing area at each end and be fully bedded on a solid bed of mortar. Only full bricks or blocks to be part of the bearing area - lintels not to be placed directly onto part bricks. Padstones and spreaders to be provided under the bearings, where required. Installation to be in accordance with manufacturer's recommendations.
Overhang of any masonry to be a maximum of 25mm and lintel toe to project beyond window head externally.
Risk of condensation at potential cold bridges to be minimised, wall insulation should abut the head of the window frame and insulation to be provided at the underside of the lintel unless the manufacturer produces an alternative. (In severely exposed locations or where the lintel does not offer a built-in DPC, a separate membrane to be fitted, turned up at the edge to ensure the water is not directed into the cavity. For coastal areas, the use of soffit cladding to also be considered to provide further protection).
- INTERNAL LIGHTING**
Install low energy light fittings that only take lamps having a luminous efficiency better than 80 lumens per circuit watt. All fixed to have lighting capacity (lm) 185 x total floor area, to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.
- HEATING**
Extend all heating and hot water services from existing and provide new TRVs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.
The energy performance of the new components to be assessed. The results should be recorded and given to the building owner.
All accessible pipes to be insulated to the standards in Table 4.4 Approved Document L.
- BACKGROUND VENTILATION**
Controllable background ventilation at least 1700mm above floor level to be provided to habitable rooms and kitchens at a rate of min 10,000mm², and to bathrooms at a rate of min 4000mm².
Total number of ventilators installed in a dwellings habitable rooms to be at least 4 ventilators for one bedroom dwellings and 5 ventilators for dwellings with more than one bedroom.
Background ventilators to be tested to BS EN 13141-1.
Background ventilator equivalent area and operation to be measured and recorded.
Noise attenuating background ventilators should be fitted to facades with sustained loud noise.
- CAVITIES**
Provide cavity trays over openings and where roofs abut walls. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers.
Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

Drawings are Prepared for Building Regulation
Approval ONLY

DO NOT SCALE OFF DRAWING

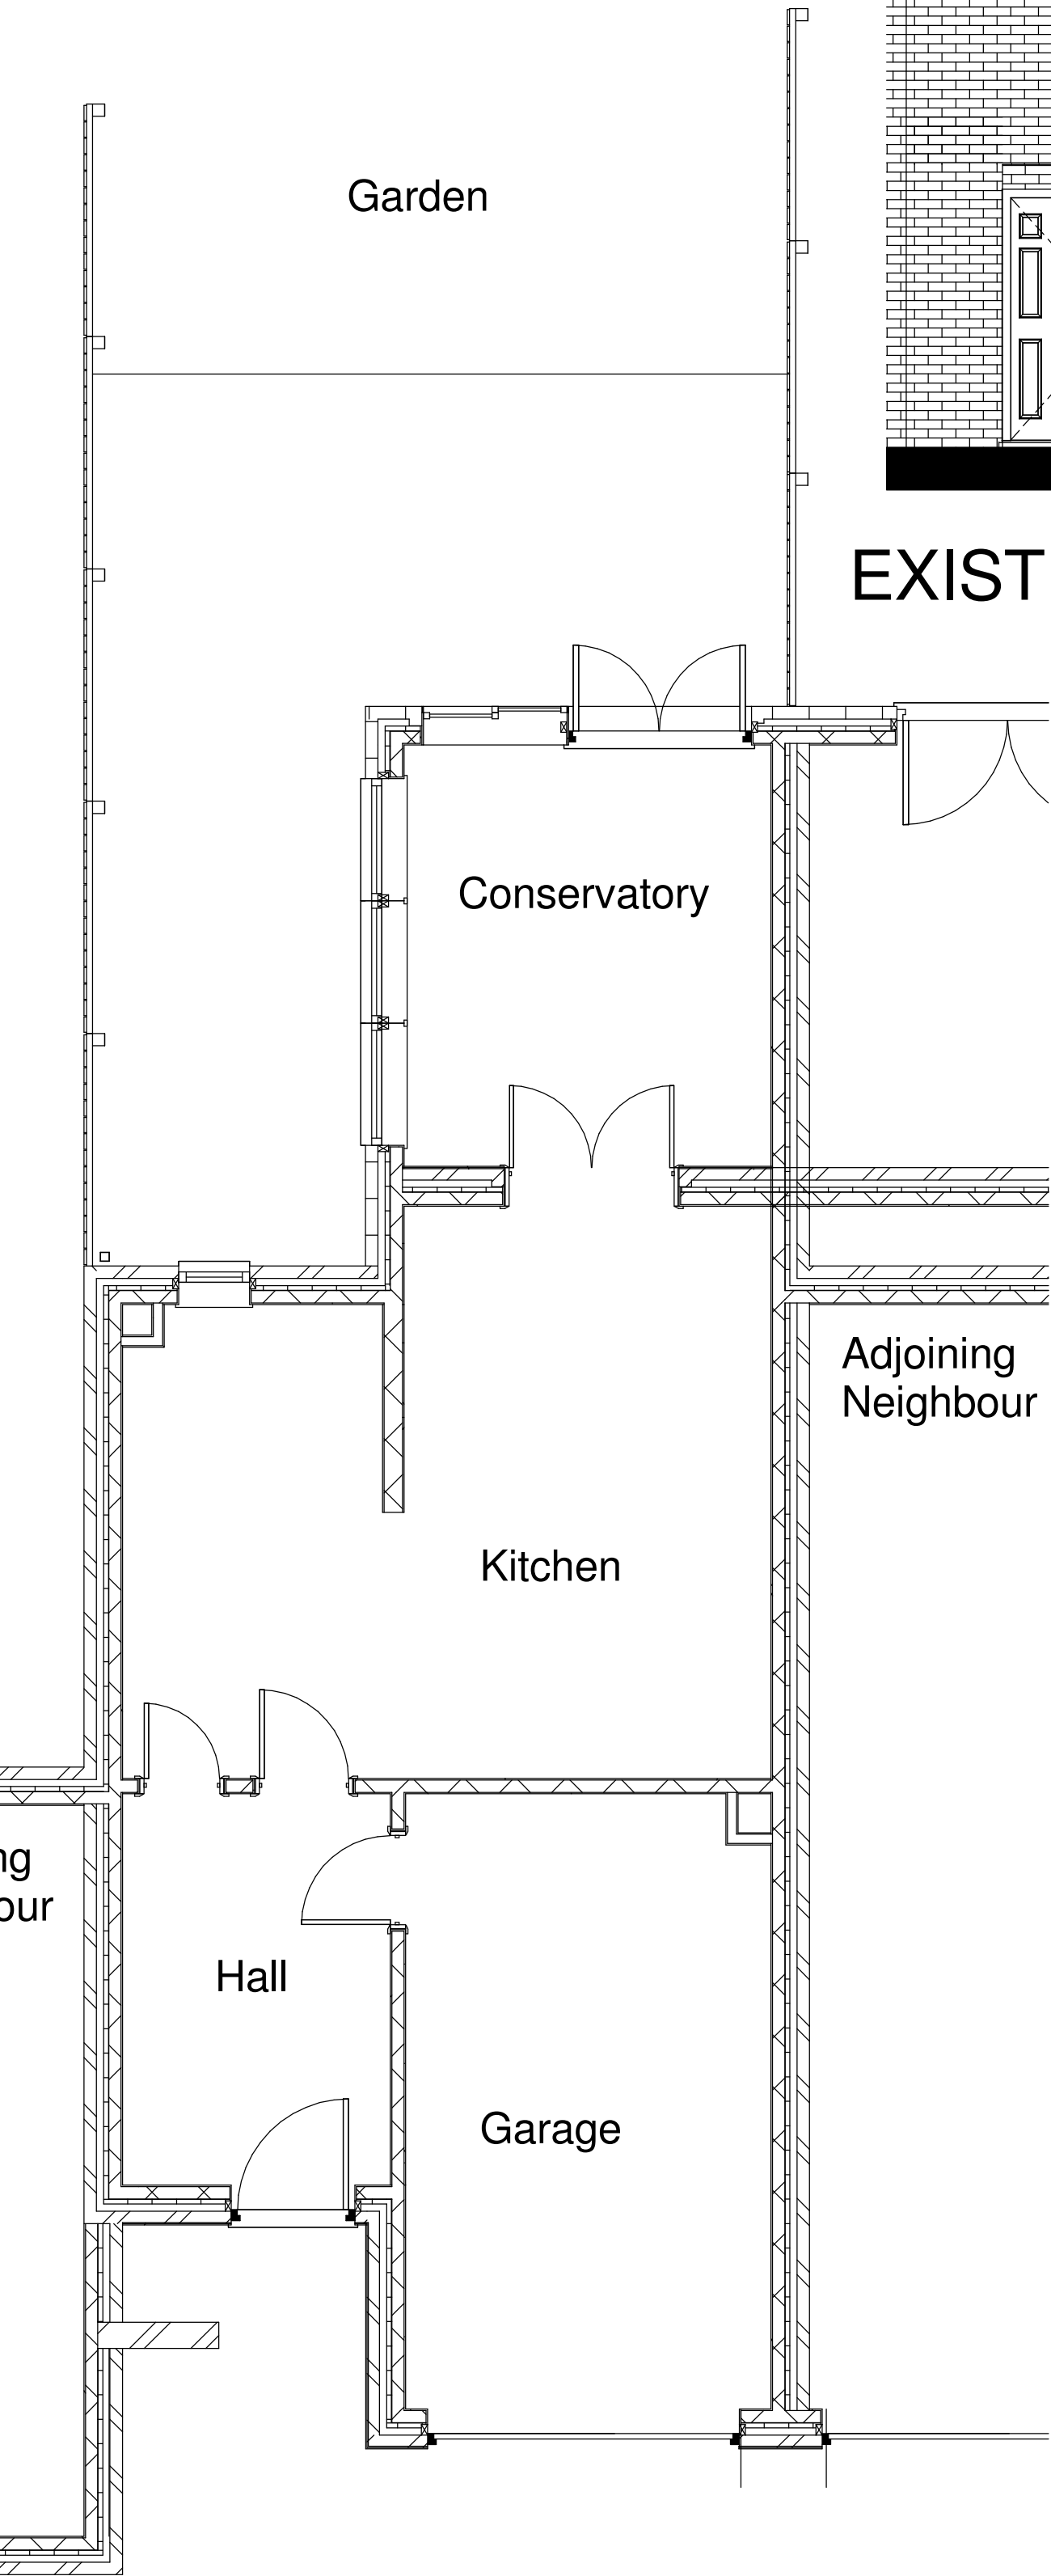

EXISTING GROUND FLOOR PLAN

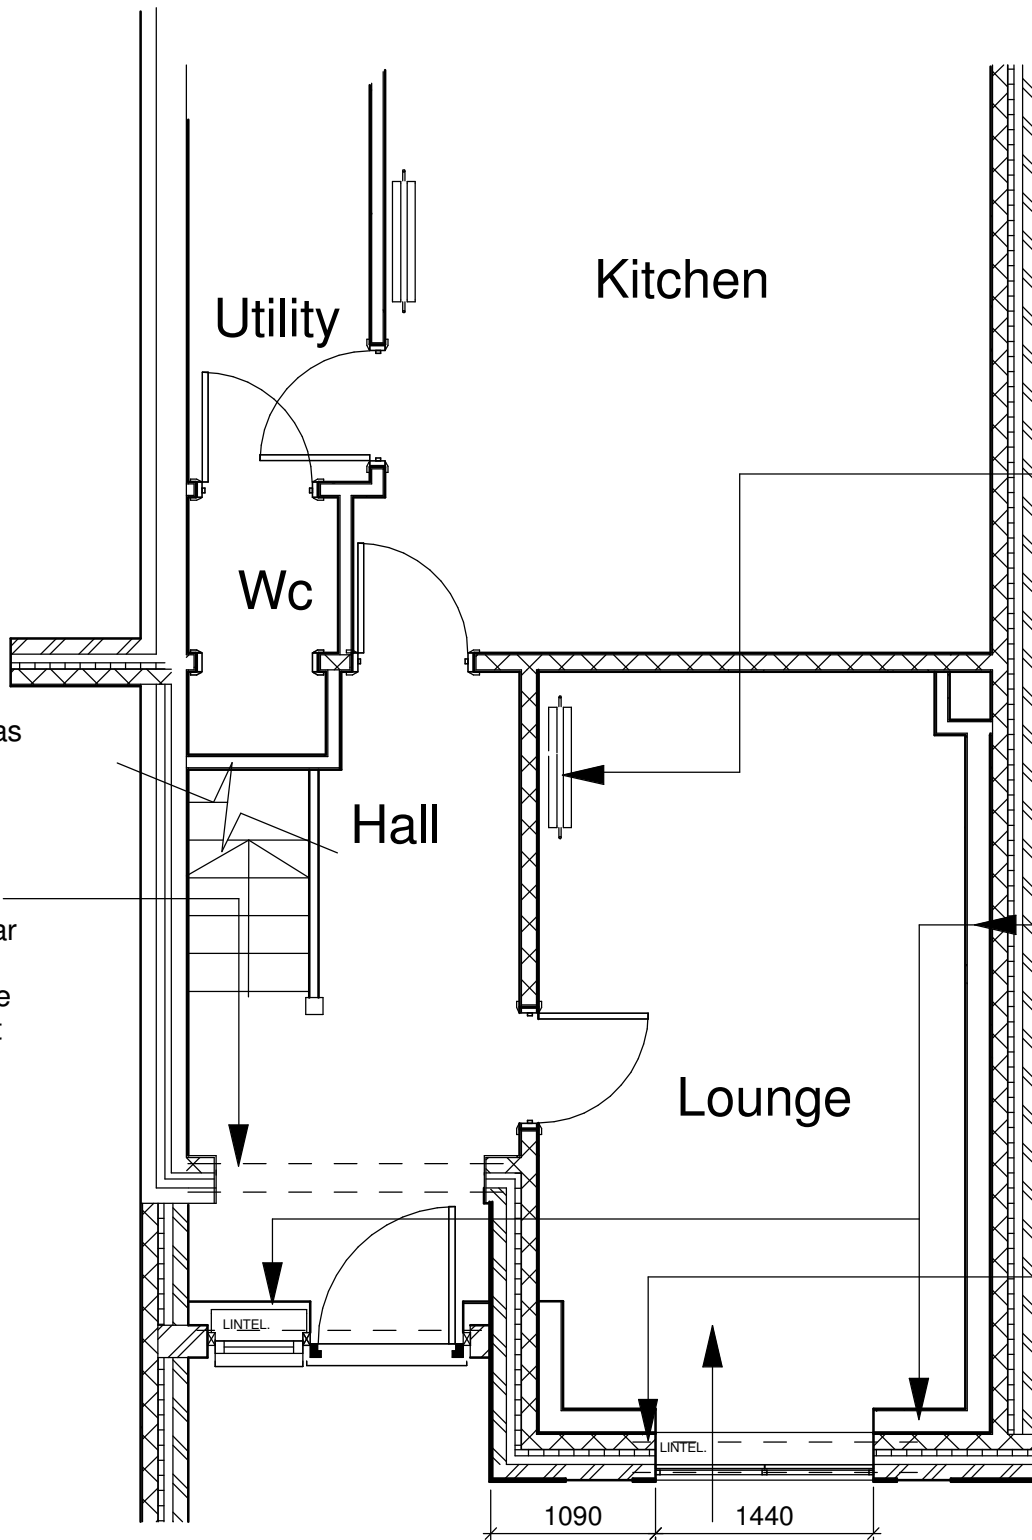

PROPOSED GROUND FLOOR PLAN

REV	DATE	AMENDMENTS		DRN	CHD
Client:		Mr & Mrs Harrison 42 Darley Avenue Manchester M21 7GG	Project:	Proposed Garage Conversion & Front Door Alteration.	REV