
LEGEND:

SYMBOL	DESCRIPTION
	EXISTING LV SUBMAIN CABLE 750mm CONTAINMENT
	EXISTING ELV 50mm CONTAINMENT
	EXISTING LANDLORD GENERAL LIGHTING & POWER 50mm CONTAINMENT
	EXISTING LANDLORD DATA 50mm CONTAINMENT
	EXISTING LANDLORD FIRE SYSTEM 50mm CONTAINMENT
	EXISTING TENANT DATA 100mm CONTAINMENT
	EXISTING SECURITY (SPECIFIC)
	EXISTING TENANT POWER AND LIGHTING 200mm CONTAINMENT
	EXISTING THREE COMPARTMENT 150mm TRUNKING FOR GENERAL LIGHTING POWER, DATA & BMS, FIRE ALARM
	NEW THREE COMPARTMENT 150mm TRUNKING FOR GENERAL LIGHTING POWER, DATA & BMS, FIRE ALARM
	EXISTING 150mm METTALIC POWDER COATED 3-COMPARTMENT TRUNKING
	NEW 150mm METTALIC POWDER COATED 3-COMPARTMENT TRUNKING
	OUT-OF-SCOPE AREA

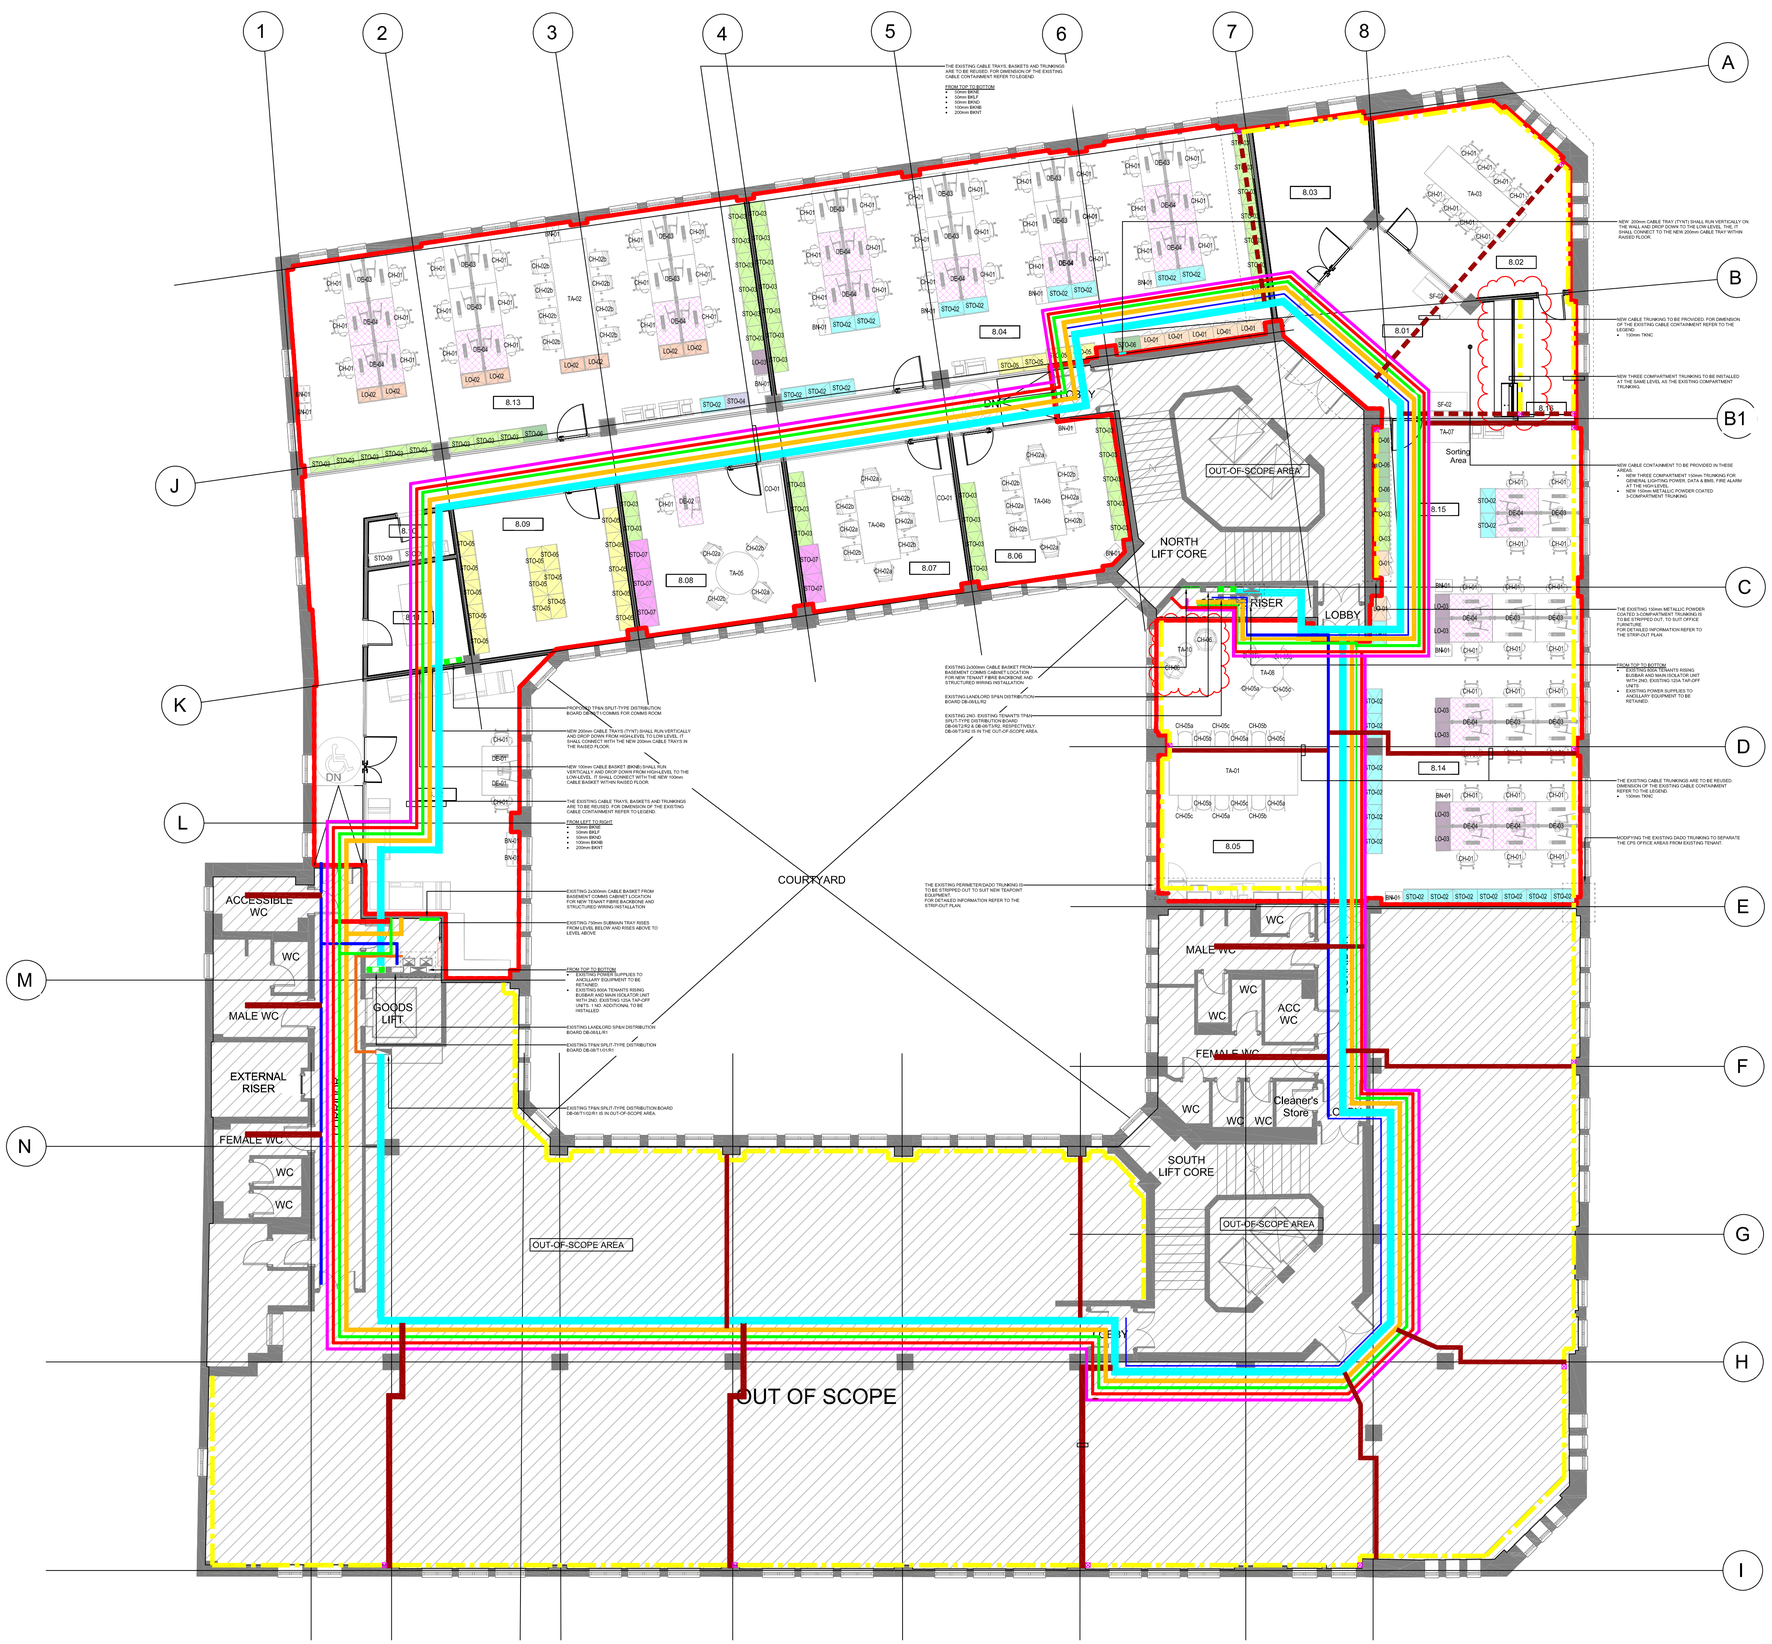

GENERAL NOTES:

1. THE PREPARED DRAWING ILLUSTRATES THE CONCEPTUAL DESIGN PRINCIPLES TO DEVELOP THE DRAWINGS AT THE NEXT STAGE.
2. ALL DESIGN OF THE CONTAINMENT SYSTEM SHALL COMPLY WITH ON THE CURRENT GOVERNMENT PROPERTY AGENCY (GPA) DESIGN GUIDES, IET GUIDES, BS OR BS EN STANDARDS, LOCAL REGULATIONS AND STANDARDS.
3. ALL DESIGN OF THE CONTAINMENT SYSTEM DESIGN PRINCIPLE AND STRATEGIC SHALL REFER TO THE RIBA STAGE 3 PERFORMANCE SPECIFICATION.
4. DO NOT SCALE THIS DRAWING. ALL DIMENSIONS AND LEVELS ARE INDICATIVE ONLY AND MUST BE VERIFIED ON SITE BY THE PRINCIPAL CONTRACTOR OR A RELATED SUBCONTRACTOR PRIOR TO THE COMMENCEMENT OF WORKS.
5. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS AND THE RIBA STAGE 3 PERFORMANCE SPECIFICATION.

ABBREVIATIONS:

LD = TRUNKINGS RACK

TY = CABLE TRAY

BK = CABLE BASKET

TK = TRUNKING

E = ESSENTIAL

N = NON ESSENTIAL

L = LIFE SAFETY

H = HIGH VOLTAGE

L = LOW VOLTAGE

E = EXTRA LOW VOLTAGE

G = GENERAL LIGHTING & POWER

D = DATA

F = FIRE ALARM

B = BUILDING MANAGEMENT SYSTEM

S = SECURITY

T = TENANT

C = GENERAL LIGHTING & POWER, DATA & BMS, FIRE ALARM

Rev	Date	Description	Prod.	Chk.	Rvd.	App.
LO2	13.03.26	LBC Submission	ZL	DK	KB	KB
LO1	03.12.25	LBC Issue	ZL	DK	KB	KB

Client:
Government Property Agency

ARCADIS

Registered office:
80 Fenchurch Street,
London
EC3M 4BT

Coordinating office:
80 Fenchurch Street,
London
EC3M 4BT

www.arcadis.com

Project:
CPS Manchester

Site
Sunlight House,
Little Quay Street,
Manchester M3 3HP

Drawing Title:
Level 08 - Proposed High-Level Containment System Plan

Designed: ARCADIS	Signed ARCADIS	Date 13.03.2026
Drawn: SS	Signed SS	Date 13.03.2026
Checked: RM	Signed RM	Date 13.03.2026
Reviewed: SP	Signed SP	Date 13.03.2026
Approved: IH	Signed IH	Date 13.03.2026

Design Stage: RIBA Stage 3

Original Size: A1	Grid: -	Datum: -
Suitability Code: A3	Scale: As indicated	Project Number: 30279810

Suitability Description: OFFICIAL-SENSITIVE

Listed Building Consent Submission

Drawing Number: 30279810-ARC-MAN-08-DR-EE-06102

Revision: LO2

1 Level 08 - Proposed High-Level Containment System Plan
1 : 100

100mm on Original

Print Date: 12/08/2025 2:57:07 pm

Autodesk Docs://AGB-10058858-Riding Gate CPS Canterbury/10058858-ARC-CAN-ZZ-M3-AR-000010.rvt

© Copyright reserved