TENANT'S LIGHTING SYSTEM LEGEND:


SYMBOL	MANUFACTURER
1g/2g/3g	ONE WAY SWITCH (4 DENOTES NUMBER OF GANGS)
KS/2KS	KEY OPERATED OVERRIDE SWITCH
	EMERGENCY LIGHTING TEST KEY SWITCH
SC	LIGHTING CONTROL WITH SCENE SETTING
PIR	PASSIVE INFRARED SENSOR PHOTOCELL SENSOR

LANDLORD'S LIGHTING SYSTEM LEGEND:

SYMBOL	MANUFACTURER
1g/2g/3g	ONE WAY SWITCH (4 DENOTES NUMBER OF GANGS)
1g/2g/3g 2W	TWO WAY SWITCH (2W DENOTES TEL:NEED OF WAY AND '2C' TELLING OF GANGS)
1g/2g/3g KS	EMERGENCY LIGHTING TEST KEY SWITCH
	ONE WAY PUSH TO MAKE SWITCH
	RETRACTIVE CRAWING SWITCH
1g/2g/3g DP	DIP/TIMESTATE SWITCH (T DENOTES NO OF GANGS)
SC	LIGHTING CONTROL WITH SCENE SETTING
PIR	PASSIVE INFRARED SENSOR
GW	HUBSENSE GATEWAY

LUMINAIRE SCHEDULE:

SYMBOL/ABBR/TYPE	DESCRIPTION	MANUFACTURER	TYPE/CODE	RECOMMENDED MAINTENANCE
A	1195mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HS	4
AP	1195mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION, PIR SENSOR, AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HSP	1
A2	2390mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HS	12
A2E	2390mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HS	66
A2P	2390mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION, PIR SENSOR, AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HSP	18
A2PE	2390mm LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION, PIR SENSOR, AND WIRELESS LIGHTING CONTROL FOR PENDANT APPLICATIONS ON 3-HOUR EMERGENCY BATTERY KIT	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HSPEL7	5
A2E	2390mm SURFACE MOUNTED LINEAR LED LUMINAIRE WITH DRAINABLE FUNCTION AND WIRELESS LIGHTING CONTROL FOR SURFACE MOUNT APPLICATIONS ON 3-HOUR EMERGENCY BATTERY KIT	ARETECH LIGHTING	AFM-1X-WP-40-S-P-W-HSEL7	6
	FLUSH BATTEN TYPE LED LUMINAIRE WITH DRAINABLE FUNCTION AND INGRESS PROTECTION	ARETECH LIGHTING	APL-SE-40-PC-S-S-HS	1
	FLUSH BATTEN TYPE LED LUMINAIRE WITH DRAINABLE FUNCTION AND INGRESS PROTECTION FOR 3-HOUR EMERGENCY BATTERY KIT FOR 3-HOUR EMERGENCY BATTERY KIT	ARETECH LIGHTING	APL-SE-40-PC-S-S-HSEL7	2
	70.2W SHORT WIRED RECESSED LED DOWNLIGHTER WITH DRAINABLE FUNCTION, WIRELESS LIGHTING CONTROL AND INGRESS PROTECTION/IP65	ARETECH LIGHTING	TRP 24-40 WI CL 107 ST WHI HSS	12
	70.2W SHORT WIRED RECESSED LED DOWNLIGHTER WITH DRAINABLE FUNCTION, WIRELESS LIGHTING CONTROL AND INGRESS PROTECTION/IP65 ON 3-HOUR BASE EMERGENCY KIT	ARETECH LIGHTING	TRP 24-40 WI CL 107 ST WHI HSEL7	21
	70.2W SHORT WIRED RECESSED LED DOWNLIGHTER WITH DRAINABLE FUNCTION, WIRELESS LIGHTING CONTROL AND INGRESS PROTECTION/IP65 ON 3-HOUR BASE EMERGENCY KIT	ARETECH LIGHTING	TRP 24-40 WI CL 107 ST WHI HSS	2
	70.2W SHORT WIRED RECESSED LED DOWNLIGHTER WITH DRAINABLE FUNCTION, WIRELESS LIGHTING CONTROL AND INGRESS PROTECTION/IP65 ON 3-HOUR BASE EMERGENCY KIT	ARETECH LIGHTING	TRP 24-40 WI CL 107 ST WHI HSEL7	1
	5.7W NON-MAINTAINED SURFACE MOUNTED EMERGENCY EXIT SIGN WITH DRAINABLE FUNCTION AND INTEGRAL ASSEMBLY FOR 3-HOUR BASE EMERGENCY KIT	ARETECH LIGHTING	EXIL ES NL S HS T	1
	5.7W NON-MAINTAINED SURFACE MOUNTED EMERGENCY EXIT SIGN WITH DRAINABLE FUNCTION AND INTEGRAL ASSEMBLY FOR 3-HOUR BASE EMERGENCY KIT	ARETECH LIGHTING	EXIL ES NL S HS L T	1

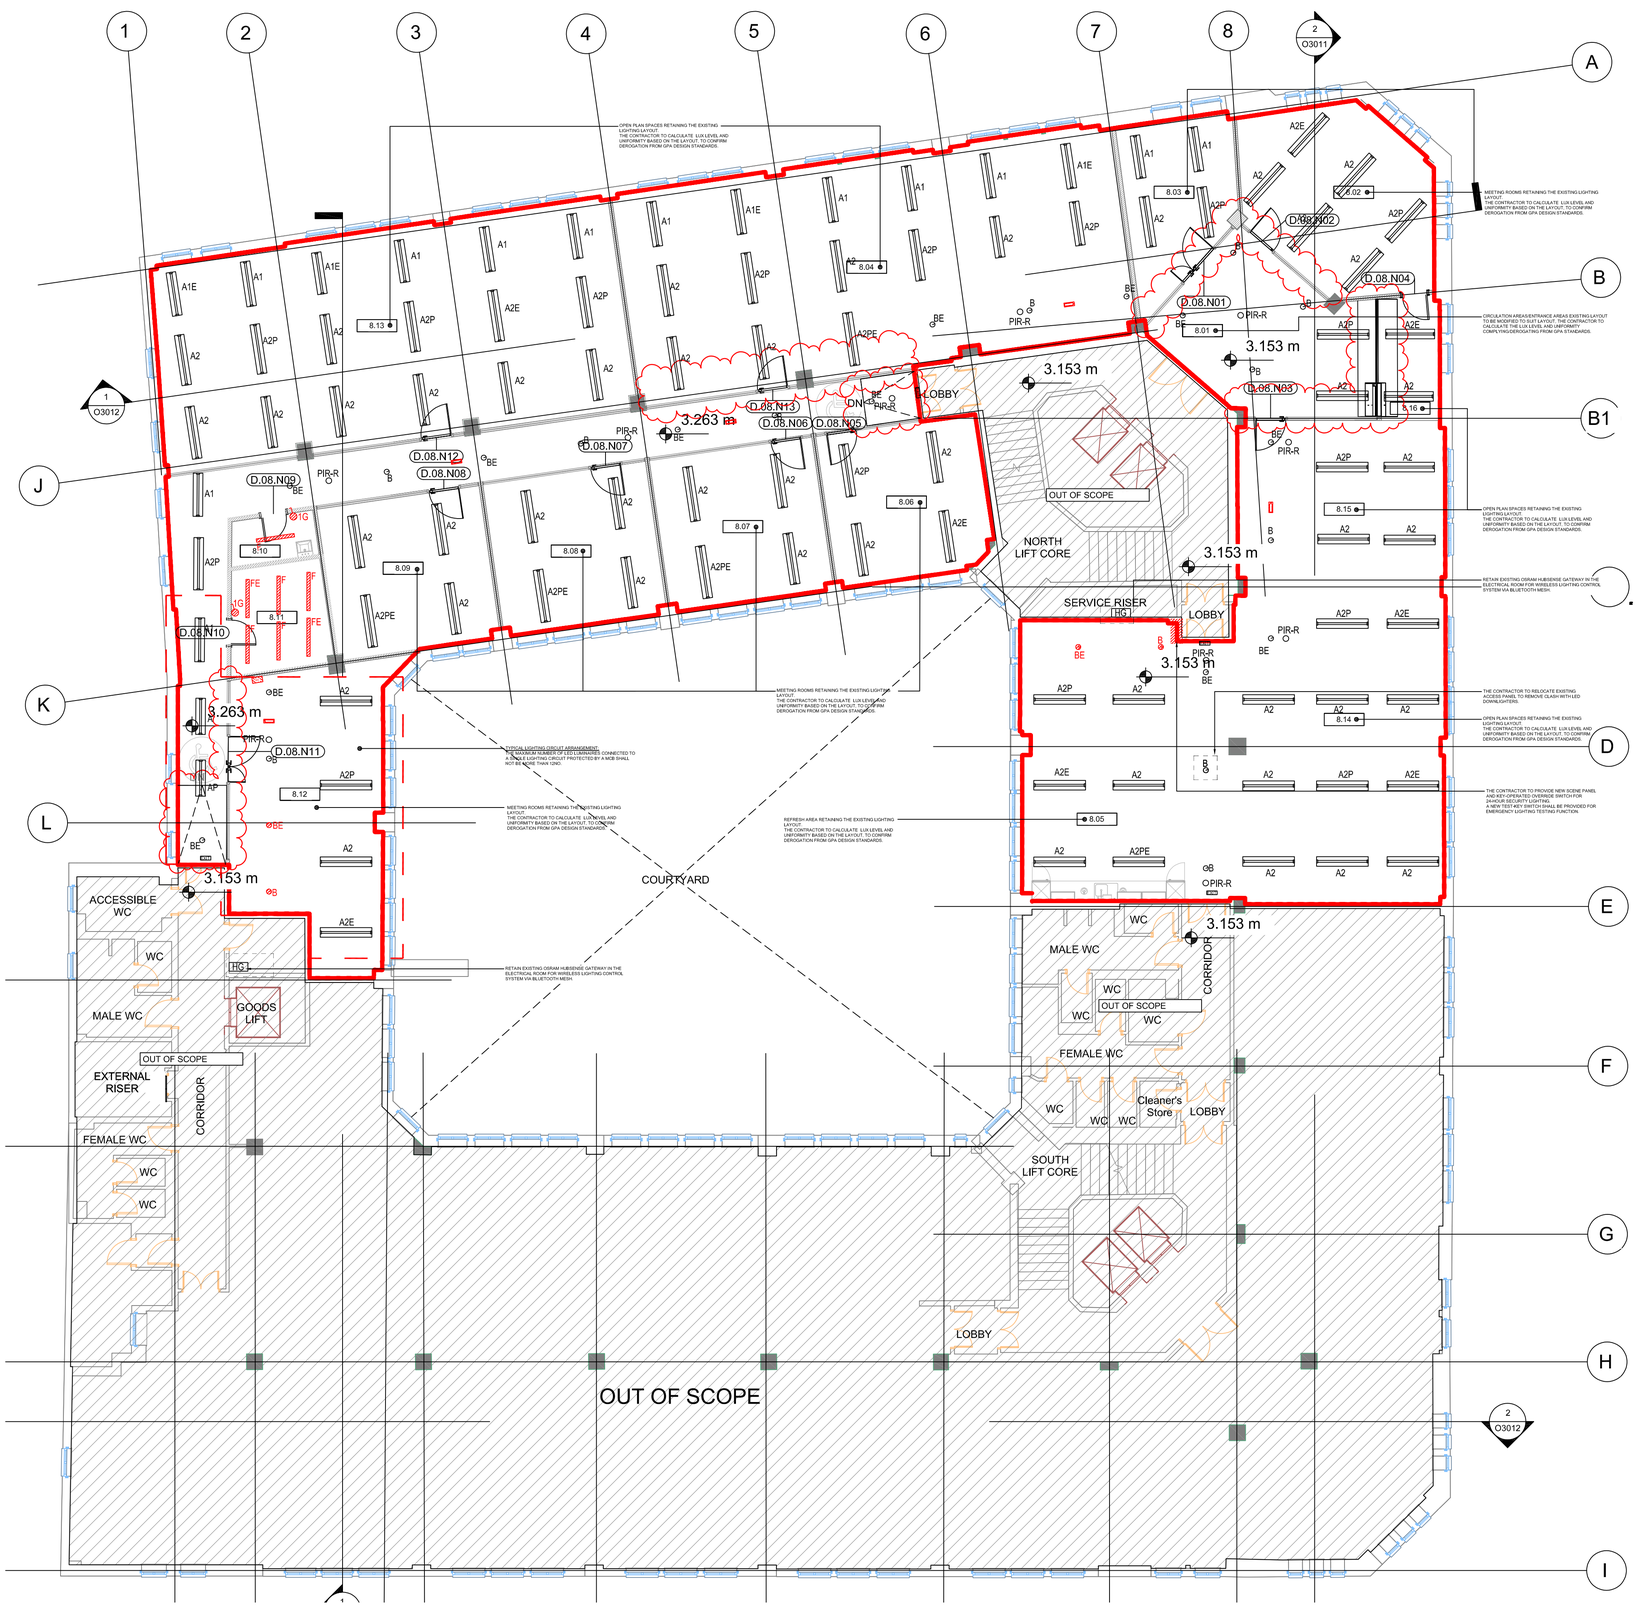

All hatched items are new.

1 Level 08 - Proposed Lighting System Plan
1 : 100

GENERAL NOTES:

1. DO NOT SCALE FROM DRAWING, ALL DIMENSIONS AND LEVELS ARE INDICATIVE ONLY AND MUST BE VERIFIED ON SITE BY THE PRINCIPAL CONTRACTOR OR A RELATED SUBCONTRACTOR PRIOR TO THE COMMENCEMENT OF WORKS.
2. THIS DRAWING ILLUSTRATES THE CONCEPTUAL DESIGN PRINCIPLES TO DEVELOP THE DRAWINGS TO THE NEXT DESIGN STAGE.
3. ALL EXISTING GENERAL AND EMERGENCY LIGHTING LUMINARIES TO BE REUSED/REPOSITIONED WHERE REQUIRED.
4. NEW LUMINARIES TO BE PROVIDED TO ENSURE SUFFICIENT LUX LEVEL AND UNIFORMITY BASED ON THE THE CURRENT GOVERNMENT PROPERTY AGENCY (GPA) DESIGN GUIDES.
5. DESIGN OF THE GENERAL, EMERGENCY LIGHTING AND LIGHTING CONTROL SYSTEM SHALL COMPLY WITH THE CURRENT GOVERNMENT PROPERTY AGENCY (GPA) DESIGN GUIDES, JET GUIDES, CIBSE GUIDES, BS OR BS EN STANDARDS, LOCAL REGULATIONS AND STANDARDS.
6. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS AND SPECIFICATIONS.

LEGEND:

OUT-OF-SCOPE AREA
ALL EXISTING GENERAL, EMERGENCY LIGHTING AND LIGHTING CONTROL SYSTEM TO BE RETAINED.

ABBREVIATIONS:

KS = KEY SWITCH

Rev	Date	Description	Prod.	Chk.	Rvd.	App.
LO2	13.03.26	LBC Submission	ZL	DK	KB	KB
LO1	03.12.25	LBC Issue	ZL	DK	KB	KB

Client:
Government Property Agency

ARCADIS
Registered office: 80 Fenchurch Street, London EC3M 4BT
Coordinating office: 80 Fenchurch Street, London EC3M 4BT
www.arcadis.com

Project: CPS Manchester
Site: Sunlight House, Little Quay Street, Manchester M3 3HP

Drawing Title: Level 08 - Proposed Lighting System Plan

Designed: ARCADIS	Signed ARCADIS	Date 13.03.2026	
Drawn: SS	Signed SS	Date 13.03.2026	
Checked: RM	Signed RM	Date 13.03.2026	
Reviewed: SP	Signed SP	Date 13.03.2026	
Approved: IH	Signed IH	Date 13.03.2026	
Design Stage: RIBA Stage 3			
Original Size: A1	Grid: -	Datum: -	
Suitability Code: A3	Scale: As indicated	Project Number: 30279810	

Suitability Description: OFFICIAL-SENSITIVE
Listed Building Consent Submission

Drawing Number: 30279810-ARC-MAN-08-DR-EE-06302
Revision: LO2

© Copyright reserved