


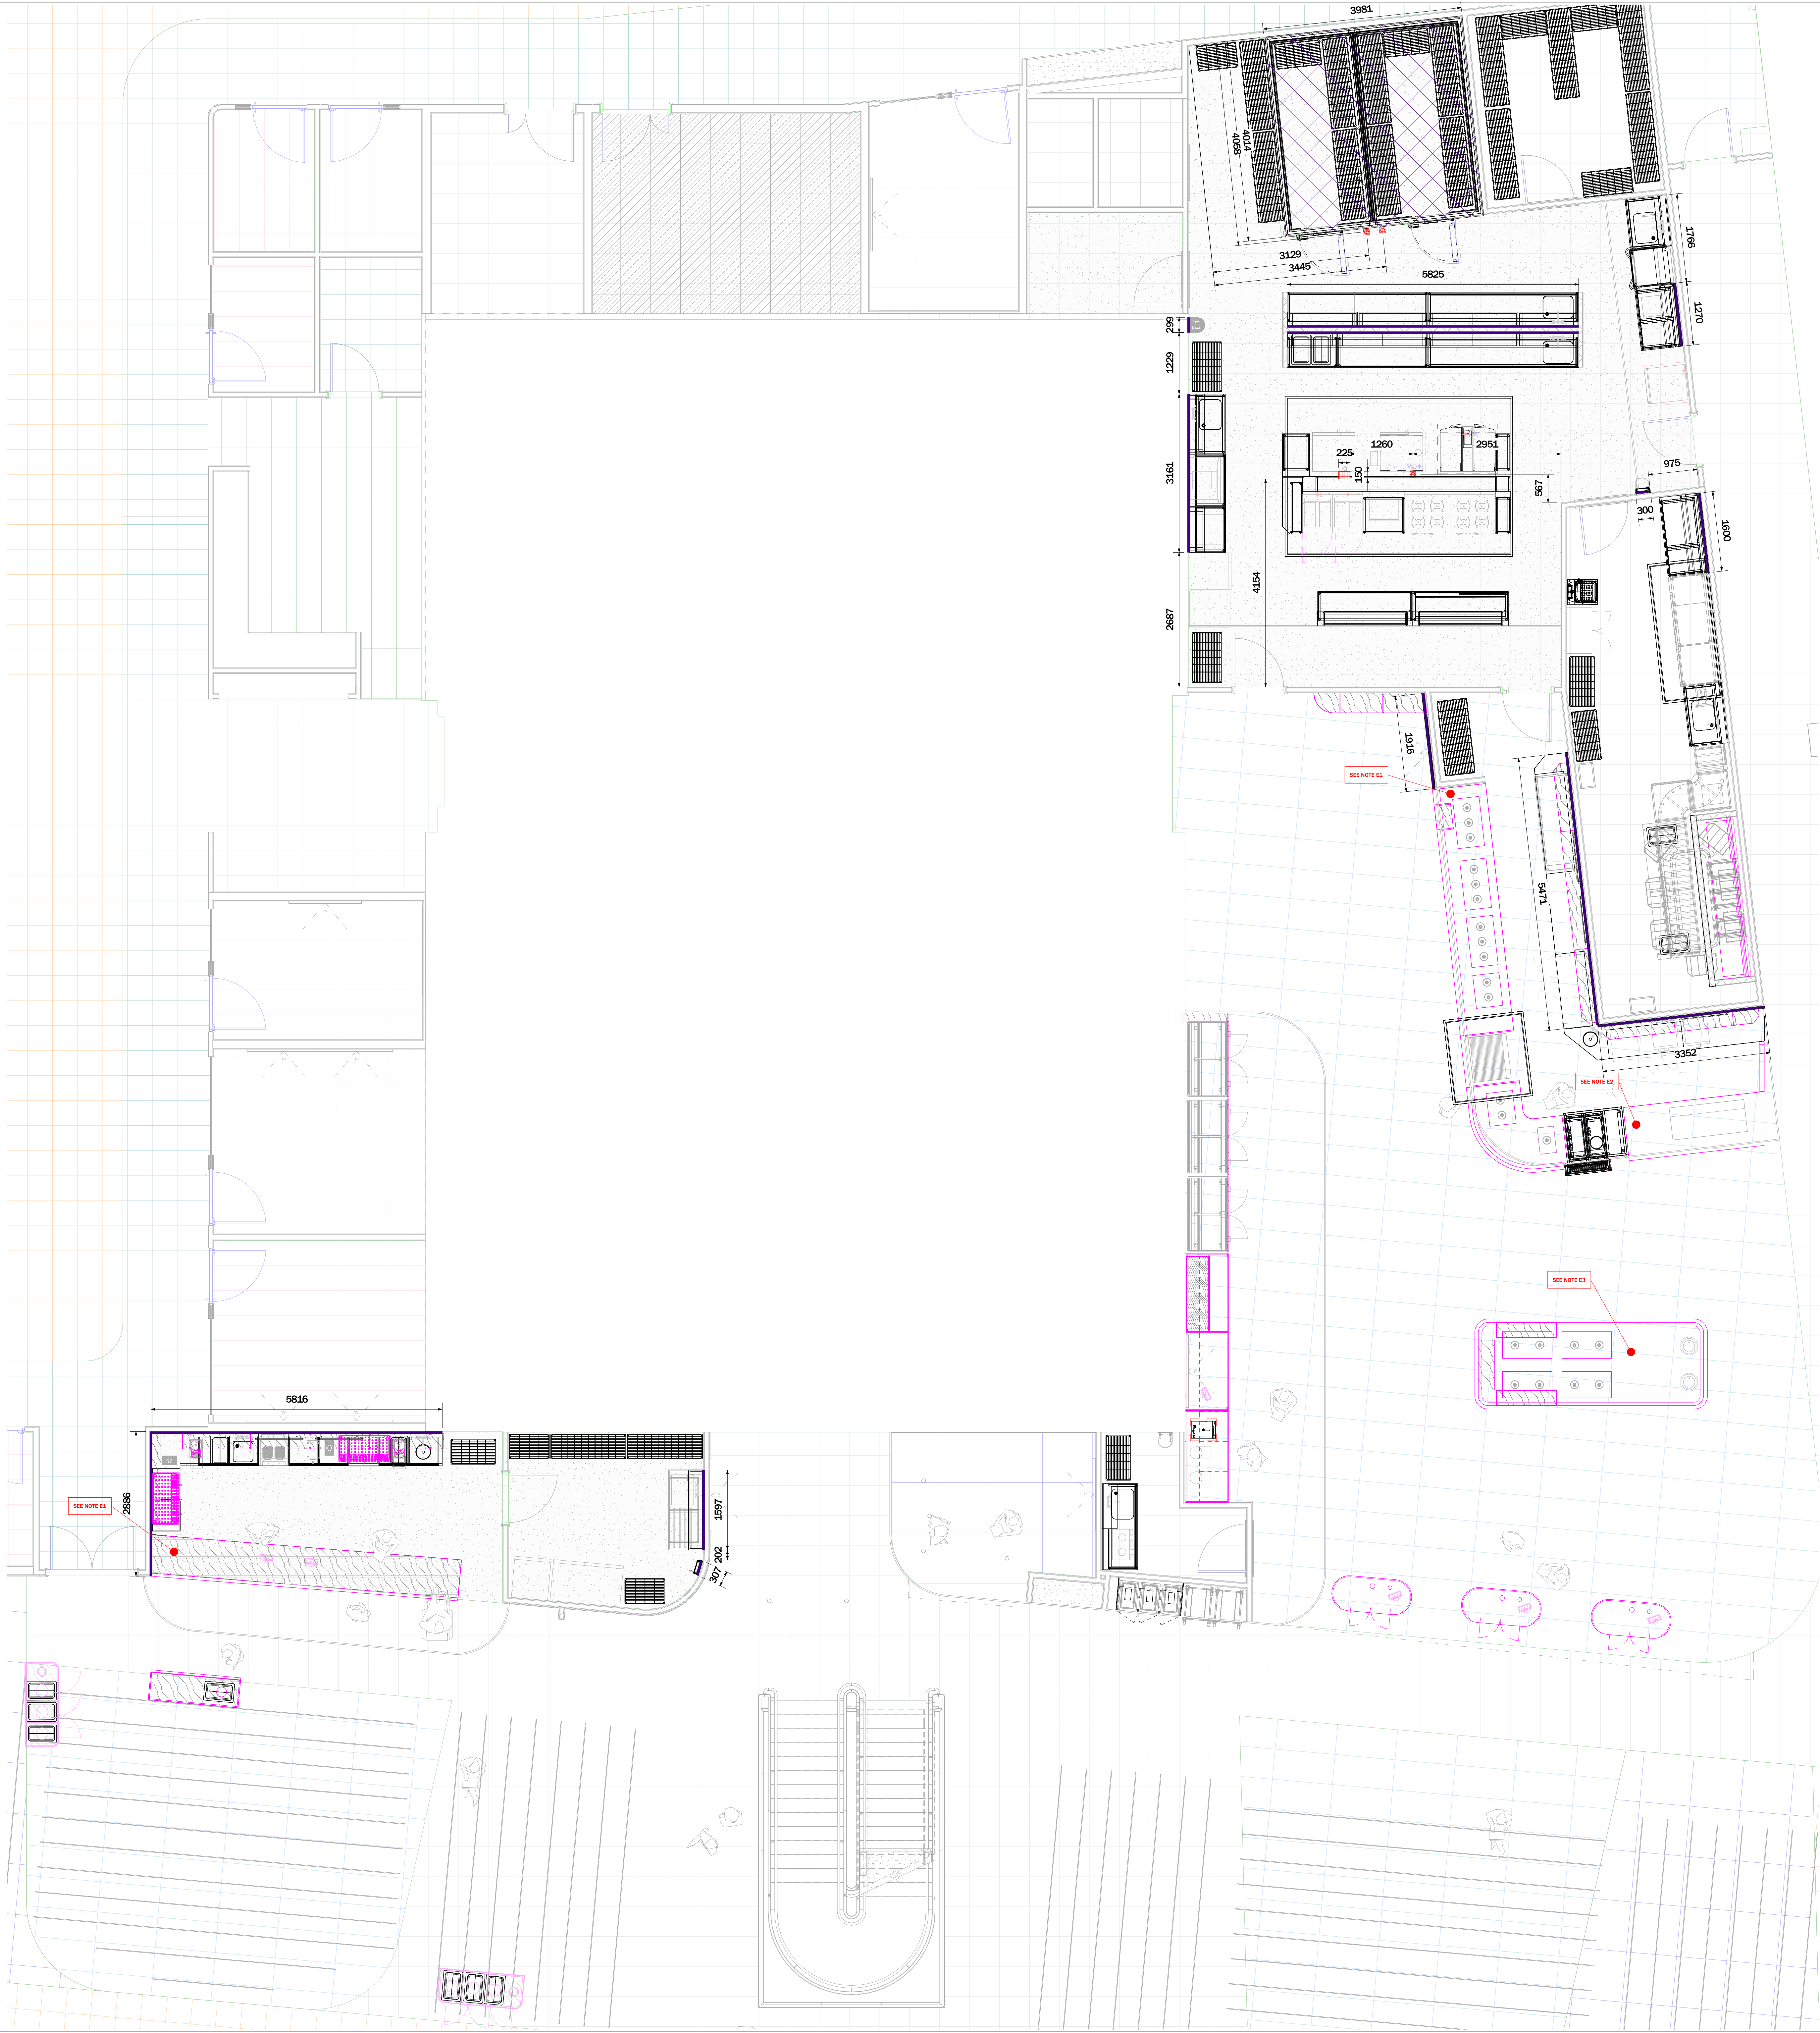

EQUIPMENT BY OTHERS

Equipment (Client Supply / Existing / By Others)

LOW LEVEL BUILDERS WORK DETAILS

- COLD ROOM RECESS HATCH, 500mm DEEP RECESS (TRC) REFER TO RESPONSE DINGS
- TRAPPED FLOOR GULLY / CHANNEL (NOT SUPPLIED BY C&C UNLESS OTHERWISE STATED)
- TRAPPED FLOOR GULLY / CHANNEL WITH TUNDISH (NOT SUPPLIED BY C&C UNLESS OTHERWISE STATED)
- TRAPPED TUNDISH
- STUB STACK RISER (TRAPPED BELOW FLOOR)
- RIISING MECHANICAL SERVICES
- RIISING ELECTRICAL SERVICES
- SUGGESTED WALL STRENGTHENING (18mm PLYWOOD)

LOCATIONS SHOWN ARE INDICATIVE POSITIONS. FINAL CO-ORDINATION REQUIRED WITH M&E CONTRACTOR

E1 (ITEM S6)
ELECTRICAL CONTRACTOR TO PROVIDE SINGLE INCOMING ELECTRICAL SUPPLY OF 32amp 1-PHASE AT LOW LEVEL FOR CONNECTION TO COUNTER MCB FOR THE FOLLOWING EQUIPMENT:
S6 HEATED DISPLAY - 3kW (LPH)
S6 HOT COLD DISPLAY - 3kW (LPH)
S6 HOT COLD DISPLAY - 3kW (LPH)
S6 HOT COLD DISPLAY - 3kW (LPH)
S6 ELECTRIC CHURNER - 1.5 kW (LPH)
S6 HOT COLD DISPLAY - 3kW (LPH)
S6 HEATED DISPLAY - 3 kW (LPH)
PLEASE NOTE TOTAL LOADING TO BE CONFIRMED BY OTHERS, COUNTER NOT IN C&C PACKAGE

E2 (ITEM S23)
ELECTRICAL CONTRACTOR TO PROVIDE SINGLE INCOMING ELECTRICAL SUPPLY OF 32amp 1-PHASE AT LOW LEVEL FOR CONNECTION TO COUNTER MCB FOR THE FOLLOWING EQUIPMENT:
S23 THEATRE COOKING TABLE - 10kW (LPH) - SERVICES TRC
S23 REPRESENTED CELL - 3kW (LPH)
PLEASE NOTE TOTAL LOADING TO BE CONFIRMED BY OTHERS, COUNTER NOT IN C&C PACKAGE

E3 (ITEM S53)
ELECTRICAL CONTRACTOR TO PROVIDE SINGLE INCOMING ELECTRICAL SUPPLY OF 32amp 1-PHASE AT LOW LEVEL FOR CONNECTION TO COUNTER MCB FOR THE FOLLOWING EQUIPMENT:
S53 HEATED DISPLAY - 3kW (LPH)
S53 HOT COLD DISPLAY - 3kW (LPH)
S53 HOT COLD DISPLAY - 3kW (LPH)
S53 SOUP KETTLE - 1.5kW (LPH)
S53 SOUP KETTLE - 1.5kW (LPH)
S53 HOT COLD DISPLAY - 3kW (LPH)
S53 HOT COLD DISPLAY - 3kW (LPH)
PLEASE NOTE TOTAL LOADING TO BE CONFIRMED BY OTHERS, COUNTER NOT IN C&C PACKAGE

E4 (ITEM C23)
ELECTRICAL CONTRACTOR TO PROVIDE SINGLE INCOMING ELECTRICAL SUPPLY OF 32amp 1-PHASE AT LOW LEVEL FOR CONNECTION TO COUNTER MCB (CLEAN SUPPLY REQUIRED FOR 2x D.S.S.O. / DATA FOR TALL NOTE BY OTHERS)
PLEASE NOTE TOTAL LOADING TO BE CONFIRMED BY OTHERS, COUNTER NOT IN C&C PACKAGE

PO1	12/12/25	FIRST ISSUE	JC
REV.	DATE	DESCRIPTION	BY

PROJECT

BNYM

TITLE

Level 06

Low Level Builders Works



C&C Catering Equipment Ltd
Quarry Buildings, Hill Road
Eccleston, Chester CH4 9HQ
TEL: 01244 625170
c&c@cateringequipment.com
www.cateringequipment.com

JOB NO.	6577	DATE	12/12/25
DESIGNER	JC	CHECKER	JPM
SCALE	As indicated	SHEET SIZE	A0
DRAWING NO.		REVISION	
BNYM-CCC-ZZ-06-DR-CA-000004		PO1	

ARCHITECT DRAWING NO.	REVISION
BNYM-TPB-ZZ-06-DR-ID-201001	C01
CONSULTANT DRAWING NO.	REVISION
BNYM-RDA-XX-06-DR-CA-106000	C01

DRAWING STATUS
FOR APPROVAL