

HEALTH AND SAFETY INFORMATION

ALL WORKS SHALL BE CARRIED OUT BY COMPETENT PEOPLE.  
IN ADDITION TO THE HAZARDS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, THE DESIGNER HAS REVIEWED THE HAZARD AND DEVELOPED A DESIGNER'S RISK ASSESSMENT.  
THE CONTRACTOR SHALL REFER TO THE CONSTRUCTION PHASE PLAN AND ADOPT THE HAS AND DESIGNER'S RISK ASSESSMENT FINDINGS IN THE DEVELOPMENT OF THEIR RISK, BEFORE UNDERTAKING ANY WORKS.  
PLEASE ALSO NOTE THE FOLLOWING ->

DIFFICULT TO MANAGE  
THERE MAY BE OBSTACLES DUE TO THE PRESENCE OF EXISTING STRUCTURES, E.G. SCAFFOLDING, DELIVERIES, PROXIMITY OF GAS MAINS OR POWER LINES, WORKING IN CLOSE PROXIMITY TO THE PUBLIC ETC.  
NOT KNOWN AT THIS TIME OR NOTHING SIGNIFICANT

UNUSUAL  
THERE MAY BE COMMON WORKS OCCURRING IN USUAL CIRCUMSTANCES, THEY WOULD NOT BE USUAL BECAUSE OF THE NATURE OF THE CONSTRUCTION METHOD OR SITE CONDITIONS, E.G. UNUSUAL OR CONTAMINATED GROUND, ASBESTOS, LEAD PAINT, SILICA DUST ETC.  
PLEASE REFER TO THE OPERATIONAL SITE SPECIFIC ASBESTOS MANAGEMENT PLAN FOR MORE INFORMATION

NOT LIKELY TO BE OBVIOUS TO A CONTRACTOR OR DESIGNER  
THE CONTRACTOR, AT THE DESIGN STAGE, AS WELL AS DURING THE DESIGN CYCLE, MAY NOT BE AWARE OF SOME OF THE LESS OBVIOUS RISKS, E.G. STRUCTURAL ISSUES ASSOCIATED WITH FOUNDATIONS, EXISTING FOUNDATION TIES, FRAGILE ROOFS OR FRAGILE SURFACES ETC.  
NOT KNOWN AT THIS TIME OR NOTHING SIGNIFICANT

OPERATIONAL ACCESS: HORIZONTAL, VERTICAL, PEDESTRIAN, VEHICLE / PLANT  
ARE THERE SIGNIFICANT ISSUES REGARDING ACCESS? IF YES, OUTLINE BELOW OR REFER TO APPROPRIATE DOCUMENT ETC.  
NOT KNOWN AT THIS TIME OR NOTHING SIGNIFICANT

OPERATIONAL HANDLING / LIFTING STRATEGY  
WHAT TYPES OF MATERIALS / COMPONENTS / EQUIPMENT WILL BE REQUIRED TO BE LIFTED? IDENTIFY ANY ITEMS THAT MAY REQUIRE SPECIAL LIFTING ARRANGEMENTS TO BE PUT IN PLACE AS WELL AS IDENTIFY ANY UNUSUAL RISKS ASSOCIATED WITH HANDLING AND LIFTING.  
PROCEED WITH CAUTION DURING OPERATIONAL HANDLING  
MANEUVERING AS THE UNDERCROFT IS A LISTED BUILDING

HEALTH AND SAFETY FILE INCLUSIONS  
IDENTIFY ANY HAZARDS / OBSTACLES / RISKS ASSOCIATED WITH MAINTENANCE OR PERSONAL / PROTECTION OF THE CONTENTS OF THIS DRAWING AT A LATER DATE.  
PLEASE REFER TO THE OPERATIONAL SITE SPECIFIC ASBESTOS MANAGEMENT PLAN FOR MORE INFORMATION

- NOTES
1.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL AND STRUCTURAL DRAWINGS.
2.

CONTAINMENT ROUTES AND HEIGHTS TO BE CO-ORDINATED WITH 3D LAYOUT DRAWINGS. FINAL POSITIONS ARE TO BE CO-ORDINATED AND AGREED ON SITE. HOWEVER IF ANY OF THE MAJOR ROUTES SHOWN ARE ALTERED, PLEASE CONTACT THE DESIGN DEPARTMENT TO CHECK ANY EFFECT ON THE CABLE SIZING CALCULATIONS. ALL INVERT LEVELS INDICATED ARE TO THE UNDERSIDE OF THE ASSOCIATED CONTAINMENT.
3.

CONTROL AND LV CABLING INCLUDING ALL SECONDARY CONTAINMENT MUST BE SEGREGATED IN ACCORDANCE WITH BS7071, INCLUDING LATEST AMENDMENTS.
4.

ALL LOCALISED SUPPORTS, TRAY AND TRUNKING DROPS AND SECONDARY CONTAINMENT TO PLANT AND EQUIPMENT TO BE AGREED ON SITE. NOT CURRENTLY SHOWN FOR CLARITY.

CONTAINMENT LEGEND:


MEDIUM DUTY CABLE LADDER FOR LV SUBMANS - SIZES AND MOUNTING HEIGHTS ON LAYOUT

1 x 150mm GALVANISED STEEL MEDIUM DUTY CABLE TRAY FOR POWER MOUNTED AT 200mm AFFL

LV MEDIUM DUTY GALVANISED STEEL PERFORATED TRAY MOUNTED AT 150mm AFFL - SIZES AND MOUNTING HEIGHT ON LAYOUT FOR BMS COMMS FIBRE AND BMS WIRING

BMS CONTROL PANEL

- REFERENCE DOCUMENTS:
- MANCHESTER PICCADILLY RAIL STATION - OPERATIONAL SITE SPECIFIC ASBESTOS MANAGEMENT PLAN
- 50902-VE-PS-XX-SC-E-6801 PICCADILLY STATION BLOCK CABLE DIAGRAM
- 50902-VE-PS-XX-SC-E-6802 PICCADILLY STATION SYSTEM ARCHITECTURE DIAGRAM
- 50902-VE-PS-XX-SC-E-6803 PICCADILLY STATION BOILER ROOM BLOCK CABLE DIAGRAM

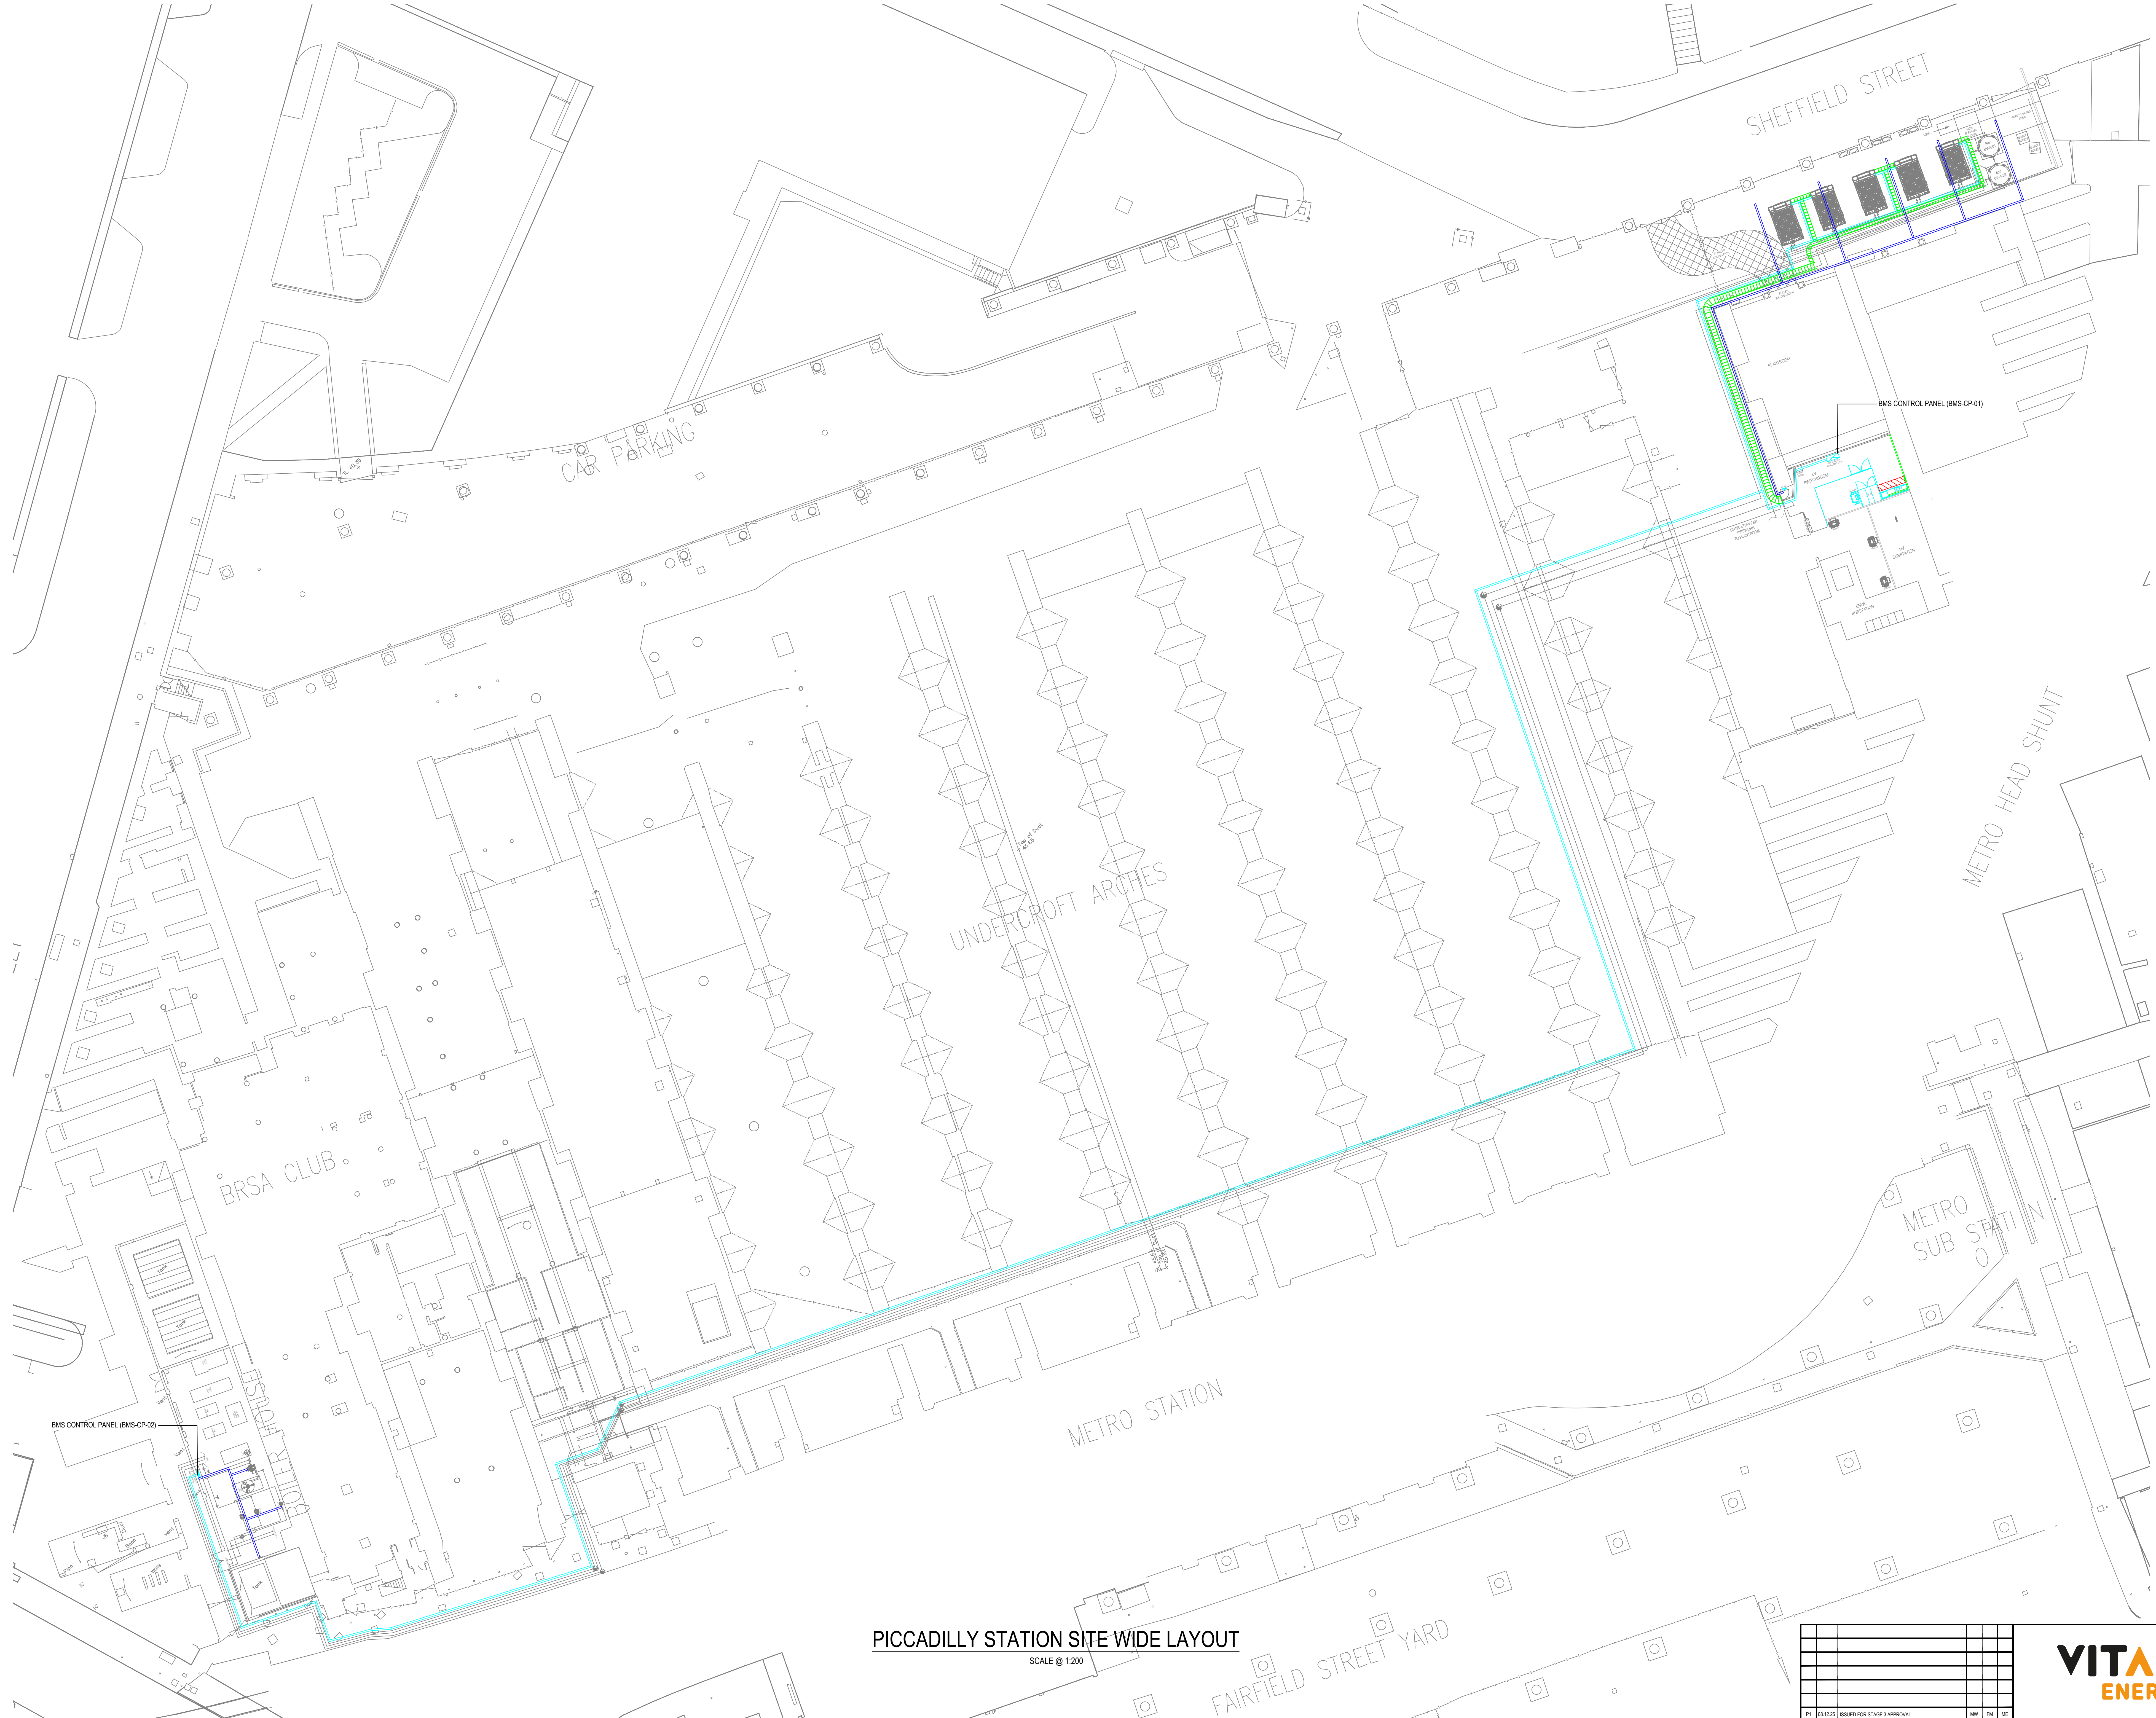

PICCADILLY STATION SITE WIDE LAYOUT  
SCALE @ 1:200

0 2 4 6 8 10 12 14

SCALE IN METRES

1:200

ISSUED FOR STAGE APPROVAL

|     |          |                             |     |     |     |
|-----|----------|-----------------------------|-----|-----|-----|
| P1  | 08.12.25 | ISSUED FOR STAGE 3 APPROVAL | MR  | FM  | VE  |
| REV | DATE     | DESCRIPTION                 | DRN | CHK | APP |

VITAL ENERGI

Vital Energi, Century House, Roman Road, Blackburn, Lancashire, BB1 2LD  
Tel: +44 (0)1254 296 000 Fax: +44 (0)1254 296 040

|                          |                                                 |
|--------------------------|-------------------------------------------------|
| Project:                 | PICCADILLY STATION                              |
| Title:                   | PICCADILLY STATION SITE WIDE CONTAINMENT LAYOUT |
| DATE:                    | 08.12.2025                                      |
| SCALE:                   | 1:200                                           |
| SHEET:                   |                                                 |
| A0                       |                                                 |
| STAGE APPROVAL           | Status: S4                                      |
| Stage:                   | 3                                               |
| 50902-VE-PS-00-DR-E-6102 | Rev: P1                                         |