

PROPOSED TENANT SUBMAIN DISTRIBUTION SCHEMATIC (1:50)




SMALL POWER ARRANGEMENT FOR 5 SEATS MEETING TABLE (1:50)

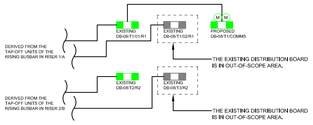


SMALL POWER ARRANGEMENT FOR 10 SEATS MEETING TABLE (1:50)




TYPICAL WORKSTATION SMALL POWER ARRANGEMENT (1:50)

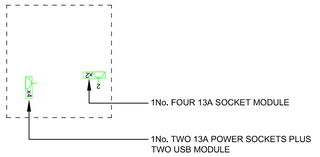

SMALL POWER ARRANGEMENT FOR 6NO. WORKSTATIONS TYPE 1 (N.T.S)

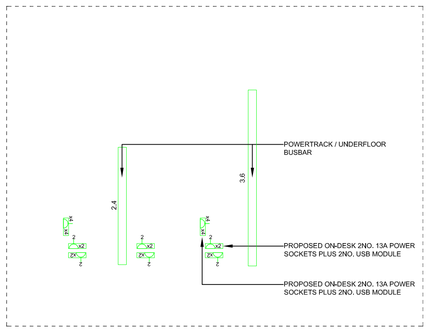

No proposed sockets/outlets to be installed on the existing walls/building fabric.

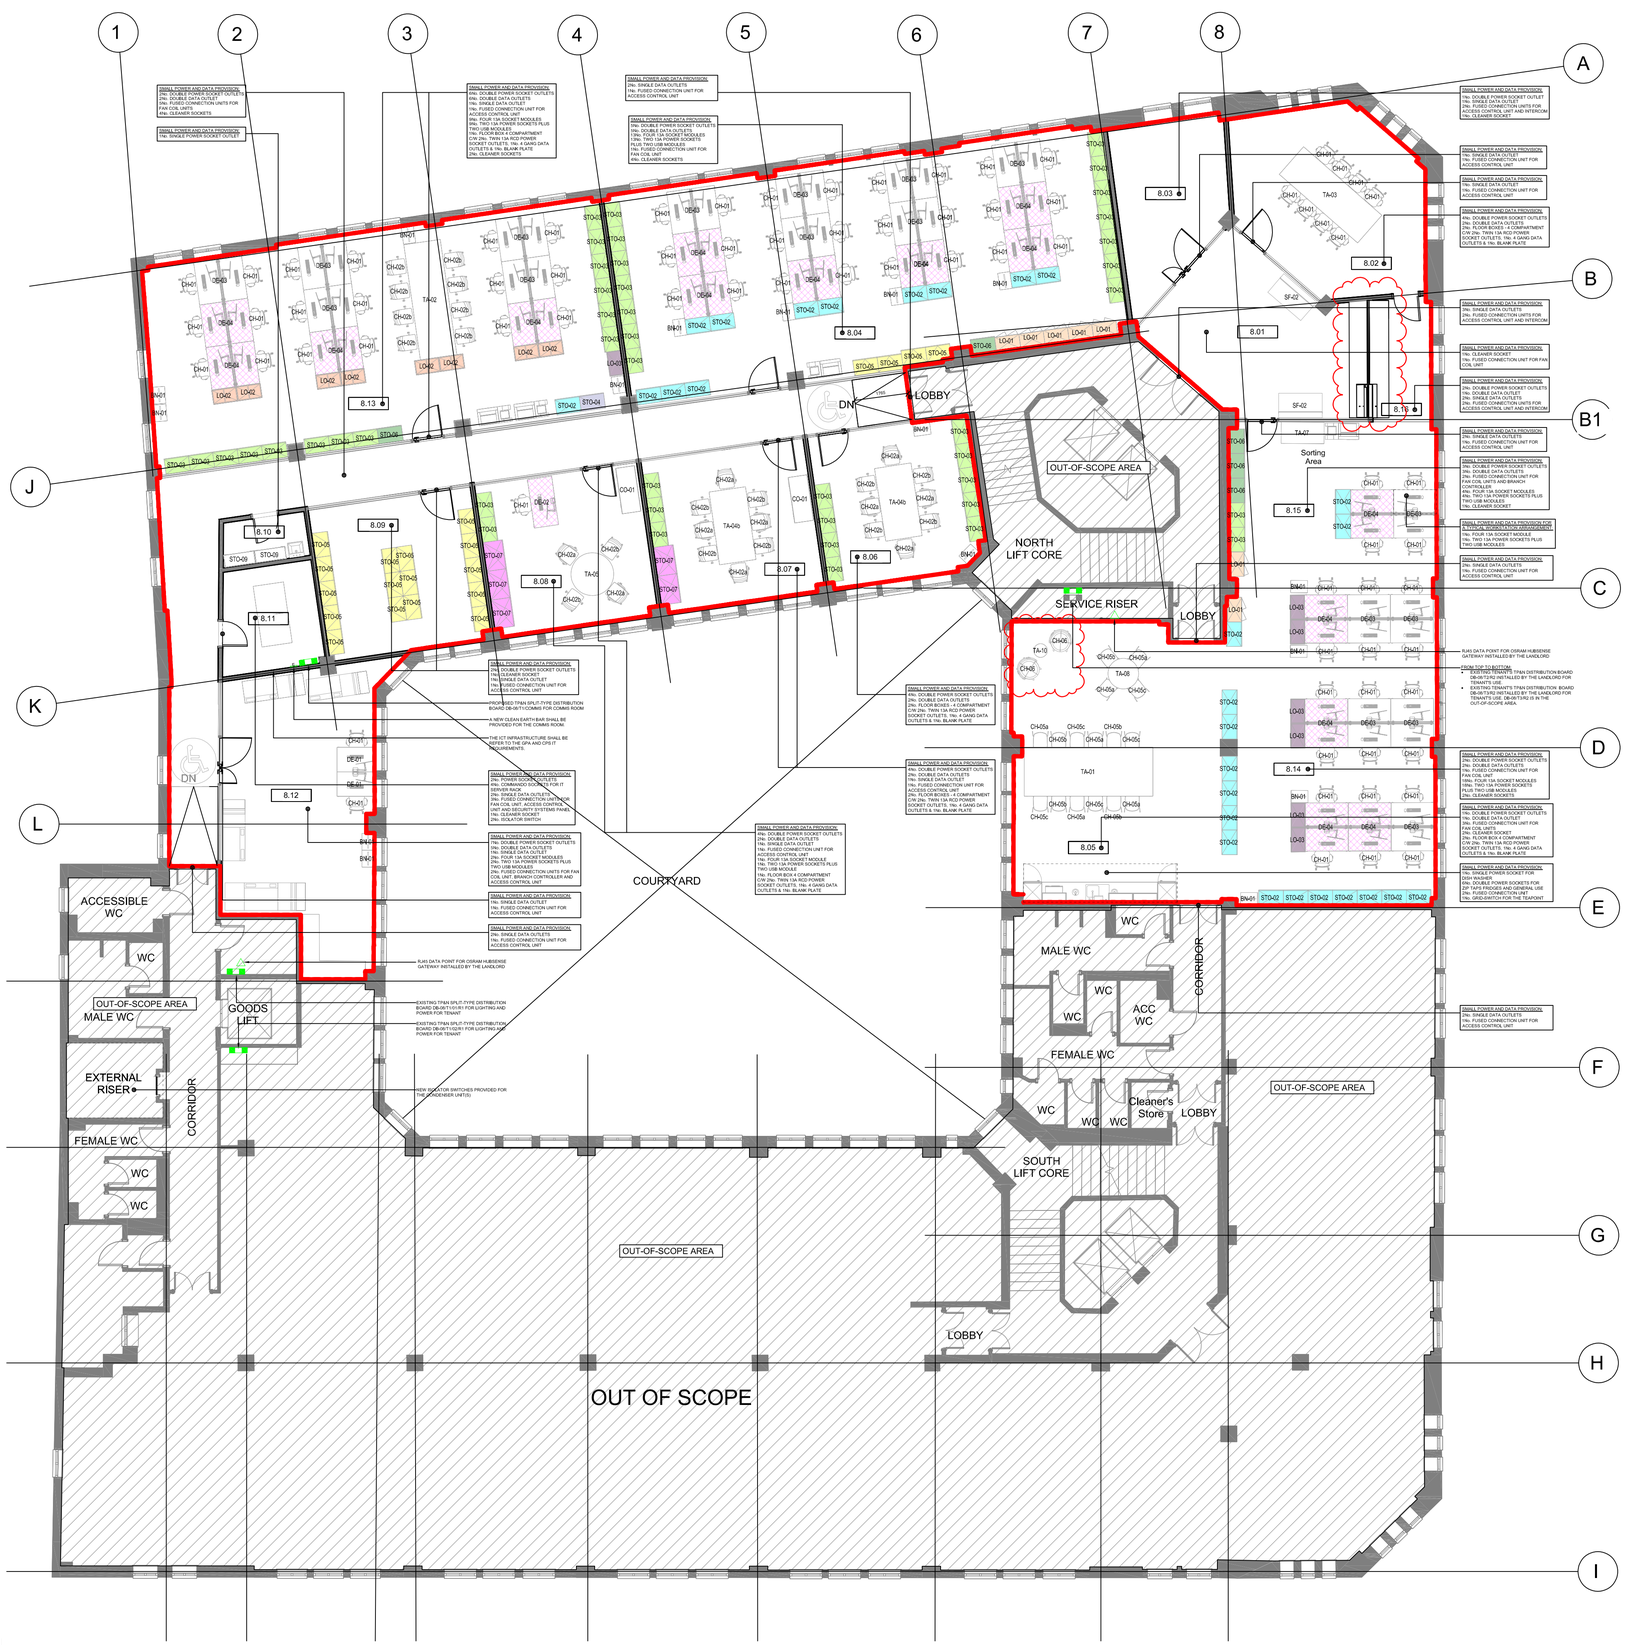

GENERAL NOTES:

1. THE PREPARED DRAWING ILLUSTRATES THE CONCEPTUAL DESIGN PRINCIPLES TO DEVELOP THE DRAWINGS AT THE NEXT STAGE.
2. ALL DESIGN OF THE SMALL POWER SYSTEM SHALL COMPLY WITH ON THE CURRENT GOVERNMENT PROPERTY AGENCY (GPA) DESIGN GUIDES, IET GUIDES, CIBSE GUIDES, BS OR BS EN STANDARDS, LOCAL REGULATIONS AND STANDARDS.
3. ALL DESIGN OF THE SMALL POWER SYSTEM DESIGN PRINCIPLE AND STRATEGIC SHALL REFER TO THE RIBA STAGE 3 PERFORMANCE SPECIFICATION.
4. DO NOT SCALE THIS DRAWING. ALL DIMENSIONS AND LEVELS ARE INDICATIVE ONLY AND MUST BE VERIFIED ON SITE BY THE PRINCIPAL CONTRACTOR OR A RELATED SUBCONTRACTOR PRIOR TO THE COMMENCEMENT OF WORKS.
5. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL MECHANICAL, ELECTRICAL, ARCHITECTURAL AND STRUCTURAL DRAWINGS AND THE RIBA STAGE 3 PERFORMANCE SPECIFICATION.

LEGEND:

SYMBOL	DESCRIPTION
	TPN SPLIT-TYPE DISTRIBUTION BOARD
	SPN DISTRIBUTION BOARD
M	CHECK METER
	EXISTING DATA POINT FOR OSRAM HUBSENSE GATEWAY
XX	PROPOSED UNDERFLOOR BUSBAR SYSTEM • XX = LENGTH OF THE BUSBAR
1X	PROPOSED UNDERDESK 4NO, 13A MODULE
2 X2	PROPOSED ONDESK 2NO, 13A POWER SOCKETS PLUS 2NO, USB MODULE
FB	PROPOSED FLOOR BOX 4 COMPARTMENT C/W 2No. TWIN 13A RCD POWER SOCKET OUTLETS, 1No. 4 GANG DATA OUTLETS & 1No. BLANK PLATE
	CLEAN EARTH BAR
	OUT-OF-SCOPE AREA. ALL EXISTING SMALL POWER SYSTEM WILL BE RETAINED.

ABBREVIATIONS:

TPN	= TRIPLE POLE AND NEUTRAL
SPN	= SINGLE POLE AND NEUTRAL
xN	= QUANTITY OF ITEMS • N DENOTES NUMBER

Rev	Date	Description	Prod.	Chk.	Rvd.	App.
LO2	13.03.26	LBC Submission	ZL	DK	KB	KB
LO1	03.12.25	LBC Issue	ZL	DK	KB	KB

Client:

Government Property Agency

ARCADIS

Registered office:
80 Fenchurch Street,
London
EC3M 4BT

Coordinating office:
80 Fenchurch Street,
London
EC3M 4BT

www.arcadis.com

Project:
CPS Manchester

Site
Sunlight House,
Little Quay Street,
Manchester M3 3HP

DrawingTitle:
Level 08 - Proposed Small Power and Data System Plan

Designed: ARCADIS	Signed: ARCADIS	Date: 13.03.2026
Drawn: SS	Signed: SS	Date: 13.03.2026
Checked: RM	Signed: RM	Date: 13.03.2026
Reviewed: SP	Signed: SP	Date: 13.03.2026
Approved: IH	Signed: IH	Date: 13.03.2026

Design Stage: RIBA Stage 3

Original Size: A1	Grid: -	Datum: -
Suitability Code: A3	Scale: As indicated	Project Number: 30279810

Suitability Description: OFFICIAL-SENSITIVE

Listed Building Consent Submission

Drawing Number: 30279810-ARC-MAN-08-DR-EE-06202
Revision: LO2

1 Level 08 - Proposed Small Power and Data System Plan
1 : 100

100mm on Original

Print Date: 12/08/2025 2:57:07 pm

Autodesk Docs://AGB-10058858-Riding Gate CPS Canterbury/10058858-ARC-CAN-ZZ-M3-AR-000010.rvt

© Copyright reserved