

- THIS DRAWING TO BE READ IN CONJUNCTION
WITH THE FOLLOWING:-



- | REV | DATE | DESCRIPTION | DRW | ENG |
|-----|------------|------------------------|-----|-----|
| P01 | 03.11.2025 | FIRST ISSUE | PD | PD |
| P02 | 11.11.2025 | PIPE SIZE DETAIL ADDED | JC | JC |
| P03 | 15.11.2025 | TENDER ISSUE | PD | PD |
| P04 | 22.12.2025 | TENDER ISSUE UPDATE | PD | PD |



Job No.	Originator	Zone	Level	Type	Role
B3322	BMT	ZZ	02	DR	M
System Classification	Drawing No.	Suitability	Revision		
Ss_60_40_17_71-2020		D2	P04		



1. ALL AC PIPEWORK IS COPPER
2. ALL PIPEWORK WILL BE ENCLOSED IN 13mm WALL THICKNESS CLASS O ELASTOMERIC INSULATION, CLOSED-CELL NITRILE RUBBER

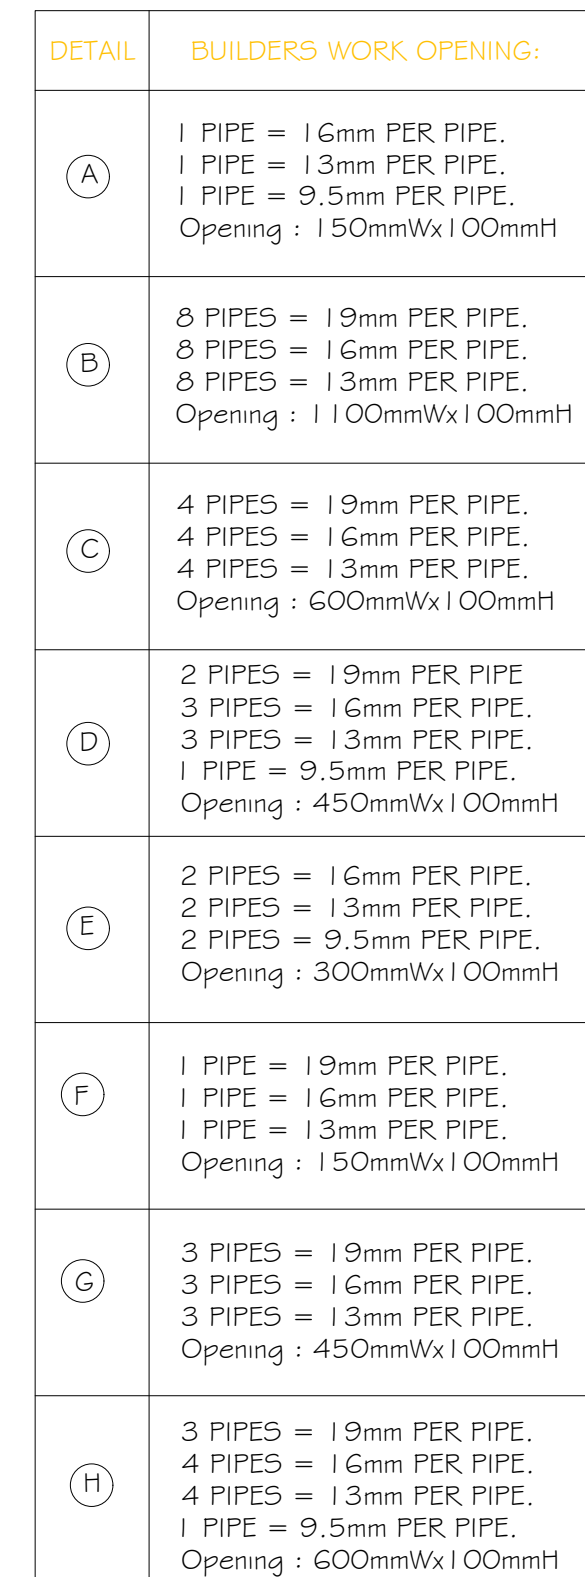

TYPICAL AC SCHEMATIC

© This Drawing Is Copyright! And May Not Be Reproduced In Any Manner Without The Prior Written Consent Of Building Management Technology Ltd