



Boddingtons, Manchester

RIBA Stage 4 TM59 Analysis

DN0107-WWL-ZZ-ZZ-RP-CS-00104



LATIMER
by Clarion Housing Group

Contents

	Page
Executive Summary	2
1.0 Introduction	3
2.0 Thermal Modelling Assessment	5
3.0 Assessment Results	8
4.0 Conclusions	9
5.0 Appendix A - Design Details (Part O, UK Building Regulations)	10
6.0 Appendix B - TM59 Full Results	11

Issue / Revision Record

Issue	Date	By	Checked	Comment
P01	25/02/22	FC	CSt/JR/AH	Stage 3 Issue
P02	24/11/23	GO	AG / CH	Revised Stage 3 Final Issue
P03	05/07/24	GO	FTC	Stage 4 Issue

Executive Summary

Wallace Whittle has been appointed by Latimer by Clarion Housing Group (LCHG Ltd to produce a thermal comfort assessment evaluating the overheating risk in the proposed Boddingtons development in Manchester.

This report presents the information used to demonstrate the route to compliance with Part O: Overheating 2021 of the UK Building Regulations. In this study, a combined Natural and Mechanical Ventilation strategy is implemented and analysed against the CIBSE TM59 overheating criteria (please note that all compliance information for Part O is summarised in appendix A).

The proposed development consists of the erection of two buildings to create a mixed-use development comprising residential uses (Use Class C3) with commercial uses (Use Class E) provided at the ground floor level, together with a new courtyard pocket park, landscaping, cycle parking, accessible parking spaces, highways work, access arrangements, and other associated works.

All apartments from the development have been assessed against the overheating benchmarks set by The Chartered Building Services Engineers Technical Memoranda 59 (CIBSE TM59): Design methodology for the assessment of overheating risk in homes. All apartments assessed are in line with the guidance provided in the TM59 and are representative of the apartments on site. Part O compliance is based on the criteria detailed in Section 2.2 below.

The following thermal modelling software: Integrated Environmental Solutions Virtual Environmental (IES VE) software, version 2023, was used to assess the dwellings using the latest CIBSE Design Summer Year (DSY1) weather file for Manchester, for the 2020s, high emissions, 50% percentile scenario for compliance with Part O. Two additional simulations using DSY 2 and 3 weather scenarios were completed to satisfy Latimer’s sustainability standards.

The proposed site has acoustic restraints which come from the Great Ducie Street located in close proximity, that affect the opening of windows for overheating purposes. An acoustician (Cundall) has assessed the site and recommended that windows are not allowed to open for reducing the risk of overheating. This has led to a mixed mode approach to manage overheating risk. The ventilation strategy for the proposal includes the following overheating mitigation measures:

- A deep (300mm) window reveal has been applied to all windows in the proposed development.
- The glazing g-value for all windows to the domestic element is proposed to be no higher than 0.37 throughout the elevations as per Nordan's Stage 4 Glazing Specification.
- Enhanced MVHR Units providing a summer bypass and overheating additional flow rates are to be installed in all units of the proposed development.
- The initial 100mm opening restriction referred to in the Employers Requirements (ERs section 7.3) will need to be overridden during summer, providing an opening of at least 350mm to bedroom windows and a 90° opening to Juliet balcony doors in order to mitigate overheating, and ensure compliance with ADO.

Description: Window Opening Restrictions & Enhanced MVHR		Weather File: DSY1			
Total Rooms Assessed:	1404	Criteria a: Average percentage of hours Operative Temperature is above 26°C (Threshold: 3%)		Criteria b: Average number of hours Operative Temperature is above 26°C (22:00 - 07:00)(Bedrooms Only)(Threshold: 32 hours)	
KLR	501	0.41	Pass (100%)	N/A	N/A
Double Bedroom	634	0.08	Pass (100%)	4.46	Pass (100%)
Single Bedroom	269	0.11	Pass (100%)	3.73	Pass (100%)

Table 1 - CIBSE TM59 Assessment results summary

Please note that results and recommendations are based on the assumptions described in this report. If any of the inputs change, results are likely to be different and the recommendations may no longer be appropriate.

In line with Latimer's Sustainability Standards, Wallace Whittle have run additional scenarios to account for DSY2 and DSY3 weather files. The results are detailed within this report for information.

1.0 Introduction

1.1 General

This report presents the findings of the thermal comfort assessment used to assess the overheating risk in the proposed Boddingtons development in Manchester. It presents the information used to demonstrate the route to compliance with Part O: Overheating 2021 of the UK Building Regulations. In this study, a combined Natural and MVHR strategy is implemented and analysed against the CIBSE TM59 overheating criteria.

1.1.1 Building / Site Description

The proposed development is located on a former industrial brownfield site formerly the Boddington brewery site. Most of the site has been cleared with existing buildings surrounding the site occupied and in situ. Great Ducie Street a main arterial route out of Manchester, is in the proximity of the site. The site is within walking distance of Manchester City Centre.

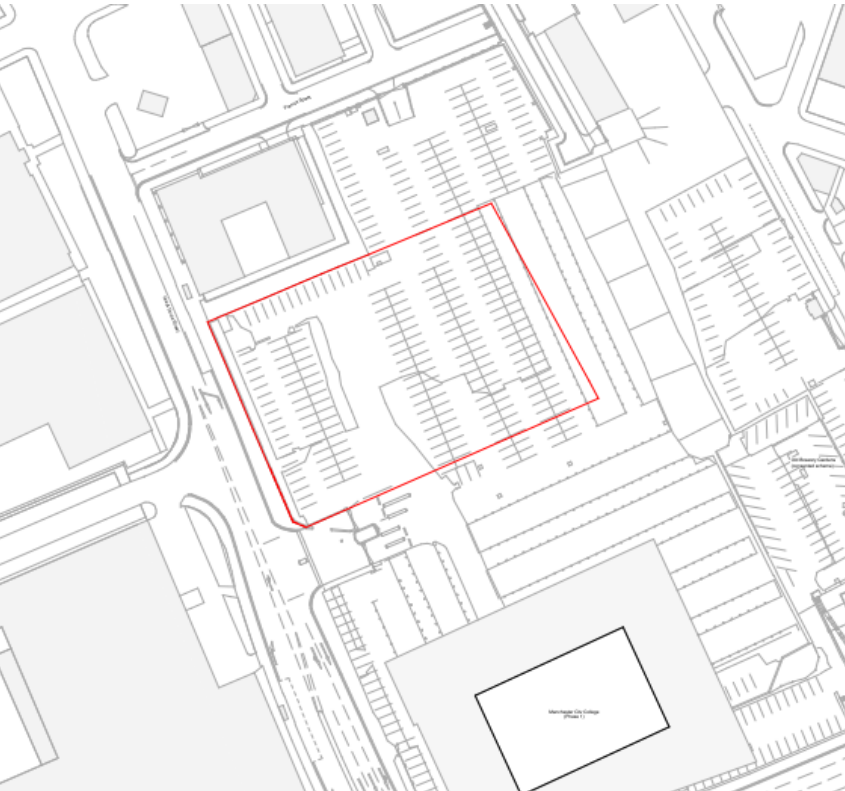


Figure 1 - Site Location Plan (A3564-ASA-XX-XX-DR-A-0100 P06)

1.1.2 Acoustic Limitations

Cundall provided a report detailing an acoustic assessment for the site (1032195 MEMO AS-001). The assessment reviewed external noise level affecting the different facades of the proposed building. The figure below illustrates the acoustic advice on openable windows for overheating purposes.

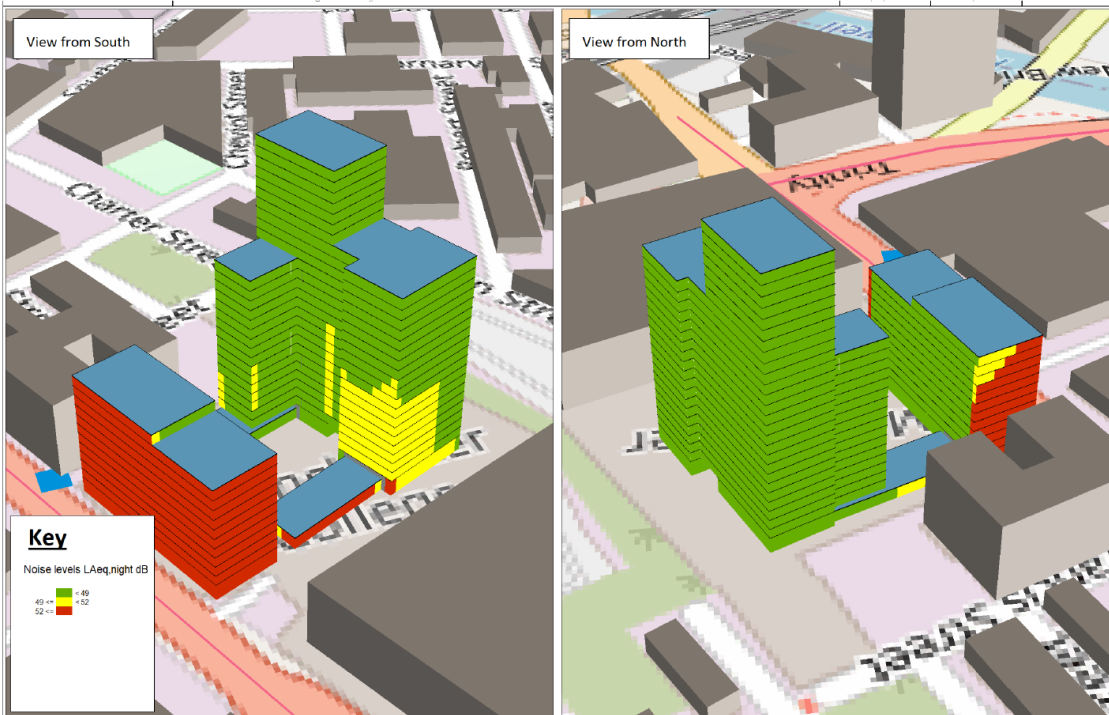


Figure 1.1 - Boddingtons ADO Risk Assessment Night-time LAeq,T Noise Levels. Cundall (1032195 MEMO AS-001)

The image above illustrates the restrictions in terms of Part O: Overheating 2021. The red areas show the elevations that cannot use openable windows during the night as an overheating measure.

It should be highlighted that all other dwellings have been modelled as per the opening information detailed within this report. The amber zones as per Cundall's report notes that these areas may be suitable for openable windows subject to a review, it should be highlighted that for these spaces an opening threshold of 100mm alongside the proposed MVHR systems will be sufficient to reduce the risk of overheating and comply with ADO.

1.1.3 Ventilation Strategy

A mixed mode ventilation strategy is proposed for the building, an assessment has been carried out at this stage to test the ventilation strategies against the ADO requirements and CIBSE TM59.

1.2 Sources of Information

In the collation of this analysis and report the following sources of information were used:

Source	Drawing File	Date
Assael	Stage 4 Package	14/06/2024

Table 1.2 - Architectural drawings used for TM59 Analysis

A summary of the design inputs can be found within Appendix A of this report.

1.3 Limitations

This report has been based on drawings provided at the time. Whilst the information used is taken from the drawings and supporting documentation, the final performance will be dependent on the final building design & operation. Any changes to the design inputs contained within this report could result in TM59 non-compliance.

2.0 Thermal Modelling Assessment

2.1 Assessment Methodology

The assessment methodology is described below:

- All apartments are modelled and assessed.
- All apartments/units were zoned into separate rooms including kitchens, living rooms, bedrooms, bathrooms and halls.
- Accurate thermal properties of all proposed building construction types have been included in the model. The following sections presents the fabric thermal performance applied to the model.
- A set of CIBSE TM59 standard occupancy and internal gains profiles were applied to the model.
- Where applicable openable windows and or passive ventilators were implemented.
- Internal and external shading provisions were applied to the model.
- Additional mechanical ventilation was applied to match the ventilation strategy proposed.
- The most appropriate weather file was applied for all simulations. The weather file used and a preliminary assessment to present the temperature profiles has been included in the following section of this report.
- The thermal modelling assessment was carried out using hourly dynamic simulation modelling on a number of simulation options described later in this report.

A three-dimensional (3D) thermal model of the proposed building was developed using Integrated Environmental Solutions Virtual Environment (IES VE) Software (Version 2023). Using the following modules to assess the potential overheating risk within all occupied domestic spaces of the development:

- Model It: To create the virtual model data, which is based on the proposed geometry and accounts for location and orientation.
- SunCast: to include the impact of the site orientation and relation to the solar impact on the development.
- MacroFlo: Bulk air movement module which simulates natural ventilation provision.
- ApacheSim: Dynamic thermal simulation module which combines the building thermo-physical characteristics to assess its thermal performance.

2.2 Design Comfort Criteria

In April 2017, CIBSE launched TM59 'Design methodology for the assessment of overheating risk in homes. This specifically focuses on acceptable thermal comfort conditions for occupants during both daytime and night-time periods. The document outlines two criteria to assess overheating for homes, which are predominantly naturally ventilated and recommends the use of the CIBSE fixed temperature test for homes which are predominately mechanically ventilated. The following are the criteria recommended by the TM59 methodology.

TM59 4.2 Criterion (a) – Applied to all occupied Rooms (Natural Ventilation):

The room temperature cannot exceed the maximum acceptable temperature by more than 1 K for more than 3% of occupied hours between May and September (inclusive). (CIBSE TM52 Criteria 1).

TM59 4.2 Criterion (b) – Applied to Bedrooms only (Natural Ventilation):

The room temperature cannot exceed 26°C for more than 1% of the annual hours between 22:00 and 07:00. (Note: 1% of the annual hours between 22:00 and 07:00 for bedrooms is 32 hours, so 33 or more hours above 26°C will be recorded as a 'fail')

TM59 4.3 Criterion (c) – Applied to predominantly mechanically ventilated Homes:

For homes with restricted window openings, the CIBSE fixed temperature test must be followed, i.e. all occupied rooms should not exceed an operative temperature of 26 °C for more than 3% of the annual occupied annual hours (CIBSE Guide A).

2.2.1 Weather Data

As per CIBSE TM59 guidelines, developments should refer to the latest CIBSE Design Summer Year (DSY) weather files published in 2016 and be required to pass the DSY1 file most appropriate for the site location, as this represents a moderately warm summer. For this study, Manchester_DSY1_2020High50 was selected as the most representative for the location.

Weather Scenario	Description	Notes:
DSY 1	moderately warm summer, with a return period of seven years.	Weather scenario used for compliance with CIBSE TM59
DSY2	Short, intense warm spell	Weather scenario used for satisfying Latimer's sustainability standards
DSY3	Long, less intense warm spell	

Table 2.2.1 - CIBSE DSY Weather Scenario

2.2.2 Internal Gains

In line with CIBSE TM59, the internal gains applied to the thermal model are summarised in Table were applied to thermal model.

Unit / Room	Occupancy	Equipment Load
Studio	2 People at 70% gains from 11pm to 8am 2 people at 100% gains from 8 am to 11pm	Peak load of 450 W from 6pm to 8pm 200 W from 8pm to 10pm 110 W from 9am to 6pm and 10pm to 12pm Base load of 85W for the rest of the day.
1 Bedroom Apartment (living/kitchen).	1 person from 9 am to 10pm; room is unoccupied for the rest of the day	Peak load of 450 W from 6pm to 8pm 200 W from 8pm to 10pm 110 W from 9am to 6pm and 10pm to 12pm Base load of 85W for the rest of the day
2 Bedroom Apartment (living/kitchen).	2 people from 9 am to 10pm; room is unoccupied for the rest of the day	Peak load of 450 W from 6pm to 8pm 200 W from 8pm to 10pm 110 W from 9am to 6pm and 10pm to 12pm Base load of 85W for the rest of the day
3 Bedroom Apartment (living/kitchen).	3 people from 9 am to 10pm; room is unoccupied for the rest of the day	Peak load of 450 W from 6pm to 8pm 200 W from 8pm to 10pm 110 W from 9am to 6pm and 10pm to 12pm Base load of 85W for the rest of the day
Double bedroom	2 People at 70% gains from 11pm to 8am 2 people at 100% gains from 8 am to 9pm and from 10pm to 11pm 1 person full gains in the bedroom from 9am to 10pm	Peak load 80 W from 8 to 11pm Based load 10 W during the sleeping hours
Single bedroom (too small to accommodate double bed)	1 person at 70% gains from 11pm to 8am 1 person at full gains from 8am to 11pm	Peak load 80 W from 8 to 11pm Based load 10 W during the sleeping hours
Communal Corridors	Assumed to be zero	Pipework heat loss only when DHN is in the design
1 Bedroom Apartment (living/kitchen).	1 person from 9 am to 10pm; room is unoccupied for the rest of the day	Peak load of 450 W from 6pm to 8pm 200 W from 8pm to 10pm 110 W from 9am to 6pm and 10pm to 12pm Base load of 85W for the rest of the day

Table 2.2.2 - Internal Gain Summary

2.3 Model Input

2.3.1 Built Form

The 3D geometry and building construction materials for all buildings in Contract 1 have been modelled in the IES VE software based on the drawing file shown in the below table. The following figure shows the 3D representation of each building in Contract 1 as designed in the IES VE software and used to conduct the overheating analysis.

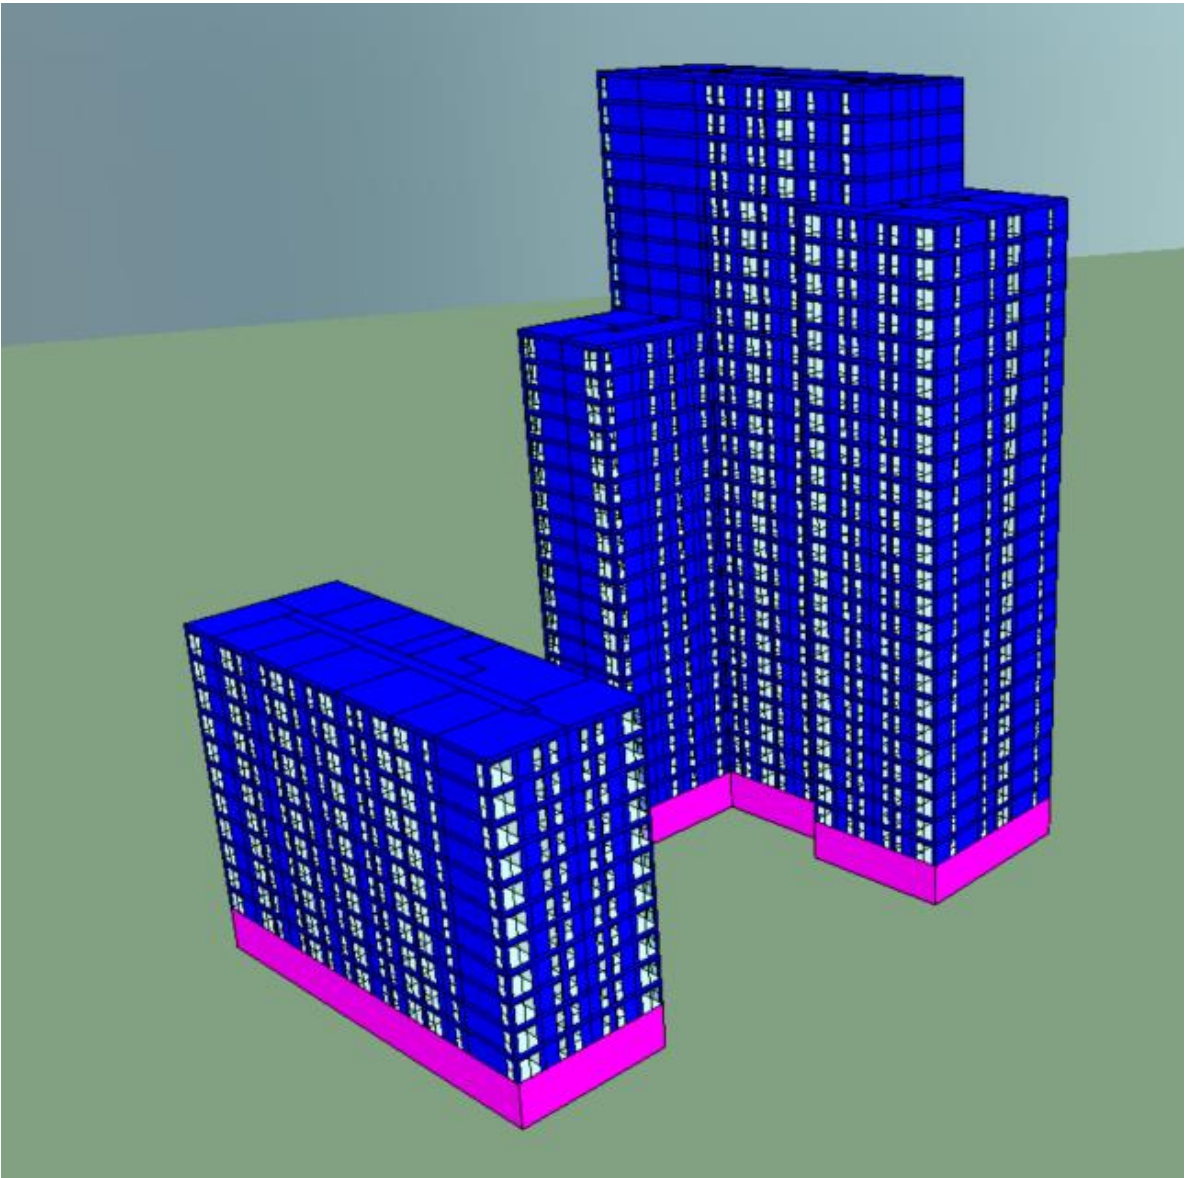


Figure 3.1.1 - Contract 1 3D Model Built Form

2.3.2 Ventilation Strategy Information

The following table details the mixed mode ventilation assumptions that have been applied to the development.

Ventilation Features	Descriptions (flow rates and operational profiles)
Infiltration	Set at 0.25 ACH (Ref: CIBSE GUIDE A)
Openable windows (free areas)	All bedroom windows to fully open a maximum of 350mm. Juliet Balcony Doors to open to an angle of 90°.
Openable window (operational)	When rooms are occupied (daytime): - Window starts to open when internal temp exceeds 22°C. - Windows to be fully open when the internal temperature exceeds 26°C. - Windows to start to close when internal temperatures fall below 26°C. - Windows to be fully closed when internal temperatures fall below 22°C. Night operation. - Internal temperature exceed 23°C at 11pm. During the day if the external temperature is greater than indoor temperature then the windows will be closed.
MVHR + Summer Bypass and Boost	70 l/s per apartment with summer bypass and boost capability to 1B2P units. 90 l/s per apartment with summer bypass and boost capability to 2B3P/2B4P/3B5P units.
MVHR + Summer Bypass and Boost	Summer bypass and boost to come on when internal temperatures reach 22°C.

Table 2.3.1 - Ventilation Strategy Description

2.3.3 External Building Fabric Information

The following fabric thermal performance has been applied to the thermal model.

Element	Target Value (RIBA Stage 4)
Ground / Exposed upper Floor U-value (W/m²K)	0.10 W/m²K
External Wall U-Value (W/m²K)	0.15 W/m²K
External Roof U-Value (W/m²K)	0.10 W/m²K
Party Walls / Walls to Corridors / Wall to Risers/Lift shafts and Stair Cores	0.20 W/m²K
External Window / Glazed Door	0.83 W/m²K (g-value 0.37 to all elevations)
Air Permeability	3.0 m³/(h.m²)@50Pa
Thermal Bridging Details	Approved Thermal Bridging Details. Calculations of repeating TB to be calculated at RIBA Stage 04.

Table 2.3.2 - Target fabric thermal performance

2.3.4 Glazing Types

The types of glazing and their properties that were used in the overheating analysis can be found in the below table and illustrated in the following figures.

Type	g-value	Visible Light Transmittance	Frame Factor
Window 1	0.37	71%	11.0%
Window 2	0.37	71%	15.3%
Window 3 (Juliet Balcony Door)	0.37	71%	12.2%

Table 2.3.3 - Glazing Construction Details



2.3.4 Window Opening Details

The details shown below in the following tables illustrate the fenestration types present in both Blocks A and B which allow for a mixed mode ventilation strategy.

The bedroom windows are restricted to 350 mm openings which results in the detailed opening angle. The windows are operated on a profile where once the internal temperature in the daytime exceeds 22°C and is fully open by 26°C.

The below tables present the different types of windows used in the proposed development, their description, opening angle (based on 350 mm opening restriction for the bedroom windows and a 90° opening for all Juliet balcony doors), and their associated image.

The below table presents the types of windows used in the modelling.

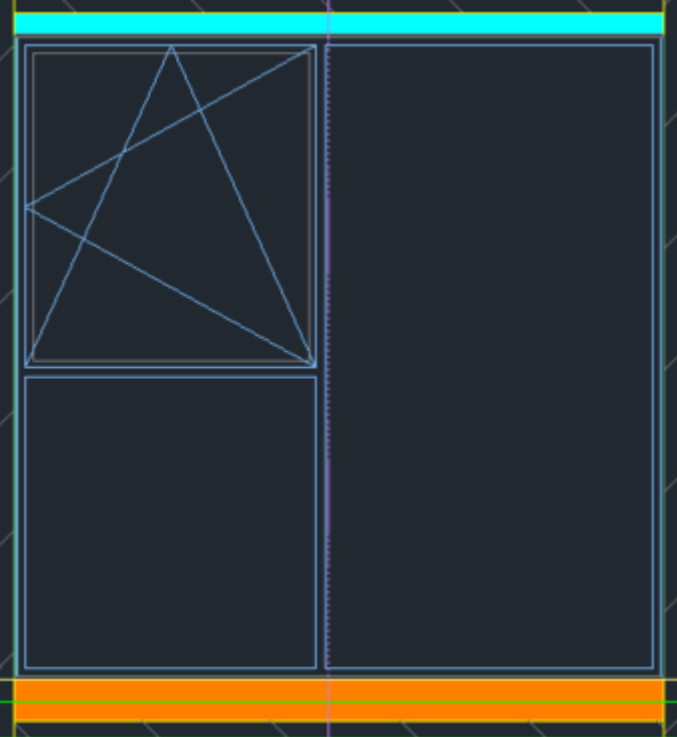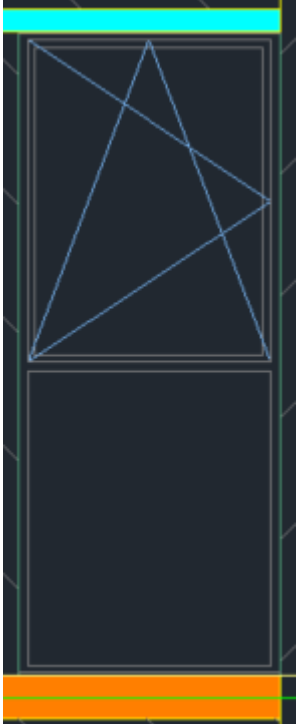Description	Opening Angle	Image
Window 1: Single window, side hung with tilt and turn operation.	20° (equates to a 350mm opening)	
Window 2: Single window, side hung with tilt and turn operation.	20° (equates to a 350mm opening)	

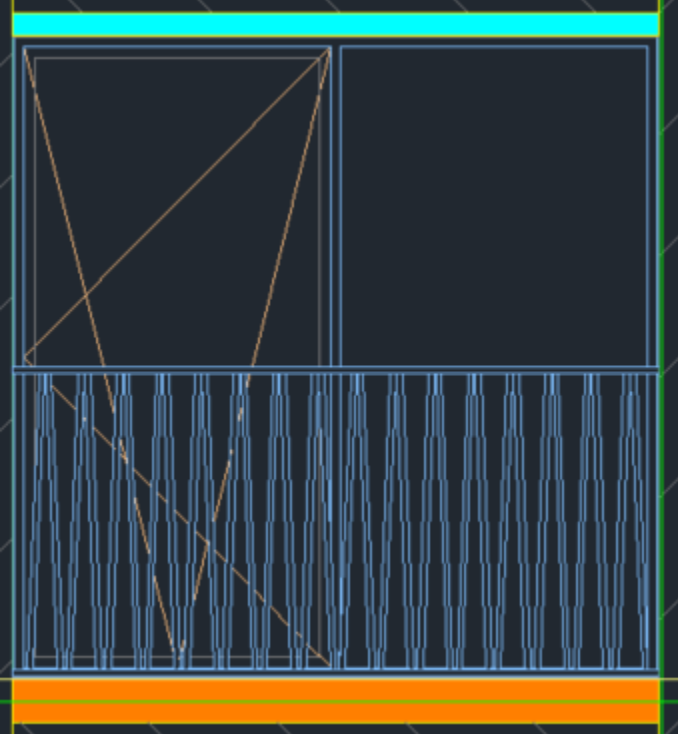
Juliet balcony doors, side hung and turn operation.	90°	
---	-----	---

Table 2.3.4 - Window fenestration types

3.0 Assessment Results

3.1 Overheating Analysis Results Summary

The table below presents a summary of the dynamic thermal modelling results for all apartments in Block A and Block B. These apartments were assessed against TM59 4.2 Criterion (a) and TM59 4.2 Criterion (b) (as described in section 2.2 above) using the DSY 1 weather file in accordance with TM59 and the DSY 2 & DSY 3 weather files as per Latimer’s sustainability standards.

The results show compliance with Criteria a and Criteria b of CIBSE TM59 for the DSY1 weather file.

Please see Appendix B for full results for all apartments.

The results shown in the below table demonstrate that all regularly occupied spaces in both Block A and B achieved TM59 compliance against DSY1 and there is no current risk of overheating.

Description: Window Opening Restrictions & Enhanced MVHR		Weather File: DSY1			
Total Rooms Assessed: 1404		Criteria a: Average percentage of hours Operative Temperature is above 26°C		Criteria b: Average number of hours Operative Temperature is above 26°C (22:00 - 07:00) (Bedrooms Only)	
KLR	501	0.41	Pass (100%)	N/A	N/A
Double Bedroom	634	0.08	Pass (100%)	4.46	Pass (100%)
Single Bedroom	269	0.11	Pass (100%)	3.73	Pass (100%)

Table 3.1.1 - Building 1 Overheating results summary for DSY1 Criteria a & Criteria b

In accordance with TM59 methodology, the above results have been ran in accordance with a current DSY 1 weather file which represents a moderately warm summer.

The TM59 methodology also recommends running further tests for DSY 2 (short, intense summer) and DSY 3 (long, less intense summer) although a pass for both of these scenarios is not mandatory and is purely for information. These results are detailed below.

Description: Window Opening Restrictions & Enhanced MVHR		Weather File: DSY2			
Total Rooms Assessed: 1404		Criteria a: Average percentage of hours Operative Temperature is above 26°C		Criteria b: Average number of hours Operative Temperature is above 26°C (22:00 - 07:00) (Bedrooms Only)	
KLR	501	0.68	Pass (100%)	N/A	N/A
Double Bedroom	634	0.19	Pass (100%)	6.82	Pass (100%)
Single Bedroom	269	0.31	Pass (100%)	6.80	Pass (100%)

Table 3.1.2 - Building 1 Overheating results summary for DSY1 Criteria a & Criteria b

Description: Window Opening Restrictions & Enhanced MVHR		Weather File: DSY3			
Total Rooms Assessed: 1404		Criteria a: Average percentage of hours Operative Temperature is above 26°C		Criteria b: Average number of hours Operative Temperature is above 26°C (22:00 - 07:00) (Bedrooms Only)	
KLR	501	1.45	Fail (26%)	N/A	N/A
Double Bedroom	634	0.41	Pass (100%)	18.19	Fail (12%)
Single Bedroom	269	0.51	Pass (100%)	16.62	Fail (9%)

Table 3.1.3 - Building 1 Overheating results summary for DSY1 Criteria a & Criteria b

3.2

Communal Corridors Overheating Summary

Although this development does not consist of any community heating pipework and is therefore, not required to run an overheating analysis for the communal corridors. An analysis has been run to highlight any potential risk of overheating. While a design cannot fail due to overheating corridors, it would be a cause for concern. A corridor is defined as overheating if it exceeds an operative temperature of 28°C for more than 3% of annual hours, or 262 hours.

For this analysis, a sample of corridors across multiple floors for sample blocks has been analysed under the DSY1 weather condition. Corridors were modelled to account for natural infiltration and gains accounting for lighting, heating, and losses from heating pipework.

Description: TM59 Criteria 4.5 Circulation Space Overheating		Weather File: DSY1	
Total Rooms Assessed:	141	Criteria 4.5: Average percentage of annual hours Operative Temperature is above 28°C (Threshold: 3%)	
Circulation Spaces	141	0.00	Pass (100%)

Table 3.2 Communal Corridor Overheating

4.0 Conclusions

This report presents the results of the dynamic thermal modelling assessment carried out for the proposed Boddington, Manchester development at RIBA Design Stage 4. The results presented confirm that the ventilation strategy (as described above) meets the requirements of CIBSE TM59 and therefore complies with Part O: Overheating of the UK Building Regulations. All details for compliance with Part O are summarised in appendix A and full TM59 results for each apartment is summarised in Appendix B below.

The proposed strategy of openable windows and proposed MVHR with summer bypass and boost capability shows a compliant solution for all apartments against Part O and TM59 requirements for the DSY1 weather file.

In accordance with Latimer's Sustainability Standards, Wallace Whittle have also modelled two additional scenarios to account for the DSY2 and DSY3 weather files. As shown in the previous section these results are showing multiple failures across the development. Wallace Whittle note that these failures are under Part O limitations regarding opening and mechanical operational parameters. Should these be operated more efficiently to combat higher temperatures by opening windows fully earlier, boosting the MVHR earlier and limiting the windows opening during higher external temperatures then the proposed ventilations strategy should be considered satisfactory at reducing the risk of overheating when it comes to these additional weather scenarios.

5.0 Appendix A - Design Details (Part O, UK Building Regulations)

2b.1 Modelling Details	
Dynamic software name and version	IES Ve 2023.2.2.0
Weather file location used, including any additional, more extreme weather files.	Manchester DSY1 2020 High 50 Manchester DSY2 2020 High 50 Manchester DSY3 2020 High 50
Number of sample units modelled, including an explanation of why the size/selection has been chosen.	All regular occupied spaces and communal corridors
2b.2 Modelled occupancy	
Has the project passed the assessment described in CIBSE's TM59, taking into account the limits detailed in paragraphs 2.5 and 2.6 (Part O 2021).	Yes
Details of occupancy profile used:	As per CIBSE TM59. See Table 2.2.2
Details of equipment profiles used:	As per CIBSE TM59. See Table 2.2.2
Details of the opening profiles used:	See section 2.3.4
2b.3 Modelled overheating mitigation strategy.	
Free areas	350mm opening restriction to bedrooms windows and 90° opening angle to Juliet balcony doors
Infiltration and mechanical ventilation flow rates.	0.25 ACH Infiltration 70l/s Max Flow rate for MVHR units in 1B2P units 90l/s Max Flow rate for MVHR units in 2B3P/2B4P/3B5P units
Window g-value	(g-value 0.37 to all elevations)
Shading strategy	Window reveals
Mechanical Cooling.	None
2b.4 Modelling Results	
Has the project passed the assessment described in CIBSE's TM59, taking into account the limits detailed in paragraphs 2.5 and 2.6 (Part O 2021).	Yes
What is the overall overheating strategy (i.e. what design features are key to the project passing?)	For all apartments in Blocks A and B, a mixed mode ventilation strategy using the MVHR summer bypass and boost mode complimented by openable windows.
2b.5 Designer's declaration	
Has the building construction proposal been modelled accurately?	Yes, the model has been created following RIBA Stage 4 information.
Designer's name	Felipe Tibabuzo Castro CEng (Associate)
Designer's organisation	Wallace Whittle
Designer's signature	<i>Felipe Tibabuzo Castro</i>
Registration number	Felipe Tibabuzo Castro LCEA: 124817 MCIBSE CEng: 034430

6.0 Appendix B - TM59 Full Results

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-10-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-10-1 1B2P KLR	0.90	Pass	N/A	-
A1-10-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-10-10 2B3P KLR	1.60	Pass	N/A	-
A1-10-10 2B3P Single Bedroom	0.60	Pass	14	Pass
A1-10-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-10-11 1B2P KLR	1.20	Pass	N/A	-
A1-10-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-10-12 1B2P KLR	1.20	Pass	N/A	-
A1-10-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-10-2 2B3P KLR	0.00	Pass	N/A	-
A1-10-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-10-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-10-3 1B2P KLR	0.00	Pass	N/A	-
A1-10-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-10-4 1B2P KLR	0.00	Pass	N/A	-
A1-10-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-10-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-10-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-10-5 2B4P KLR	0.00	Pass	N/A	-
A1-10-6 2B3P Bedroom	0.00	Pass	9	Pass
A1-10-6 2B3P KLR	0.00	Pass	N/A	-
A1-10-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-10-7 2B3P Bedroom	0.00	Pass	11	Pass
A1-10-7 2B3P KLR	0.40	Pass	N/A	-
A1-10-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-10-8 1B2P Bedroom	0.40	Pass	11	Pass
A1-10-8 1B2P KLR	1.60	Pass	N/A	-
A1-10-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-10-9 2B3P KLR	1.70	Pass	N/A	-
A1-10-9 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-1-1 1B2P Bedroom	0.00	Pass	6	Pass
A1-1-1 1B2P KLR	1.00	Pass	N/A	-
A1-1-10 2B3P Bedroom	0.50	Pass	22	Pass
A1-1-10 2B3P KLR	1.70	Pass	N/A	-
A1-1-10 2B3P Single Bedroom	0.70	Pass	18	Pass
A1-11-1 1B2P Bedroom	0.00	Pass	5	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-1-11 1B2P Bedroom	0.40	Pass	19	Pass
A1-11-1 1B2P KLR	0.80	Pass	N/A	-
A1-1-11 1B2P KLR	1.60	Pass	N/A	-
A1-11-10 2B3P Bedroom	0.40	Pass	18	Pass
A1-11-10 2B3P KLR	1.60	Pass	N/A	-
A1-11-10 2B3P Single Bedroom	0.60	Pass	12	Pass
A1-11-11 1B2P Bedroom	0.30	Pass	15	Pass
A1-11-11 1B2P KLR	1.10	Pass	N/A	-
A1-11-12 1B2P Bedroom	0.30	Pass	14	Pass
A1-11-12 1B2P KLR	1.00	Pass	N/A	-
A1-1-12 1B2P Bedroom	0.50	Pass	18	Pass
A1-1-12 1B2P KLR	1.60	Pass	N/A	-
A1-11-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-11-2 2B3P KLR	0.00	Pass	N/A	-
A1-11-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-11-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-11-3 1B2P KLR	0.00	Pass	N/A	-
A1-11-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-11-4 1B2P KLR	0.00	Pass	N/A	-
A1-11-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-11-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-11-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-11-5 2B4P KLR	0.00	Pass	N/A	-
A1-11-6 2B3P Bedroom	0.00	Pass	9	Pass
A1-11-6 2B3P KLR	0.00	Pass	N/A	-
A1-11-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-11-7 2B3P Bedroom	0.00	Pass	11	Pass
A1-11-7 2B3P KLR	0.40	Pass	N/A	-
A1-11-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-11-8 1B2P Bedroom	0.40	Pass	9	Pass
A1-11-8 1B2P KLR	1.60	Pass	N/A	-
A1-11-9 2B3P Bedroom	0.40	Pass	18	Pass
A1-11-9 2B3P KLR	1.60	Pass	N/A	-
A1-11-9 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-1-2 2B3P Bedroom	0.00	Pass	3	Pass
A1-1-2 2B3P KLR	0.00	Pass	N/A	-
A1-1-2 2B3P Single Bedroom	0.00	Pass	6	Pass
A1-1-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-1-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-1-4 1B2P Bedroom	0.00	Pass	1	Pass
A1-1-4 1B2P KLR	0.00	Pass	N/A	-
A1-1-5 2B4P Bedroom	0.00	Pass	7	Pass
A1-1-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-1-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-1-5 2B4P KLR	0.00	Pass	N/A	-
A1-1-6 2B3P Bedroom	0.00	Pass	17	Pass
A1-1-6 2B3P KLR	0.10	Pass	N/A	-
A1-1-6 2B3P Single Bedroom	0.00	Pass	6	Pass
A1-1-7 2B3P Bedroom	0.00	Pass	18	Pass
A1-1-7 2B3P KLR	0.60	Pass	N/A	-
A1-1-7 2B3P Single Bedroom	0.00	Pass	7	Pass
A1-1-8 1B2P Bedroom	0.50	Pass	18	Pass
A1-1-8 1B2P KLR	2.10	Pass	N/A	-
A1-1-9 2B3P Bedroom	0.60	Pass	25	Pass
A1-1-9 2B3P KLR	2.40	Pass	N/A	-
A1-1-9 2B3P Single Bedroom	0.70	Pass	18	Pass
A1-2-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-2-1 1B2P KLR	1.00	Pass	N/A	-
A1-2-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-2-10 2B3P KLR	1.60	Pass	N/A	-
A1-2-10 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-2-11 1B2P Bedroom	0.40	Pass	16	Pass
A1-2-11 1B2P KLR	1.40	Pass	N/A	-
A1-2-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-2-12 1B2P KLR	1.30	Pass	N/A	-
A1-2-2 2B3P Bedroom	0.00	Pass	2	Pass
A1-2-2 2B3P KLR	0.00	Pass	N/A	-
A1-2-2 2B3P Single Bedroom	0.00	Pass	4	Pass
A1-2-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-2-3 1B2P KLR	0.00	Pass	N/A	-
A1-2-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-2-4 1B2P KLR	0.00	Pass	N/A	-
A1-2-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-2-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-2-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-2-5 2B4P KLR	0.00	Pass	N/A	-
A1-2-6 2B3P Bedroom	0.00	Pass	12	Pass
A1-2-6 2B3P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-2-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-2-7 2B3P Bedroom	0.00	Pass	14	Pass
A1-2-7 2B3P KLR	0.50	Pass	N/A	-
A1-2-7 2B3P Single Bedroom	0.00	Pass	6	Pass
A1-2-8 1B2P Bedroom	0.40	Pass	14	Pass
A1-2-8 1B2P KLR	1.70	Pass	N/A	-
A1-2-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-2-9 2B3P KLR	2.00	Pass	N/A	-
A1-2-9 2B3P Single Bedroom	0.70	Pass	17	Pass
A1-3-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-3-1 1B2P KLR	1.00	Pass	N/A	-
A1-3-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-3-10 2B3P KLR	1.60	Pass	N/A	-
A1-3-10 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-3-11 1B2P Bedroom	0.40	Pass	16	Pass
A1-3-11 1B2P KLR	1.40	Pass	N/A	-
A1-3-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-3-12 1B2P KLR	1.20	Pass	N/A	-
A1-3-2 2B3P Bedroom	0.00	Pass	2	Pass
A1-3-2 2B3P KLR	0.00	Pass	N/A	-
A1-3-2 2B3P Single Bedroom	0.00	Pass	4	Pass
A1-3-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-3-3 1B2P KLR	0.00	Pass	N/A	-
A1-3-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-3-4 1B2P KLR	0.00	Pass	N/A	-
A1-3-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-3-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-3-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-3-5 2B4P KLR	0.00	Pass	N/A	-
A1-3-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-3-6 2B3P KLR	0.00	Pass	N/A	-
A1-3-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-3-7 2B3P Bedroom	0.00	Pass	14	Pass
A1-3-7 2B3P KLR	0.40	Pass	N/A	-
A1-3-7 2B3P Single Bedroom	0.00	Pass	6	Pass
A1-3-8 1B2P Bedroom	0.40	Pass	13	Pass
A1-3-8 1B2P KLR	1.70	Pass	N/A	-
A1-3-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-3-9 2B3P KLR	2.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-3-9 2B3P Single Bedroom	0.70	Pass	16	Pass
A1-4-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-4-1 1B2P KLR	1.00	Pass	N/A	-
A1-4-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-4-10 2B3P KLR	1.60	Pass	N/A	-
A1-4-10 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-4-11 1B2P Bedroom	0.40	Pass	16	Pass
A1-4-11 1B2P KLR	1.40	Pass	N/A	-
A1-4-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-4-12 1B2P KLR	1.20	Pass	N/A	-
A1-4-2 2B3P Bedroom	0.00	Pass	2	Pass
A1-4-2 2B3P KLR	0.00	Pass	N/A	-
A1-4-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-4-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-4-3 1B2P KLR	0.00	Pass	N/A	-
A1-4-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-4-4 1B2P KLR	0.00	Pass	N/A	-
A1-4-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-4-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-4-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-4-5 2B4P KLR	0.00	Pass	N/A	-
A1-4-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-4-6 2B3P KLR	0.00	Pass	N/A	-
A1-4-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-4-7 2B3P Bedroom	0.00	Pass	12	Pass
A1-4-7 2B3P KLR	0.40	Pass	N/A	-
A1-4-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-4-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-4-8 1B2P KLR	1.70	Pass	N/A	-
A1-4-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-4-9 2B3P KLR	1.80	Pass	N/A	-
A1-4-9 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-5-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-5-1 1B2P KLR	0.90	Pass	N/A	-
A1-5-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-5-10 2B3P KLR	1.60	Pass	N/A	-
A1-5-10 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-5-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-5-11 1B2P KLR	1.30	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-5-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-5-12 1B2P KLR	1.20	Pass	N/A	-
A1-5-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-5-2 2B3P KLR	0.00	Pass	N/A	-
A1-5-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-5-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-5-3 1B2P KLR	0.00	Pass	N/A	-
A1-5-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-5-4 1B2P KLR	0.00	Pass	N/A	-
A1-5-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-5-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-5-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-5-5 2B4P KLR	0.00	Pass	N/A	-
A1-5-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-5-6 2B3P KLR	0.00	Pass	N/A	-
A1-5-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-5-7 2B3P Bedroom	0.00	Pass	12	Pass
A1-5-7 2B3P KLR	0.40	Pass	N/A	-
A1-5-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-5-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-5-8 1B2P KLR	1.60	Pass	N/A	-
A1-5-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-5-9 2B3P KLR	1.80	Pass	N/A	-
A1-5-9 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-6-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-6-1 1B2P KLR	0.90	Pass	N/A	-
A1-6-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-6-10 2B3P KLR	1.60	Pass	N/A	-
A1-6-10 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-6-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-6-11 1B2P KLR	1.20	Pass	N/A	-
A1-6-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-6-12 1B2P KLR	1.20	Pass	N/A	-
A1-6-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-6-2 2B3P KLR	0.00	Pass	N/A	-
A1-6-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-6-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-6-3 1B2P KLR	0.00	Pass	N/A	-
A1-6-4 1B2P Bedroom	0.00	Pass	0	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-6-4 1B2P KLR	0.00	Pass	N/A	-
A1-6-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-6-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-6-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-6-5 2B4P KLR	0.00	Pass	N/A	-
A1-6-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-6-6 2B3P KLR	0.00	Pass	N/A	-
A1-6-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-6-7 2B3P Bedroom	0.00	Pass	12	Pass
A1-6-7 2B3P KLR	0.40	Pass	N/A	-
A1-6-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-6-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-6-8 1B2P KLR	1.60	Pass	N/A	-
A1-6-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-6-9 2B3P KLR	1.70	Pass	N/A	-
A1-6-9 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-7-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-7-1 1B2P KLR	0.90	Pass	N/A	-
A1-7-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-7-10 2B3P KLR	1.60	Pass	N/A	-
A1-7-10 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-7-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-7-11 1B2P KLR	1.20	Pass	N/A	-
A1-7-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-7-12 1B2P KLR	1.20	Pass	N/A	-
A1-7-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-7-2 2B3P KLR	0.00	Pass	N/A	-
A1-7-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-7-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-7-3 1B2P KLR	0.00	Pass	N/A	-
A1-7-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-7-4 1B2P KLR	0.00	Pass	N/A	-
A1-7-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-7-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-7-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-7-5 2B4P KLR	0.00	Pass	N/A	-
A1-7-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-7-6 2B3P KLR	0.00	Pass	N/A	-
A1-7-6 2B3P Single Bedroom	0.00	Pass	5	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-7-7 2B3P Bedroom	0.00	Pass	11	Pass
A1-7-7 2B3P KLR	0.40	Pass	N/A	-
A1-7-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-7-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-7-8 1B2P KLR	1.60	Pass	N/A	-
A1-7-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-7-9 2B3P KLR	1.70	Pass	N/A	-
A1-7-9 2B3P Single Bedroom	0.60	Pass	16	Pass
A1-8-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-8-1 1B2P KLR	0.90	Pass	N/A	-
A1-8-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-8-10 2B3P KLR	1.60	Pass	N/A	-
A1-8-10 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-8-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-8-11 1B2P KLR	1.20	Pass	N/A	-
A1-8-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-8-12 1B2P KLR	1.20	Pass	N/A	-
A1-8-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-8-2 2B3P KLR	0.00	Pass	N/A	-
A1-8-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-8-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-8-3 1B2P KLR	0.00	Pass	N/A	-
A1-8-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-8-4 1B2P KLR	0.00	Pass	N/A	-
A1-8-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-8-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-8-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-8-5 2B4P KLR	0.00	Pass	N/A	-
A1-8-6 2B3P Bedroom	0.00	Pass	11	Pass
A1-8-6 2B3P KLR	0.00	Pass	N/A	-
A1-8-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-8-7 2B3P Bedroom	0.00	Pass	11	Pass
A1-8-7 2B3P KLR	0.40	Pass	N/A	-
A1-8-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-8-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-8-8 1B2P KLR	1.60	Pass	N/A	-
A1-8-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-8-9 2B3P KLR	1.70	Pass	N/A	-
A1-8-9 2B3P Single Bedroom	0.60	Pass	16	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-9-1 1B2P Bedroom	0.00	Pass	5	Pass
A1-9-1 1B2P KLR	0.90	Pass	N/A	-
A1-9-10 2B3P Bedroom	0.40	Pass	19	Pass
A1-9-10 2B3P KLR	1.60	Pass	N/A	-
A1-9-10 2B3P Single Bedroom	0.60	Pass	15	Pass
A1-9-11 1B2P Bedroom	0.30	Pass	16	Pass
A1-9-11 1B2P KLR	1.20	Pass	N/A	-
A1-9-12 1B2P Bedroom	0.40	Pass	16	Pass
A1-9-12 1B2P KLR	1.20	Pass	N/A	-
A1-9-2 2B3P Bedroom	0.00	Pass	1	Pass
A1-9-2 2B3P KLR	0.00	Pass	N/A	-
A1-9-2 2B3P Single Bedroom	0.00	Pass	3	Pass
A1-9-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-9-3 1B2P KLR	0.00	Pass	N/A	-
A1-9-4 1B2P Bedroom	0.00	Pass	0	Pass
A1-9-4 1B2P KLR	0.00	Pass	N/A	-
A1-9-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-9-5 2B4P Bedroom 1	0.00	Pass	1	Pass
A1-9-5 2B4P Bedroom 2	0.00	Pass	0	Pass
A1-9-5 2B4P KLR	0.00	Pass	N/A	-
A1-9-6 2B3P Bedroom	0.00	Pass	9	Pass
A1-9-6 2B3P KLR	0.00	Pass	N/A	-
A1-9-6 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-9-7 2B3P Bedroom	0.00	Pass	11	Pass
A1-9-7 2B3P KLR	0.40	Pass	N/A	-
A1-9-7 2B3P Single Bedroom	0.00	Pass	5	Pass
A1-9-8 1B2P Bedroom	0.40	Pass	12	Pass
A1-9-8 1B2P KLR	1.60	Pass	N/A	-
A1-9-9 2B3P Bedroom	0.40	Pass	19	Pass
A1-9-9 2B3P KLR	1.70	Pass	N/A	-
A1-9-9 2B3P Single Bedroom	0.60	Pass	15	Pass
B1-10-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-10-1 2B3P KLR	0.10	Pass	N/A	-
B1-10-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-10-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-10-2 2B3P KLR	0.00	Pass	N/A	-
B1-10-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-10-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-10-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-10-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-10-4 2B3P KLR	0.00	Pass	N/A	-
B1-10-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-10-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-10-5 2B3P KLR	0.50	Pass	N/A	-
B1-10-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-10-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-10-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-10-6 3B5P KLR	0.70	Pass	N/A	-
B1-10-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-10-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-10-7 2B3P KLR	1.10	Pass	N/A	-
B1-10-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-10-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-10-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-1-1 2B3P KLR	0.10	Pass	N/A	-
B1-1-1 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-11-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-11-1 2B3P KLR	0.10	Pass	N/A	-
B1-11-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-11-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-11-2 2B3P KLR	0.00	Pass	N/A	-
B1-11-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-11-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-11-3 1B2P KLR	0.00	Pass	N/A	-
B1-11-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-11-4 2B3P KLR	0.00	Pass	N/A	-
B1-11-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-11-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-11-5 2B3P KLR	0.50	Pass	N/A	-
B1-11-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-11-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-11-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-11-6 3B5P KLR	0.70	Pass	N/A	-
B1-11-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-11-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-11-7 2B3P KLR	1.10	Pass	N/A	-
B1-11-7 2B3P Single Bedroom	0.10	Pass	3	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-11-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-11-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-1-2 2B3P KLR	0.00	Pass	N/A	-
B1-1-2 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-12-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-12-1 2B3P KLR	0.10	Pass	N/A	-
B1-12-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-12-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-12-2 2B3P KLR	0.00	Pass	N/A	-
B1-12-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-12-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-12-3 1B2P KLR	0.00	Pass	N/A	-
B1-12-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-12-4 2B3P KLR	0.00	Pass	N/A	-
B1-12-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-12-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-12-5 2B3P KLR	0.50	Pass	N/A	-
B1-12-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-12-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-12-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-12-6 3B5P KLR	0.70	Pass	N/A	-
B1-12-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-12-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-12-7 2B3P KLR	1.10	Pass	N/A	-
B1-12-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-12-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-12-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-3 1B2P Bedroom	0.00	Pass	4	Pass
B1-1-3 1B2P KLR	0.00	Pass	N/A	-
B1-13-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-13-1 2B3P KLR	0.10	Pass	N/A	-
B1-13-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-13-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-13-2 2B3P KLR	0.00	Pass	N/A	-
B1-13-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-13-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-13-3 1B2P KLR	0.00	Pass	N/A	-
B1-13-4 2B3P Bedroom 1	0.00	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-13-4 2B3P KLR	0.00	Pass	N/A	-
B1-13-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-13-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-13-5 2B3P KLR	0.50	Pass	N/A	-
B1-13-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-13-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-13-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-13-6 3B5P KLR	0.70	Pass	N/A	-
B1-13-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-13-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-13-7 2B3P KLR	1.10	Pass	N/A	-
B1-13-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-13-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-13-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-1-4 2B3P KLR	0.00	Pass	N/A	-
B1-1-4 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-14-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-14-1 2B3P KLR	0.00	Pass	N/A	-
B1-14-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-14-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-14-2 2B3P KLR	0.00	Pass	N/A	-
B1-14-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-14-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-14-3 1B2P KLR	0.00	Pass	N/A	-
B1-14-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-14-4 2B3P KLR	0.00	Pass	N/A	-
B1-14-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-14-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-14-5 2B3P KLR	0.50	Pass	N/A	-
B1-14-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-14-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-14-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-14-6 3B5P KLR	0.70	Pass	N/A	-
B1-14-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-14-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-14-7 2B3P KLR	1.10	Pass	N/A	-
B1-14-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-14-8 1B2P Bedroom	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-14-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-1-5 2B3P KLR	0.00	Pass	N/A	-
B1-1-5 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-15-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-15-1 2B3P KLR	0.00	Pass	N/A	-
B1-15-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-15-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-15-2 2B3P KLR	0.00	Pass	N/A	-
B1-15-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-15-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-15-3 1B2P KLR	0.00	Pass	N/A	-
B1-15-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-15-4 2B3P KLR	0.00	Pass	N/A	-
B1-15-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-15-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-15-5 2B3P KLR	0.50	Pass	N/A	-
B1-15-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-15-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-15-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-15-6 3B5P KLR	0.70	Pass	N/A	-
B1-15-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-15-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-15-7 2B3P KLR	1.10	Pass	N/A	-
B1-15-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-15-8 1B2P Bedroom	0.00	Pass	1	Pass
B1-15-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-6 3B5P Bedroom 1	0.00	Pass	1	Pass
B1-1-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-1-6 3B5P KLR	0.00	Pass	N/A	-
B1-1-6 3B5P Single Bedroom 3	0.00	Pass	4	Pass
B1-16-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-16-1 2B3P KLR	0.00	Pass	N/A	-
B1-16-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-16-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-16-2 2B3P KLR	0.00	Pass	N/A	-
B1-16-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-16-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-16-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-16-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-16-4 2B3P KLR	0.00	Pass	N/A	-
B1-16-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-16-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-16-5 2B3P KLR	0.50	Pass	N/A	-
B1-16-5 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-16-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-16-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-16-6 3B5P KLR	0.70	Pass	N/A	-
B1-16-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-16-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-16-7 2B3P KLR	1.10	Pass	N/A	-
B1-16-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-16-8 1B2P Bedroom	0.00	Pass	1	Pass
B1-16-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-1-7 2B3P KLR	0.60	Pass	N/A	-
B1-1-7 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-17-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-17-1 2B3P KLR	0.00	Pass	N/A	-
B1-17-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-17-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-17-2 2B3P KLR	0.00	Pass	N/A	-
B1-17-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-17-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-17-3 1B2P KLR	0.00	Pass	N/A	-
B1-17-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-17-4 2B3P KLR	0.00	Pass	N/A	-
B1-17-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-17-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-17-5 2B3P KLR	0.60	Pass	N/A	-
B1-17-5 2B3P Single Bedroom	0.20	Pass	3	Pass
B1-17-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-17-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-17-6 3B5P KLR	0.70	Pass	N/A	-
B1-17-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-17-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-17-7 2B3P KLR	1.10	Pass	N/A	-
B1-17-7 2B3P Single Bedroom	0.10	Pass	3	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-17-8 1B2P Bedroom	0.00	Pass	1	Pass
B1-17-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-8 1B2P Bedroom	0.00	Pass	4	Pass
B1-1-8 1B2P KLR	0.00	Pass	N/A	-
B1-18-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-18-1 2B3P KLR	0.10	Pass	N/A	-
B1-18-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-18-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-18-2 2B3P KLR	0.00	Pass	N/A	-
B1-18-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-18-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-18-3 1B2P KLR	0.00	Pass	N/A	-
B1-18-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-18-4 2B3P KLR	0.00	Pass	N/A	-
B1-18-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-18-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-18-5 2B3P KLR	0.80	Pass	N/A	-
B1-18-5 2B3P Single Bedroom	0.20	Pass	3	Pass
B1-18-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-18-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-18-6 3B5P KLR	0.70	Pass	N/A	-
B1-18-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-18-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-18-7 2B3P KLR	1.10	Pass	N/A	-
B1-18-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-18-8 1B2P Bedroom	0.00	Pass	1	Pass
B1-18-8 1B2P KLR	0.00	Pass	N/A	-
B1-19-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-19-1 2B3P KLR	0.10	Pass	N/A	-
B1-19-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-19-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-19-2 2B3P KLR	0.00	Pass	N/A	-
B1-19-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-19-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-19-3 1B2P KLR	0.00	Pass	N/A	-
B1-19-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-19-4 2B3P KLR	0.00	Pass	N/A	-
B1-19-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-19-5 2B3P Bedroom 1	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-19-5 2B3P KLR	1.20	Pass	N/A	-
B1-19-5 2B3P Single Bedroom	0.40	Pass	3	Pass
B1-19-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-19-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-19-6 3B5P KLR	0.70	Pass	N/A	-
B1-19-6 3B5P Single Bedroom 3	0.00	Pass	2	Pass
B1-19-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-19-7 2B3P KLR	1.00	Pass	N/A	-
B1-19-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-19-8 1B2P Bedroom	0.00	Pass	1	Pass
B1-19-8 1B2P KLR	0.00	Pass	N/A	-
B1-20-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B1-20-1 2B3P KLR	0.10	Pass	N/A	-
B1-20-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-20-2 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-20-2 2B3P KLR	0.00	Pass	N/A	-
B1-20-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-20-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-20-3 1B2P KLR	0.00	Pass	N/A	-
B1-20-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-20-4 2B3P KLR	0.00	Pass	N/A	-
B1-20-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-20-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-20-5 2B3P KLR	1.30	Pass	N/A	-
B1-20-5 2B3P Single Bedroom	0.50	Pass	4	Pass
B1-2-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-2-1 2B3P KLR	0.10	Pass	N/A	-
B1-2-1 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-21-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-21-1 2B3P KLR	0.10	Pass	N/A	-
B1-21-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-21-2 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-21-2 2B3P KLR	0.00	Pass	N/A	-
B1-21-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-21-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-21-3 1B2P KLR	0.00	Pass	N/A	-
B1-21-4 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-21-4 2B3P KLR	0.00	Pass	N/A	-
B1-21-4 2B3P Single Bedroom	0.00	Pass	2	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-21-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-21-5 2B3P KLR	1.30	Pass	N/A	-
B1-21-5 2B3P Single Bedroom	0.50	Pass	4	Pass
B1-2-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-2-2 2B3P KLR	0.00	Pass	N/A	-
B1-2-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-22-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-22-1 2B3P KLR	0.10	Pass	N/A	-
B1-22-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-22-2 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-22-2 2B3P KLR	0.00	Pass	N/A	-
B1-22-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-22-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-22-3 1B2P KLR	0.00	Pass	N/A	-
B1-22-4 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-22-4 2B3P KLR	0.00	Pass	N/A	-
B1-22-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-22-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-22-5 2B3P KLR	1.30	Pass	N/A	-
B1-22-5 2B3P Single Bedroom	0.50	Pass	4	Pass
B1-2-3 1B2P Bedroom	0.00	Pass	4	Pass
B1-2-3 1B2P KLR	0.00	Pass	N/A	-
B1-23-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-23-1 2B3P KLR	0.10	Pass	N/A	-
B1-23-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-23-2 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-23-2 2B3P KLR	0.00	Pass	N/A	-
B1-23-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-23-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-23-3 1B2P KLR	0.00	Pass	N/A	-
B1-23-4 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-23-4 2B3P KLR	0.00	Pass	N/A	-
B1-23-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-23-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-23-5 2B3P KLR	1.30	Pass	N/A	-
B1-23-5 2B3P Single Bedroom	0.50	Pass	4	Pass
B1-2-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-2-4 2B3P KLR	0.00	Pass	N/A	-
B1-2-4 2B3P Single Bedroom	0.00	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-24-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-24-1 2B3P KLR	0.10	Pass	N/A	-
B1-24-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-24-2 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-24-2 2B3P KLR	0.00	Pass	N/A	-
B1-24-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-24-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-24-3 1B2P KLR	0.00	Pass	N/A	-
B1-24-4 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-24-4 2B3P KLR	0.00	Pass	N/A	-
B1-24-4 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-24-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-24-5 2B3P KLR	1.20	Pass	N/A	-
B1-24-5 2B3P Single Bedroom	0.50	Pass	3	Pass
B1-2-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-2-5 2B3P KLR	0.00	Pass	N/A	-
B1-2-5 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-25-1 2B3P Bedroom	0.00	Pass	1	Pass
B1-25-1 2B3P KLR	0.10	Pass	N/A	-
B1-25-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-25-2 2B3P Bedroom	0.00	Pass	3	Pass
B1-25-2 2B3P KLR	0.00	Pass	N/A	-
B1-25-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-25-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-25-3 1B2P KLR	0.00	Pass	N/A	-
B1-25-4 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-25-4 2B4P Bedroom 2	0.00	Pass	2	Pass
B1-25-4 2B4P KLR	0.00	Pass	N/A	-
B1-25-5 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-25-5 2B4P Bedroom 2	0.00	Pass	0	Pass
B1-25-5 2B4P KLR	0.00	Pass	N/A	-
B1-25-6 2B4P Bedroom 1	0.10	Pass	4	Pass
B1-25-6 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-25-6 2B4P KLR	0.60	Pass	N/A	-
B1-25-7 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-25-7 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-2-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-2-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-2-6 3B5P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-2-6 3B5P Single Bedroom 3	0.00	Pass	4	Pass
B1-26-1 2B3P Bedroom	0.00	Pass	1	Pass
B1-26-1 2B3P KLR	0.10	Pass	N/A	-
B1-26-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-26-2 2B3P Bedroom	0.00	Pass	3	Pass
B1-26-2 2B3P KLR	0.00	Pass	N/A	-
B1-26-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-26-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-26-3 1B2P KLR	0.00	Pass	N/A	-
B1-26-4 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-26-4 2B4P Bedroom 2	0.00	Pass	2	Pass
B1-26-4 2B4P KLR	0.00	Pass	N/A	-
B1-26-5 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-26-5 2B4P Bedroom 2	0.00	Pass	0	Pass
B1-26-5 2B4P KLR	0.00	Pass	N/A	-
B1-26-6 2B4P Bedroom 1	0.10	Pass	4	Pass
B1-26-6 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-26-6 2B4P KLR	0.60	Pass	N/A	-
B1-26-7 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-26-7 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-2-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-2-7 2B3P KLR	0.60	Pass	N/A	-
B1-2-7 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-27-1 2B3P Bedroom	0.00	Pass	1	Pass
B1-27-1 2B3P Bedroom	0.00	Pass	1	Pass
B1-27-1 2B3P KLR	0.10	Pass	N/A	-
B1-27-1 2B3P KLR	0.10	Pass	N/A	-
B1-27-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-27-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-27-2 2B3P Bedroom	0.00	Pass	3	Pass
B1-27-2 2B3P Bedroom	0.00	Pass	2	Pass
B1-27-2 2B3P KLR	0.00	Pass	N/A	-
B1-27-2 2B3P KLR	0.00	Pass	N/A	-
B1-27-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-27-2 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	1	Pass
B1-27-3 1B2P KLR	0.00	Pass	N/A	-
B1-27-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-27-4 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-4 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	2	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	2	Pass
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-5 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	0	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	0	Pass
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-6 2B4P Bedroom 1	0.10	Pass	4	Pass
B1-27-6 2B4P Bedroom 1	0.10	Pass	4	Pass
B1-27-6 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-27-6 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-27-6 2B4P KLR	0.50	Pass	N/A	-
B1-27-6 2B4P KLR	0.50	Pass	N/A	-
B1-27-7 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-7 2B4P Bedroom 1	0.00	Pass	1	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	1	Pass
B1-2-8 1B2P Bedroom	0.00	Pass	3	Pass
B1-2-8 1B2P KLR	0.00	Pass	N/A	-
B1-3-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-3-1 2B3P KLR	0.10	Pass	N/A	-
B1-3-1 2B3P Single Bedroom	0.00	Pass	2	Pass
B1-3-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-3-2 2B3P KLR	0.00	Pass	N/A	-
B1-3-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-3-3 1B2P Bedroom	0.00	Pass	4	Pass
B1-3-3 1B2P KLR	0.00	Pass	N/A	-
B1-3-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-3-4 2B3P KLR	0.00	Pass	N/A	-
B1-3-4 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-3-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-3-5 2B3P KLR	0.00	Pass	N/A	-
B1-3-5 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-3-6 3B5P Bedroom 1	0.00	Pass	0	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-3-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-3-6 3B5P KLR	0.00	Pass	N/A	-
B1-3-6 3B5P Single Bedroom 3	0.00	Pass	4	Pass
B1-3-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-3-7 2B3P KLR	0.60	Pass	N/A	-
B1-3-7 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-3-8 1B2P Bedroom	0.00	Pass	3	Pass
B1-3-8 1B2P KLR	0.00	Pass	N/A	-
B1-4-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-4-1 2B3P KLR	0.10	Pass	N/A	-
B1-4-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-4-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-4-2 2B3P KLR	0.00	Pass	N/A	-
B1-4-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-4-3 1B2P Bedroom	0.00	Pass	4	Pass
B1-4-3 1B2P KLR	0.00	Pass	N/A	-
B1-4-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-4-4 2B3P KLR	0.00	Pass	N/A	-
B1-4-4 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-4-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-4-5 2B3P KLR	0.00	Pass	N/A	-
B1-4-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-4-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-4-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-4-6 3B5P KLR	0.00	Pass	N/A	-
B1-4-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-4-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-4-7 2B3P KLR	0.60	Pass	N/A	-
B1-4-7 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-4-8 1B2P Bedroom	0.00	Pass	3	Pass
B1-4-8 1B2P KLR	0.00	Pass	N/A	-
B1-5-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-5-1 2B3P KLR	0.10	Pass	N/A	-
B1-5-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-5-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-5-2 2B3P KLR	0.00	Pass	N/A	-
B1-5-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-5-3 1B2P Bedroom	0.00	Pass	3	Pass
B1-5-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-5-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-5-4 2B3P KLR	0.00	Pass	N/A	-
B1-5-4 2B3P Single Bedroom	0.00	Pass	4	Pass
B1-5-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-5-5 2B3P KLR	0.00	Pass	N/A	-
B1-5-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-5-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-5-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-5-6 3B5P KLR	0.00	Pass	N/A	-
B1-5-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-5-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-5-7 2B3P KLR	0.60	Pass	N/A	-
B1-5-7 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-5-8 1B2P Bedroom	0.00	Pass	3	Pass
B1-5-8 1B2P KLR	0.00	Pass	N/A	-
B1-6-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-6-1 2B3P KLR	0.10	Pass	N/A	-
B1-6-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-6-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-6-2 2B3P KLR	0.00	Pass	N/A	-
B1-6-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-6-3 1B2P Bedroom	0.00	Pass	3	Pass
B1-6-3 1B2P KLR	0.00	Pass	N/A	-
B1-6-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-6-4 2B3P KLR	0.00	Pass	N/A	-
B1-6-4 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-6-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-6-5 2B3P KLR	0.50	Pass	N/A	-
B1-6-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-6-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-6-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-6-6 3B5P KLR	0.00	Pass	N/A	-
B1-6-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-6-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-6-7 2B3P KLR	0.70	Pass	N/A	-
B1-6-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-6-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-6-8 1B2P KLR	0.00	Pass	N/A	-
B1-7-1 2B3P Bedroom 1	0.00	Pass	3	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-7-1 2B3P KLR	0.10	Pass	N/A	-
B1-7-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-7-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-7-2 2B3P KLR	0.00	Pass	N/A	-
B1-7-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-7-3 1B2P Bedroom	0.00	Pass	3	Pass
B1-7-3 1B2P KLR	0.00	Pass	N/A	-
B1-7-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-7-4 2B3P KLR	0.00	Pass	N/A	-
B1-7-4 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-7-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-7-5 2B3P KLR	0.50	Pass	N/A	-
B1-7-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-7-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-7-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-7-6 3B5P KLR	0.10	Pass	N/A	-
B1-7-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-7-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-7-7 2B3P KLR	1.10	Pass	N/A	-
B1-7-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-7-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-7-8 1B2P KLR	0.00	Pass	N/A	-
B1-8-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-8-1 2B3P KLR	0.10	Pass	N/A	-
B1-8-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-8-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-8-2 2B3P KLR	0.00	Pass	N/A	-
B1-8-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-8-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-8-3 1B2P KLR	0.00	Pass	N/A	-
B1-8-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-8-4 2B3P KLR	0.00	Pass	N/A	-
B1-8-4 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-8-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-8-5 2B3P KLR	0.50	Pass	N/A	-
B1-8-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-8-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-8-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-8-6 3B5P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-8-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-8-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-8-7 2B3P KLR	1.10	Pass	N/A	-
B1-8-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-8-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-8-8 1B2P KLR	0.00	Pass	N/A	-
B1-9-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B1-9-1 2B3P KLR	0.10	Pass	N/A	-
B1-9-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B1-9-2 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-9-2 2B3P KLR	0.00	Pass	N/A	-
B1-9-2 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-9-3 1B2P Bedroom	0.00	Pass	2	Pass
B1-9-3 1B2P KLR	0.00	Pass	N/A	-
B1-9-4 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-9-4 2B3P KLR	0.00	Pass	N/A	-
B1-9-4 2B3P Single Bedroom	0.00	Pass	3	Pass
B1-9-5 2B3P Bedroom 1	0.00	Pass	1	Pass
B1-9-5 2B3P KLR	0.50	Pass	N/A	-
B1-9-5 2B3P Single Bedroom	0.10	Pass	4	Pass
B1-9-6 3B5P Bedroom 1	0.00	Pass	0	Pass
B1-9-6 3B5P Bedroom 2	0.00	Pass	4	Pass
B1-9-6 3B5P KLR	0.60	Pass	N/A	-
B1-9-6 3B5P Single Bedroom 3	0.00	Pass	3	Pass
B1-9-7 2B3P Bedroom	0.00	Pass	4	Pass
B1-9-7 2B3P KLR	1.10	Pass	N/A	-
B1-9-7 2B3P Single Bedroom	0.10	Pass	3	Pass
B1-9-8 1B2P Bedroom	0.00	Pass	2	Pass
B1-9-8 1B2P KLR	0.00	Pass	N/A	-
B2-10-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-10-1 2B3P KLR	0.00	Pass	N/A	-
B2-10-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-10-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-10-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-10-2 2B4P KLR	0.00	Pass	N/A	-
B2-10-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-10-3 1B2P KLR	0.00	Pass	N/A	-
B2-10-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-10-4 2B4P Bedroom 2	0.40	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-10-4 2B4P KLR	1.00	Pass	N/A	-
B2-10-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-10-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-10-5 2B4P KLR	1.20	Pass	N/A	-
B2-10-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-10-6 2B3P KLR	1.00	Pass	N/A	-
B2-10-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-10-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-10-7 2B3P KLR	0.00	Pass	N/A	-
B2-10-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-1-1 2B3P KLR	0.00	Pass	N/A	-
B2-1-1 2B3P Single Bedroom	0.00	Pass	3	Pass
B2-11-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-11-1 2B3P KLR	0.00	Pass	N/A	-
B2-11-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-11-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-11-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-11-2 2B4P KLR	0.00	Pass	N/A	-
B2-11-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-11-3 1B2P KLR	0.00	Pass	N/A	-
B2-11-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-11-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-11-4 2B4P KLR	1.00	Pass	N/A	-
B2-11-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-11-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-11-5 2B4P KLR	1.30	Pass	N/A	-
B2-11-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-11-6 2B3P KLR	1.00	Pass	N/A	-
B2-11-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-11-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-11-7 2B3P KLR	0.00	Pass	N/A	-
B2-11-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-1-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-1-2 2B4P KLR	0.00	Pass	N/A	-
B2-12-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-12-1 2B3P KLR	0.00	Pass	N/A	-
B2-12-1 2B3P Single Bedroom	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-12-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-12-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-12-2 2B4P KLR	0.00	Pass	N/A	-
B2-12-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-12-3 1B2P KLR	0.00	Pass	N/A	-
B2-12-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-12-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-12-4 2B4P KLR	1.00	Pass	N/A	-
B2-12-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-12-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-12-5 2B4P KLR	1.30	Pass	N/A	-
B2-12-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-12-6 2B3P KLR	1.00	Pass	N/A	-
B2-12-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-12-7 2B3P Bedroom	0.00	Pass	3	Pass
B2-12-7 2B3P KLR	0.00	Pass	N/A	-
B2-12-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-3 1B2P Bedroom	0.00	Pass	4	Pass
B2-1-3 1B2P KLR	0.00	Pass	N/A	-
B2-13-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-13-1 2B3P KLR	0.00	Pass	N/A	-
B2-13-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-13-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-13-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-13-2 2B4P KLR	0.00	Pass	N/A	-
B2-13-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-13-3 1B2P KLR	0.00	Pass	N/A	-
B2-13-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-13-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-13-4 2B4P KLR	1.00	Pass	N/A	-
B2-13-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-13-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-13-5 2B4P KLR	1.30	Pass	N/A	-
B2-13-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-13-6 2B3P KLR	1.00	Pass	N/A	-
B2-13-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-13-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-13-7 2B3P KLR	0.00	Pass	N/A	-
B2-13-7 2B3P Single Bedroom	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-1-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-1-4 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-1-4 2B4P KLR	0.20	Pass	N/A	-
B2-14-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-14-1 2B3P KLR	0.00	Pass	N/A	-
B2-14-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-14-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-14-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-14-2 2B4P KLR	0.00	Pass	N/A	-
B2-14-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-14-3 1B2P KLR	0.00	Pass	N/A	-
B2-14-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-14-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-14-4 2B4P KLR	1.00	Pass	N/A	-
B2-14-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-14-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-14-5 2B4P KLR	1.30	Pass	N/A	-
B2-14-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-14-6 2B3P KLR	1.00	Pass	N/A	-
B2-14-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-14-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-14-7 2B3P KLR	0.00	Pass	N/A	-
B2-14-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-1-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-1-5 2B4P KLR	0.00	Pass	N/A	-
B2-15-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-15-1 2B3P KLR	0.00	Pass	N/A	-
B2-15-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-15-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-15-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-15-2 2B4P KLR	0.00	Pass	N/A	-
B2-15-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-15-3 1B2P KLR	0.00	Pass	N/A	-
B2-15-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-15-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-15-4 2B4P KLR	1.00	Pass	N/A	-
B2-15-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-15-5 2B4P Bedroom 2	0.30	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-15-5 2B4P KLR	1.30	Pass	N/A	-
B2-15-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-15-6 2B3P KLR	1.00	Pass	N/A	-
B2-15-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-15-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-15-7 2B3P KLR	0.00	Pass	N/A	-
B2-15-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-6 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-1-6 2B3P KLR	0.00	Pass	N/A	-
B2-1-6 2B3P Single Bedroom	0.00	Pass	4	Pass
B2-16-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-16-1 2B3P KLR	0.00	Pass	N/A	-
B2-16-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-16-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-16-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-16-2 2B4P KLR	0.00	Pass	N/A	-
B2-16-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-16-3 1B2P KLR	0.00	Pass	N/A	-
B2-16-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-16-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-16-4 2B4P KLR	1.00	Pass	N/A	-
B2-16-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-16-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-16-5 2B4P KLR	1.30	Pass	N/A	-
B2-16-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-16-6 2B3P KLR	1.00	Pass	N/A	-
B2-16-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-16-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-16-7 2B3P KLR	0.00	Pass	N/A	-
B2-16-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-1-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-1-7 2B3P KLR	0.00	Pass	N/A	-
B2-1-7 2B3P Single Bedroom	0.00	Pass	4	Pass
B2-17-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-17-1 2B3P KLR	0.00	Pass	N/A	-
B2-17-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-17-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-17-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-17-2 2B4P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-17-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-17-3 1B2P KLR	0.00	Pass	N/A	-
B2-17-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-17-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-17-4 2B4P KLR	1.00	Pass	N/A	-
B2-17-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-17-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-17-5 2B4P KLR	1.30	Pass	N/A	-
B2-17-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-17-6 2B3P KLR	1.00	Pass	N/A	-
B2-17-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-17-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-17-7 2B3P KLR	0.00	Pass	N/A	-
B2-17-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-18-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-18-1 2B3P KLR	0.00	Pass	N/A	-
B2-18-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-18-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-18-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-18-2 2B4P KLR	0.00	Pass	N/A	-
B2-18-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-18-3 1B2P KLR	0.00	Pass	N/A	-
B2-18-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-18-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-18-4 2B4P KLR	1.00	Pass	N/A	-
B2-18-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-18-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-18-5 2B4P KLR	1.30	Pass	N/A	-
B2-18-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-18-6 2B3P KLR	1.00	Pass	N/A	-
B2-18-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-18-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-18-7 2B3P KLR	0.00	Pass	N/A	-
B2-18-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-19-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-19-1 2B3P KLR	0.00	Pass	N/A	-
B2-19-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-19-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-19-2 2B4P Bedroom 1	0.00	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-19-2 2B4P KLR	0.00	Pass	N/A	-
B2-19-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-19-3 1B2P KLR	0.00	Pass	N/A	-
B2-19-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-19-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-19-4 2B4P KLR	1.00	Pass	N/A	-
B2-19-5 2B4P Bedroom 1	0.50	Pass	4	Pass
B2-19-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-19-5 2B4P KLR	1.30	Pass	N/A	-
B2-19-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-19-6 2B3P KLR	1.00	Pass	N/A	-
B2-19-6 2B3P Single Bedroom	0.60	Pass	4	Pass
B2-19-7 2B3P Bedroom	0.00	Pass	2	Pass
B2-19-7 2B3P KLR	0.00	Pass	N/A	-
B2-19-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-20-1 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-20-1 2B3P KLR	0.00	Pass	N/A	-
B2-20-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-20-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-20-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-20-2 2B4P KLR	0.00	Pass	N/A	-
B2-20-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-20-3 1B2P KLR	0.00	Pass	N/A	-
B2-20-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-20-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-20-4 2B4P KLR	1.00	Pass	N/A	-
B2-20-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-20-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-20-5 2B4P KLR	1.30	Pass	N/A	-
B2-20-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-20-6 2B3P KLR	1.00	Pass	N/A	-
B2-20-6 2B3P Single Bedroom	0.60	Pass	4	Pass
B2-20-7 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-20-7 2B3P KLR	0.00	Pass	N/A	-
B2-20-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-2-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-2-1 2B3P KLR	0.00	Pass	N/A	-
B2-2-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-21-1 2B3P Bedroom 1	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-21-1 2B3P KLR	0.00	Pass	N/A	-
B2-21-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-21-2 2B4P Bedroom 1	0.00	Pass	3	Pass
B2-21-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-21-2 2B4P KLR	0.00	Pass	N/A	-
B2-21-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-21-3 1B2P KLR	0.00	Pass	N/A	-
B2-21-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-21-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-21-4 2B4P KLR	1.00	Pass	N/A	-
B2-21-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-21-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-21-5 2B4P KLR	1.30	Pass	N/A	-
B2-21-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-21-6 2B3P KLR	1.00	Pass	N/A	-
B2-21-6 2B3P Single Bedroom	0.60	Pass	4	Pass
B2-21-7 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-21-7 2B3P KLR	0.00	Pass	N/A	-
B2-21-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-2-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-2-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-2-2 2B4P KLR	0.00	Pass	N/A	-
B2-22-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B2-22-1 2B3P KLR	0.00	Pass	N/A	-
B2-22-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-22-2 2B4P Bedroom 1	0.00	Pass	2	Pass
B2-22-2 2B4P Bedroom 1	0.00	Pass	3	Pass
B2-22-2 2B4P KLR	0.00	Pass	N/A	-
B2-22-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-22-3 1B2P KLR	0.00	Pass	N/A	-
B2-22-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-22-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-22-4 2B4P KLR	1.00	Pass	N/A	-
B2-22-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-22-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-22-5 2B4P KLR	1.30	Pass	N/A	-
B2-22-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-22-6 2B3P KLR	1.00	Pass	N/A	-
B2-22-6 2B3P Single Bedroom	0.60	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-22-7 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-22-7 2B3P KLR	0.00	Pass	N/A	-
B2-22-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-2-3 1B2P Bedroom	0.00	Pass	3	Pass
B2-2-3 1B2P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B2-23-1 2B3P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-23-2 2B4P Bedroom 1	0.00	Pass	2	Pass
B2-23-2 2B4P Bedroom 1	0.00	Pass	3	Pass
B2-23-2 2B4P KLR	0.00	Pass	N/A	-
B2-23-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-23-3 1B2P KLR	0.00	Pass	N/A	-
B2-23-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-23-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-23-4 2B4P KLR	1.00	Pass	N/A	-
B2-23-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-23-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-23-5 2B4P KLR	1.20	Pass	N/A	-
B2-23-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-23-6 2B3P KLR	1.10	Pass	N/A	-
B2-23-6 2B3P Single Bedroom	0.60	Pass	4	Pass
B2-23-7 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-23-7 2B3P KLR	0.00	Pass	N/A	-
B2-23-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-2-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-2-4 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-2-4 2B4P KLR	0.10	Pass	N/A	-
B2-24-1 2B3P Bedroom 1	0.00	Pass	1	Pass
B2-24-1 2B3P KLR	0.00	Pass	N/A	-
B2-24-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-24-2 2B4P Bedroom 1	0.00	Pass	2	Pass
B2-24-2 2B4P Bedroom 1	0.00	Pass	3	Pass
B2-24-2 2B4P KLR	0.00	Pass	N/A	-
B2-24-3 1B2P Bedroom	0.00	Pass	1	Pass
B2-24-3 1B2P KLR	0.00	Pass	N/A	-
B2-24-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-24-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-24-4 2B4P KLR	1.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-24-5 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-24-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-24-5 2B4P KLR	1.20	Pass	N/A	-
B2-24-6 2B3P Bedroom 1	0.30	Pass	4	Pass
B2-24-6 2B3P KLR	1.10	Pass	N/A	-
B2-24-6 2B3P Single Bedroom	0.60	Pass	4	Pass
B2-24-7 2B3P Bedroom 1	0.00	Pass	2	Pass
B2-24-7 2B3P KLR	0.00	Pass	N/A	-
B2-24-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-2-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-2-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-2-5 2B4P KLR	0.00	Pass	N/A	-
B2-2-6 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-2-6 2B3P KLR	0.00	Pass	N/A	-
B2-2-6 2B3P Single Bedroom	0.00	Pass	4	Pass
B2-2-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-2-7 2B3P KLR	0.00	Pass	N/A	-
B2-2-7 2B3P Single Bedroom	0.00	Pass	3	Pass
B2-3-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-3-1 2B3P KLR	0.00	Pass	N/A	-
B2-3-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-3-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-3-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-3-2 2B4P KLR	0.00	Pass	N/A	-
B2-3-3 1B2P Bedroom	0.00	Pass	3	Pass
B2-3-3 1B2P KLR	0.00	Pass	N/A	-
B2-3-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-3-4 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-3-4 2B4P KLR	0.20	Pass	N/A	-
B2-3-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-3-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-3-5 2B4P KLR	0.00	Pass	N/A	-
B2-3-6 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-3-6 2B3P KLR	0.00	Pass	N/A	-
B2-3-6 2B3P Single Bedroom	0.00	Pass	4	Pass
B2-3-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-3-7 2B3P KLR	0.00	Pass	N/A	-
B2-3-7 2B3P Single Bedroom	0.00	Pass	3	Pass
B2-4-1 2B3P Bedroom 1	0.00	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-4-1 2B3P KLR	0.00	Pass	N/A	-
B2-4-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-4-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-4-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-4-2 2B4P KLR	0.00	Pass	N/A	-
B2-4-3 1B2P Bedroom	0.00	Pass	3	Pass
B2-4-3 1B2P KLR	0.00	Pass	N/A	-
B2-4-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-4-4 2B4P Bedroom 2	0.10	Pass	4	Pass
B2-4-4 2B4P KLR	0.50	Pass	N/A	-
B2-4-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-4-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-4-5 2B4P KLR	0.00	Pass	N/A	-
B2-4-6 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-4-6 2B3P KLR	0.10	Pass	N/A	-
B2-4-6 2B3P Single Bedroom	0.20	Pass	4	Pass
B2-4-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-4-7 2B3P KLR	0.00	Pass	N/A	-
B2-4-7 2B3P Single Bedroom	0.00	Pass	3	Pass
B2-5-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-5-1 2B3P KLR	0.00	Pass	N/A	-
B2-5-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-5-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-5-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-5-2 2B4P KLR	0.00	Pass	N/A	-
B2-5-3 1B2P Bedroom	0.00	Pass	3	Pass
B2-5-3 1B2P KLR	0.00	Pass	N/A	-
B2-5-4 2B4P Bedroom 1	0.10	Pass	4	Pass
B2-5-4 2B4P Bedroom 2	0.10	Pass	4	Pass
B2-5-4 2B4P KLR	0.70	Pass	N/A	-
B2-5-5 2B4P Bedroom 1	0.10	Pass	4	Pass
B2-5-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-5-5 2B4P KLR	0.20	Pass	N/A	-
B2-5-6 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-5-6 2B3P KLR	0.10	Pass	N/A	-
B2-5-6 2B3P Single Bedroom	0.20	Pass	4	Pass
B2-5-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-5-7 2B3P KLR	0.00	Pass	N/A	-
B2-5-7 2B3P Single Bedroom	0.00	Pass	2	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-6-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-6-1 2B3P KLR	0.00	Pass	N/A	-
B2-6-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-6-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-6-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-6-2 2B4P KLR	0.00	Pass	N/A	-
B2-6-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-6-3 1B2P KLR	0.00	Pass	N/A	-
B2-6-4 2B4P Bedroom 1	0.10	Pass	4	Pass
B2-6-4 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-6-4 2B4P KLR	0.80	Pass	N/A	-
B2-6-5 2B4P Bedroom 1	0.20	Pass	4	Pass
B2-6-5 2B4P Bedroom 2	0.00	Pass	4	Pass
B2-6-5 2B4P KLR	0.50	Pass	N/A	-
B2-6-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-6-6 2B3P KLR	0.60	Pass	N/A	-
B2-6-6 2B3P Single Bedroom	0.40	Pass	4	Pass
B2-6-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-6-7 2B3P KLR	0.00	Pass	N/A	-
B2-6-7 2B3P Single Bedroom	0.00	Pass	2	Pass
B2-7-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-7-1 2B3P KLR	0.00	Pass	N/A	-
B2-7-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-7-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-7-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-7-2 2B4P KLR	0.00	Pass	N/A	-
B2-7-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-7-3 1B2P KLR	0.00	Pass	N/A	-
B2-7-4 2B4P Bedroom 1	0.20	Pass	4	Pass
B2-7-4 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-7-4 2B4P KLR	0.90	Pass	N/A	-
B2-7-5 2B4P Bedroom 1	0.20	Pass	4	Pass
B2-7-5 2B4P Bedroom 2	0.20	Pass	4	Pass
B2-7-5 2B4P KLR	1.00	Pass	N/A	-
B2-7-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-7-6 2B3P KLR	0.70	Pass	N/A	-
B2-7-6 2B3P Single Bedroom	0.40	Pass	4	Pass
B2-7-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-7-7 2B3P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-7-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-8-1 2B3P Bedroom 1	0.00	Pass	4	Pass
B2-8-1 2B3P KLR	0.00	Pass	N/A	-
B2-8-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-8-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-8-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-8-2 2B4P KLR	0.00	Pass	N/A	-
B2-8-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-8-3 1B2P KLR	0.00	Pass	N/A	-
B2-8-4 2B4P Bedroom 1	0.20	Pass	4	Pass
B2-8-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-8-4 2B4P KLR	0.90	Pass	N/A	-
B2-8-5 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-8-5 2B4P Bedroom 2	0.20	Pass	4	Pass
B2-8-5 2B4P KLR	1.10	Pass	N/A	-
B2-8-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-8-6 2B3P KLR	0.90	Pass	N/A	-
B2-8-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-8-7 2B3P Bedroom	0.00	Pass	4	Pass
B2-8-7 2B3P KLR	0.00	Pass	N/A	-
B2-8-7 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-9-1 2B3P Bedroom 1	0.00	Pass	3	Pass
B2-9-1 2B3P KLR	0.00	Pass	N/A	-
B2-9-1 2B3P Single Bedroom	0.00	Pass	1	Pass
B2-9-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-9-2 2B4P Bedroom 1	0.00	Pass	4	Pass
B2-9-2 2B4P KLR	0.00	Pass	N/A	-
B2-9-3 1B2P Bedroom	0.00	Pass	2	Pass
B2-9-3 1B2P KLR	0.00	Pass	N/A	-
B2-9-4 2B4P Bedroom 1	0.30	Pass	4	Pass
B2-9-4 2B4P Bedroom 2	0.40	Pass	4	Pass
B2-9-4 2B4P KLR	1.00	Pass	N/A	-
B2-9-5 2B4P Bedroom 1	0.40	Pass	4	Pass
B2-9-5 2B4P Bedroom 2	0.30	Pass	4	Pass
B2-9-5 2B4P KLR	1.20	Pass	N/A	-
B2-9-6 2B3P Bedroom 1	0.20	Pass	4	Pass
B2-9-6 2B3P KLR	1.00	Pass	N/A	-
B2-9-6 2B3P Single Bedroom	0.50	Pass	4	Pass
B2-9-7 2B3P Bedroom	0.00	Pass	4	Pass

CIBSE TM59 Results - DSY 1				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-9-7 2B3P KLR	0.00	Pass	N/A	-
B2-9-7 2B3P Single Bedroom	0.00	Pass	1	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-10-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-10-1 1B2P KLR	1.30	Pass	N/A	-
A1-10-10 2B3P Bedroom	0.60	Pass	14	Pass
A1-10-10 2B3P KLR	1.80	Pass	N/A	-
A1-10-10 2B3P Single Bedroom	0.90	Pass	11	Pass
A1-10-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-10-11 1B2P KLR	1.50	Pass	N/A	-
A1-10-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-10-12 1B2P KLR	1.50	Pass	N/A	-
A1-10-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-10-2 2B3P KLR	0.30	Pass	N/A	-
A1-10-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-10-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-10-3 1B2P KLR	0.00	Pass	N/A	-
A1-10-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-10-4 1B2P KLR	0.00	Pass	N/A	-
A1-10-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-10-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-10-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-10-5 2B4P KLR	0.00	Pass	N/A	-
A1-10-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-10-6 2B3P KLR	0.90	Pass	N/A	-
A1-10-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-10-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-10-7 2B3P KLR	1.00	Pass	N/A	-
A1-10-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-10-8 1B2P Bedroom	0.60	Pass	10	Pass
A1-10-8 1B2P KLR	1.80	Pass	N/A	-
A1-10-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-10-9 2B3P KLR	2.10	Pass	N/A	-
A1-10-9 2B3P Single Bedroom	1.00	Pass	11	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-1-1 1B2P Bedroom	0.30	Pass	10	Pass
A1-1-1 1B2P KLR	1.60	Pass	N/A	-
A1-1-10 2B3P Bedroom	0.90	Pass	18	Pass
A1-1-10 2B3P KLR	2.40	Pass	N/A	-
A1-1-10 2B3P Single Bedroom	1.10	Pass	16	Pass
A1-11-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-1-11 1B2P Bedroom	0.80	Pass	16	Pass
A1-11-1 1B2P KLR	1.20	Pass	N/A	-
A1-1-11 1B2P KLR	2.00	Pass	N/A	-
A1-11-10 2B3P Bedroom	0.50	Pass	13	Pass
A1-11-10 2B3P KLR	1.80	Pass	N/A	-
A1-11-10 2B3P Single Bedroom	0.90	Pass	11	Pass
A1-11-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-11-11 1B2P KLR	1.40	Pass	N/A	-
A1-11-12 1B2P Bedroom	0.50	Pass	11	Pass
A1-11-12 1B2P KLR	1.50	Pass	N/A	-
A1-1-12 1B2P Bedroom	0.80	Pass	16	Pass
A1-1-12 1B2P KLR	2.00	Pass	N/A	-
A1-11-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-11-2 2B3P KLR	0.30	Pass	N/A	-
A1-11-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-11-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-11-3 1B2P KLR	0.00	Pass	N/A	-
A1-11-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-11-4 1B2P KLR	0.00	Pass	N/A	-
A1-11-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-11-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-11-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-11-5 2B4P KLR	0.00	Pass	N/A	-
A1-11-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-11-6 2B3P KLR	0.90	Pass	N/A	-
A1-11-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-11-7 2B3P Bedroom	0.40	Pass	10	Pass
A1-11-7 2B3P KLR	1.00	Pass	N/A	-
A1-11-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-11-8 1B2P Bedroom	0.50	Pass	10	Pass
A1-11-8 1B2P KLR	1.80	Pass	N/A	-
A1-11-9 2B3P Bedroom	0.60	Pass	14	Pass
A1-11-9 2B3P KLR	2.00	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-11-9 2B3P Single Bedroom	0.90	Pass	11	Pass
A1-1-2 2B3P Bedroom	0.10	Pass	7	Pass
A1-1-2 2B3P KLR	0.50	Pass	N/A	-
A1-1-2 2B3P Single Bedroom	0.20	Pass	8	Pass
A1-1-3 1B2P Bedroom	0.00	Pass	8	Pass
A1-1-3 1B2P KLR	0.00	Pass	N/A	-
A1-1-4 1B2P Bedroom	0.00	Pass	4	Pass
A1-1-4 1B2P KLR	0.00	Pass	N/A	-
A1-1-5 2B4P Bedroom	0.00	Pass	7	Pass
A1-1-5 2B4P Bedroom 1	0.00	Pass	5	Pass
A1-1-5 2B4P Bedroom 2	0.00	Pass	3	Pass
A1-1-5 2B4P KLR	0.00	Pass	N/A	-
A1-1-6 2B3P Bedroom	0.50	Pass	15	Pass
A1-1-6 2B3P KLR	1.00	Pass	N/A	-
A1-1-6 2B3P Single Bedroom	0.50	Pass	9	Pass
A1-1-7 2B3P Bedroom	0.50	Pass	15	Pass
A1-1-7 2B3P KLR	1.10	Pass	N/A	-
A1-1-7 2B3P Single Bedroom	0.50	Pass	10	Pass
A1-1-8 1B2P Bedroom	0.80	Pass	16	Pass
A1-1-8 1B2P KLR	2.50	Pass	N/A	-
A1-1-9 2B3P Bedroom	1.00	Pass	20	Pass
A1-1-9 2B3P KLR	2.70	Pass	N/A	-
A1-1-9 2B3P Single Bedroom	1.20	Pass	17	Pass
A1-2-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-2-1 1B2P KLR	1.30	Pass	N/A	-
A1-2-10 2B3P Bedroom	0.70	Pass	15	Pass
A1-2-10 2B3P KLR	2.00	Pass	N/A	-
A1-2-10 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-2-11 1B2P Bedroom	0.60	Pass	12	Pass
A1-2-11 1B2P KLR	1.60	Pass	N/A	-
A1-2-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-2-12 1B2P KLR	1.60	Pass	N/A	-
A1-2-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-2-2 2B3P KLR	0.40	Pass	N/A	-
A1-2-2 2B3P Single Bedroom	0.10	Pass	8	Pass
A1-2-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-2-3 1B2P KLR	0.00	Pass	N/A	-
A1-2-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-2-4 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-2-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-2-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-2-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-2-5 2B4P KLR	0.00	Pass	N/A	-
A1-2-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-2-6 2B3P KLR	0.90	Pass	N/A	-
A1-2-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-2-7 2B3P Bedroom	0.50	Pass	11	Pass
A1-2-7 2B3P KLR	1.00	Pass	N/A	-
A1-2-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-2-8 1B2P Bedroom	0.70	Pass	11	Pass
A1-2-8 1B2P KLR	2.00	Pass	N/A	-
A1-2-9 2B3P Bedroom	0.80	Pass	15	Pass
A1-2-9 2B3P KLR	2.40	Pass	N/A	-
A1-2-9 2B3P Single Bedroom	1.10	Pass	13	Pass
A1-3-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-3-1 1B2P KLR	1.30	Pass	N/A	-
A1-3-10 2B3P Bedroom	0.70	Pass	15	Pass
A1-3-10 2B3P KLR	2.00	Pass	N/A	-
A1-3-10 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-3-11 1B2P Bedroom	0.60	Pass	11	Pass
A1-3-11 1B2P KLR	1.60	Pass	N/A	-
A1-3-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-3-12 1B2P KLR	1.50	Pass	N/A	-
A1-3-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-3-2 2B3P KLR	0.30	Pass	N/A	-
A1-3-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-3-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-3-3 1B2P KLR	0.00	Pass	N/A	-
A1-3-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-3-4 1B2P KLR	0.00	Pass	N/A	-
A1-3-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-3-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-3-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-3-5 2B4P KLR	0.00	Pass	N/A	-
A1-3-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-3-6 2B3P KLR	0.90	Pass	N/A	-
A1-3-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-3-7 2B3P Bedroom	0.50	Pass	11	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-3-7 2B3P KLR	1.00	Pass	N/A	-
A1-3-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-3-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-3-8 1B2P KLR	2.00	Pass	N/A	-
A1-3-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-3-9 2B3P KLR	2.40	Pass	N/A	-
A1-3-9 2B3P Single Bedroom	1.00	Pass	13	Pass
A1-4-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-4-1 1B2P KLR	1.30	Pass	N/A	-
A1-4-10 2B3P Bedroom	0.70	Pass	15	Pass
A1-4-10 2B3P KLR	1.90	Pass	N/A	-
A1-4-10 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-4-11 1B2P Bedroom	0.60	Pass	11	Pass
A1-4-11 1B2P KLR	1.60	Pass	N/A	-
A1-4-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-4-12 1B2P KLR	1.50	Pass	N/A	-
A1-4-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-4-2 2B3P KLR	0.30	Pass	N/A	-
A1-4-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-4-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-4-3 1B2P KLR	0.00	Pass	N/A	-
A1-4-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-4-4 1B2P KLR	0.00	Pass	N/A	-
A1-4-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-4-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-4-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-4-5 2B4P KLR	0.00	Pass	N/A	-
A1-4-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-4-6 2B3P KLR	0.90	Pass	N/A	-
A1-4-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-4-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-4-7 2B3P KLR	1.00	Pass	N/A	-
A1-4-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-4-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-4-8 1B2P KLR	2.00	Pass	N/A	-
A1-4-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-4-9 2B3P KLR	2.40	Pass	N/A	-
A1-4-9 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-5-1 1B2P Bedroom	0.20	Pass	8	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-5-1 1B2P KLR	1.30	Pass	N/A	-
A1-5-10 2B3P Bedroom	0.70	Pass	15	Pass
A1-5-10 2B3P KLR	1.90	Pass	N/A	-
A1-5-10 2B3P Single Bedroom	1.00	Pass	11	Pass
A1-5-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-5-11 1B2P KLR	1.60	Pass	N/A	-
A1-5-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-5-12 1B2P KLR	1.50	Pass	N/A	-
A1-5-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-5-2 2B3P KLR	0.30	Pass	N/A	-
A1-5-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-5-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-5-3 1B2P KLR	0.00	Pass	N/A	-
A1-5-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-5-4 1B2P KLR	0.00	Pass	N/A	-
A1-5-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-5-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-5-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-5-5 2B4P KLR	0.00	Pass	N/A	-
A1-5-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-5-6 2B3P KLR	0.90	Pass	N/A	-
A1-5-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-5-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-5-7 2B3P KLR	1.00	Pass	N/A	-
A1-5-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-5-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-5-8 1B2P KLR	2.00	Pass	N/A	-
A1-5-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-5-9 2B3P KLR	2.30	Pass	N/A	-
A1-5-9 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-6-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-6-1 1B2P KLR	1.30	Pass	N/A	-
A1-6-10 2B3P Bedroom	0.70	Pass	15	Pass
A1-6-10 2B3P KLR	1.90	Pass	N/A	-
A1-6-10 2B3P Single Bedroom	1.00	Pass	11	Pass
A1-6-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-6-11 1B2P KLR	1.60	Pass	N/A	-
A1-6-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-6-12 1B2P KLR	1.50	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-6-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-6-2 2B3P KLR	0.30	Pass	N/A	-
A1-6-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-6-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-6-3 1B2P KLR	0.00	Pass	N/A	-
A1-6-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-6-4 1B2P KLR	0.00	Pass	N/A	-
A1-6-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-6-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-6-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-6-5 2B4P KLR	0.00	Pass	N/A	-
A1-6-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-6-6 2B3P KLR	0.90	Pass	N/A	-
A1-6-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-6-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-6-7 2B3P KLR	1.00	Pass	N/A	-
A1-6-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-6-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-6-8 1B2P KLR	2.00	Pass	N/A	-
A1-6-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-6-9 2B3P KLR	2.30	Pass	N/A	-
A1-6-9 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-7-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-7-1 1B2P KLR	1.30	Pass	N/A	-
A1-7-10 2B3P Bedroom	0.60	Pass	15	Pass
A1-7-10 2B3P KLR	1.90	Pass	N/A	-
A1-7-10 2B3P Single Bedroom	1.00	Pass	11	Pass
A1-7-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-7-11 1B2P KLR	1.50	Pass	N/A	-
A1-7-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-7-12 1B2P KLR	1.50	Pass	N/A	-
A1-7-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-7-2 2B3P KLR	0.30	Pass	N/A	-
A1-7-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-7-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-7-3 1B2P KLR	0.00	Pass	N/A	-
A1-7-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-7-4 1B2P KLR	0.00	Pass	N/A	-
A1-7-5 2B4P Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-7-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-7-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-7-5 2B4P KLR	0.00	Pass	N/A	-
A1-7-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-7-6 2B3P KLR	0.90	Pass	N/A	-
A1-7-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-7-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-7-7 2B3P KLR	1.00	Pass	N/A	-
A1-7-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-7-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-7-8 1B2P KLR	2.00	Pass	N/A	-
A1-7-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-7-9 2B3P KLR	2.30	Pass	N/A	-
A1-7-9 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-8-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-8-1 1B2P KLR	1.30	Pass	N/A	-
A1-8-10 2B3P Bedroom	0.60	Pass	14	Pass
A1-8-10 2B3P KLR	1.90	Pass	N/A	-
A1-8-10 2B3P Single Bedroom	1.00	Pass	11	Pass
A1-8-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-8-11 1B2P KLR	1.50	Pass	N/A	-
A1-8-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-8-12 1B2P KLR	1.50	Pass	N/A	-
A1-8-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-8-2 2B3P KLR	0.30	Pass	N/A	-
A1-8-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-8-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-8-3 1B2P KLR	0.00	Pass	N/A	-
A1-8-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-8-4 1B2P KLR	0.00	Pass	N/A	-
A1-8-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-8-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-8-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-8-5 2B4P KLR	0.00	Pass	N/A	-
A1-8-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-8-6 2B3P KLR	0.90	Pass	N/A	-
A1-8-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-8-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-8-7 2B3P KLR	1.00	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-8-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-8-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-8-8 1B2P KLR	2.00	Pass	N/A	-
A1-8-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-8-9 2B3P KLR	2.30	Pass	N/A	-
A1-8-9 2B3P Single Bedroom	1.00	Pass	12	Pass
A1-9-1 1B2P Bedroom	0.20	Pass	8	Pass
A1-9-1 1B2P KLR	1.30	Pass	N/A	-
A1-9-10 2B3P Bedroom	0.60	Pass	14	Pass
A1-9-10 2B3P KLR	1.90	Pass	N/A	-
A1-9-10 2B3P Single Bedroom	0.90	Pass	11	Pass
A1-9-11 1B2P Bedroom	0.50	Pass	11	Pass
A1-9-11 1B2P KLR	1.50	Pass	N/A	-
A1-9-12 1B2P Bedroom	0.60	Pass	11	Pass
A1-9-12 1B2P KLR	1.50	Pass	N/A	-
A1-9-2 2B3P Bedroom	0.00	Pass	6	Pass
A1-9-2 2B3P KLR	0.30	Pass	N/A	-
A1-9-2 2B3P Single Bedroom	0.10	Pass	7	Pass
A1-9-3 1B2P Bedroom	0.00	Pass	7	Pass
A1-9-3 1B2P KLR	0.00	Pass	N/A	-
A1-9-4 1B2P Bedroom	0.00	Pass	3	Pass
A1-9-4 1B2P KLR	0.00	Pass	N/A	-
A1-9-5 2B4P Bedroom	0.00	Pass	6	Pass
A1-9-5 2B4P Bedroom 1	0.00	Pass	4	Pass
A1-9-5 2B4P Bedroom 2	0.00	Pass	1	Pass
A1-9-5 2B4P KLR	0.00	Pass	N/A	-
A1-9-6 2B3P Bedroom	0.40	Pass	10	Pass
A1-9-6 2B3P KLR	0.90	Pass	N/A	-
A1-9-6 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-9-7 2B3P Bedroom	0.50	Pass	10	Pass
A1-9-7 2B3P KLR	1.00	Pass	N/A	-
A1-9-7 2B3P Single Bedroom	0.50	Pass	8	Pass
A1-9-8 1B2P Bedroom	0.60	Pass	11	Pass
A1-9-8 1B2P KLR	2.00	Pass	N/A	-
A1-9-9 2B3P Bedroom	0.70	Pass	15	Pass
A1-9-9 2B3P KLR	2.30	Pass	N/A	-
A1-9-9 2B3P Single Bedroom	1.00	Pass	11	Pass
B1-10-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-10-1 2B3P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-10-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-10-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-10-2 2B3P KLR	0.40	Pass	N/A	-
B1-10-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-10-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-10-3 1B2P KLR	0.10	Pass	N/A	-
B1-10-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-10-4 2B3P KLR	0.10	Pass	N/A	-
B1-10-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-10-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-10-5 2B3P KLR	0.80	Pass	N/A	-
B1-10-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-10-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-10-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-10-6 3B5P KLR	1.10	Pass	N/A	-
B1-10-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-10-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-10-7 2B3P KLR	1.60	Pass	N/A	-
B1-10-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-10-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-10-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-1 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-1-1 2B3P KLR	0.40	Pass	N/A	-
B1-1-1 2B3P Single Bedroom	0.20	Pass	7	Pass
B1-11-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-11-1 2B3P KLR	0.40	Pass	N/A	-
B1-11-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-11-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-11-2 2B3P KLR	0.40	Pass	N/A	-
B1-11-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-11-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-11-3 1B2P KLR	0.00	Pass	N/A	-
B1-11-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-11-4 2B3P KLR	0.10	Pass	N/A	-
B1-11-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-11-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-11-5 2B3P KLR	0.90	Pass	N/A	-
B1-11-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-11-6 3B5P Bedroom 1	0.00	Pass	3	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-11-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-11-6 3B5P KLR	1.10	Pass	N/A	-
B1-11-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-11-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-11-7 2B3P KLR	1.50	Pass	N/A	-
B1-11-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-11-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-11-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-2 2B3P Bedroom 1	0.30	Pass	8	Pass
B1-1-2 2B3P KLR	0.60	Pass	N/A	-
B1-1-2 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-12-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-12-1 2B3P KLR	0.40	Pass	N/A	-
B1-12-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-12-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-12-2 2B3P KLR	0.40	Pass	N/A	-
B1-12-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-12-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-12-3 1B2P KLR	0.10	Pass	N/A	-
B1-12-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-12-4 2B3P KLR	0.10	Pass	N/A	-
B1-12-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-12-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-12-5 2B3P KLR	0.90	Pass	N/A	-
B1-12-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-12-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-12-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-12-6 3B5P KLR	1.10	Pass	N/A	-
B1-12-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-12-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-12-7 2B3P KLR	1.50	Pass	N/A	-
B1-12-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-12-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-12-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-3 1B2P Bedroom	0.20	Pass	7	Pass
B1-1-3 1B2P KLR	0.20	Pass	N/A	-
B1-13-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-13-1 2B3P KLR	0.40	Pass	N/A	-
B1-13-1 2B3P Single Bedroom	0.10	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-13-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-13-2 2B3P KLR	0.40	Pass	N/A	-
B1-13-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-13-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-13-3 1B2P KLR	0.00	Pass	N/A	-
B1-13-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-13-4 2B3P KLR	0.10	Pass	N/A	-
B1-13-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-13-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-13-5 2B3P KLR	0.90	Pass	N/A	-
B1-13-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-13-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-13-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-13-6 3B5P KLR	1.10	Pass	N/A	-
B1-13-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-13-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-13-7 2B3P KLR	1.50	Pass	N/A	-
B1-13-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-13-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-13-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-4 2B3P Bedroom 1	0.10	Pass	8	Pass
B1-1-4 2B3P KLR	0.30	Pass	N/A	-
B1-1-4 2B3P Single Bedroom	0.20	Pass	7	Pass
B1-14-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-14-1 2B3P KLR	0.40	Pass	N/A	-
B1-14-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-14-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-14-2 2B3P KLR	0.40	Pass	N/A	-
B1-14-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-14-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-14-3 1B2P KLR	0.00	Pass	N/A	-
B1-14-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-14-4 2B3P KLR	0.10	Pass	N/A	-
B1-14-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-14-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-14-5 2B3P KLR	0.90	Pass	N/A	-
B1-14-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-14-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-14-6 3B5P Bedroom 2	0.10	Pass	7	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-14-6 3B5P KLR	1.10	Pass	N/A	-
B1-14-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-14-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-14-7 2B3P KLR	1.50	Pass	N/A	-
B1-14-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-14-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-14-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-5 2B3P Bedroom 1	0.00	Pass	5	Pass
B1-1-5 2B3P KLR	0.40	Pass	N/A	-
B1-1-5 2B3P Single Bedroom	0.30	Pass	7	Pass
B1-15-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-15-1 2B3P KLR	0.40	Pass	N/A	-
B1-15-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-15-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-15-2 2B3P KLR	0.40	Pass	N/A	-
B1-15-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-15-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-15-3 1B2P KLR	0.00	Pass	N/A	-
B1-15-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-15-4 2B3P KLR	0.10	Pass	N/A	-
B1-15-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-15-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-15-5 2B3P KLR	0.90	Pass	N/A	-
B1-15-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-15-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-15-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-15-6 3B5P KLR	1.10	Pass	N/A	-
B1-15-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-15-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-15-7 2B3P KLR	1.50	Pass	N/A	-
B1-15-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-15-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-15-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-6 3B5P Bedroom 1	0.00	Pass	4	Pass
B1-1-6 3B5P Bedroom 2	0.00	Pass	8	Pass
B1-1-6 3B5P KLR	0.40	Pass	N/A	-
B1-1-6 3B5P Single Bedroom 3	0.10	Pass	7	Pass
B1-16-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-16-1 2B3P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-16-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-16-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-16-2 2B3P KLR	0.40	Pass	N/A	-
B1-16-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-16-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-16-3 1B2P KLR	0.00	Pass	N/A	-
B1-16-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-16-4 2B3P KLR	0.10	Pass	N/A	-
B1-16-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-16-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-16-5 2B3P KLR	0.90	Pass	N/A	-
B1-16-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-16-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-16-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-16-6 3B5P KLR	1.10	Pass	N/A	-
B1-16-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-16-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-16-7 2B3P KLR	1.50	Pass	N/A	-
B1-16-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-16-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-16-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-7 2B3P Bedroom	0.20	Pass	8	Pass
B1-1-7 2B3P KLR	1.10	Pass	N/A	-
B1-1-7 2B3P Single Bedroom	0.30	Pass	7	Pass
B1-17-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-17-1 2B3P KLR	0.40	Pass	N/A	-
B1-17-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-17-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-17-2 2B3P KLR	0.40	Pass	N/A	-
B1-17-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-17-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-17-3 1B2P KLR	0.00	Pass	N/A	-
B1-17-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-17-4 2B3P KLR	0.10	Pass	N/A	-
B1-17-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-17-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-17-5 2B3P KLR	1.00	Pass	N/A	-
B1-17-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-17-6 3B5P Bedroom 1	0.00	Pass	3	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-17-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-17-6 3B5P KLR	1.10	Pass	N/A	-
B1-17-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-17-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-17-7 2B3P KLR	1.50	Pass	N/A	-
B1-17-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-17-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-17-8 1B2P KLR	0.10	Pass	N/A	-
B1-1-8 1B2P Bedroom	0.10	Pass	7	Pass
B1-1-8 1B2P KLR	0.20	Pass	N/A	-
B1-18-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-18-1 2B3P KLR	0.40	Pass	N/A	-
B1-18-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-18-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-18-2 2B3P KLR	0.40	Pass	N/A	-
B1-18-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-18-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-18-3 1B2P KLR	0.00	Pass	N/A	-
B1-18-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-18-4 2B3P KLR	0.10	Pass	N/A	-
B1-18-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-18-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-18-5 2B3P KLR	1.30	Pass	N/A	-
B1-18-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-18-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-18-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-18-6 3B5P KLR	1.00	Pass	N/A	-
B1-18-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-18-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-18-7 2B3P KLR	1.40	Pass	N/A	-
B1-18-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-18-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-18-8 1B2P KLR	0.10	Pass	N/A	-
B1-19-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-19-1 2B3P KLR	0.40	Pass	N/A	-
B1-19-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-19-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-19-2 2B3P KLR	0.40	Pass	N/A	-
B1-19-2 2B3P Single Bedroom	0.20	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-19-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-19-3 1B2P KLR	0.00	Pass	N/A	-
B1-19-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-19-4 2B3P KLR	0.10	Pass	N/A	-
B1-19-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-19-5 2B3P Bedroom 1	0.20	Pass	5	Pass
B1-19-5 2B3P KLR	1.60	Pass	N/A	-
B1-19-5 2B3P Single Bedroom	0.70	Pass	6	Pass
B1-19-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-19-6 3B5P Bedroom 2	0.10	Pass	6	Pass
B1-19-6 3B5P KLR	1.00	Pass	N/A	-
B1-19-6 3B5P Single Bedroom 3	0.30	Pass	6	Pass
B1-19-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-19-7 2B3P KLR	1.40	Pass	N/A	-
B1-19-7 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-19-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-19-8 1B2P KLR	0.10	Pass	N/A	-
B1-20-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-20-1 2B3P KLR	0.40	Pass	N/A	-
B1-20-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-20-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-20-2 2B3P KLR	0.40	Pass	N/A	-
B1-20-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-20-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-20-3 1B2P KLR	0.00	Pass	N/A	-
B1-20-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-20-4 2B3P KLR	0.10	Pass	N/A	-
B1-20-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-20-5 2B3P Bedroom 1	0.30	Pass	6	Pass
B1-20-5 2B3P KLR	1.70	Pass	N/A	-
B1-20-5 2B3P Single Bedroom	0.80	Pass	6	Pass
B1-2-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-2-1 2B3P KLR	0.40	Pass	N/A	-
B1-2-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-21-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-21-1 2B3P KLR	0.40	Pass	N/A	-
B1-21-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-21-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-21-2 2B3P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-21-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-21-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-21-3 1B2P KLR	0.00	Pass	N/A	-
B1-21-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-21-4 2B3P KLR	0.10	Pass	N/A	-
B1-21-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-21-5 2B3P Bedroom 1	0.30	Pass	6	Pass
B1-21-5 2B3P KLR	1.70	Pass	N/A	-
B1-21-5 2B3P Single Bedroom	0.80	Pass	6	Pass
B1-2-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-2-2 2B3P KLR	0.40	Pass	N/A	-
B1-2-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-22-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-22-1 2B3P KLR	0.40	Pass	N/A	-
B1-22-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-22-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-22-2 2B3P KLR	0.40	Pass	N/A	-
B1-22-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-22-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-22-3 1B2P KLR	0.00	Pass	N/A	-
B1-22-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-22-4 2B3P KLR	0.10	Pass	N/A	-
B1-22-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-22-5 2B3P Bedroom 1	0.30	Pass	6	Pass
B1-22-5 2B3P KLR	1.60	Pass	N/A	-
B1-22-5 2B3P Single Bedroom	0.80	Pass	6	Pass
B1-2-3 1B2P Bedroom	0.00	Pass	7	Pass
B1-2-3 1B2P KLR	0.10	Pass	N/A	-
B1-23-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-23-1 2B3P KLR	0.40	Pass	N/A	-
B1-23-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-23-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-23-2 2B3P KLR	0.40	Pass	N/A	-
B1-23-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-23-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-23-3 1B2P KLR	0.00	Pass	N/A	-
B1-23-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-23-4 2B3P KLR	0.10	Pass	N/A	-
B1-23-4 2B3P Single Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-23-5 2B3P Bedroom 1	0.30	Pass	6	Pass
B1-23-5 2B3P KLR	1.60	Pass	N/A	-
B1-23-5 2B3P Single Bedroom	0.80	Pass	6	Pass
B1-2-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-2-4 2B3P KLR	0.10	Pass	N/A	-
B1-2-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-24-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-24-1 2B3P KLR	0.40	Pass	N/A	-
B1-24-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-24-2 2B3P Bedroom 1	0.10	Pass	6	Pass
B1-24-2 2B3P KLR	0.40	Pass	N/A	-
B1-24-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-24-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-24-3 1B2P KLR	0.00	Pass	N/A	-
B1-24-4 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-24-4 2B3P KLR	0.10	Pass	N/A	-
B1-24-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-24-5 2B3P Bedroom 1	0.30	Pass	6	Pass
B1-24-5 2B3P KLR	1.60	Pass	N/A	-
B1-24-5 2B3P Single Bedroom	0.80	Pass	6	Pass
B1-2-5 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-2-5 2B3P KLR	0.20	Pass	N/A	-
B1-2-5 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-25-1 2B3P Bedroom	0.00	Pass	6	Pass
B1-25-1 2B3P KLR	0.50	Pass	N/A	-
B1-25-1 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-25-2 2B3P Bedroom	0.10	Pass	6	Pass
B1-25-2 2B3P KLR	0.30	Pass	N/A	-
B1-25-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-25-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-25-3 1B2P KLR	0.00	Pass	N/A	-
B1-25-4 2B4P Bedroom 1	0.00	Pass	5	Pass
B1-25-4 2B4P Bedroom 2	0.00	Pass	6	Pass
B1-25-4 2B4P KLR	0.00	Pass	N/A	-
B1-25-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-25-5 2B4P Bedroom 2	0.00	Pass	3	Pass
B1-25-5 2B4P KLR	0.00	Pass	N/A	-
B1-25-6 2B4P Bedroom 1	0.30	Pass	6	Pass
B1-25-6 2B4P Bedroom 2	0.10	Pass	5	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-25-6 2B4P KLR	0.90	Pass	N/A	-
B1-25-7 2B4P Bedroom 1	0.10	Pass	6	Pass
B1-25-7 2B4P Bedroom 2	0.00	Pass	4	Pass
B1-2-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-2-6 3B5P Bedroom 2	0.00	Pass	6	Pass
B1-2-6 3B5P KLR	0.20	Pass	N/A	-
B1-2-6 3B5P Single Bedroom 3	0.00	Pass	6	Pass
B1-26-1 2B3P Bedroom	0.00	Pass	6	Pass
B1-26-1 2B3P KLR	0.50	Pass	N/A	-
B1-26-1 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-26-2 2B3P Bedroom	0.10	Pass	6	Pass
B1-26-2 2B3P KLR	0.30	Pass	N/A	-
B1-26-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-26-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-26-3 1B2P KLR	0.00	Pass	N/A	-
B1-26-4 2B4P Bedroom 1	0.00	Pass	5	Pass
B1-26-4 2B4P Bedroom 2	0.00	Pass	6	Pass
B1-26-4 2B4P KLR	0.00	Pass	N/A	-
B1-26-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-26-5 2B4P Bedroom 2	0.00	Pass	3	Pass
B1-26-5 2B4P KLR	0.00	Pass	N/A	-
B1-26-6 2B4P Bedroom 1	0.30	Pass	6	Pass
B1-26-6 2B4P Bedroom 2	0.10	Pass	5	Pass
B1-26-6 2B4P KLR	0.80	Pass	N/A	-
B1-26-7 2B4P Bedroom 1	0.10	Pass	6	Pass
B1-26-7 2B4P Bedroom 2	0.00	Pass	4	Pass
B1-2-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-2-7 2B3P KLR	0.90	Pass	N/A	-
B1-2-7 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-27-1 2B3P Bedroom	0.00	Pass	6	Pass
B1-27-1 2B3P Bedroom	0.10	Pass	6	Pass
B1-27-1 2B3P KLR	0.50	Pass	N/A	-
B1-27-1 2B3P KLR	0.50	Pass	N/A	-
B1-27-1 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-27-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-27-2 2B3P Bedroom	0.10	Pass	6	Pass
B1-27-2 2B3P Bedroom	0.10	Pass	6	Pass
B1-27-2 2B3P KLR	0.30	Pass	N/A	-
B1-27-2 2B3P KLR	0.30	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-27-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-27-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-27-3 1B2P KLR	0.00	Pass	N/A	-
B1-27-3 1B2P KLR	0.00	Pass	N/A	-
B1-27-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-27-4 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	6	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	6	Pass
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-27-5 2B4P Bedroom 1	0.00	Pass	4	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	3	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	3	Pass
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-6 2B4P Bedroom 1	0.30	Pass	6	Pass
B1-27-6 2B4P Bedroom 1	0.30	Pass	6	Pass
B1-27-6 2B4P Bedroom 2	0.10	Pass	5	Pass
B1-27-6 2B4P Bedroom 2	0.10	Pass	5	Pass
B1-27-6 2B4P KLR	0.80	Pass	N/A	-
B1-27-6 2B4P KLR	0.80	Pass	N/A	-
B1-27-7 2B4P Bedroom 1	0.10	Pass	5	Pass
B1-27-7 2B4P Bedroom 1	0.10	Pass	5	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	4	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	4	Pass
B1-2-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-2-8 1B2P KLR	0.10	Pass	N/A	-
B1-3-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-3-1 2B3P KLR	0.40	Pass	N/A	-
B1-3-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-3-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-3-2 2B3P KLR	0.40	Pass	N/A	-
B1-3-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-3-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-3-3 1B2P KLR	0.10	Pass	N/A	-
B1-3-4 2B3P Bedroom 1	0.00	Pass	7	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-3-4 2B3P KLR	0.10	Pass	N/A	-
B1-3-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-3-5 2B3P Bedroom 1	0.00	Pass	4	Pass
B1-3-5 2B3P KLR	0.30	Pass	N/A	-
B1-3-5 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-3-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-3-6 3B5P Bedroom 2	0.00	Pass	6	Pass
B1-3-6 3B5P KLR	0.30	Pass	N/A	-
B1-3-6 3B5P Single Bedroom 3	0.00	Pass	6	Pass
B1-3-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-3-7 2B3P KLR	0.90	Pass	N/A	-
B1-3-7 2B3P Single Bedroom	0.30	Pass	7	Pass
B1-3-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-3-8 1B2P KLR	0.10	Pass	N/A	-
B1-4-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-4-1 2B3P KLR	0.40	Pass	N/A	-
B1-4-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-4-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-4-2 2B3P KLR	0.40	Pass	N/A	-
B1-4-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-4-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-4-3 1B2P KLR	0.10	Pass	N/A	-
B1-4-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-4-4 2B3P KLR	0.10	Pass	N/A	-
B1-4-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-4-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-4-5 2B3P KLR	0.40	Pass	N/A	-
B1-4-5 2B3P Single Bedroom	0.30	Pass	6	Pass
B1-4-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-4-6 3B5P Bedroom 2	0.00	Pass	6	Pass
B1-4-6 3B5P KLR	0.30	Pass	N/A	-
B1-4-6 3B5P Single Bedroom 3	0.00	Pass	6	Pass
B1-4-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-4-7 2B3P KLR	1.00	Pass	N/A	-
B1-4-7 2B3P Single Bedroom	0.30	Pass	7	Pass
B1-4-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-4-8 1B2P KLR	0.10	Pass	N/A	-
B1-5-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-5-1 2B3P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-5-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-5-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-5-2 2B3P KLR	0.40	Pass	N/A	-
B1-5-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-5-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-5-3 1B2P KLR	0.10	Pass	N/A	-
B1-5-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-5-4 2B3P KLR	0.10	Pass	N/A	-
B1-5-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-5-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-5-5 2B3P KLR	0.40	Pass	N/A	-
B1-5-5 2B3P Single Bedroom	0.30	Pass	6	Pass
B1-5-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-5-6 3B5P Bedroom 2	0.00	Pass	6	Pass
B1-5-6 3B5P KLR	0.50	Pass	N/A	-
B1-5-6 3B5P Single Bedroom 3	0.00	Pass	6	Pass
B1-5-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-5-7 2B3P KLR	1.10	Pass	N/A	-
B1-5-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-5-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-5-8 1B2P KLR	0.10	Pass	N/A	-
B1-6-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-6-1 2B3P KLR	0.40	Pass	N/A	-
B1-6-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-6-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-6-2 2B3P KLR	0.40	Pass	N/A	-
B1-6-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-6-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-6-3 1B2P KLR	0.10	Pass	N/A	-
B1-6-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-6-4 2B3P KLR	0.10	Pass	N/A	-
B1-6-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-6-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-6-5 2B3P KLR	0.70	Pass	N/A	-
B1-6-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-6-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-6-6 3B5P Bedroom 2	0.00	Pass	6	Pass
B1-6-6 3B5P KLR	0.60	Pass	N/A	-
B1-6-6 3B5P Single Bedroom 3	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-6-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-6-7 2B3P KLR	1.20	Pass	N/A	-
B1-6-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-6-8 1B2P Bedroom	0.00	Pass	6	Pass
B1-6-8 1B2P KLR	0.10	Pass	N/A	-
B1-7-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-7-1 2B3P KLR	0.40	Pass	N/A	-
B1-7-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-7-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-7-2 2B3P KLR	0.40	Pass	N/A	-
B1-7-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-7-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-7-3 1B2P KLR	0.10	Pass	N/A	-
B1-7-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-7-4 2B3P KLR	0.10	Pass	N/A	-
B1-7-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-7-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-7-5 2B3P KLR	0.70	Pass	N/A	-
B1-7-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-7-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-7-6 3B5P Bedroom 2	0.00	Pass	7	Pass
B1-7-6 3B5P KLR	0.70	Pass	N/A	-
B1-7-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-7-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-7-7 2B3P KLR	1.60	Pass	N/A	-
B1-7-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-7-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-7-8 1B2P KLR	0.10	Pass	N/A	-
B1-8-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-8-1 2B3P KLR	0.40	Pass	N/A	-
B1-8-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-8-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-8-2 2B3P KLR	0.40	Pass	N/A	-
B1-8-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-8-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-8-3 1B2P KLR	0.10	Pass	N/A	-
B1-8-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-8-4 2B3P KLR	0.10	Pass	N/A	-
B1-8-4 2B3P Single Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-8-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-8-5 2B3P KLR	0.70	Pass	N/A	-
B1-8-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-8-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-8-6 3B5P Bedroom 2	0.00	Pass	7	Pass
B1-8-6 3B5P KLR	0.80	Pass	N/A	-
B1-8-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-8-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-8-7 2B3P KLR	1.60	Pass	N/A	-
B1-8-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-8-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-8-8 1B2P KLR	0.10	Pass	N/A	-
B1-9-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B1-9-1 2B3P KLR	0.40	Pass	N/A	-
B1-9-1 2B3P Single Bedroom	0.10	Pass	6	Pass
B1-9-2 2B3P Bedroom 1	0.10	Pass	7	Pass
B1-9-2 2B3P KLR	0.40	Pass	N/A	-
B1-9-2 2B3P Single Bedroom	0.20	Pass	6	Pass
B1-9-3 1B2P Bedroom	0.00	Pass	6	Pass
B1-9-3 1B2P KLR	0.10	Pass	N/A	-
B1-9-4 2B3P Bedroom 1	0.00	Pass	7	Pass
B1-9-4 2B3P KLR	0.10	Pass	N/A	-
B1-9-4 2B3P Single Bedroom	0.00	Pass	6	Pass
B1-9-5 2B3P Bedroom 1	0.10	Pass	5	Pass
B1-9-5 2B3P KLR	0.70	Pass	N/A	-
B1-9-5 2B3P Single Bedroom	0.40	Pass	6	Pass
B1-9-6 3B5P Bedroom 1	0.00	Pass	3	Pass
B1-9-6 3B5P Bedroom 2	0.10	Pass	7	Pass
B1-9-6 3B5P KLR	1.00	Pass	N/A	-
B1-9-6 3B5P Single Bedroom 3	0.20	Pass	6	Pass
B1-9-7 2B3P Bedroom	0.20	Pass	7	Pass
B1-9-7 2B3P KLR	1.60	Pass	N/A	-
B1-9-7 2B3P Single Bedroom	0.40	Pass	7	Pass
B1-9-8 1B2P Bedroom	0.10	Pass	6	Pass
B1-9-8 1B2P KLR	0.10	Pass	N/A	-
B2-10-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-10-1 2B3P KLR	0.10	Pass	N/A	-
B2-10-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-10-2 2B4P Bedroom 1	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-10-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-10-2 2B4P KLR	0.30	Pass	N/A	-
B2-10-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-10-3 1B2P KLR	0.10	Pass	N/A	-
B2-10-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-10-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-10-4 2B4P KLR	1.50	Pass	N/A	-
B2-10-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-10-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-10-5 2B4P KLR	1.60	Pass	N/A	-
B2-10-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-10-6 2B3P KLR	1.30	Pass	N/A	-
B2-10-6 2B3P Single Bedroom	0.90	Pass	7	Pass
B2-10-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-10-7 2B3P KLR	0.00	Pass	N/A	-
B2-10-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-1 2B3P Bedroom 1	0.00	Pass	7	Pass
B2-1-1 2B3P KLR	0.20	Pass	N/A	-
B2-1-1 2B3P Single Bedroom	0.10	Pass	7	Pass
B2-11-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-11-1 2B3P KLR	0.10	Pass	N/A	-
B2-11-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-11-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-11-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-11-2 2B4P KLR	0.30	Pass	N/A	-
B2-11-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-11-3 1B2P KLR	0.10	Pass	N/A	-
B2-11-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-11-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-11-4 2B4P KLR	1.50	Pass	N/A	-
B2-11-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-11-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-11-5 2B4P KLR	1.70	Pass	N/A	-
B2-11-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-11-6 2B3P KLR	1.30	Pass	N/A	-
B2-11-6 2B3P Single Bedroom	0.90	Pass	7	Pass
B2-11-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-11-7 2B3P KLR	0.00	Pass	N/A	-
B2-11-7 2B3P Single Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-1-2 2B4P Bedroom 1	0.20	Pass	8	Pass
B2-1-2 2B4P Bedroom 1	0.30	Pass	8	Pass
B2-1-2 2B4P KLR	0.60	Pass	N/A	-
B2-12-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-12-1 2B3P KLR	0.10	Pass	N/A	-
B2-12-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-12-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-12-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-12-2 2B4P KLR	0.30	Pass	N/A	-
B2-12-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-12-3 1B2P KLR	0.00	Pass	N/A	-
B2-12-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-12-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-12-4 2B4P KLR	1.50	Pass	N/A	-
B2-12-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-12-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-12-5 2B4P KLR	1.70	Pass	N/A	-
B2-12-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-12-6 2B3P KLR	1.30	Pass	N/A	-
B2-12-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-12-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-12-7 2B3P KLR	0.00	Pass	N/A	-
B2-12-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-3 1B2P Bedroom	0.10	Pass	7	Pass
B2-1-3 1B2P KLR	0.20	Pass	N/A	-
B2-13-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-13-1 2B3P KLR	0.10	Pass	N/A	-
B2-13-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-13-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-13-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-13-2 2B4P KLR	0.30	Pass	N/A	-
B2-13-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-13-3 1B2P KLR	0.00	Pass	N/A	-
B2-13-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-13-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-13-4 2B4P KLR	1.50	Pass	N/A	-
B2-13-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-13-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-13-5 2B4P KLR	1.60	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-13-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-13-6 2B3P KLR	1.30	Pass	N/A	-
B2-13-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-13-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-13-7 2B3P KLR	0.00	Pass	N/A	-
B2-13-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-4 2B4P Bedroom 1	0.40	Pass	8	Pass
B2-1-4 2B4P Bedroom 2	0.40	Pass	8	Pass
B2-1-4 2B4P KLR	0.80	Pass	N/A	-
B2-14-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-14-1 2B3P KLR	0.10	Pass	N/A	-
B2-14-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-14-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-14-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-14-2 2B4P KLR	0.30	Pass	N/A	-
B2-14-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-14-3 1B2P KLR	0.00	Pass	N/A	-
B2-14-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-14-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-14-4 2B4P KLR	1.50	Pass	N/A	-
B2-14-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-14-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-14-5 2B4P KLR	1.60	Pass	N/A	-
B2-14-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-14-6 2B3P KLR	1.30	Pass	N/A	-
B2-14-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-14-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-14-7 2B3P KLR	0.00	Pass	N/A	-
B2-14-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-5 2B4P Bedroom 1	0.20	Pass	7	Pass
B2-1-5 2B4P Bedroom 2	0.20	Pass	8	Pass
B2-1-5 2B4P KLR	0.40	Pass	N/A	-
B2-15-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-15-1 2B3P KLR	0.10	Pass	N/A	-
B2-15-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-15-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-15-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-15-2 2B4P KLR	0.30	Pass	N/A	-
B2-15-3 1B2P Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-15-3 1B2P KLR	0.00	Pass	N/A	-
B2-15-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-15-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-15-4 2B4P KLR	1.50	Pass	N/A	-
B2-15-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-15-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-15-5 2B4P KLR	1.50	Pass	N/A	-
B2-15-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-15-6 2B3P KLR	1.30	Pass	N/A	-
B2-15-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-15-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-15-7 2B3P KLR	0.00	Pass	N/A	-
B2-15-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-6 2B3P Bedroom 1	0.30	Pass	8	Pass
B2-1-6 2B3P KLR	0.30	Pass	N/A	-
B2-1-6 2B3P Single Bedroom	0.30	Pass	7	Pass
B2-16-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-16-1 2B3P KLR	0.10	Pass	N/A	-
B2-16-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-16-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-16-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-16-2 2B4P KLR	0.30	Pass	N/A	-
B2-16-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-16-3 1B2P KLR	0.00	Pass	N/A	-
B2-16-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-16-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-16-4 2B4P KLR	1.50	Pass	N/A	-
B2-16-5 2B4P Bedroom 1	0.70	Pass	8	Pass
B2-16-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-16-5 2B4P KLR	1.50	Pass	N/A	-
B2-16-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-16-6 2B3P KLR	1.30	Pass	N/A	-
B2-16-6 2B3P Single Bedroom	0.80	Pass	6	Pass
B2-16-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-16-7 2B3P KLR	0.00	Pass	N/A	-
B2-16-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-1-7 2B3P Bedroom	0.00	Pass	7	Pass
B2-1-7 2B3P KLR	0.10	Pass	N/A	-
B2-1-7 2B3P Single Bedroom	0.20	Pass	7	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-17-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-17-1 2B3P KLR	0.10	Pass	N/A	-
B2-17-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-17-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-17-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-17-2 2B4P KLR	0.30	Pass	N/A	-
B2-17-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-17-3 1B2P KLR	0.00	Pass	N/A	-
B2-17-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-17-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-17-4 2B4P KLR	1.50	Pass	N/A	-
B2-17-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-17-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-17-5 2B4P KLR	1.50	Pass	N/A	-
B2-17-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-17-6 2B3P KLR	1.30	Pass	N/A	-
B2-17-6 2B3P Single Bedroom	0.80	Pass	6	Pass
B2-17-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-17-7 2B3P KLR	0.00	Pass	N/A	-
B2-17-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-18-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-18-1 2B3P KLR	0.10	Pass	N/A	-
B2-18-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-18-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-18-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-18-2 2B4P KLR	0.30	Pass	N/A	-
B2-18-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-18-3 1B2P KLR	0.00	Pass	N/A	-
B2-18-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-18-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-18-4 2B4P KLR	1.50	Pass	N/A	-
B2-18-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-18-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-18-5 2B4P KLR	1.60	Pass	N/A	-
B2-18-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-18-6 2B3P KLR	1.40	Pass	N/A	-
B2-18-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-18-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-18-7 2B3P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-18-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-19-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-19-1 2B3P KLR	0.00	Pass	N/A	-
B2-19-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-19-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-19-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-19-2 2B4P KLR	0.30	Pass	N/A	-
B2-19-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-19-3 1B2P KLR	0.00	Pass	N/A	-
B2-19-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-19-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-19-4 2B4P KLR	1.50	Pass	N/A	-
B2-19-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-19-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-19-5 2B4P KLR	1.60	Pass	N/A	-
B2-19-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-19-6 2B3P KLR	1.40	Pass	N/A	-
B2-19-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-19-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-19-7 2B3P KLR	0.00	Pass	N/A	-
B2-19-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-20-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-20-1 2B3P KLR	0.00	Pass	N/A	-
B2-20-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-20-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-20-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-20-2 2B4P KLR	0.30	Pass	N/A	-
B2-20-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-20-3 1B2P KLR	0.10	Pass	N/A	-
B2-20-4 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-20-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-20-4 2B4P KLR	1.50	Pass	N/A	-
B2-20-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-20-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-20-5 2B4P KLR	1.60	Pass	N/A	-
B2-20-6 2B3P Bedroom 1	0.50	Pass	8	Pass
B2-20-6 2B3P KLR	1.40	Pass	N/A	-
B2-20-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-20-7 2B3P Bedroom 1	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-20-7 2B3P KLR	0.00	Pass	N/A	-
B2-20-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-2-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-2-1 2B3P KLR	0.10	Pass	N/A	-
B2-2-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-21-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-21-1 2B3P KLR	0.00	Pass	N/A	-
B2-21-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-21-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-21-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-21-2 2B4P KLR	0.30	Pass	N/A	-
B2-21-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-21-3 1B2P KLR	0.10	Pass	N/A	-
B2-21-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-21-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-21-4 2B4P KLR	1.50	Pass	N/A	-
B2-21-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-21-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-21-5 2B4P KLR	1.60	Pass	N/A	-
B2-21-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-21-6 2B3P KLR	1.40	Pass	N/A	-
B2-21-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-21-7 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-21-7 2B3P KLR	0.00	Pass	N/A	-
B2-21-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-2-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-2-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-2-2 2B4P KLR	0.30	Pass	N/A	-
B2-22-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-22-1 2B3P KLR	0.00	Pass	N/A	-
B2-22-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-22-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-22-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-22-2 2B4P KLR	0.30	Pass	N/A	-
B2-22-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-22-3 1B2P KLR	0.10	Pass	N/A	-
B2-22-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-22-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-22-4 2B4P KLR	1.50	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-22-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-22-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-22-5 2B4P KLR	1.60	Pass	N/A	-
B2-22-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-22-6 2B3P KLR	1.40	Pass	N/A	-
B2-22-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-22-7 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-22-7 2B3P KLR	0.00	Pass	N/A	-
B2-22-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-2-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-2-3 1B2P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-23-1 2B3P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-23-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-23-2 2B4P Bedroom 1	0.10	Pass	6	Pass
B2-23-2 2B4P KLR	0.30	Pass	N/A	-
B2-23-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-23-3 1B2P KLR	0.10	Pass	N/A	-
B2-23-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-23-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-23-4 2B4P KLR	1.50	Pass	N/A	-
B2-23-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-23-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-23-5 2B4P KLR	1.60	Pass	N/A	-
B2-23-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-23-6 2B3P KLR	1.40	Pass	N/A	-
B2-23-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-23-7 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-23-7 2B3P KLR	0.00	Pass	N/A	-
B2-23-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-2-4 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-2-4 2B4P Bedroom 2	0.30	Pass	7	Pass
B2-2-4 2B4P KLR	0.70	Pass	N/A	-
B2-24-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-24-1 2B3P KLR	0.00	Pass	N/A	-
B2-24-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-24-2 2B4P Bedroom 1	0.00	Pass	6	Pass
B2-24-2 2B4P Bedroom 1	0.10	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-24-2 2B4P KLR	0.30	Pass	N/A	-
B2-24-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-24-3 1B2P KLR	0.10	Pass	N/A	-
B2-24-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-24-4 2B4P Bedroom 2	0.60	Pass	7	Pass
B2-24-4 2B4P KLR	1.50	Pass	N/A	-
B2-24-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-24-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-24-5 2B4P KLR	1.40	Pass	N/A	-
B2-24-6 2B3P Bedroom 1	0.50	Pass	7	Pass
B2-24-6 2B3P KLR	1.40	Pass	N/A	-
B2-24-6 2B3P Single Bedroom	0.90	Pass	6	Pass
B2-24-7 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-24-7 2B3P KLR	0.00	Pass	N/A	-
B2-24-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-2-5 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-2-5 2B4P Bedroom 2	0.10	Pass	7	Pass
B2-2-5 2B4P KLR	0.30	Pass	N/A	-
B2-2-6 2B3P Bedroom 1	0.10	Pass	6	Pass
B2-2-6 2B3P KLR	0.10	Pass	N/A	-
B2-2-6 2B3P Single Bedroom	0.30	Pass	6	Pass
B2-2-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-2-7 2B3P KLR	0.00	Pass	N/A	-
B2-2-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-3-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-3-1 2B3P KLR	0.10	Pass	N/A	-
B2-3-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-3-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-3-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-3-2 2B4P KLR	0.30	Pass	N/A	-
B2-3-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-3-3 1B2P KLR	0.00	Pass	N/A	-
B2-3-4 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-3-4 2B4P Bedroom 2	0.30	Pass	7	Pass
B2-3-4 2B4P KLR	0.80	Pass	N/A	-
B2-3-5 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-3-5 2B4P Bedroom 2	0.10	Pass	7	Pass
B2-3-5 2B4P KLR	0.30	Pass	N/A	-
B2-3-6 2B3P Bedroom 1	0.10	Pass	6	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-3-6 2B3P KLR	0.20	Pass	N/A	-
B2-3-6 2B3P Single Bedroom	0.30	Pass	6	Pass
B2-3-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-3-7 2B3P KLR	0.00	Pass	N/A	-
B2-3-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-4-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-4-1 2B3P KLR	0.10	Pass	N/A	-
B2-4-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-4-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-4-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-4-2 2B4P KLR	0.30	Pass	N/A	-
B2-4-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-4-3 1B2P KLR	0.00	Pass	N/A	-
B2-4-4 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-4-4 2B4P Bedroom 2	0.40	Pass	7	Pass
B2-4-4 2B4P KLR	1.00	Pass	N/A	-
B2-4-5 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-4-5 2B4P Bedroom 2	0.20	Pass	7	Pass
B2-4-5 2B4P KLR	0.40	Pass	N/A	-
B2-4-6 2B3P Bedroom 1	0.30	Pass	7	Pass
B2-4-6 2B3P KLR	0.60	Pass	N/A	-
B2-4-6 2B3P Single Bedroom	0.50	Pass	6	Pass
B2-4-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-4-7 2B3P KLR	0.00	Pass	N/A	-
B2-4-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-5-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-5-1 2B3P KLR	0.10	Pass	N/A	-
B2-5-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-5-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-5-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-5-2 2B4P KLR	0.30	Pass	N/A	-
B2-5-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-5-3 1B2P KLR	0.00	Pass	N/A	-
B2-5-4 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-5-4 2B4P Bedroom 2	0.40	Pass	7	Pass
B2-5-4 2B4P KLR	1.20	Pass	N/A	-
B2-5-5 2B4P Bedroom 1	0.30	Pass	7	Pass
B2-5-5 2B4P Bedroom 2	0.30	Pass	7	Pass
B2-5-5 2B4P KLR	0.80	Pass	N/A	-

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-5-6 2B3P Bedroom 1	0.30	Pass	7	Pass
B2-5-6 2B3P KLR	0.70	Pass	N/A	-
B2-5-6 2B3P Single Bedroom	0.60	Pass	6	Pass
B2-5-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-5-7 2B3P KLR	0.00	Pass	N/A	-
B2-5-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-6-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-6-1 2B3P KLR	0.10	Pass	N/A	-
B2-6-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-6-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-6-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-6-2 2B4P KLR	0.30	Pass	N/A	-
B2-6-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-6-3 1B2P KLR	0.00	Pass	N/A	-
B2-6-4 2B4P Bedroom 1	0.40	Pass	7	Pass
B2-6-4 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-6-4 2B4P KLR	1.40	Pass	N/A	-
B2-6-5 2B4P Bedroom 1	0.40	Pass	7	Pass
B2-6-5 2B4P Bedroom 2	0.30	Pass	7	Pass
B2-6-5 2B4P KLR	1.10	Pass	N/A	-
B2-6-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-6-6 2B3P KLR	1.10	Pass	N/A	-
B2-6-6 2B3P Single Bedroom	0.70	Pass	6	Pass
B2-6-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-6-7 2B3P KLR	0.00	Pass	N/A	-
B2-6-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-7-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-7-1 2B3P KLR	0.10	Pass	N/A	-
B2-7-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-7-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-7-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-7-2 2B4P KLR	0.30	Pass	N/A	-
B2-7-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-7-3 1B2P KLR	0.10	Pass	N/A	-
B2-7-4 2B4P Bedroom 1	0.40	Pass	7	Pass
B2-7-4 2B4P Bedroom 2	0.60	Pass	7	Pass
B2-7-4 2B4P KLR	1.60	Pass	N/A	-
B2-7-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-7-5 2B4P Bedroom 2	0.40	Pass	7	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-7-5 2B4P KLR	1.50	Pass	N/A	-
B2-7-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-7-6 2B3P KLR	1.10	Pass	N/A	-
B2-7-6 2B3P Single Bedroom	0.70	Pass	6	Pass
B2-7-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-7-7 2B3P KLR	0.00	Pass	N/A	-
B2-7-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-8-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-8-1 2B3P KLR	0.10	Pass	N/A	-
B2-8-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-8-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-8-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-8-2 2B4P KLR	0.30	Pass	N/A	-
B2-8-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-8-3 1B2P KLR	0.10	Pass	N/A	-
B2-8-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-8-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-8-4 2B4P KLR	1.50	Pass	N/A	-
B2-8-5 2B4P Bedroom 1	0.60	Pass	7	Pass
B2-8-5 2B4P Bedroom 2	0.50	Pass	7	Pass
B2-8-5 2B4P KLR	1.50	Pass	N/A	-
B2-8-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-8-6 2B3P KLR	1.30	Pass	N/A	-
B2-8-6 2B3P Single Bedroom	0.80	Pass	6	Pass
B2-8-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-8-7 2B3P KLR	0.00	Pass	N/A	-
B2-8-7 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-9-1 2B3P Bedroom 1	0.00	Pass	6	Pass
B2-9-1 2B3P KLR	0.10	Pass	N/A	-
B2-9-1 2B3P Single Bedroom	0.00	Pass	6	Pass
B2-9-2 2B4P Bedroom 1	0.00	Pass	7	Pass
B2-9-2 2B4P Bedroom 1	0.10	Pass	7	Pass
B2-9-2 2B4P KLR	0.30	Pass	N/A	-
B2-9-3 1B2P Bedroom	0.00	Pass	6	Pass
B2-9-3 1B2P KLR	0.10	Pass	N/A	-
B2-9-4 2B4P Bedroom 1	0.50	Pass	7	Pass
B2-9-4 2B4P Bedroom 2	0.70	Pass	7	Pass
B2-9-4 2B4P KLR	1.50	Pass	N/A	-
B2-9-5 2B4P Bedroom 1	0.60	Pass	8	Pass

CIBSE TM59 Results - DSY2				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-9-5 2B4P Bedroom 2	0.50	Pass	8	Pass
B2-9-5 2B4P KLR	1.60	Pass	N/A	-
B2-9-6 2B3P Bedroom 1	0.40	Pass	7	Pass
B2-9-6 2B3P KLR	1.30	Pass	N/A	-
B2-9-6 2B3P Single Bedroom	0.90	Pass	7	Pass
B2-9-7 2B3P Bedroom	0.00	Pass	6	Pass
B2-9-7 2B3P KLR	0.00	Pass	N/A	-
B2-9-7 2B3P Single Bedroom	0.00	Pass	6	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-10-1 1B2P Bedroom	0.10	Pass	30	Pass
A1-10-1 1B2P KLR	3.40	Fail	N/A	-
A1-10-10 2B3P Bedroom	1.70	Pass	52	Fail
A1-10-10 2B3P KLR	4.30	Fail	N/A	-
A1-10-10 2B3P Single Bedroom	2.00	Pass	42	Fail
A1-10-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-10-11 1B2P KLR	3.50	Fail	N/A	-
A1-10-12 1B2P Bedroom	1.60	Pass	43	Fail
A1-10-12 1B2P KLR	3.50	Fail	N/A	-
A1-10-2 2B3P Bedroom	0.00	Pass	12	Pass
A1-10-2 2B3P KLR	0.30	Pass	N/A	-
A1-10-2 2B3P Single Bedroom	0.00	Pass	19	Pass
A1-10-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-10-3 1B2P KLR	0.00	Pass	N/A	-
A1-10-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-10-4 1B2P KLR	0.00	Pass	N/A	-
A1-10-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-10-5 2B4P Bedroom 1	0.00	Pass	10	Pass
A1-10-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-10-5 2B4P KLR	0.00	Pass	N/A	-
A1-10-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-10-6 2B3P KLR	1.00	Pass	N/A	-
A1-10-6 2B3P Single Bedroom	0.30	Pass	25	Pass
A1-10-7 2B3P Bedroom	0.20	Pass	41	Fail
A1-10-7 2B3P KLR	2.80	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-10-7 2B3P Single Bedroom	0.60	Pass	28	Pass
A1-10-8 1B2P Bedroom	1.70	Pass	38	Fail
A1-10-8 1B2P KLR	4.30	Fail	N/A	-
A1-10-9 2B3P Bedroom	1.80	Pass	53	Fail
A1-10-9 2B3P KLR	4.80	Fail	N/A	-
A1-10-9 2B3P Single Bedroom	2.10	Pass	42	Fail
A1-1-1 1B2P Bedroom	0.30	Pass	35	Fail
A1-1-1 1B2P KLR	3.70	Fail	N/A	-
A1-1-10 2B3P Bedroom	2.10	Pass	72	Fail
A1-1-10 2B3P KLR	5.00	Fail	N/A	-
A1-1-10 2B3P Single Bedroom	2.50	Pass	51	Fail
A1-11-1 1B2P Bedroom	0.10	Pass	30	Pass
A1-1-11 1B2P Bedroom	1.80	Pass	53	Fail
A1-11-1 1B2P KLR	3.40	Fail	N/A	-
A1-1-11 1B2P KLR	4.20	Fail	N/A	-
A1-11-10 2B3P Bedroom	1.60	Pass	51	Fail
A1-11-10 2B3P KLR	4.00	Fail	N/A	-
A1-11-10 2B3P Single Bedroom	2.00	Pass	42	Fail
A1-11-11 1B2P Bedroom	1.40	Pass	43	Fail
A1-11-11 1B2P KLR	3.50	Fail	N/A	-
A1-11-12 1B2P Bedroom	1.60	Pass	43	Fail
A1-11-12 1B2P KLR	3.40	Fail	N/A	-
A1-1-12 1B2P Bedroom	1.90	Pass	53	Fail
A1-1-12 1B2P KLR	4.10	Fail	N/A	-
A1-11-2 2B3P Bedroom	0.00	Pass	12	Pass
A1-11-2 2B3P KLR	0.40	Pass	N/A	-
A1-11-2 2B3P Single Bedroom	0.00	Pass	20	Pass
A1-11-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-11-3 1B2P KLR	0.00	Pass	N/A	-
A1-11-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-11-4 1B2P KLR	0.00	Pass	N/A	-
A1-11-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-11-5 2B4P Bedroom 1	0.00	Pass	10	Pass
A1-11-5 2B4P Bedroom 2	0.00	Pass	4	Pass
A1-11-5 2B4P KLR	0.00	Pass	N/A	-
A1-11-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-11-6 2B3P KLR	0.90	Pass	N/A	-
A1-11-6 2B3P Single Bedroom	0.30	Pass	24	Pass
A1-11-7 2B3P Bedroom	0.30	Pass	41	Fail

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-11-7 2B3P KLR	2.80	Pass	N/A	-
A1-11-7 2B3P Single Bedroom	0.60	Pass	27	Pass
A1-11-8 1B2P Bedroom	1.60	Pass	38	Fail
A1-11-8 1B2P KLR	4.10	Fail	N/A	-
A1-11-9 2B3P Bedroom	1.70	Pass	52	Fail
A1-11-9 2B3P KLR	4.70	Fail	N/A	-
A1-11-9 2B3P Single Bedroom	2.10	Pass	42	Fail
A1-1-2 2B3P Bedroom	0.00	Pass	15	Pass
A1-1-2 2B3P KLR	0.80	Pass	N/A	-
A1-1-2 2B3P Single Bedroom	0.00	Pass	26	Pass
A1-1-3 1B2P Bedroom	0.00	Pass	30	Pass
A1-1-3 1B2P KLR	0.00	Pass	N/A	-
A1-1-4 1B2P Bedroom	0.00	Pass	8	Pass
A1-1-4 1B2P KLR	0.00	Pass	N/A	-
A1-1-5 2B4P Bedroom	0.00	Pass	24	Pass
A1-1-5 2B4P Bedroom 1	0.00	Pass	14	Pass
A1-1-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-1-5 2B4P KLR	0.00	Pass	N/A	-
A1-1-6 2B3P Bedroom	0.40	Pass	51	Fail
A1-1-6 2B3P KLR	1.50	Pass	N/A	-
A1-1-6 2B3P Single Bedroom	0.60	Pass	35	Fail
A1-1-7 2B3P Bedroom	0.60	Pass	51	Fail
A1-1-7 2B3P KLR	3.40	Fail	N/A	-
A1-1-7 2B3P Single Bedroom	1.00	Pass	36	Fail
A1-1-8 1B2P Bedroom	2.00	Pass	49	Fail
A1-1-8 1B2P KLR	5.00	Fail	N/A	-
A1-1-9 2B3P Bedroom	2.20	Pass	73	Fail
A1-1-9 2B3P KLR	5.20	Fail	N/A	-
A1-1-9 2B3P Single Bedroom	2.60	Pass	52	Fail
A1-2-1 1B2P Bedroom	0.20	Pass	32	Pass
A1-2-1 1B2P KLR	3.50	Fail	N/A	-
A1-2-10 2B3P Bedroom	1.80	Pass	54	Fail
A1-2-10 2B3P KLR	4.50	Fail	N/A	-
A1-2-10 2B3P Single Bedroom	2.20	Pass	45	Fail
A1-2-11 1B2P Bedroom	1.60	Pass	47	Fail
A1-2-11 1B2P KLR	3.80	Fail	N/A	-
A1-2-12 1B2P Bedroom	1.70	Pass	45	Fail
A1-2-12 1B2P KLR	3.70	Fail	N/A	-
A1-2-2 2B3P Bedroom	0.00	Pass	14	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-2-2 2B3P KLR	0.40	Pass	N/A	-
A1-2-2 2B3P Single Bedroom	0.00	Pass	21	Pass
A1-2-3 1B2P Bedroom	0.00	Pass	24	Pass
A1-2-3 1B2P KLR	0.00	Pass	N/A	-
A1-2-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-2-4 1B2P KLR	0.00	Pass	N/A	-
A1-2-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-2-5 2B4P Bedroom 1	0.00	Pass	13	Pass
A1-2-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-2-5 2B4P KLR	0.00	Pass	N/A	-
A1-2-6 2B3P Bedroom	0.10	Pass	41	Fail
A1-2-6 2B3P KLR	1.00	Pass	N/A	-
A1-2-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-2-7 2B3P Bedroom	0.30	Pass	44	Fail
A1-2-7 2B3P KLR	3.00	Pass	N/A	-
A1-2-7 2B3P Single Bedroom	0.70	Pass	29	Pass
A1-2-8 1B2P Bedroom	1.80	Pass	42	Fail
A1-2-8 1B2P KLR	4.60	Fail	N/A	-
A1-2-9 2B3P Bedroom	1.90	Pass	58	Fail
A1-2-9 2B3P KLR	5.00	Fail	N/A	-
A1-2-9 2B3P Single Bedroom	2.40	Pass	45	Fail
A1-3-1 1B2P Bedroom	0.20	Pass	32	Pass
A1-3-1 1B2P KLR	3.50	Fail	N/A	-
A1-3-10 2B3P Bedroom	1.80	Pass	54	Fail
A1-3-10 2B3P KLR	4.50	Fail	N/A	-
A1-3-10 2B3P Single Bedroom	2.10	Pass	45	Fail
A1-3-11 1B2P Bedroom	1.60	Pass	47	Fail
A1-3-11 1B2P KLR	3.80	Fail	N/A	-
A1-3-12 1B2P Bedroom	1.70	Pass	45	Fail
A1-3-12 1B2P KLR	3.70	Fail	N/A	-
A1-3-2 2B3P Bedroom	0.00	Pass	14	Pass
A1-3-2 2B3P KLR	0.40	Pass	N/A	-
A1-3-2 2B3P Single Bedroom	0.00	Pass	21	Pass
A1-3-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-3-3 1B2P KLR	0.00	Pass	N/A	-
A1-3-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-3-4 1B2P KLR	0.00	Pass	N/A	-
A1-3-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-3-5 2B4P Bedroom 1	0.00	Pass	13	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-3-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-3-5 2B4P KLR	0.00	Pass	N/A	-
A1-3-6 2B3P Bedroom	0.10	Pass	41	Fail
A1-3-6 2B3P KLR	1.00	Pass	N/A	-
A1-3-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-3-7 2B3P Bedroom	0.30	Pass	44	Fail
A1-3-7 2B3P KLR	3.00	Pass	N/A	-
A1-3-7 2B3P Single Bedroom	0.70	Pass	29	Pass
A1-3-8 1B2P Bedroom	1.80	Pass	41	Fail
A1-3-8 1B2P KLR	4.50	Fail	N/A	-
A1-3-9 2B3P Bedroom	1.90	Pass	55	Fail
A1-3-9 2B3P KLR	5.00	Fail	N/A	-
A1-3-9 2B3P Single Bedroom	2.40	Pass	45	Fail
A1-4-1 1B2P Bedroom	0.20	Pass	32	Pass
A1-4-1 1B2P KLR	3.50	Fail	N/A	-
A1-4-10 2B3P Bedroom	1.80	Pass	54	Fail
A1-4-10 2B3P KLR	4.50	Fail	N/A	-
A1-4-10 2B3P Single Bedroom	2.10	Pass	44	Fail
A1-4-11 1B2P Bedroom	1.60	Pass	46	Fail
A1-4-11 1B2P KLR	3.70	Fail	N/A	-
A1-4-12 1B2P Bedroom	1.70	Pass	44	Fail
A1-4-12 1B2P KLR	3.70	Fail	N/A	-
A1-4-2 2B3P Bedroom	0.00	Pass	13	Pass
A1-4-2 2B3P KLR	0.40	Pass	N/A	-
A1-4-2 2B3P Single Bedroom	0.00	Pass	21	Pass
A1-4-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-4-3 1B2P KLR	0.00	Pass	N/A	-
A1-4-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-4-4 1B2P KLR	0.00	Pass	N/A	-
A1-4-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-4-5 2B4P Bedroom 1	0.00	Pass	13	Pass
A1-4-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-4-5 2B4P KLR	0.00	Pass	N/A	-
A1-4-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-4-6 2B3P KLR	1.00	Pass	N/A	-
A1-4-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-4-7 2B3P Bedroom	0.30	Pass	43	Fail
A1-4-7 2B3P KLR	3.00	Pass	N/A	-
A1-4-7 2B3P Single Bedroom	0.70	Pass	29	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-4-8 1B2P Bedroom	1.70	Pass	41	Fail
A1-4-8 1B2P KLR	4.40	Fail	N/A	-
A1-4-9 2B3P Bedroom	1.90	Pass	55	Fail
A1-4-9 2B3P KLR	5.00	Fail	N/A	-
A1-4-9 2B3P Single Bedroom	2.30	Pass	45	Fail
A1-5-1 1B2P Bedroom	0.10	Pass	32	Pass
A1-5-1 1B2P KLR	3.40	Fail	N/A	-
A1-5-10 2B3P Bedroom	1.80	Pass	54	Fail
A1-5-10 2B3P KLR	4.50	Fail	N/A	-
A1-5-10 2B3P Single Bedroom	2.10	Pass	43	Fail
A1-5-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-5-11 1B2P KLR	3.70	Fail	N/A	-
A1-5-12 1B2P Bedroom	1.70	Pass	44	Fail
A1-5-12 1B2P KLR	3.70	Fail	N/A	-
A1-5-2 2B3P Bedroom	0.00	Pass	13	Pass
A1-5-2 2B3P KLR	0.40	Pass	N/A	-
A1-5-2 2B3P Single Bedroom	0.00	Pass	20	Pass
A1-5-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-5-3 1B2P KLR	0.00	Pass	N/A	-
A1-5-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-5-4 1B2P KLR	0.00	Pass	N/A	-
A1-5-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-5-5 2B4P Bedroom 1	0.00	Pass	13	Pass
A1-5-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-5-5 2B4P KLR	0.00	Pass	N/A	-
A1-5-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-5-6 2B3P KLR	1.00	Pass	N/A	-
A1-5-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-5-7 2B3P Bedroom	0.20	Pass	42	Fail
A1-5-7 2B3P KLR	2.90	Pass	N/A	-
A1-5-7 2B3P Single Bedroom	0.70	Pass	28	Pass
A1-5-8 1B2P Bedroom	1.70	Pass	41	Fail
A1-5-8 1B2P KLR	4.40	Fail	N/A	-
A1-5-9 2B3P Bedroom	1.90	Pass	55	Fail
A1-5-9 2B3P KLR	5.00	Fail	N/A	-
A1-5-9 2B3P Single Bedroom	2.30	Pass	44	Fail
A1-6-1 1B2P Bedroom	0.10	Pass	32	Pass
A1-6-1 1B2P KLR	3.40	Fail	N/A	-
A1-6-10 2B3P Bedroom	1.70	Pass	53	Fail

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-6-10 2B3P KLR	4.50	Fail	N/A	-
A1-6-10 2B3P Single Bedroom	2.10	Pass	42	Fail
A1-6-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-6-11 1B2P KLR	3.70	Fail	N/A	-
A1-6-12 1B2P Bedroom	1.60	Pass	44	Fail
A1-6-12 1B2P KLR	3.70	Fail	N/A	-
A1-6-2 2B3P Bedroom	0.00	Pass	13	Pass
A1-6-2 2B3P KLR	0.30	Pass	N/A	-
A1-6-2 2B3P Single Bedroom	0.00	Pass	19	Pass
A1-6-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-6-3 1B2P KLR	0.00	Pass	N/A	-
A1-6-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-6-4 1B2P KLR	0.00	Pass	N/A	-
A1-6-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-6-5 2B4P Bedroom 1	0.00	Pass	12	Pass
A1-6-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-6-5 2B4P KLR	0.00	Pass	N/A	-
A1-6-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-6-6 2B3P KLR	1.00	Pass	N/A	-
A1-6-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-6-7 2B3P Bedroom	0.20	Pass	42	Fail
A1-6-7 2B3P KLR	2.90	Pass	N/A	-
A1-6-7 2B3P Single Bedroom	0.60	Pass	28	Pass
A1-6-8 1B2P Bedroom	1.70	Pass	41	Fail
A1-6-8 1B2P KLR	4.40	Fail	N/A	-
A1-6-9 2B3P Bedroom	1.90	Pass	55	Fail
A1-6-9 2B3P KLR	4.90	Fail	N/A	-
A1-6-9 2B3P Single Bedroom	2.30	Pass	44	Fail
A1-7-1 1B2P Bedroom	0.10	Pass	32	Pass
A1-7-1 1B2P KLR	3.40	Fail	N/A	-
A1-7-10 2B3P Bedroom	1.70	Pass	52	Fail
A1-7-10 2B3P KLR	4.50	Fail	N/A	-
A1-7-10 2B3P Single Bedroom	2.10	Pass	42	Fail
A1-7-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-7-11 1B2P KLR	3.70	Fail	N/A	-
A1-7-12 1B2P Bedroom	1.60	Pass	43	Fail
A1-7-12 1B2P KLR	3.60	Fail	N/A	-
A1-7-2 2B3P Bedroom	0.00	Pass	13	Pass
A1-7-2 2B3P KLR	0.30	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-7-2 2B3P Single Bedroom	0.00	Pass	19	Pass
A1-7-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-7-3 1B2P KLR	0.00	Pass	N/A	-
A1-7-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-7-4 1B2P KLR	0.00	Pass	N/A	-
A1-7-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-7-5 2B4P Bedroom 1	0.00	Pass	11	Pass
A1-7-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-7-5 2B4P KLR	0.00	Pass	N/A	-
A1-7-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-7-6 2B3P KLR	1.00	Pass	N/A	-
A1-7-6 2B3P Single Bedroom	0.30	Pass	26	Pass
A1-7-7 2B3P Bedroom	0.20	Pass	41	Fail
A1-7-7 2B3P KLR	2.90	Pass	N/A	-
A1-7-7 2B3P Single Bedroom	0.60	Pass	28	Pass
A1-7-8 1B2P Bedroom	1.70	Pass	41	Fail
A1-7-8 1B2P KLR	4.30	Fail	N/A	-
A1-7-9 2B3P Bedroom	1.80	Pass	55	Fail
A1-7-9 2B3P KLR	4.90	Fail	N/A	-
A1-7-9 2B3P Single Bedroom	2.30	Pass	43	Fail
A1-8-1 1B2P Bedroom	0.10	Pass	31	Pass
A1-8-1 1B2P KLR	3.40	Fail	N/A	-
A1-8-10 2B3P Bedroom	1.70	Pass	52	Fail
A1-8-10 2B3P KLR	4.40	Fail	N/A	-
A1-8-10 2B3P Single Bedroom	2.10	Pass	42	Fail
A1-8-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-8-11 1B2P KLR	3.70	Fail	N/A	-
A1-8-12 1B2P Bedroom	1.60	Pass	43	Fail
A1-8-12 1B2P KLR	3.60	Fail	N/A	-
A1-8-2 2B3P Bedroom	0.00	Pass	12	Pass
A1-8-2 2B3P KLR	0.40	Pass	N/A	-
A1-8-2 2B3P Single Bedroom	0.00	Pass	19	Pass
A1-8-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-8-3 1B2P KLR	0.00	Pass	N/A	-
A1-8-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-8-4 1B2P KLR	0.00	Pass	N/A	-
A1-8-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-8-5 2B4P Bedroom 1	0.00	Pass	11	Pass
A1-8-5 2B4P Bedroom 2	0.00	Pass	5	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-8-5 2B4P KLR	0.00	Pass	N/A	-
A1-8-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-8-6 2B3P KLR	1.00	Pass	N/A	-
A1-8-6 2B3P Single Bedroom	0.30	Pass	25	Pass
A1-8-7 2B3P Bedroom	0.20	Pass	41	Fail
A1-8-7 2B3P KLR	2.90	Pass	N/A	-
A1-8-7 2B3P Single Bedroom	0.60	Pass	28	Pass
A1-8-8 1B2P Bedroom	1.70	Pass	41	Fail
A1-8-8 1B2P KLR	4.30	Fail	N/A	-
A1-8-9 2B3P Bedroom	1.80	Pass	55	Fail
A1-8-9 2B3P KLR	4.90	Fail	N/A	-
A1-8-9 2B3P Single Bedroom	2.20	Pass	43	Fail
A1-9-1 1B2P Bedroom	0.10	Pass	31	Pass
A1-9-1 1B2P KLR	3.40	Fail	N/A	-
A1-9-10 2B3P Bedroom	1.70	Pass	52	Fail
A1-9-10 2B3P KLR	4.30	Fail	N/A	-
A1-9-10 2B3P Single Bedroom	2.00	Pass	42	Fail
A1-9-11 1B2P Bedroom	1.60	Pass	44	Fail
A1-9-11 1B2P KLR	3.70	Fail	N/A	-
A1-9-12 1B2P Bedroom	1.60	Pass	43	Fail
A1-9-12 1B2P KLR	3.60	Fail	N/A	-
A1-9-2 2B3P Bedroom	0.00	Pass	12	Pass
A1-9-2 2B3P KLR	0.30	Pass	N/A	-
A1-9-2 2B3P Single Bedroom	0.00	Pass	19	Pass
A1-9-3 1B2P Bedroom	0.00	Pass	23	Pass
A1-9-3 1B2P KLR	0.00	Pass	N/A	-
A1-9-4 1B2P Bedroom	0.00	Pass	7	Pass
A1-9-4 1B2P KLR	0.00	Pass	N/A	-
A1-9-5 2B4P Bedroom	0.00	Pass	20	Pass
A1-9-5 2B4P Bedroom 1	0.00	Pass	11	Pass
A1-9-5 2B4P Bedroom 2	0.00	Pass	5	Pass
A1-9-5 2B4P KLR	0.00	Pass	N/A	-
A1-9-6 2B3P Bedroom	0.10	Pass	40	Fail
A1-9-6 2B3P KLR	1.00	Pass	N/A	-
A1-9-6 2B3P Single Bedroom	0.30	Pass	25	Pass
A1-9-7 2B3P Bedroom	0.20	Pass	41	Fail
A1-9-7 2B3P KLR	2.90	Pass	N/A	-
A1-9-7 2B3P Single Bedroom	0.60	Pass	28	Pass
A1-9-8 1B2P Bedroom	1.70	Pass	41	Fail

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
A1-9-8 1B2P KLR	4.30	Fail	N/A	-
A1-9-9 2B3P Bedroom	1.80	Pass	53	Fail
A1-9-9 2B3P KLR	4.90	Fail	N/A	-
A1-9-9 2B3P Single Bedroom	2.10	Pass	43	Fail
B1-10-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-10-1 2B3P KLR	0.50	Pass	N/A	-
B1-10-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-10-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-10-2 2B3P KLR	0.40	Pass	N/A	-
B1-10-2 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-10-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-10-3 1B2P KLR	0.00	Pass	N/A	-
B1-10-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-10-4 2B3P KLR	0.00	Pass	N/A	-
B1-10-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-10-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-10-5 2B3P KLR	2.20	Pass	N/A	-
B1-10-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-10-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-10-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-10-6 3B5P KLR	2.80	Pass	N/A	-
B1-10-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-10-7 2B3P Bedroom	0.20	Pass	16	Pass
B1-10-7 2B3P KLR	3.70	Fail	N/A	-
B1-10-7 2B3P Single Bedroom	0.90	Pass	14	Pass
B1-10-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-10-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-1 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-1-1 2B3P KLR	0.80	Pass	N/A	-
B1-1-1 2B3P Single Bedroom	0.10	Pass	15	Pass
B1-11-1 2B3P Bedroom 1	0.00	Pass	12	Pass
B1-11-1 2B3P KLR	0.50	Pass	N/A	-
B1-11-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-11-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-11-2 2B3P KLR	0.50	Pass	N/A	-
B1-11-2 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-11-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-11-3 1B2P KLR	0.00	Pass	N/A	-
B1-11-4 2B3P Bedroom 1	0.00	Pass	15	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-11-4 2B3P KLR	0.00	Pass	N/A	-
B1-11-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-11-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-11-5 2B3P KLR	2.20	Pass	N/A	-
B1-11-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-11-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-11-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-11-6 3B5P KLR	2.80	Pass	N/A	-
B1-11-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-11-7 2B3P Bedroom	0.20	Pass	16	Pass
B1-11-7 2B3P KLR	3.60	Fail	N/A	-
B1-11-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-11-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-11-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-2 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-1-2 2B3P KLR	0.70	Pass	N/A	-
B1-1-2 2B3P Single Bedroom	0.10	Pass	15	Pass
B1-12-1 2B3P Bedroom 1	0.00	Pass	12	Pass
B1-12-1 2B3P KLR	0.50	Pass	N/A	-
B1-12-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-12-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-12-2 2B3P KLR	0.50	Pass	N/A	-
B1-12-2 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-12-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-12-3 1B2P KLR	0.00	Pass	N/A	-
B1-12-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-12-4 2B3P KLR	0.00	Pass	N/A	-
B1-12-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-12-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-12-5 2B3P KLR	2.20	Pass	N/A	-
B1-12-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-12-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-12-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-12-6 3B5P KLR	2.80	Pass	N/A	-
B1-12-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-12-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-12-7 2B3P KLR	3.60	Fail	N/A	-
B1-12-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-12-8 1B2P Bedroom	0.00	Pass	11	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-12-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-3 1B2P Bedroom	0.00	Pass	16	Pass
B1-1-3 1B2P KLR	0.00	Pass	N/A	-
B1-13-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-13-1 2B3P KLR	0.50	Pass	N/A	-
B1-13-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-13-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-13-2 2B3P KLR	0.50	Pass	N/A	-
B1-13-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-13-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-13-3 1B2P KLR	0.00	Pass	N/A	-
B1-13-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-13-4 2B3P KLR	0.00	Pass	N/A	-
B1-13-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-13-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-13-5 2B3P KLR	2.20	Pass	N/A	-
B1-13-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-13-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-13-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-13-6 3B5P KLR	2.80	Pass	N/A	-
B1-13-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-13-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-13-7 2B3P KLR	3.60	Fail	N/A	-
B1-13-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-13-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-13-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-4 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-1-4 2B3P KLR	0.10	Pass	N/A	-
B1-1-4 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-14-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-14-1 2B3P KLR	0.50	Pass	N/A	-
B1-14-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-14-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-14-2 2B3P KLR	0.50	Pass	N/A	-
B1-14-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-14-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-14-3 1B2P KLR	0.00	Pass	N/A	-
B1-14-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-14-4 2B3P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-14-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-14-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-14-5 2B3P KLR	2.20	Pass	N/A	-
B1-14-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-14-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-14-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-14-6 3B5P KLR	2.80	Pass	N/A	-
B1-14-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-14-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-14-7 2B3P KLR	3.60	Fail	N/A	-
B1-14-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-14-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-14-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-5 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-1-5 2B3P KLR	0.60	Pass	N/A	-
B1-1-5 2B3P Single Bedroom	0.10	Pass	15	Pass
B1-15-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-15-1 2B3P KLR	0.50	Pass	N/A	-
B1-15-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-15-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-15-2 2B3P KLR	0.50	Pass	N/A	-
B1-15-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-15-3 1B2P Bedroom	0.00	Pass	13	Pass
B1-15-3 1B2P KLR	0.00	Pass	N/A	-
B1-15-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-15-4 2B3P KLR	0.00	Pass	N/A	-
B1-15-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-15-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-15-5 2B3P KLR	2.20	Pass	N/A	-
B1-15-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-15-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-15-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-15-6 3B5P KLR	2.80	Pass	N/A	-
B1-15-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-15-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-15-7 2B3P KLR	3.60	Fail	N/A	-
B1-15-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-15-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-15-8 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-1-6 3B5P Bedroom 1	0.00	Pass	10	Pass
B1-1-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-1-6 3B5P KLR	0.40	Pass	N/A	-
B1-1-6 3B5P Single Bedroom 3	0.00	Pass	15	Pass
B1-16-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-16-1 2B3P KLR	0.50	Pass	N/A	-
B1-16-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-16-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-16-2 2B3P KLR	0.50	Pass	N/A	-
B1-16-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-16-3 1B2P Bedroom	0.00	Pass	13	Pass
B1-16-3 1B2P KLR	0.00	Pass	N/A	-
B1-16-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-16-4 2B3P KLR	0.00	Pass	N/A	-
B1-16-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-16-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-16-5 2B3P KLR	2.20	Pass	N/A	-
B1-16-5 2B3P Single Bedroom	0.90	Pass	13	Pass
B1-16-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-16-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-16-6 3B5P KLR	2.80	Pass	N/A	-
B1-16-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-16-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-16-7 2B3P KLR	3.60	Fail	N/A	-
B1-16-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-16-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-16-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-7 2B3P Bedroom	0.10	Pass	17	Pass
B1-1-7 2B3P KLR	2.10	Pass	N/A	-
B1-1-7 2B3P Single Bedroom	0.70	Pass	17	Pass
B1-17-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-17-1 2B3P KLR	0.50	Pass	N/A	-
B1-17-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-17-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-17-2 2B3P KLR	0.50	Pass	N/A	-
B1-17-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-17-3 1B2P Bedroom	0.00	Pass	13	Pass
B1-17-3 1B2P KLR	0.00	Pass	N/A	-
B1-17-4 2B3P Bedroom 1	0.00	Pass	15	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-17-4 2B3P KLR	0.00	Pass	N/A	-
B1-17-4 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-17-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-17-5 2B3P KLR	2.50	Pass	N/A	-
B1-17-5 2B3P Single Bedroom	1.00	Pass	13	Pass
B1-17-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-17-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-17-6 3B5P KLR	2.80	Pass	N/A	-
B1-17-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-17-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-17-7 2B3P KLR	3.60	Fail	N/A	-
B1-17-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-17-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-17-8 1B2P KLR	0.00	Pass	N/A	-
B1-1-8 1B2P Bedroom	0.00	Pass	15	Pass
B1-1-8 1B2P KLR	0.10	Pass	N/A	-
B1-18-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-18-1 2B3P KLR	0.50	Pass	N/A	-
B1-18-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-18-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-18-2 2B3P KLR	0.50	Pass	N/A	-
B1-18-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-18-3 1B2P Bedroom	0.00	Pass	13	Pass
B1-18-3 1B2P KLR	0.00	Pass	N/A	-
B1-18-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-18-4 2B3P KLR	0.00	Pass	N/A	-
B1-18-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-18-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-18-5 2B3P KLR	2.60	Pass	N/A	-
B1-18-5 2B3P Single Bedroom	1.20	Pass	13	Pass
B1-18-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-18-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-18-6 3B5P KLR	2.80	Pass	N/A	-
B1-18-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-18-7 2B3P Bedroom	0.20	Pass	15	Pass
B1-18-7 2B3P KLR	3.60	Fail	N/A	-
B1-18-7 2B3P Single Bedroom	0.90	Pass	12	Pass
B1-18-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-18-8 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-19-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-19-1 2B3P KLR	0.60	Pass	N/A	-
B1-19-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-19-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-19-2 2B3P KLR	0.50	Pass	N/A	-
B1-19-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-19-3 1B2P Bedroom	0.00	Pass	13	Pass
B1-19-3 1B2P KLR	0.00	Pass	N/A	-
B1-19-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-19-4 2B3P KLR	0.00	Pass	N/A	-
B1-19-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-19-5 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-19-5 2B3P KLR	3.30	Fail	N/A	-
B1-19-5 2B3P Single Bedroom	1.60	Pass	13	Pass
B1-19-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-19-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-19-6 3B5P KLR	2.70	Pass	N/A	-
B1-19-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-19-7 2B3P Bedroom	0.20	Pass	14	Pass
B1-19-7 2B3P KLR	3.50	Fail	N/A	-
B1-19-7 2B3P Single Bedroom	0.80	Pass	12	Pass
B1-19-8 1B2P Bedroom	0.00	Pass	11	Pass
B1-19-8 1B2P KLR	0.00	Pass	N/A	-
B1-20-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-20-1 2B3P KLR	0.80	Pass	N/A	-
B1-20-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-20-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-20-2 2B3P KLR	0.40	Pass	N/A	-
B1-20-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-20-3 1B2P Bedroom	0.00	Pass	12	Pass
B1-20-3 1B2P KLR	0.00	Pass	N/A	-
B1-20-4 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-20-4 2B3P KLR	0.00	Pass	N/A	-
B1-20-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-20-5 2B3P Bedroom 1	0.40	Pass	11	Pass
B1-20-5 2B3P KLR	3.50	Fail	N/A	-
B1-20-5 2B3P Single Bedroom	1.70	Pass	14	Pass
B1-2-1 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-2-1 2B3P KLR	0.50	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-2-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-21-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-21-1 2B3P KLR	0.80	Pass	N/A	-
B1-21-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-21-2 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-21-2 2B3P KLR	0.40	Pass	N/A	-
B1-21-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-21-3 1B2P Bedroom	0.00	Pass	12	Pass
B1-21-3 1B2P KLR	0.00	Pass	N/A	-
B1-21-4 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-21-4 2B3P KLR	0.00	Pass	N/A	-
B1-21-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-21-5 2B3P Bedroom 1	0.40	Pass	11	Pass
B1-21-5 2B3P KLR	3.50	Fail	N/A	-
B1-21-5 2B3P Single Bedroom	1.70	Pass	14	Pass
B1-2-2 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-2-2 2B3P KLR	0.60	Pass	N/A	-
B1-2-2 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-22-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-22-1 2B3P KLR	0.80	Pass	N/A	-
B1-22-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-22-2 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-22-2 2B3P KLR	0.40	Pass	N/A	-
B1-22-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-22-3 1B2P Bedroom	0.00	Pass	12	Pass
B1-22-3 1B2P KLR	0.00	Pass	N/A	-
B1-22-4 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-22-4 2B3P KLR	0.00	Pass	N/A	-
B1-22-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-22-5 2B3P Bedroom 1	0.40	Pass	11	Pass
B1-22-5 2B3P KLR	3.50	Fail	N/A	-
B1-22-5 2B3P Single Bedroom	1.70	Pass	14	Pass
B1-2-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-2-3 1B2P KLR	0.00	Pass	N/A	-
B1-23-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-23-1 2B3P KLR	0.80	Pass	N/A	-
B1-23-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-23-2 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-23-2 2B3P KLR	0.40	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-23-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-23-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-23-3 1B2P KLR	0.00	Pass	N/A	-
B1-23-4 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-23-4 2B3P KLR	0.00	Pass	N/A	-
B1-23-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-23-5 2B3P Bedroom 1	0.40	Pass	11	Pass
B1-23-5 2B3P KLR	3.50	Fail	N/A	-
B1-23-5 2B3P Single Bedroom	1.70	Pass	14	Pass
B1-2-4 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-2-4 2B3P KLR	0.00	Pass	N/A	-
B1-2-4 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-24-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-24-1 2B3P KLR	0.80	Pass	N/A	-
B1-24-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-24-2 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-24-2 2B3P KLR	0.40	Pass	N/A	-
B1-24-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-24-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-24-3 1B2P KLR	0.00	Pass	N/A	-
B1-24-4 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-24-4 2B3P KLR	0.00	Pass	N/A	-
B1-24-4 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-24-5 2B3P Bedroom 1	0.40	Pass	11	Pass
B1-24-5 2B3P KLR	3.40	Fail	N/A	-
B1-24-5 2B3P Single Bedroom	1.70	Pass	14	Pass
B1-2-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-2-5 2B3P KLR	0.20	Pass	N/A	-
B1-2-5 2B3P Single Bedroom	0.10	Pass	14	Pass
B1-25-1 2B3P Bedroom	0.00	Pass	11	Pass
B1-25-1 2B3P KLR	1.00	Pass	N/A	-
B1-25-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-25-2 2B3P Bedroom	0.00	Pass	11	Pass
B1-25-2 2B3P KLR	0.30	Pass	N/A	-
B1-25-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-25-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-25-3 1B2P KLR	0.00	Pass	N/A	-
B1-25-4 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-25-4 2B4P Bedroom 2	0.00	Pass	11	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-25-4 2B4P KLR	0.00	Pass	N/A	-
B1-25-5 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-25-5 2B4P Bedroom 2	0.00	Pass	7	Pass
B1-25-5 2B4P KLR	0.00	Pass	N/A	-
B1-25-6 2B4P Bedroom 1	0.80	Pass	16	Pass
B1-25-6 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-25-6 2B4P KLR	1.70	Pass	N/A	-
B1-25-7 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-25-7 2B4P Bedroom 2	0.00	Pass	9	Pass
B1-2-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-2-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-2-6 3B5P KLR	0.30	Pass	N/A	-
B1-2-6 3B5P Single Bedroom 3	0.00	Pass	14	Pass
B1-26-1 2B3P Bedroom	0.00	Pass	11	Pass
B1-26-1 2B3P KLR	1.00	Pass	N/A	-
B1-26-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-26-2 2B3P Bedroom	0.00	Pass	11	Pass
B1-26-2 2B3P KLR	0.30	Pass	N/A	-
B1-26-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-26-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-26-3 1B2P KLR	0.00	Pass	N/A	-
B1-26-4 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-26-4 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-26-4 2B4P KLR	0.00	Pass	N/A	-
B1-26-5 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-26-5 2B4P Bedroom 2	0.00	Pass	7	Pass
B1-26-5 2B4P KLR	0.00	Pass	N/A	-
B1-26-6 2B4P Bedroom 1	0.80	Pass	16	Pass
B1-26-6 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-26-6 2B4P KLR	1.70	Pass	N/A	-
B1-26-7 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-26-7 2B4P Bedroom 2	0.00	Pass	8	Pass
B1-2-7 2B3P Bedroom	0.10	Pass	17	Pass
B1-2-7 2B3P KLR	2.10	Pass	N/A	-
B1-2-7 2B3P Single Bedroom	0.50	Pass	15	Pass
B1-27-1 2B3P Bedroom	0.00	Pass	11	Pass
B1-27-1 2B3P Bedroom	0.00	Pass	11	Pass
B1-27-1 2B3P KLR	1.00	Pass	N/A	-
B1-27-1 2B3P KLR	0.90	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-27-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-27-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-27-2 2B3P Bedroom	0.00	Pass	11	Pass
B1-27-2 2B3P Bedroom	0.00	Pass	11	Pass
B1-27-2 2B3P KLR	0.30	Pass	N/A	-
B1-27-2 2B3P KLR	0.30	Pass	N/A	-
B1-27-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-27-2 2B3P Single Bedroom	0.00	Pass	11	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-27-3 1B2P Bedroom	0.00	Pass	11	Pass
B1-27-3 1B2P KLR	0.00	Pass	N/A	-
B1-27-3 1B2P KLR	0.00	Pass	N/A	-
B1-27-4 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-27-4 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-27-4 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-4 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-27-5 2B4P Bedroom 1	0.00	Pass	10	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	7	Pass
B1-27-5 2B4P Bedroom 2	0.00	Pass	7	Pass
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-5 2B4P KLR	0.00	Pass	N/A	-
B1-27-6 2B4P Bedroom 1	0.80	Pass	15	Pass
B1-27-6 2B4P Bedroom 1	0.70	Pass	15	Pass
B1-27-6 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-27-6 2B4P Bedroom 2	0.00	Pass	11	Pass
B1-27-6 2B4P KLR	1.70	Pass	N/A	-
B1-27-6 2B4P KLR	1.60	Pass	N/A	-
B1-27-7 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-27-7 2B4P Bedroom 1	0.00	Pass	11	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	8	Pass
B1-27-7 2B4P Bedroom 2	0.00	Pass	8	Pass
B1-2-8 1B2P Bedroom	0.00	Pass	14	Pass
B1-2-8 1B2P KLR	0.10	Pass	N/A	-
B1-3-1 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-3-1 2B3P KLR	0.50	Pass	N/A	-
B1-3-1 2B3P Single Bedroom	0.10	Pass	11	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-3-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-3-2 2B3P KLR	0.60	Pass	N/A	-
B1-3-2 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-3-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-3-3 1B2P KLR	0.00	Pass	N/A	-
B1-3-4 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-3-4 2B3P KLR	0.00	Pass	N/A	-
B1-3-4 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-3-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-3-5 2B3P KLR	0.30	Pass	N/A	-
B1-3-5 2B3P Single Bedroom	0.10	Pass	14	Pass
B1-3-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-3-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-3-6 3B5P KLR	0.30	Pass	N/A	-
B1-3-6 3B5P Single Bedroom 3	0.00	Pass	14	Pass
B1-3-7 2B3P Bedroom	0.10	Pass	17	Pass
B1-3-7 2B3P KLR	2.20	Pass	N/A	-
B1-3-7 2B3P Single Bedroom	0.50	Pass	15	Pass
B1-3-8 1B2P Bedroom	0.00	Pass	14	Pass
B1-3-8 1B2P KLR	0.10	Pass	N/A	-
B1-4-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B1-4-1 2B3P KLR	0.50	Pass	N/A	-
B1-4-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-4-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-4-2 2B3P KLR	0.60	Pass	N/A	-
B1-4-2 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-4-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-4-3 1B2P KLR	0.00	Pass	N/A	-
B1-4-4 2B3P Bedroom 1	0.00	Pass	16	Pass
B1-4-4 2B3P KLR	0.00	Pass	N/A	-
B1-4-4 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-4-5 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-4-5 2B3P KLR	1.00	Pass	N/A	-
B1-4-5 2B3P Single Bedroom	0.50	Pass	15	Pass
B1-4-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-4-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-4-6 3B5P KLR	0.30	Pass	N/A	-
B1-4-6 3B5P Single Bedroom 3	0.00	Pass	12	Pass
B1-4-7 2B3P Bedroom	0.10	Pass	17	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-4-7 2B3P KLR	2.40	Pass	N/A	-
B1-4-7 2B3P Single Bedroom	0.60	Pass	15	Pass
B1-4-8 1B2P Bedroom	0.00	Pass	14	Pass
B1-4-8 1B2P KLR	0.10	Pass	N/A	-
B1-5-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B1-5-1 2B3P KLR	0.50	Pass	N/A	-
B1-5-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-5-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-5-2 2B3P KLR	0.50	Pass	N/A	-
B1-5-2 2B3P Single Bedroom	0.00	Pass	14	Pass
B1-5-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-5-3 1B2P KLR	0.00	Pass	N/A	-
B1-5-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-5-4 2B3P KLR	0.00	Pass	N/A	-
B1-5-4 2B3P Single Bedroom	0.00	Pass	15	Pass
B1-5-5 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-5-5 2B3P KLR	1.20	Pass	N/A	-
B1-5-5 2B3P Single Bedroom	0.50	Pass	15	Pass
B1-5-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-5-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-5-6 3B5P KLR	0.50	Pass	N/A	-
B1-5-6 3B5P Single Bedroom 3	0.00	Pass	12	Pass
B1-5-7 2B3P Bedroom	0.10	Pass	17	Pass
B1-5-7 2B3P KLR	2.70	Pass	N/A	-
B1-5-7 2B3P Single Bedroom	0.60	Pass	15	Pass
B1-5-8 1B2P Bedroom	0.00	Pass	14	Pass
B1-5-8 1B2P KLR	0.00	Pass	N/A	-
B1-6-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B1-6-1 2B3P KLR	0.50	Pass	N/A	-
B1-6-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-6-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-6-2 2B3P KLR	0.50	Pass	N/A	-
B1-6-2 2B3P Single Bedroom	0.00	Pass	14	Pass
B1-6-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-6-3 1B2P KLR	0.00	Pass	N/A	-
B1-6-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-6-4 2B3P KLR	0.00	Pass	N/A	-
B1-6-4 2B3P Single Bedroom	0.00	Pass	14	Pass
B1-6-5 2B3P Bedroom 1	0.00	Pass	11	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-6-5 2B3P KLR	1.90	Pass	N/A	-
B1-6-5 2B3P Single Bedroom	0.70	Pass	15	Pass
B1-6-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-6-6 3B5P Bedroom 2	0.00	Pass	15	Pass
B1-6-6 3B5P KLR	0.90	Pass	N/A	-
B1-6-6 3B5P Single Bedroom 3	0.00	Pass	12	Pass
B1-6-7 2B3P Bedroom	0.10	Pass	17	Pass
B1-6-7 2B3P KLR	2.80	Pass	N/A	-
B1-6-7 2B3P Single Bedroom	0.70	Pass	15	Pass
B1-6-8 1B2P Bedroom	0.00	Pass	14	Pass
B1-6-8 1B2P KLR	0.00	Pass	N/A	-
B1-7-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-7-1 2B3P KLR	0.50	Pass	N/A	-
B1-7-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-7-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-7-2 2B3P KLR	0.50	Pass	N/A	-
B1-7-2 2B3P Single Bedroom	0.00	Pass	13	Pass
B1-7-3 1B2P Bedroom	0.00	Pass	15	Pass
B1-7-3 1B2P KLR	0.00	Pass	N/A	-
B1-7-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-7-4 2B3P KLR	0.00	Pass	N/A	-
B1-7-4 2B3P Single Bedroom	0.00	Pass	14	Pass
B1-7-5 2B3P Bedroom 1	0.00	Pass	11	Pass
B1-7-5 2B3P KLR	2.10	Pass	N/A	-
B1-7-5 2B3P Single Bedroom	0.80	Pass	14	Pass
B1-7-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-7-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-7-6 3B5P KLR	2.00	Pass	N/A	-
B1-7-6 3B5P Single Bedroom 3	0.00	Pass	12	Pass
B1-7-7 2B3P Bedroom	0.20	Pass	17	Pass
B1-7-7 2B3P KLR	3.60	Fail	N/A	-
B1-7-7 2B3P Single Bedroom	0.90	Pass	15	Pass
B1-7-8 1B2P Bedroom	0.00	Pass	13	Pass
B1-7-8 1B2P KLR	0.00	Pass	N/A	-
B1-8-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-8-1 2B3P KLR	0.50	Pass	N/A	-
B1-8-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-8-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-8-2 2B3P KLR	0.50	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-8-2 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-8-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-8-3 1B2P KLR	0.00	Pass	N/A	-
B1-8-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-8-4 2B3P KLR	0.00	Pass	N/A	-
B1-8-4 2B3P Single Bedroom	0.00	Pass	13	Pass
B1-8-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-8-5 2B3P KLR	2.10	Pass	N/A	-
B1-8-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-8-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-8-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-8-6 3B5P KLR	2.30	Pass	N/A	-
B1-8-6 3B5P Single Bedroom 3	0.00	Pass	11	Pass
B1-8-7 2B3P Bedroom	0.20	Pass	17	Pass
B1-8-7 2B3P KLR	3.70	Fail	N/A	-
B1-8-7 2B3P Single Bedroom	0.90	Pass	15	Pass
B1-8-8 1B2P Bedroom	0.00	Pass	12	Pass
B1-8-8 1B2P KLR	0.00	Pass	N/A	-
B1-9-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B1-9-1 2B3P KLR	0.50	Pass	N/A	-
B1-9-1 2B3P Single Bedroom	0.10	Pass	11	Pass
B1-9-2 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-9-2 2B3P KLR	0.40	Pass	N/A	-
B1-9-2 2B3P Single Bedroom	0.00	Pass	12	Pass
B1-9-3 1B2P Bedroom	0.00	Pass	14	Pass
B1-9-3 1B2P KLR	0.00	Pass	N/A	-
B1-9-4 2B3P Bedroom 1	0.00	Pass	15	Pass
B1-9-4 2B3P KLR	0.00	Pass	N/A	-
B1-9-4 2B3P Single Bedroom	0.00	Pass	13	Pass
B1-9-5 2B3P Bedroom 1	0.00	Pass	10	Pass
B1-9-5 2B3P KLR	2.20	Pass	N/A	-
B1-9-5 2B3P Single Bedroom	0.80	Pass	13	Pass
B1-9-6 3B5P Bedroom 1	0.00	Pass	8	Pass
B1-9-6 3B5P Bedroom 2	0.00	Pass	16	Pass
B1-9-6 3B5P KLR	2.70	Pass	N/A	-
B1-9-6 3B5P Single Bedroom 3	0.10	Pass	11	Pass
B1-9-7 2B3P Bedroom	0.20	Pass	16	Pass
B1-9-7 2B3P KLR	3.70	Fail	N/A	-
B1-9-7 2B3P Single Bedroom	0.90	Pass	15	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B1-9-8 1B2P Bedroom	0.00	Pass	12	Pass
B1-9-8 1B2P KLR	0.00	Pass	N/A	-
B2-10-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-10-1 2B3P KLR	0.00	Pass	N/A	-
B2-10-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-10-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-10-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-10-2 2B4P KLR	0.20	Pass	N/A	-
B2-10-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-10-3 1B2P KLR	0.00	Pass	N/A	-
B2-10-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-10-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-10-4 2B4P KLR	3.70	Fail	N/A	-
B2-10-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-10-5 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-10-5 2B4P KLR	3.60	Fail	N/A	-
B2-10-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-10-6 2B3P KLR	3.00	Pass	N/A	-
B2-10-6 2B3P Single Bedroom	1.80	Pass	17	Pass
B2-10-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-10-7 2B3P KLR	0.00	Pass	N/A	-
B2-10-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-1 2B3P Bedroom 1	0.00	Pass	15	Pass
B2-1-1 2B3P KLR	0.00	Pass	N/A	-
B2-1-1 2B3P Single Bedroom	0.00	Pass	14	Pass
B2-11-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B2-11-1 2B3P KLR	0.00	Pass	N/A	-
B2-11-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-11-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-11-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-11-2 2B4P KLR	0.20	Pass	N/A	-
B2-11-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-11-3 1B2P KLR	0.00	Pass	N/A	-
B2-11-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-11-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-11-4 2B4P KLR	3.70	Fail	N/A	-
B2-11-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-11-5 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-11-5 2B4P KLR	3.60	Fail	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-11-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-11-6 2B3P KLR	3.10	Fail	N/A	-
B2-11-6 2B3P Single Bedroom	1.80	Pass	17	Pass
B2-11-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-11-7 2B3P KLR	0.00	Pass	N/A	-
B2-11-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-2 2B4P Bedroom 1	0.00	Pass	16	Pass
B2-1-2 2B4P Bedroom 1	0.00	Pass	17	Pass
B2-1-2 2B4P KLR	0.60	Pass	N/A	-
B2-12-1 2B3P Bedroom 1	0.00	Pass	13	Pass
B2-12-1 2B3P KLR	0.00	Pass	N/A	-
B2-12-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-12-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-12-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-12-2 2B4P KLR	0.20	Pass	N/A	-
B2-12-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-12-3 1B2P KLR	0.00	Pass	N/A	-
B2-12-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-12-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-12-4 2B4P KLR	3.70	Fail	N/A	-
B2-12-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-12-5 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-12-5 2B4P KLR	3.60	Fail	N/A	-
B2-12-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-12-6 2B3P KLR	3.10	Fail	N/A	-
B2-12-6 2B3P Single Bedroom	1.80	Pass	17	Pass
B2-12-7 2B3P Bedroom	0.00	Pass	13	Pass
B2-12-7 2B3P KLR	0.00	Pass	N/A	-
B2-12-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-3 1B2P Bedroom	0.00	Pass	15	Pass
B2-1-3 1B2P KLR	0.00	Pass	N/A	-
B2-13-1 2B3P Bedroom 1	0.00	Pass	12	Pass
B2-13-1 2B3P KLR	0.00	Pass	N/A	-
B2-13-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-13-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-13-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-13-2 2B4P KLR	0.20	Pass	N/A	-
B2-13-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-13-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-13-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-13-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-13-4 2B4P KLR	3.70	Fail	N/A	-
B2-13-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-13-5 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-13-5 2B4P KLR	3.60	Fail	N/A	-
B2-13-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-13-6 2B3P KLR	3.10	Fail	N/A	-
B2-13-6 2B3P Single Bedroom	1.80	Pass	17	Pass
B2-13-7 2B3P Bedroom	0.00	Pass	13	Pass
B2-13-7 2B3P KLR	0.00	Pass	N/A	-
B2-13-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-4 2B4P Bedroom 1	0.20	Pass	17	Pass
B2-1-4 2B4P Bedroom 2	0.60	Pass	17	Pass
B2-1-4 2B4P KLR	2.30	Pass	N/A	-
B2-14-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-14-1 2B3P KLR	0.00	Pass	N/A	-
B2-14-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-14-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-14-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-14-2 2B4P KLR	0.20	Pass	N/A	-
B2-14-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-14-3 1B2P KLR	0.00	Pass	N/A	-
B2-14-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-14-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-14-4 2B4P KLR	3.70	Fail	N/A	-
B2-14-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-14-5 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-14-5 2B4P KLR	3.60	Fail	N/A	-
B2-14-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-14-6 2B3P KLR	3.00	Pass	N/A	-
B2-14-6 2B3P Single Bedroom	1.80	Pass	16	Pass
B2-14-7 2B3P Bedroom	0.00	Pass	13	Pass
B2-14-7 2B3P KLR	0.00	Pass	N/A	-
B2-14-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-5 2B4P Bedroom 1	0.00	Pass	17	Pass
B2-1-5 2B4P Bedroom 2	0.00	Pass	17	Pass
B2-1-5 2B4P KLR	0.20	Pass	N/A	-
B2-15-1 2B3P Bedroom 1	0.00	Pass	11	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-15-1 2B3P KLR	0.00	Pass	N/A	-
B2-15-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-15-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-15-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-15-2 2B4P KLR	0.20	Pass	N/A	-
B2-15-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-15-3 1B2P KLR	0.00	Pass	N/A	-
B2-15-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-15-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-15-4 2B4P KLR	3.70	Fail	N/A	-
B2-15-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-15-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-15-5 2B4P KLR	3.60	Fail	N/A	-
B2-15-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-15-6 2B3P KLR	3.00	Pass	N/A	-
B2-15-6 2B3P Single Bedroom	1.80	Pass	15	Pass
B2-15-7 2B3P Bedroom	0.00	Pass	13	Pass
B2-15-7 2B3P KLR	0.00	Pass	N/A	-
B2-15-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-6 2B3P Bedroom 1	0.10	Pass	17	Pass
B2-1-6 2B3P KLR	0.10	Pass	N/A	-
B2-1-6 2B3P Single Bedroom	0.50	Pass	15	Pass
B2-16-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-16-1 2B3P KLR	0.00	Pass	N/A	-
B2-16-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-16-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-16-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-16-2 2B4P KLR	0.20	Pass	N/A	-
B2-16-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-16-3 1B2P KLR	0.00	Pass	N/A	-
B2-16-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-16-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-16-4 2B4P KLR	3.70	Fail	N/A	-
B2-16-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-16-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-16-5 2B4P KLR	3.50	Fail	N/A	-
B2-16-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-16-6 2B3P KLR	3.00	Pass	N/A	-
B2-16-6 2B3P Single Bedroom	1.80	Pass	14	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-16-7 2B3P Bedroom	0.00	Pass	12	Pass
B2-16-7 2B3P KLR	0.00	Pass	N/A	-
B2-16-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-1-7 2B3P Bedroom	0.00	Pass	15	Pass
B2-1-7 2B3P KLR	0.00	Pass	N/A	-
B2-1-7 2B3P Single Bedroom	0.00	Pass	15	Pass
B2-17-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-17-1 2B3P KLR	0.00	Pass	N/A	-
B2-17-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-17-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-17-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-17-2 2B4P KLR	0.20	Pass	N/A	-
B2-17-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-17-3 1B2P KLR	0.00	Pass	N/A	-
B2-17-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-17-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-17-4 2B4P KLR	3.70	Fail	N/A	-
B2-17-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-17-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-17-5 2B4P KLR	3.50	Fail	N/A	-
B2-17-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-17-6 2B3P KLR	3.00	Pass	N/A	-
B2-17-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-17-7 2B3P Bedroom	0.00	Pass	11	Pass
B2-17-7 2B3P KLR	0.00	Pass	N/A	-
B2-17-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-18-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-18-1 2B3P KLR	0.00	Pass	N/A	-
B2-18-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-18-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-18-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-18-2 2B4P KLR	0.20	Pass	N/A	-
B2-18-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-18-3 1B2P KLR	0.00	Pass	N/A	-
B2-18-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-18-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-18-4 2B4P KLR	3.70	Fail	N/A	-
B2-18-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-18-5 2B4P Bedroom 2	1.30	Pass	17	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-18-5 2B4P KLR	3.50	Fail	N/A	-
B2-18-6 2B3P Bedroom 1	1.30	Pass	17	Pass
B2-18-6 2B3P KLR	3.00	Pass	N/A	-
B2-18-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-18-7 2B3P Bedroom	0.00	Pass	11	Pass
B2-18-7 2B3P KLR	0.00	Pass	N/A	-
B2-18-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-19-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-19-1 2B3P KLR	0.00	Pass	N/A	-
B2-19-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-19-2 2B4P Bedroom 1	0.00	Pass	14	Pass
B2-19-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-19-2 2B4P KLR	0.20	Pass	N/A	-
B2-19-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-19-3 1B2P KLR	0.00	Pass	N/A	-
B2-19-4 2B4P Bedroom 1	1.40	Pass	17	Pass
B2-19-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-19-4 2B4P KLR	3.70	Fail	N/A	-
B2-19-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-19-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-19-5 2B4P KLR	3.50	Fail	N/A	-
B2-19-6 2B3P Bedroom 1	1.40	Pass	17	Pass
B2-19-6 2B3P KLR	3.10	Fail	N/A	-
B2-19-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-19-7 2B3P Bedroom	0.00	Pass	11	Pass
B2-19-7 2B3P KLR	0.00	Pass	N/A	-
B2-19-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-20-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-20-1 2B3P KLR	0.00	Pass	N/A	-
B2-20-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-20-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-20-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-20-2 2B4P KLR	0.20	Pass	N/A	-
B2-20-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-20-3 1B2P KLR	0.00	Pass	N/A	-
B2-20-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-20-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-20-4 2B4P KLR	3.70	Fail	N/A	-
B2-20-5 2B4P Bedroom 1	1.60	Pass	17	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-20-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-20-5 2B4P KLR	3.50	Fail	N/A	-
B2-20-6 2B3P Bedroom 1	1.40	Pass	17	Pass
B2-20-6 2B3P KLR	3.20	Fail	N/A	-
B2-20-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-20-7 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-20-7 2B3P KLR	0.00	Pass	N/A	-
B2-20-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-2-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-2-1 2B3P KLR	0.00	Pass	N/A	-
B2-2-1 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-21-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-21-1 2B3P KLR	0.00	Pass	N/A	-
B2-21-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-21-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-21-2 2B4P Bedroom 1	0.00	Pass	13	Pass
B2-21-2 2B4P KLR	0.20	Pass	N/A	-
B2-21-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-21-3 1B2P KLR	0.00	Pass	N/A	-
B2-21-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-21-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-21-4 2B4P KLR	3.70	Fail	N/A	-
B2-21-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-21-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-21-5 2B4P KLR	3.50	Fail	N/A	-
B2-21-6 2B3P Bedroom 1	1.40	Pass	17	Pass
B2-21-6 2B3P KLR	3.20	Fail	N/A	-
B2-21-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-21-7 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-21-7 2B3P KLR	0.00	Pass	N/A	-
B2-21-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-2-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-2-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-2-2 2B4P KLR	0.20	Pass	N/A	-
B2-22-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-22-1 2B3P KLR	0.00	Pass	N/A	-
B2-22-1 2B3P Single Bedroom	0.00	Pass	10	Pass
B2-22-2 2B4P Bedroom 1	0.00	Pass	12	Pass
B2-22-2 2B4P Bedroom 1	0.00	Pass	12	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-22-2 2B4P KLR	0.20	Pass	N/A	-
B2-22-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-22-3 1B2P KLR	0.00	Pass	N/A	-
B2-22-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-22-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-22-4 2B4P KLR	3.70	Fail	N/A	-
B2-22-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-22-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-22-5 2B4P KLR	3.50	Fail	N/A	-
B2-22-6 2B3P Bedroom 1	1.40	Pass	17	Pass
B2-22-6 2B3P KLR	3.20	Fail	N/A	-
B2-22-6 2B3P Single Bedroom	1.80	Pass	14	Pass
B2-22-7 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-22-7 2B3P KLR	0.00	Pass	N/A	-
B2-22-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-2-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-2-3 1B2P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-23-1 2B3P KLR	0.00	Pass	N/A	-
B2-23-1 2B3P Single Bedroom	0.00	Pass	10	Pass
B2-23-2 2B4P Bedroom 1	0.00	Pass	12	Pass
B2-23-2 2B4P Bedroom 1	0.00	Pass	12	Pass
B2-23-2 2B4P KLR	0.20	Pass	N/A	-
B2-23-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-23-3 1B2P KLR	0.00	Pass	N/A	-
B2-23-4 2B4P Bedroom 1	1.50	Pass	18	Pass
B2-23-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-23-4 2B4P KLR	3.70	Fail	N/A	-
B2-23-5 2B4P Bedroom 1	1.60	Pass	17	Pass
B2-23-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-23-5 2B4P KLR	3.50	Fail	N/A	-
B2-23-6 2B3P Bedroom 1	1.40	Pass	17	Pass
B2-23-6 2B3P KLR	3.20	Fail	N/A	-
B2-23-6 2B3P Single Bedroom	1.90	Pass	14	Pass
B2-23-7 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-23-7 2B3P KLR	0.00	Pass	N/A	-
B2-23-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-2-4 2B4P Bedroom 1	0.20	Pass	16	Pass
B2-2-4 2B4P Bedroom 2	0.70	Pass	17	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-2-4 2B4P KLR	2.20	Pass	N/A	-
B2-24-1 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-24-1 2B3P KLR	0.00	Pass	N/A	-
B2-24-1 2B3P Single Bedroom	0.00	Pass	10	Pass
B2-24-2 2B4P Bedroom 1	0.00	Pass	12	Pass
B2-24-2 2B4P Bedroom 1	0.00	Pass	11	Pass
B2-24-2 2B4P KLR	0.20	Pass	N/A	-
B2-24-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-24-3 1B2P KLR	0.00	Pass	N/A	-
B2-24-4 2B4P Bedroom 1	1.50	Pass	17	Pass
B2-24-4 2B4P Bedroom 2	1.70	Pass	16	Pass
B2-24-4 2B4P KLR	3.70	Fail	N/A	-
B2-24-5 2B4P Bedroom 1	1.50	Pass	17	Pass
B2-24-5 2B4P Bedroom 2	1.20	Pass	17	Pass
B2-24-5 2B4P KLR	3.40	Fail	N/A	-
B2-24-6 2B3P Bedroom 1	1.50	Pass	17	Pass
B2-24-6 2B3P KLR	3.40	Fail	N/A	-
B2-24-6 2B3P Single Bedroom	1.90	Pass	14	Pass
B2-24-7 2B3P Bedroom 1	0.00	Pass	11	Pass
B2-24-7 2B3P KLR	0.00	Pass	N/A	-
B2-24-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-2-5 2B4P Bedroom 1	0.20	Pass	16	Pass
B2-2-5 2B4P Bedroom 2	0.10	Pass	16	Pass
B2-2-5 2B4P KLR	0.50	Pass	N/A	-
B2-2-6 2B3P Bedroom 1	0.10	Pass	16	Pass
B2-2-6 2B3P KLR	0.10	Pass	N/A	-
B2-2-6 2B3P Single Bedroom	0.40	Pass	14	Pass
B2-2-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-2-7 2B3P KLR	0.00	Pass	N/A	-
B2-2-7 2B3P Single Bedroom	0.00	Pass	13	Pass
B2-3-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-3-1 2B3P KLR	0.00	Pass	N/A	-
B2-3-1 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-3-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-3-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-3-2 2B4P KLR	0.20	Pass	N/A	-
B2-3-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-3-3 1B2P KLR	0.00	Pass	N/A	-
B2-3-4 2B4P Bedroom 1	0.30	Pass	16	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-3-4 2B4P Bedroom 2	0.70	Pass	17	Pass
B2-3-4 2B4P KLR	2.20	Pass	N/A	-
B2-3-5 2B4P Bedroom 1	0.20	Pass	17	Pass
B2-3-5 2B4P Bedroom 2	0.10	Pass	16	Pass
B2-3-5 2B4P KLR	0.50	Pass	N/A	-
B2-3-6 2B3P Bedroom 1	0.20	Pass	16	Pass
B2-3-6 2B3P KLR	0.40	Pass	N/A	-
B2-3-6 2B3P Single Bedroom	0.50	Pass	15	Pass
B2-3-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-3-7 2B3P KLR	0.00	Pass	N/A	-
B2-3-7 2B3P Single Bedroom	0.00	Pass	13	Pass
B2-4-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-4-1 2B3P KLR	0.00	Pass	N/A	-
B2-4-1 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-4-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-4-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-4-2 2B4P KLR	0.20	Pass	N/A	-
B2-4-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-4-3 1B2P KLR	0.00	Pass	N/A	-
B2-4-4 2B4P Bedroom 1	0.70	Pass	17	Pass
B2-4-4 2B4P Bedroom 2	1.10	Pass	17	Pass
B2-4-4 2B4P KLR	2.90	Pass	N/A	-
B2-4-5 2B4P Bedroom 1	0.60	Pass	17	Pass
B2-4-5 2B4P Bedroom 2	0.40	Pass	16	Pass
B2-4-5 2B4P KLR	1.30	Pass	N/A	-
B2-4-6 2B3P Bedroom 1	0.60	Pass	17	Pass
B2-4-6 2B3P KLR	1.10	Pass	N/A	-
B2-4-6 2B3P Single Bedroom	1.10	Pass	15	Pass
B2-4-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-4-7 2B3P KLR	0.00	Pass	N/A	-
B2-4-7 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-5-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-5-1 2B3P KLR	0.00	Pass	N/A	-
B2-5-1 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-5-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-5-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-5-2 2B4P KLR	0.20	Pass	N/A	-
B2-5-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-5-3 1B2P KLR	0.00	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-5-4 2B4P Bedroom 1	1.00	Pass	17	Pass
B2-5-4 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-5-4 2B4P KLR	3.00	Pass	N/A	-
B2-5-5 2B4P Bedroom 1	0.90	Pass	17	Pass
B2-5-5 2B4P Bedroom 2	0.70	Pass	17	Pass
B2-5-5 2B4P KLR	1.90	Pass	N/A	-
B2-5-6 2B3P Bedroom 1	0.70	Pass	17	Pass
B2-5-6 2B3P KLR	1.20	Pass	N/A	-
B2-5-6 2B3P Single Bedroom	1.20	Pass	15	Pass
B2-5-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-5-7 2B3P KLR	0.00	Pass	N/A	-
B2-5-7 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-6-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-6-1 2B3P KLR	0.00	Pass	N/A	-
B2-6-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-6-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-6-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-6-2 2B4P KLR	0.20	Pass	N/A	-
B2-6-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-6-3 1B2P KLR	0.00	Pass	N/A	-
B2-6-4 2B4P Bedroom 1	1.10	Pass	17	Pass
B2-6-4 2B4P Bedroom 2	1.40	Pass	17	Pass
B2-6-4 2B4P KLR	3.30	Fail	N/A	-
B2-6-5 2B4P Bedroom 1	1.10	Pass	17	Pass
B2-6-5 2B4P Bedroom 2	0.90	Pass	17	Pass
B2-6-5 2B4P KLR	2.80	Pass	N/A	-
B2-6-6 2B3P Bedroom 1	1.00	Pass	17	Pass
B2-6-6 2B3P KLR	2.50	Pass	N/A	-
B2-6-6 2B3P Single Bedroom	1.60	Pass	17	Pass
B2-6-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-6-7 2B3P KLR	0.00	Pass	N/A	-
B2-6-7 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-7-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-7-1 2B3P KLR	0.00	Pass	N/A	-
B2-7-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-7-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-7-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-7-2 2B4P KLR	0.20	Pass	N/A	-
B2-7-3 1B2P Bedroom	0.00	Pass	14	Pass

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-7-3 1B2P KLR	0.00	Pass	N/A	-
B2-7-4 2B4P Bedroom 1	1.30	Pass	17	Pass
B2-7-4 2B4P Bedroom 2	1.60	Pass	17	Pass
B2-7-4 2B4P KLR	3.50	Fail	N/A	-
B2-7-5 2B4P Bedroom 1	1.40	Pass	17	Pass
B2-7-5 2B4P Bedroom 2	1.20	Pass	17	Pass
B2-7-5 2B4P KLR	3.20	Fail	N/A	-
B2-7-6 2B3P Bedroom 1	1.10	Pass	17	Pass
B2-7-6 2B3P KLR	2.60	Pass	N/A	-
B2-7-6 2B3P Single Bedroom	1.70	Pass	17	Pass
B2-7-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-7-7 2B3P KLR	0.00	Pass	N/A	-
B2-7-7 2B3P Single Bedroom	0.00	Pass	12	Pass
B2-8-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-8-1 2B3P KLR	0.00	Pass	N/A	-
B2-8-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-8-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-8-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-8-2 2B4P KLR	0.20	Pass	N/A	-
B2-8-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-8-3 1B2P KLR	0.00	Pass	N/A	-
B2-8-4 2B4P Bedroom 1	1.40	Pass	17	Pass
B2-8-4 2B4P Bedroom 2	1.60	Pass	17	Pass
B2-8-4 2B4P KLR	3.60	Fail	N/A	-
B2-8-5 2B4P Bedroom 1	1.40	Pass	17	Pass
B2-8-5 2B4P Bedroom 2	1.20	Pass	17	Pass
B2-8-5 2B4P KLR	3.20	Fail	N/A	-
B2-8-6 2B3P Bedroom 1	1.10	Pass	17	Pass
B2-8-6 2B3P KLR	2.80	Pass	N/A	-
B2-8-6 2B3P Single Bedroom	1.70	Pass	17	Pass
B2-8-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-8-7 2B3P KLR	0.00	Pass	N/A	-
B2-8-7 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-9-1 2B3P Bedroom 1	0.00	Pass	14	Pass
B2-9-1 2B3P KLR	0.00	Pass	N/A	-
B2-9-1 2B3P Single Bedroom	0.00	Pass	11	Pass
B2-9-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-9-2 2B4P Bedroom 1	0.00	Pass	15	Pass
B2-9-2 2B4P KLR	0.20	Pass	N/A	-

CIBSE TM59 Results - DSY3				
Room Names	Criteria a % Hours >26°C	Pass/Fail	Criteria b Total Hours >26°C (22:00 - 07:00) (Bedrooms Only)	Pass/Fail
B2-9-3 1B2P Bedroom	0.00	Pass	14	Pass
B2-9-3 1B2P KLR	0.00	Pass	N/A	-
B2-9-4 2B4P Bedroom 1	1.40	Pass	18	Pass
B2-9-4 2B4P Bedroom 2	1.70	Pass	17	Pass
B2-9-4 2B4P KLR	3.70	Fail	N/A	-
B2-9-5 2B4P Bedroom 1	1.50	Pass	17	Pass
B2-9-5 2B4P Bedroom 2	1.30	Pass	17	Pass
B2-9-5 2B4P KLR	3.60	Fail	N/A	-
B2-9-6 2B3P Bedroom 1	1.20	Pass	17	Pass
B2-9-6 2B3P KLR	3.00	Pass	N/A	-
B2-9-6 2B3P Single Bedroom	1.80	Pass	17	Pass
B2-9-7 2B3P Bedroom	0.00	Pass	14	Pass
B2-9-7 2B3P KLR	0.00	Pass	N/A	-
B2-9-7 2B3P Single Bedroom	0.00	Pass	11	Pass



Aberdeen Office
1 Marischal Square
Broad Street
Aberdeen, AB10 1BL

Glasgow Office
The Garment Factory
10 Montrose Street
Glasgow, G1 1RE

Belfast Office
Suite 3, Bamford House
91-93 Saintfield Road
Belfast, BT8 7HN

London Office
2-6 Boundary Row
London
SE1 8HP

Birmingham Office
Suite 213, Cornwall Buildings,
45 Newhall Street,
Birmingham, B3 3QR

Manchester Office
53 King Street
Manchester
M2 4LQ

Edinburgh Office
38 Thistle Street
Edinburgh
EH2 1EN

Warrington Office
Suite F, Chadwick House
Birchwood Park
Warrington, WA3 6AE

General
Tel: +44(0)330 460 5200
Email: contact@wallacewhittle.com
www.wallacewhittle.com

