


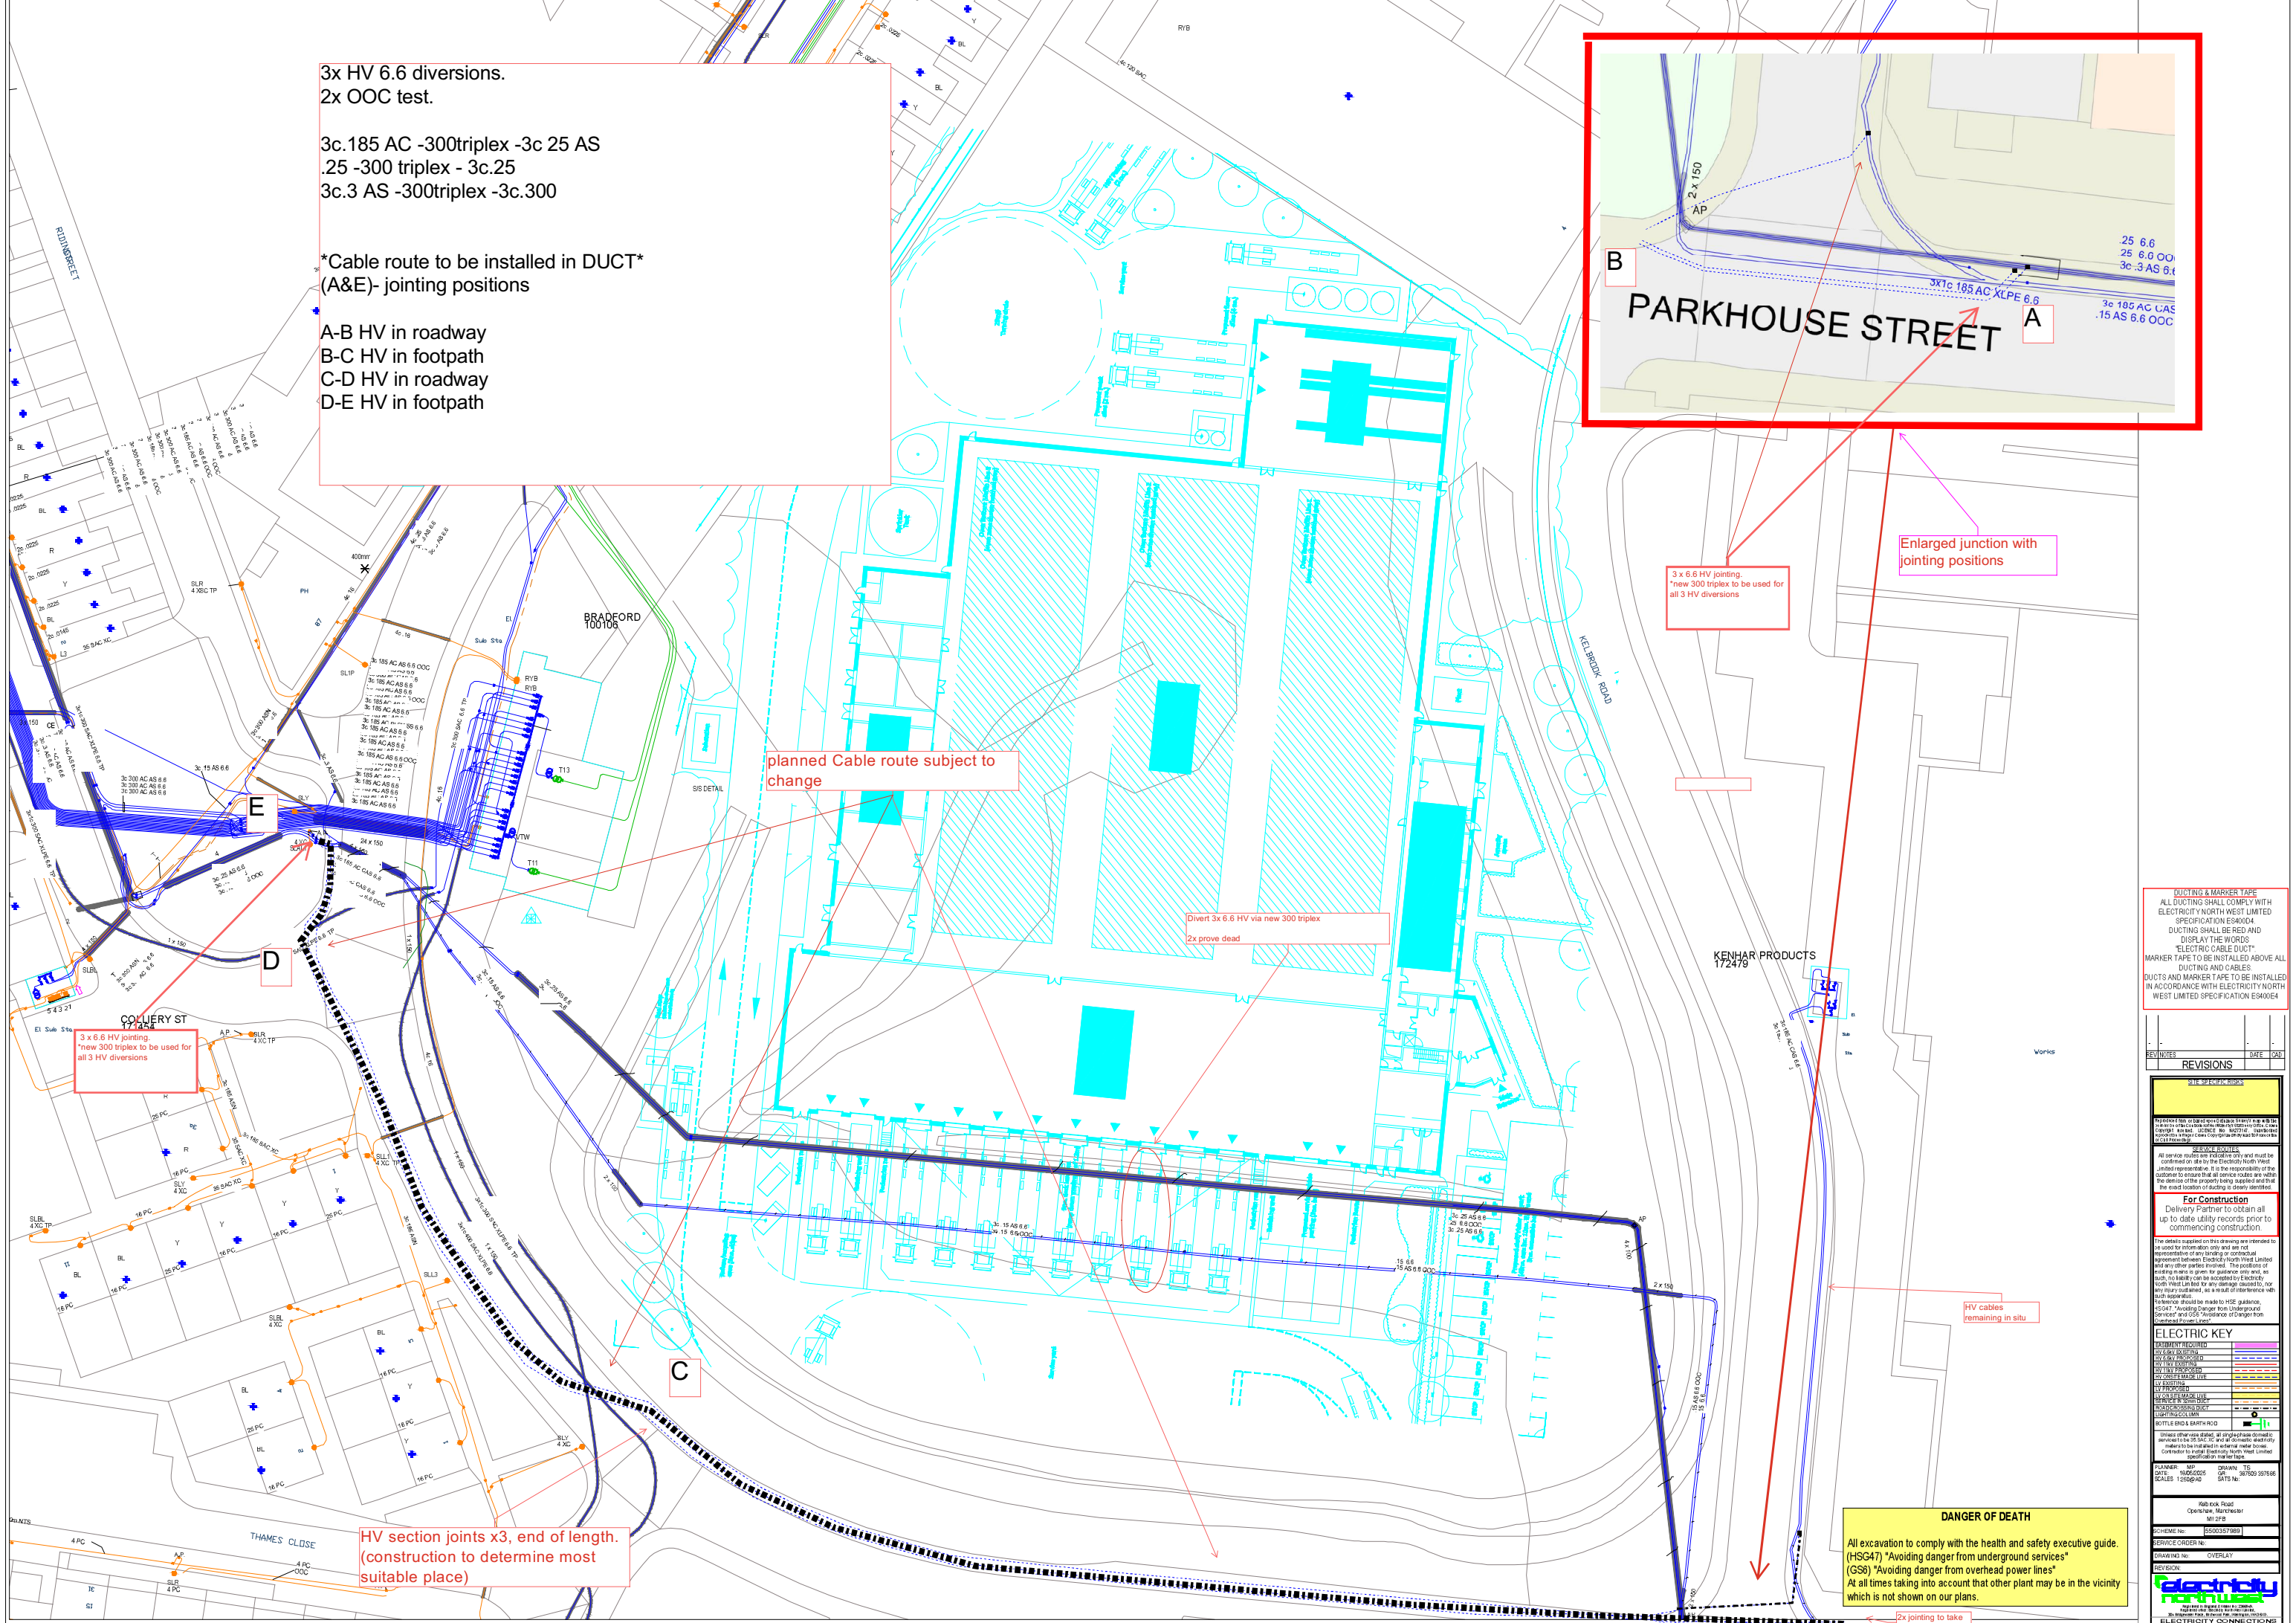

Cable Layout. Scale 1: 250

**DUCTING & MARKER TAPE**  
ALL DUCTING SHALL COMPLY WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES40X04  
DUCTING SHALL BE RED AND DISPLAY THE WORDS "ELECTRIC CABLE DUCT"  
MARKER TAPE TO BE INSTALLED ABOVE ALL DUCTING AND CABLES  
DUCTS AND MARKER TAPE TO BE INSTALLED IN ACCORDANCE WITH ELECTRICITY NORTH WEST LIMITED SPECIFICATION ES40X04

| REV | DATE       | QTD |
|-----|------------|-----|
| 1   | 15/06/2025 | 1   |

**REVISIONS**

| REV | DATE       | QTD |
|-----|------------|-----|
| 1   | 15/06/2025 | 1   |

**For Construction**  
Delivery Partner to obtain all up to date utility records prior to commencing construction

The details supplied on this drawing are intended to be used for information only and are not representative of any binding or contractual agreement between Electricity North West Limited and any other parties involved. The positions of existing services are given for guidance only and, as such, no liability can be accepted by Electricity North West Limited for any damage caused to, nor any other customer, as a result of interference with such apparatus.

Permitted work should be made to HSE guidance, R5047 "Avoiding Danger from Underground Services" and G55 "Avoidance of Danger from Overhead Power Lines".

| ELECTRIC KEY  |               |
|---------------|---------------|
| 15KV DUCTING  | 15KV DUCTING  |
| 15KV PROPOSED | 15KV PROPOSED |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |
| 15KV EXISTING | 15KV EXISTING |

**PLANNER:** MP  
**DATE:** 15/06/2025  
**SCALE:** 1:250

**REVISION:**  
15/06/2025  
15/06/2025  
15/06/2025

**DANGER OF DEATH**  
All excavation to comply with the health and safety executive guide. (HSG47) "Avoiding danger from underground services" (GS6) "Avoiding danger from overhead power lines" At all times taking into account that other plant may be in the vicinity which is not shown on our plans.

Enlarged junction with jointing positions

3 x 6.6 HV jointing.  
\*new 300 triplex to be used for all 3 HV diversions

planned Cable route subject to change

Divert 3x 6.6 HV via new 300 triplex  
2x prove dead

HV cables remaining in situ

HV section joints x3, end of length.  
(construction to determine most suitable place)