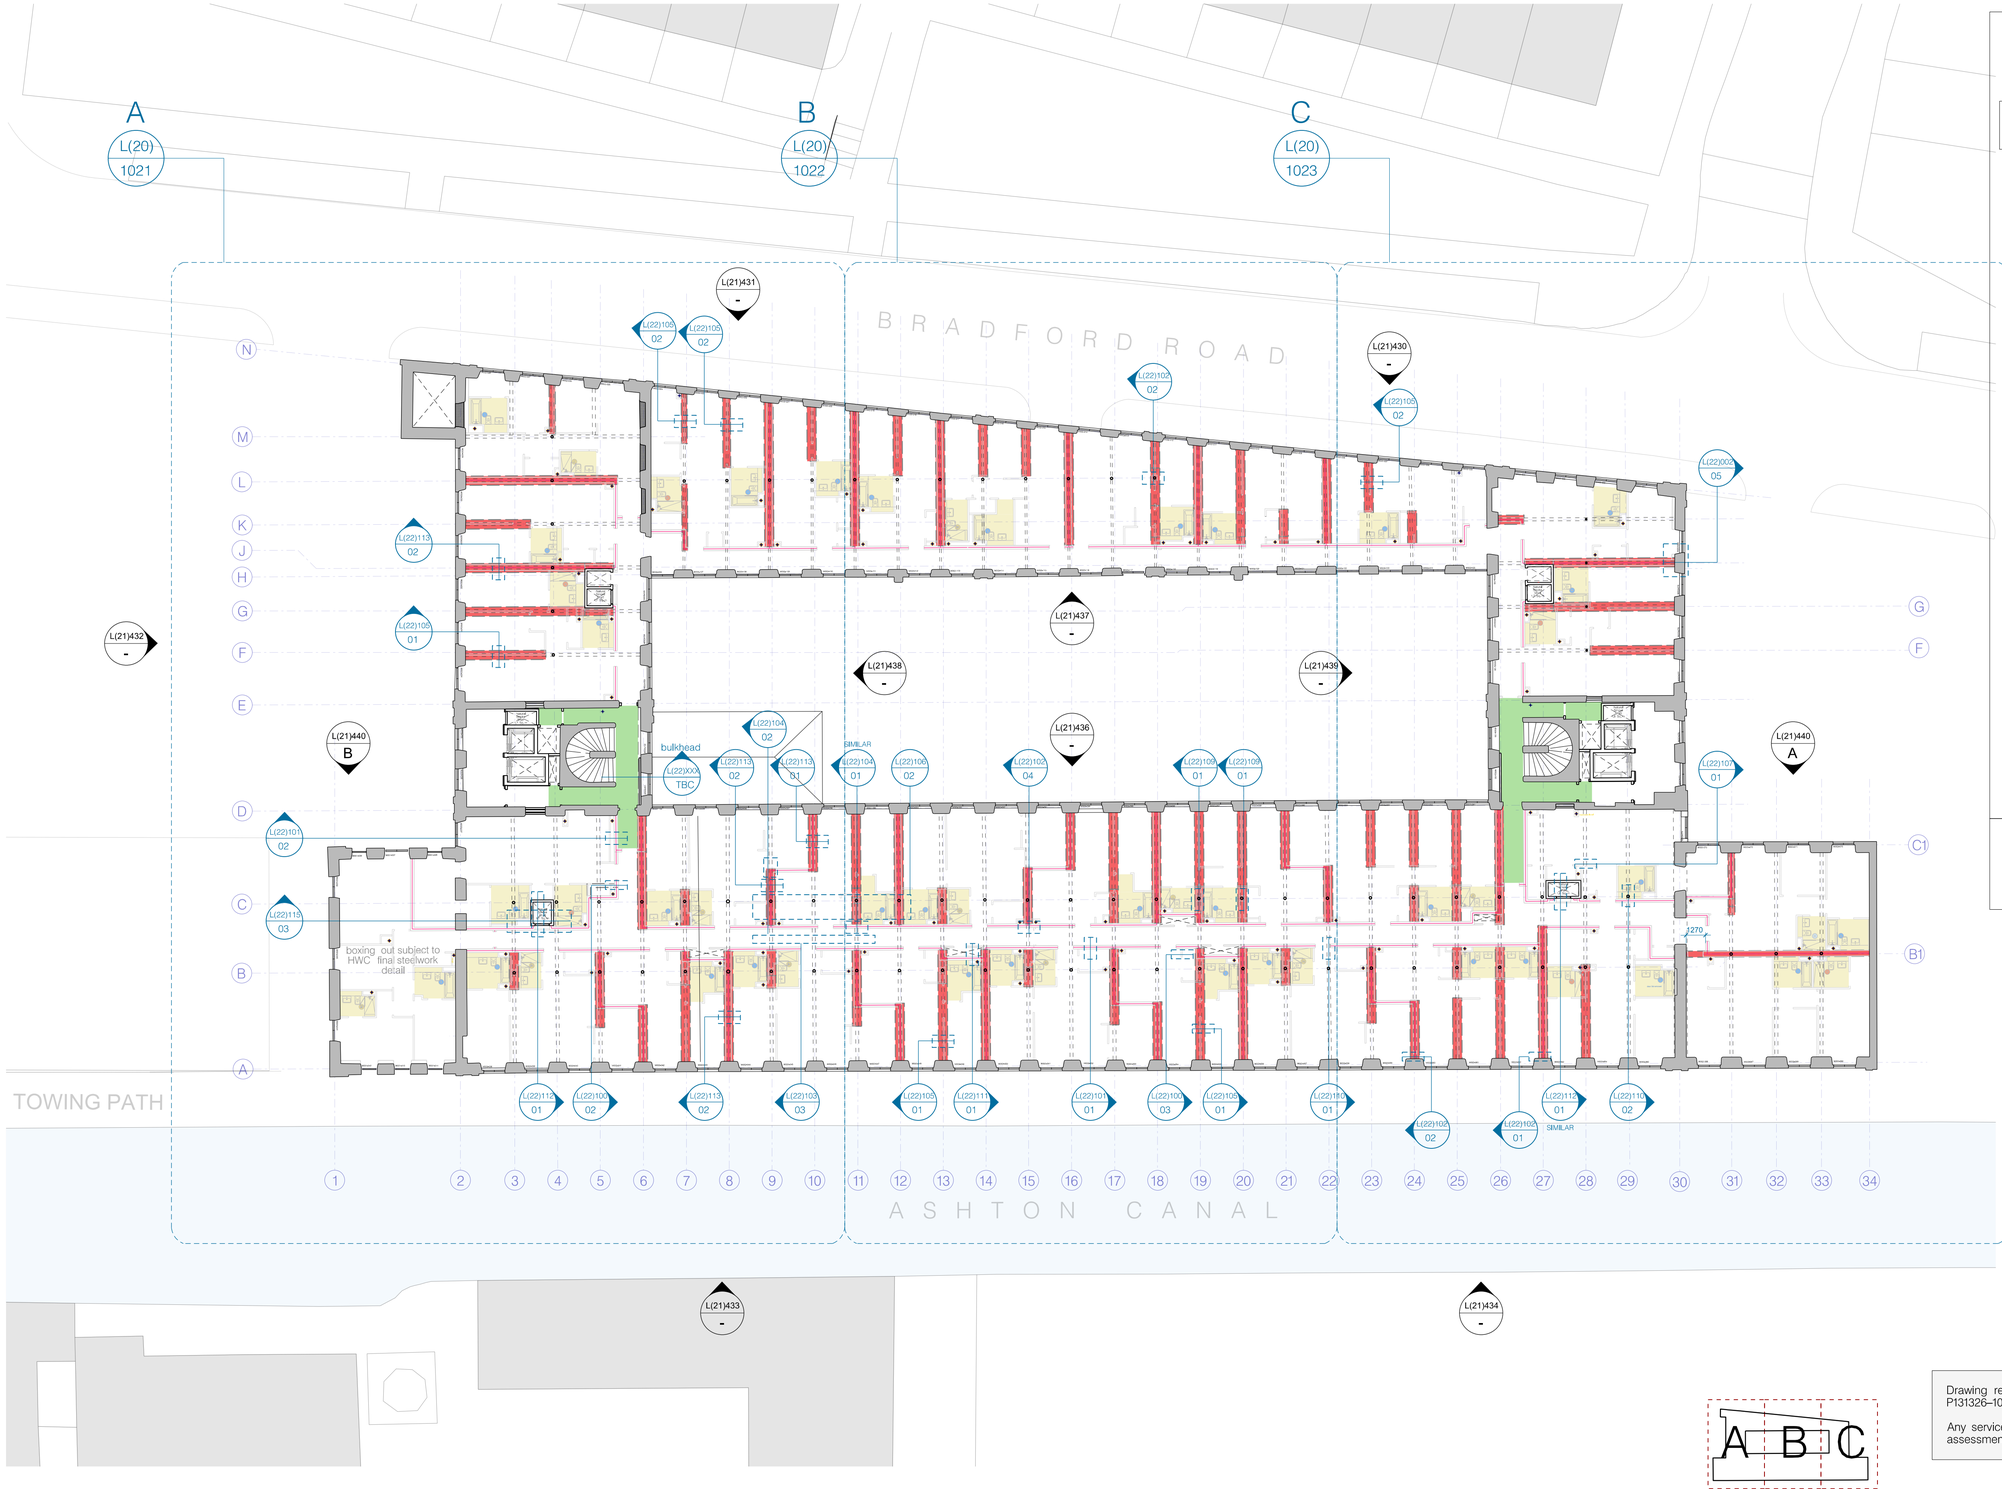


INTERNAL WALLS
Issued for design intent. Detail design by specialist S/C.

Dry lining partitioning detailing to be in accordance with Knauf information or acceptable equivalent:

Refer to
- Knauf Project Information Pack -
- Set of Knauf Standard details - Brunswick Mill, Manchester

- Wind post designs to SE detail

- Lintels to SE detail and specification

- Refer to the SE Movement and Tolerance Report information from the structural engineer re head deflection information

FIRE PROTECTION
- REFER TO THE BRE THIRD PARTY REPORT REF: P131326-100 FOR ASSESSMENT OF NON STANDARD PROTECTION DETAILS

- Refer to AMPyro Fire Strategy Report
- Refer to Knauf specification for details

- Refer to and Acoustic Reports for acoustic details.

Blockwork specification by Structural Engineer

Final on site tested acoustic values may vary from the stated laboratory acoustically tested detail. All wall acoustic ratings to be accepted by acoustician.

Refer to drawings:
- 20 series for GA Plans. L(20)200 to L(20)207
- 20 series for Detail GA Plans. L(20)1001 to L(20)1073
- 20 Series for Fire Strategy Plans. L(20)230 to L(20)237
- 20 series for Wall Types GA Plans. L(20)250 to L(20)256
- 22 series for Typical internal wall details
- 22 series for Central party wall set out*

* CENTRAL PARTY WALL ACOUSTIC SEPARATION
Note acoustic strip proposed (OR SEPARATION GAP as accepted by Acoustician). Saw tooth air gap separation in new screed and under screed horizontal layer accepted on basis that existing substrate is not cut into.

PATTRESSING
18mm ply pattress where required.

Pattressing for bathroom and kitchen fittings - subject to subcontractor drawings of bathroom and kitchen layouts.

For typical bathrooms refer to drawing L(74)001. Note full height and width patressing proposed to section of wall behind shower. Vanity unit wall (not shown on typical wall type plans) to incorporate full height / width patressing.

Full height & width pattresses to each active side of the drylined riser walls.

Pattressing fixed within depth of stud with angle fixed to stud strictly to suppliers recommendation unless otherwise stated

HUMID AREAS
For any humid areas such as bathrooms use Knauf Moisture panel in lieu of Knauf wallboard, or Knauf performance plus in lieu of Knauf soundshield plus even when tiling such walls. (OEA)

Drawing reissued following receipt of BRE third party fire assessment; Report number: P131326–1000, Fire Consultant and Knauf subcontractor commentary.

Any service penetrations through dry line boxing–in subject to Fire Consultant/BRE assessment and stage 5 M&E design.

hodder+partners

SGI Studios
1 Kelso Place
Manchester M15 4LE

t: +44(0)161 832 9842
e: mail@hodderandpartners.com
w: www.hodderandpartners.com

DO NOT SCALE
Work to annotated dimensions only.
Read drawing in conjunction with relevant specification, Structural Engineers' and Services Engineers' drawings.
Confirm all dimensions before commencement of any work on site or fabrication.

revisions + notes:

C1	31.07.25	PRELIMINARY CONSTRUCTION ISSUE
C2	11.08.25	PRELIMINARY CONSTRUCTION ISSUE BOXING /ANNOTATION UPDATED
C3	12.08.25	FR CEILING TO CORE SHOWN, AESTHETIC BOXING AND KEY OUT UPDATED.
C4	21.08.25	ISSUE FOR BRE /TEAM ASSESSMENT
C5	23.09.25	SECTION REF UPDATE
C6	04.12.25	DRYLINE RESISSUE FOLLOWING BRE ASSESSMENT.
C7	23.01.26	Update in line with GA Plans – High level boxing out reduced. Exposed (FR encased) services in core in lieu of FR ceiling

DRYLINE HEAD BOXING IN
BOXING IN SUBJECT TO THIRD PARTY REVIEW WITH BRE / AMPYRO

Indicates Boxing in. Refer to seperate section details (22)series detail drawings. Refer to drawings (22)221- 226 for typical plan layout of dry line boxing-in and detail referencing.

Line indicates centre line of partition / acoustic separation strip within screed.
Party wall between apartments to be central about the existing line of existing steel beams unless otherwise stated. Refer to seperate drawings (20)221- 226 for set out of centre of party walls. All dimensions to be checked on site

Indicates zone of exposed soffit with fire protected encased services within core - to be design and installed strictly to suppliers recommendation and to AMPyro review approval

Indicates 120mm FR Fire rated ceiling / boxing in of services. EI120 Self supporting ceilling membrane (fire from above or below) E1120-0015-SUPLALUX by Promat (OEA)Separating FR walls to extend to existing soffit. Detail subject to confirmation from Fire Consultant. To concierge to follow pitch of roof.

other:
Bathrooms and shower rooms to have MR plasterboard MF ceilling. Refer to 74 series drawings for typical bathrooms. All other areas of ceillings to be exposed. Bathroom ceilling to conceal FR boxing in where applicable

Illustrates extent of MF suspended plasterboard ceillings in bathroom



0 10m 20m

client:	**date:**	
ARROWSMITH BRUNSWICK SQUARE LTD.	JUNE 2025	
project:	**scale:**	**drawn by:**
BRUNSWICK MILL DEVELOPMENT PHASE 1	1:200 @A1	TC
title:	**drawing number:**	
LEVEL 2 PROPOSED – PROPOSED DRYLINE HEAD BOXING	L(22)222	
status:	**job number:**	**revision:**
STAGE 5 – CONSTRUCTION	0586	C7

hodder+partners