



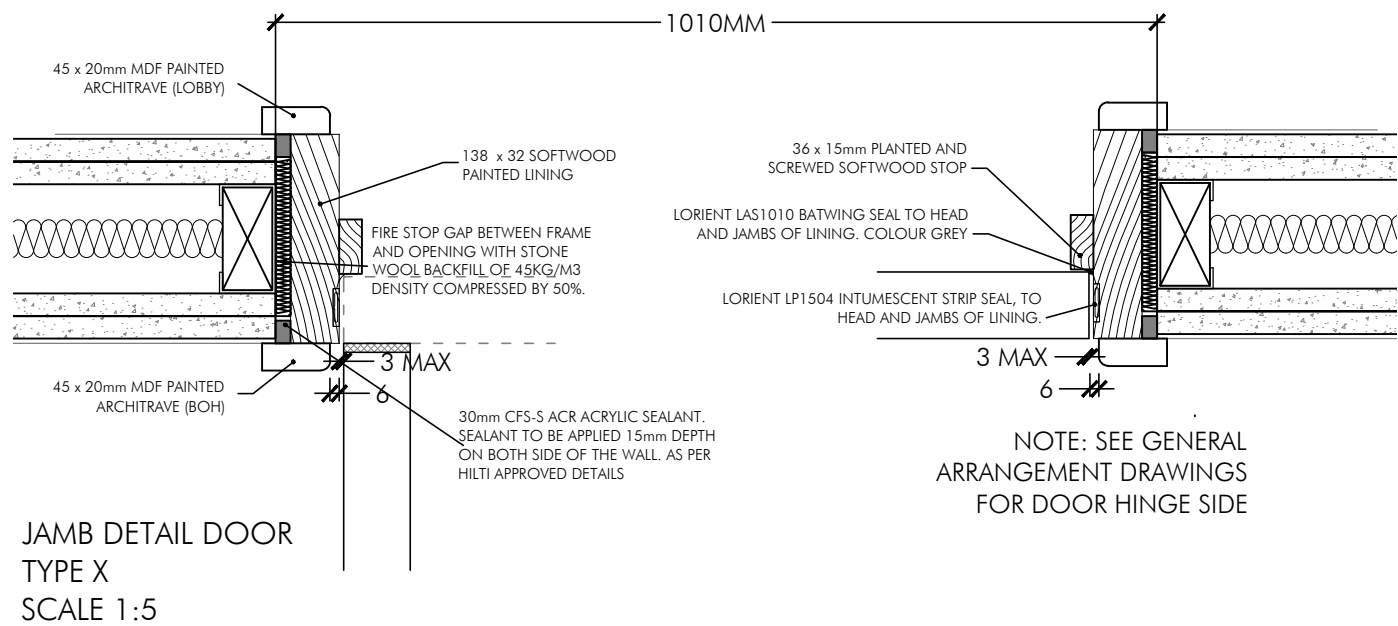

JAMB DETAIL DOOR
TYPE X
SCALE 1:5

DOOR TYPE X - OFFICE & LINEN ROOM
DOOR No. 2D.41, 2D.42, 3D.41, 4D.32 / TOTAL No. OF DOORS = 4

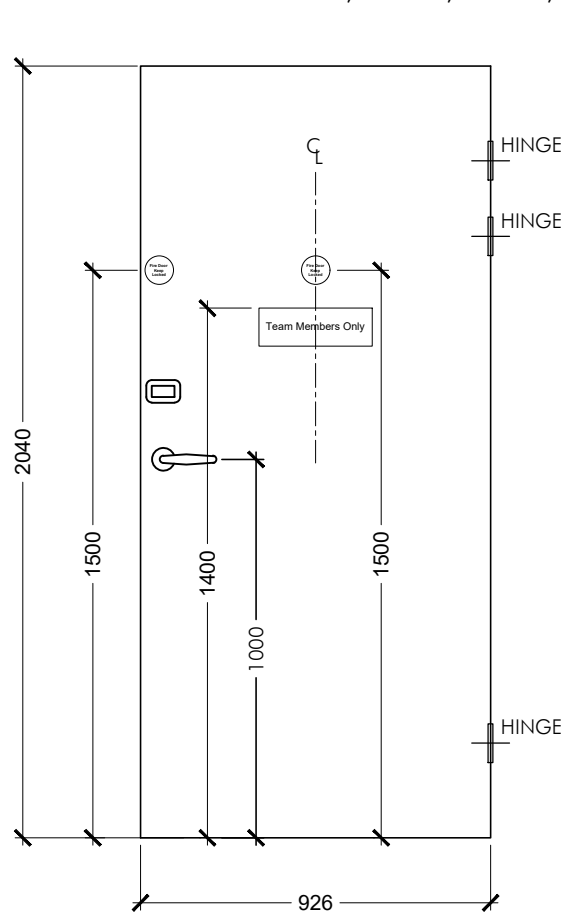

DOOR TYPE X
CORRIDOR SIDE
SCALE 1:20

DESCRIPTION: DOOR TYPE X

STRUCTURAL OPENING 1010 x 2100mm
LEAF SIZE: 926x 2040mm

FINISH: VENEERED FIRE DOOR. DOOR TO
BE STAINED AND POLISHED TO MATCH
LAMINATE REF TBC.

DOOR EDGES STAINED TO MATCH DOOR
FACE.


FIRE RATING: FD 30S
ACOUSTIC RATING: N/A

IRONMONGUERY:
1.5 x PAIR BALL BEARING BUTT HINGES.
1 x CAM ACTION OVERHEAD DOOR
CLOSER.
1 x FLOOR/WALL MOUNT DOOR STOP

DOOR DOES REQUIRE ELECTRONIC
LOCKING
*ROOM ELECTRONIC LOCKS
SPECIFICATION TBC

DOOR SEALS = LORIENT LP1504
INTUMESCENT STRIP SEAL TO HEAD AND
JAMBS.
LORIENT IS1010 BATWING SEAL TO HEAD
AND JAMBS.
COLOUR: TBC

SIGNAGE = 1 x TEAM MEMBERS ONLY
2 x FIRE DOOR KEEP LOCKED SIGN

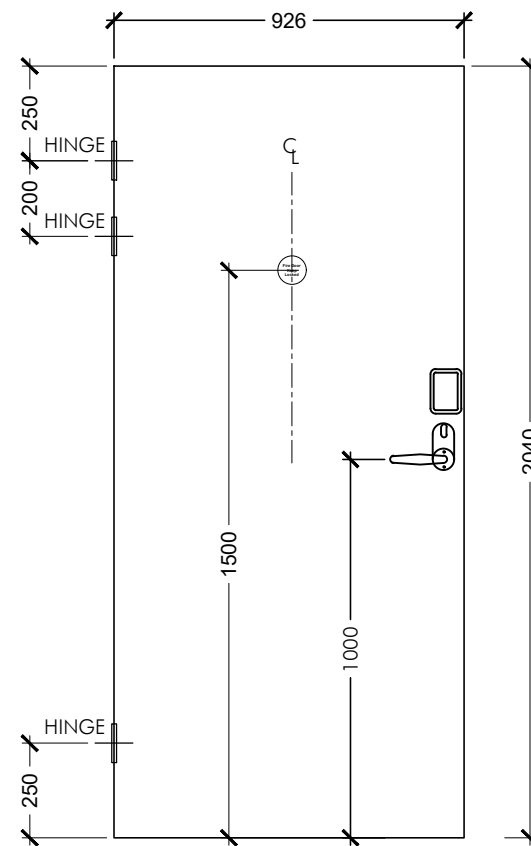

DOOR TYPE X
LOBBY SIDE
SCALE 1:20

NOTE:
ALL DIMENSIONS TO BE CHECKED ON SITE AND ANY
DISCREPANCIES REPORTED PRIOR TO COMMENCEMENT OF
WORK.

ALL EXISTING OPENINGS TO BE MEASURED ON SITE PRIOR TO
MANUFACTURING OF NEW DOORS.

DO NOT SCALE FROM THE DRAWING. IF IN DOUBT ASK.

NOTE:
FIRE STOPPING MEASURES TO EXISTING DOORS HAS BEEN
ASSUMED FOR THE PURPOSE OF TENDER ONLY. FRMA WILL
PROVIDE GUIDANCE ON FIRE STOPPING.

FIRE DOOR INSTALLATION NOTES:

NOTE: IN ALL CASES, ALL FRAME, JOINERY AND IRONMONGERY
MATERIALS TO BE SUPPLIED AND INSTALLED IN ACCORDANCE
WITH THE APPLICABLE FIRE CERTIFICATE TEST DETAILS.
GAPS BETWEEN DOOR LIPPING AND FRAME AT BOTH JAMBS AND
HEAD TO BE 3-4mm. WHERE DROP-DOWN SEAL TO BASE OF
DOOR IS TO BE PROVIDED, GAP BETWEEN THRESHOLD AND
DOOR TO BE MAX 13mm, IF NO DROP-SEAL IS PROPOSED, GAP
TO BE AS SPECIFIED IN THE FIRE CERTIFICATE TEST DETAILS.
ALLOW FOR INTUMESCENT HINGE LINERS TO BE INSTALLED IN
ACCORDANCE WITH THE TEST CERTIFICATE DETAILS, AND ALLOW
FOR INTUMESCENT LINERS TO ANY DOOR LOCK SETS AND KEEP.
BATWING SEALS TO BE TIGHTLY MITRED AT TOP CORNER
JUNCTIONS AND FITTED IN STRICT ACCORDANCE WITH LORIENT
INSTRUCTIONS.
INSTALLING CONTRACTOR TO REFER TO BWF-CERTIFIRE BEST
PRACTICE GUIDE (FIRE DOORS AND DOORSETS) FOR FURTHER
DETAILED GUIDANCE.
WHERE REPAIR AND UPGRADE WORKS ARE BEING DONE TO
EXISTING DOORS, THE INSTITUTION OF FIRE ENGINEERS 'GUIDE
TO THE FIRE RESISTANCE OF HISTORIC TIMBER PANEL DOORS'
AND REPORT 'TBC' BY FRMA ARE TO BE USED FOR GUIDANCE
AND INFORMATION.

TENDER ISSUE	RSB DRAWN	DRAWN REVISION	DEC 25 DATE	PC VER
	<div> ALLISON PIKE</div> <div>ARCHITECTS & DESIGNERS</div>			
	<div><div>7 Buxton Road West, Disley, Stockport, Cheshire, SK12 2AE. Website: www.allisonpike.com</div><div>Telephone: 01663 763000 Facsimile: 01663 766772 Email: studio@allisonpike.com</div></div>			
	© Allison Pike Partnership Limited.			
	PROJECT INNKEEPERS COLLECTION 1-3 YORK STREET (BROWNS) MANCHESTER			
	TITLE DOOR TYPE X SCHEDULE AND DETAILS			
	SCALE 1:20, AND 1:5 @ A3			
	JOB No MAB46	DRAWING No AZ81		REV /