


DOOR TYPE Z: SERVICE CUPBOARD
DOOR No. RD. 03, RD.05, RD.07 / TOTAL No. OF DOORS = 3

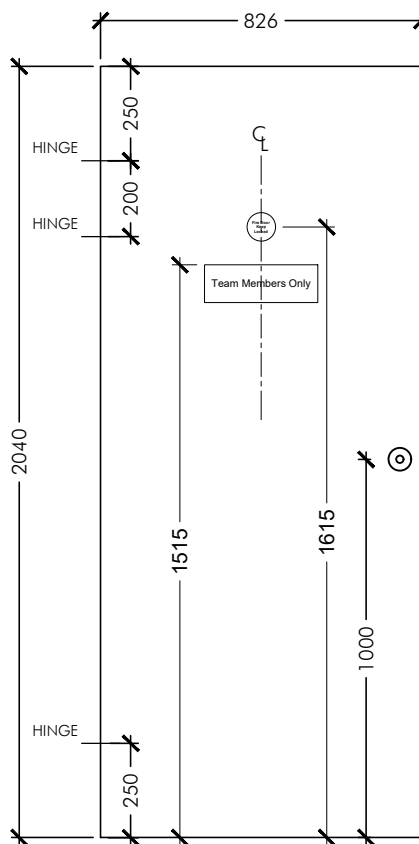

DOOR TYPE Z
SERVICE CUPBOARD - CORRIDOR SIDE
SCALE 1:20

DESCRIPTION : TYPE Z

STRUCTURAL OPENING 910 x 2100

DOOR LEAF SIZE: 826 x 2040

FINISH: PAINTED FINISH DOOR. COLOUR TBC

DOOR EDGES STAINED TO MATCH DOOR FACE.

FIRE RATING: FD60S

IRONMONGERY:

- 1.5 x PAIR BALL BEARING BUTT HINGES.
- 1 x CAM ACTION OVERHEAD DOOR CLOSER.
- 1 x MANUAL STAR LOCK

DOOR SEALS = LORIENT LP1504 INTUMESCENT STRIP
SEAL TO HEAD AND JAMBS.


LORIENT LAS1010 BATWING SEAL TO HEAD AND
JAMBS.

LORIENT IS8010 SI DROP-DOWN THRESHOLD SEAL
RECESSED INTO THE BOTTOM OF THE DOOR LEAF.

COLOUR: TBC

SIGNAGE = 1 x TEAM MEMBERS ONLY

2 x FIRE DOOR KEEP LOCKED SIGN

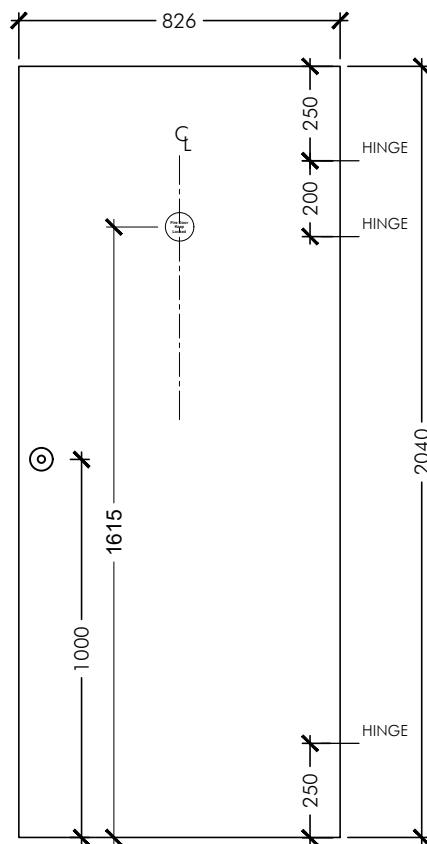

DOOR TYPE Z
CUPBOARD SIDE
SCALE 1:20

NOTE:
ALL DIMENSIONS TO BE CHECKED ON SITE AND ANY DISCREPANCIES REPORTED PRIOR TO COMMENCEMENT OF WORK.

ALL EXISTING OPENINGS TO BE MEASURED ON SITE PRIOR TO MANUFACTURING OF NEW DOORS.

DO NOT SCALE FROM THE DRAWING. IF IN DOUBT ASK.

NOTE:
FIRE STOPPING MEASURES TO EXISTING DOORS HAS BEEN ASSUMED FOR THE PURPOSE OF TENDER ONLY. FRMA WILL PROVIDE GUIDANCE ON FIRE STOPPING.

FIRE DOOR INSTALLATION NOTES:

NOTE: IN ALL CASES, ALL FRAME, JOINERY AND IRONMONGERY MATERIALS TO BE SUPPLIED AND INSTALLED IN ACCORDANCE WITH THE APPLICABLE FIRE CERTIFICATE TEST DETAILS.

GAPS BETWEEN DOOR LIPPING AND FRAME AT BOTH JAMBS AND HEAD TO BE 3-4mm. WHERE DROP-DOWN SEAL TO BASE OF DOOR IS TO BE PROVIDED, GAP BETWEEN THRESHOLD AND DOOR TO BE MAX 13mm, IF NO DROP-SEAL IS PROPOSED, GAP TO BE AS SPECIFIED IN THE FIRE CERTIFICATE TEST DETAILS.

ALLOW FOR INTUMESCENT HINGE LINERS TO BE INSTALLED IN ACCORDANCE WITH THE TEST CERTIFICATE DETAILS, AND ALLOW FOR INTUMESCENT LINERS TO ANY DOOR LOCK SETS AND KEEP.

BATWING SEALS TO BE TIGHTLY MITRED AT TOP CORNER JUNCTIONS AND FITTED IN STRICT ACCORDANCE WITH LORIENT INSTRUCTIONS.

INSTALLING CONTRACTOR TO REFER TO BWF-CERTIFIRE BEST PRACTICE GUIDE (FIRE DOORS AND DOORSETS) FOR FURTHER DETAILED GUIDANCE.

WHERE REPAIR AND UPGRADE WORKS ARE BEING DONE TO EXISTING DOORS, THE INSTITUTION OF FIRE ENGINEERS 'GUIDE TO THE FIRE RESISTANCE OF HISTORIC TIMBER PANEL DOORS' AND REPORT 'TBC' BY FRMA ARE TO BE USED FOR GUIDANCE AND INFORMATION.

TENDER ISSUE	RSB DRAWN	DRAWN REVISION	DEC 25 DATE	PC VER
	<div><div>AP</div><div>ALLISON PIKE</div><div>ARCHITECTS & DESIGNERS</div></div>			
	7 Buxton Road West, Disley, Stockport, Cheshire, SK12 2AE. Website: www.allisonpike.com		Telephone: 01663 763000 Facsimile: 01663 766772 Email: studio@allisonpike.com	
	© Allison Pike Partnership Limited.			
	PROJECT INNKEEPERS COLLECTION 1-3 YORK STREET (BROWNS) MANCHESTER			
TITLE DOOR TYPE Z SCHEDULE AND DETAILS				
SCALE 1:20, AND 1:5 @ A3				
JOB No MAB46	DRAWING No AZ83		REV /	