


NOTES: All dimensions must be checked on site and not scaled from this drawing.

Revit Link Schedule  
EYJW-PRP-BA-ZZ-M3-A-000001\_P33  
EYJW-PRP-BB-ZZ-M3-A-000002\_P29  
EYJW-RBG-BA-ZZ-M3-S-000001\_P13  
EYJW-RBG-BB-ZZ-M3-S-000001\_P16  
EYJW-RBG-BC-ZZ-M3-S-000001\_P15

| Rev | Date     | Description                | By   |
|-----|----------|----------------------------|------|
| P01 | 25.10.24 | Preliminary Issue          | C.P. |
| P02 | 09.04.25 | Revised to Client Comments | N.O. |
| C01 | 17.06.25 | Construction Issue         | B.C. |
| C02 | 18.07.25 | External Lighting Added    | N.O. |
| C03 | 03.09.25 | Revisions as clouded       | B.C. |
| C04 | 22.10.25 | Revised to Ext Ltg Calcs   | B.C. |
| C05 | 16.12.25 | Revised to client comments | B.C. |

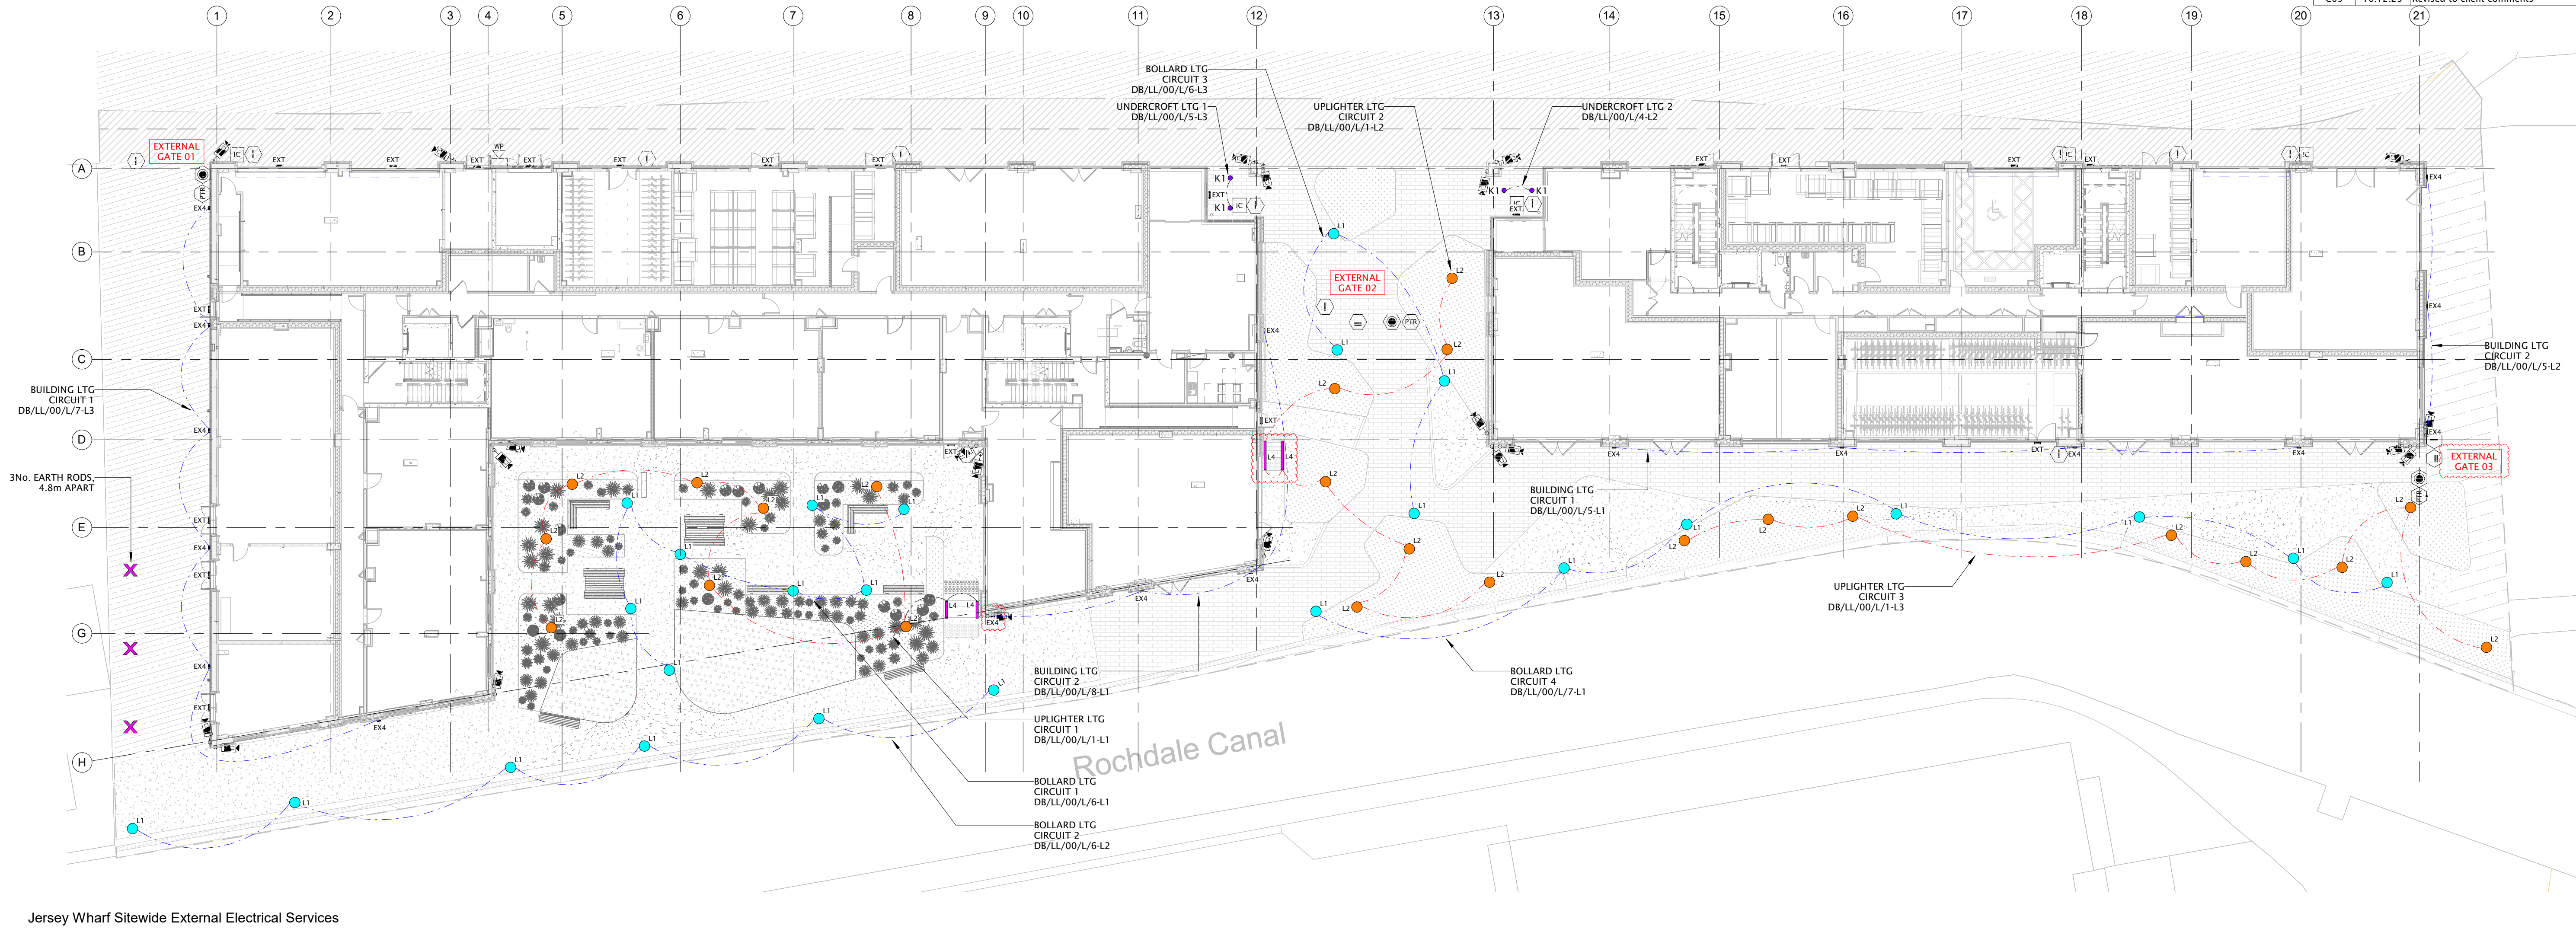

Jersey Wharf Sitewide External Electrical Services

1 : 200

GENERAL NOTES:

- THIS DRAWING IS TO BE READ IN COLOUR.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH AMEON TECHNICAL SUBMITTALS AND LAYOUTS FROM THE FOLLOWING AMEON GROUND FLOOR BLOCK A+B SERIES DRAWINGS:  
62 SERIES - SMALL POWER & DATA  
63 SERIES - LIGHTING  
67 SERIES - FIRE ALARM  
68 SERIES - SECURITY  
69 SERIES - LIGHTNING PROTECTION
- POSITIONS OF DUCTS TO EXTERNAL LIGHTING POSITIONS ARE SHOWN ON AMEON DRAWING NO EYJW-AME-ZZ-XX-DR-Z-500002 EXTERNAL DUCTING LAYOUT
- ALL EXTERNAL ELECTRICAL ACCESSORIES AND FITTINGS TO BE SUITABLY WEATHERPOOFED
- DATA AND INTERFACING FOR EXTERNAL GATES LOCATED INTERNALLY WITHIN BLOCK A+B. REFER TO THE AMEON SERVICE LAYOUTS FOR FURTHER INFORMATION.
- FIXING DETAILS FOR EXTERNAL GATE SECURITY ACCESSORIES TO BE CO-ORDINATED & CONFIRMED WITH GILLESPIES. SECURITY REQUIREMENTS BASED ON GILLESPIE DRAWINGS EYJW-GIL-EX-00-DR-L-900330, EYJW-GIL-EX-00-DR-L-900331 & EYJW-GIL-EX-00-DR-L-900332.

FINAL COORDINATION IS TO BE AGREED ON SITE.


EXTERNAL ELECTRICAL SERVICES LEGEND

- EXTERNAL STATIC DOME CAMERA
- VIDEO INTERCOM (COMELIT IP VIDEO) POE
- PROXIMITY CARD READER
- MAGLOCK
- PUSH TO RELEASE
- EMERGENCY BREAK GLASS
- COMBINED SOUNDER & VAD, WHITE LED, RED BODY, LOOP POWERED
- ANTI PANIC EMERGENCY BULKHEAD

EXTERNAL LIGHTING LEGEND


- BOLLARD LIGHT FITTING SHELBY SHE/10/949/3/BLK
- TREE UPLIGHTER LIGHT FITTING SALTA SALT/3/1600
- INTEGRATED HANDRAIL LIGHT FITTING - SUPPLIED BY OTHERS
- LED 1P54 4000K DOWNLIGHTER 1889/m 17W - HEM-1890-4-5G3
- LDL MINI BOXSTER NM EMERGENCY AVA - 9W-780LM-4K-FO

EXTERNAL LIGHTING POSITIONS BASED ON DWG NO. EYJW-GIL-EX-00-DR-L-900105

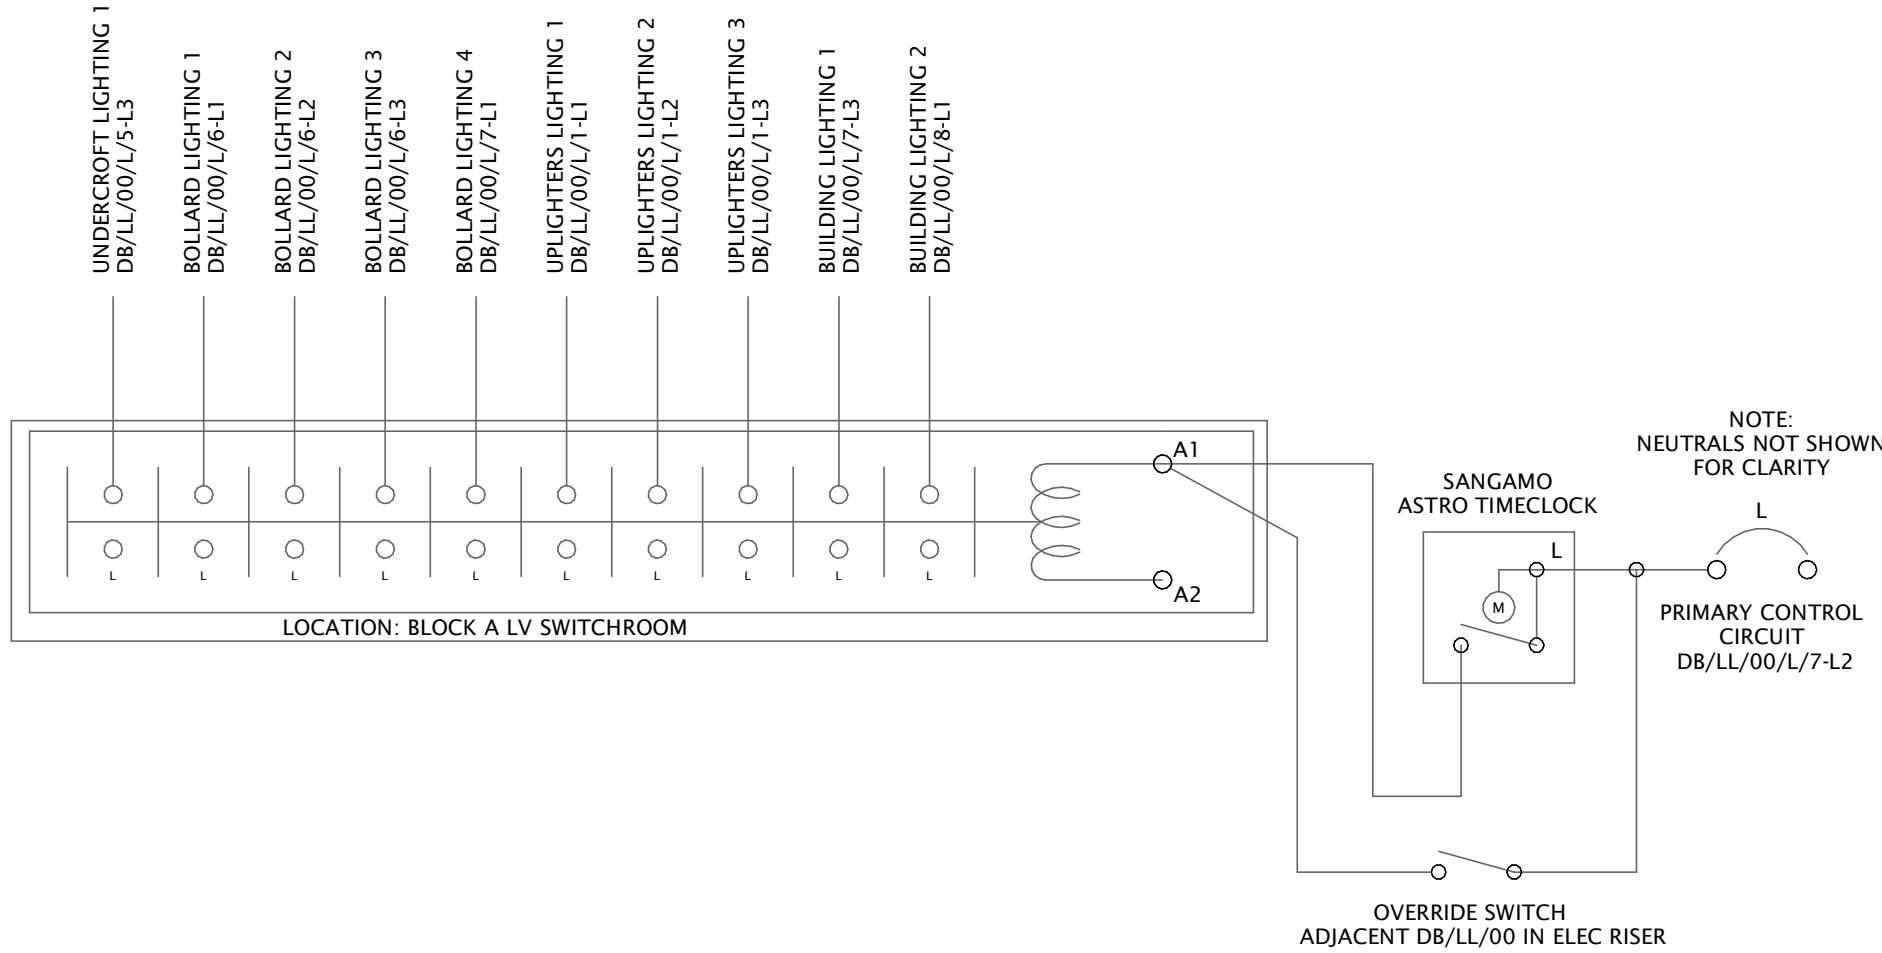

61 - Photocell T/C External Lighting Control Detail (Block A)

N.T.S.

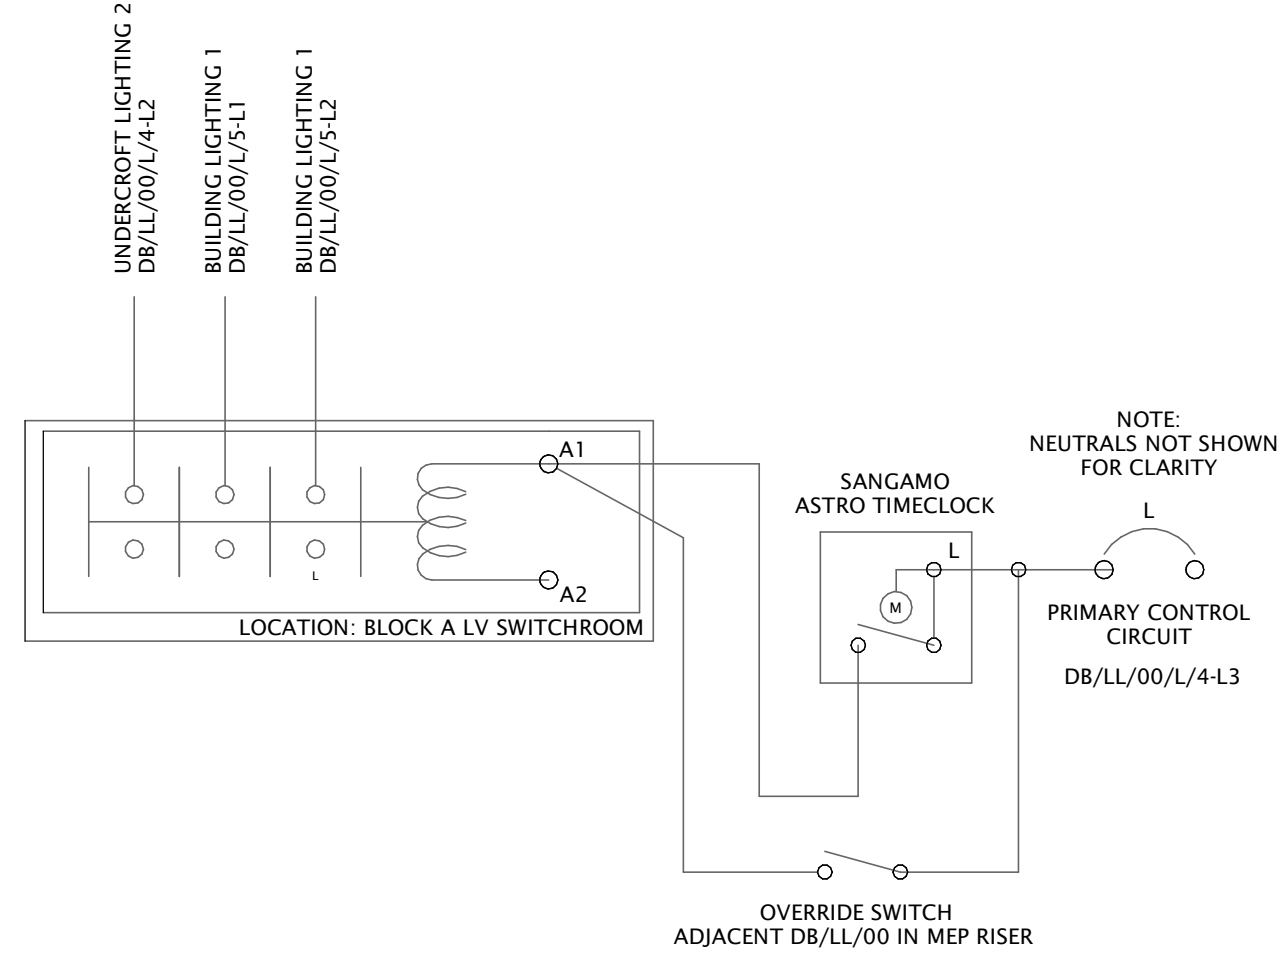

61 - Photocell T/C External Lighting Control Detail (Block B)

N.T.S.

0m 1m 2m 3m 4m 5m

VISUAL SCALE 1:50 @ A1

CONSTRUCTION

Company  
**ameon**  
Building Services Engineering  
Unit 9-10 Olympic Court, Boardmans Way, Whitehills Business Park, Blackpool, FY4 5GU  
Tel: 01253 760160  
Email: info@ameon.co.uk

Client  
**BUILDERS SISK CONTRACTORS**  
Established 1859

Job Title  
**Eliza & Jersey Site Wide Model Manchester**

Drawing Title  
**Jersey Wharf Sitewide External Electrical Services Layout**

Date  
**OCTOBER 2024**

Scale @ A1  
**As indicated**

Drawing Number  
**EYJW-AME-ZZ-00-DR-E-610014**