

Vent pipe detail at wall abutment

B

Lead slate turn up at roof abutment to align with top of soakers

75 Min

Code 6 lead flashing

Code 6 lead slate

New softwood boarding as NBS reference K20.222 supporting lead where slating omitted at wall abutment

Stainless steel wire balloon fitted into cast iron soil pipe

Lead sleeve dressed into the top of the copper pipe

Code 6 lead sleeve

Code 6 lead slate welded to lead sleeve

150 Minimum

Code 6 lead sleeve welded to lead slate with end soldered to copper pipe


500mm long 100mm diameter copper pipe

Pipe coupling by Mechanical Engineer

Cast iron pipe

Section A-A

B

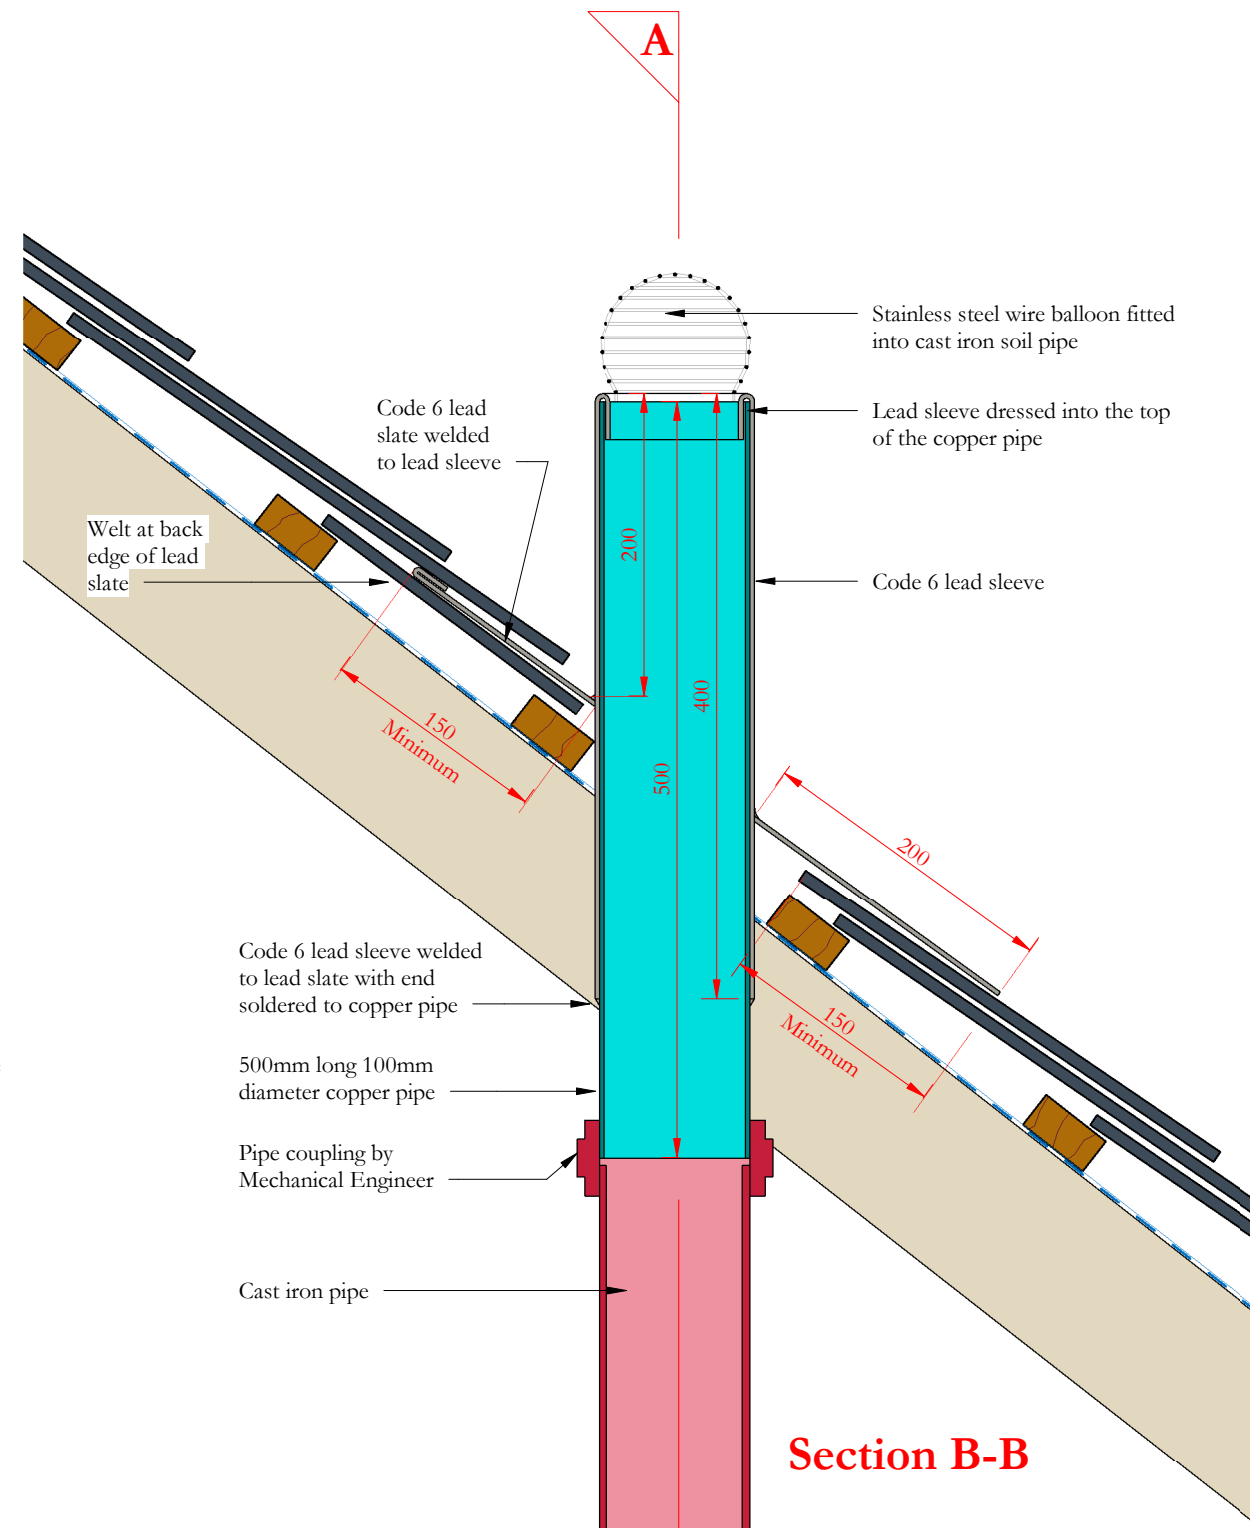

/10/2023 22:59:14