A0

This drawing shall not be scaled.
Work from the dimensions shown in the drawing or given in relevant specifications

LEGEND

- SMOKE DETECTOR (OPTICAL)
- SMOKE DETECTOR WITH INTEGRAL VISUAL ALARM DEVICE, STROBE OR BEACON AND SOUNDER BASE (OPTICAL)
- MANUAL CALL POINT
- BEACON
- HEAT DETECTOR
- HEAT DETECTOR WITH INTEGRAL VISUAL ALARM DEVICE, STROBE OR BEACON AND SOUNDER BASE (OPTICAL)

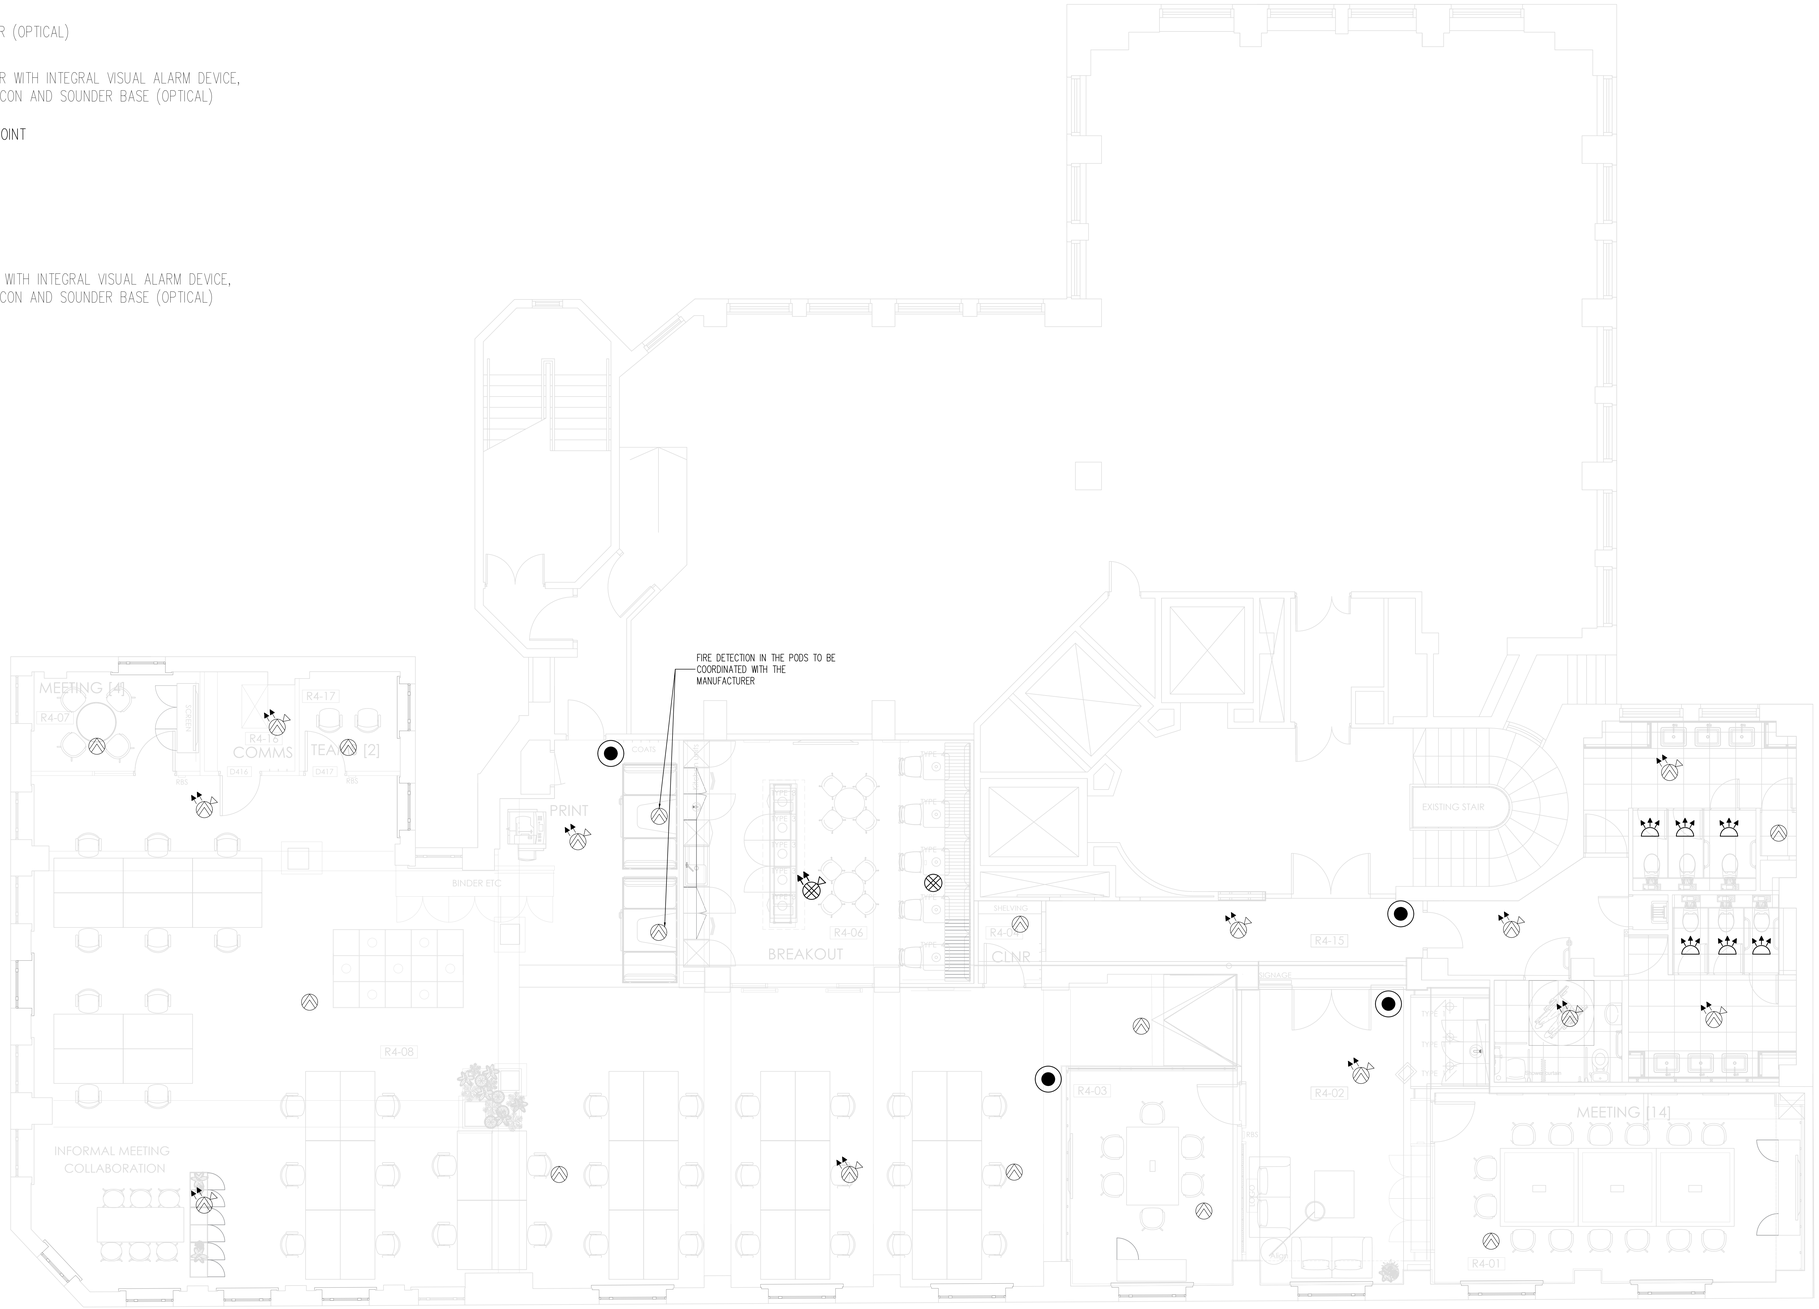

CEILING ARRANGEMENT

CDM Regulations:

In addition to any information included in this drawing or the model from which it is derived, refer also to the project CDM Risk Register for information on residual risks.

General Notes:

- The drawing does not necessarily show all the information needed to interpret the design intent or the construction details.
- The drawing contains information from more than one source and must be read in conjunction with all relevant specifications.
- Any apparent drafting errors and differences between other drawings and specifications shall be brought to our attention.

Project Notes:

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER M&E SERVICES DRAWINGS AND SPECIFICATIONS.
2. THE CONTRACTOR IS TO NOTE THAT THIS DRAWING SHOWS DESIGN INTENT WITH INDICATIVE SERVICES LAYOUT. DESIGN RESPONSIBILITY LIES WITH THE CONTRACTOR WHO SHALL BE RESPONSIBLE FOR ESTABLISHING EXACT QUANTITIES, SELECTIONS, DISTRIBUTION ROUTES OF THE EQUIPMENT AND THE SYSTEM TO MEET THE SPECIFICATION.
3. CONTRACTOR IS TO MAKE ALLOWANCE FOR 3NO. FIRE ALARM INTERFACES FOR MECHANICAL PLANT.
4. FINAL LOCATIONS OF FIRE ALARM DEVICES AND PANELS TO BE CONFIRMED AND AGREED BY THE FIRE SPECIALIST IN ACCORDANCE WITH THEIR STRATEGY.
5. SYSTEM SHOULD BE IN ACCORDANCE WITH BS 5839-1 AND DESIGNED TO MEET CATEGORY L1
6. SYSTEM IS TO BE DESIGNED AS A SINGLE STAGE ALARM.
7. FITOUT CONTRACTOR TO LIAISE WITH THE INCUMBENT FIRE ALARM CONTRACTOR

Index	Description	Designed	Reviewed	Authorised	Date
P01	PRELIMINARY ISSUE	MT	BB	SM	07/11/25

REVISIONS:

HOARE LEA

ARCHITECT:
Bluesky Design Interiors Ltd

CLIENT:
Grosvenor OEI Ltd

PROJECT TITLE:
Ship Canal House 4th Floor Refurbishment Works

DRAWING TITLE:
Fire Detection

PRELIMINARY ISSUE

PERSON RESPONSIBLE FOR:		
Design: MT	Review: BB	Authorising Issue: SM
Project No: 17/18784	Date: 07/11/25	Scale @ A0: 1:100

DRAWING NUMBER:	Status:	Rev:
791-E1718784-HLEA-XX-04-DR-E-754001	S3	P01

© Hoare Lea LLP