
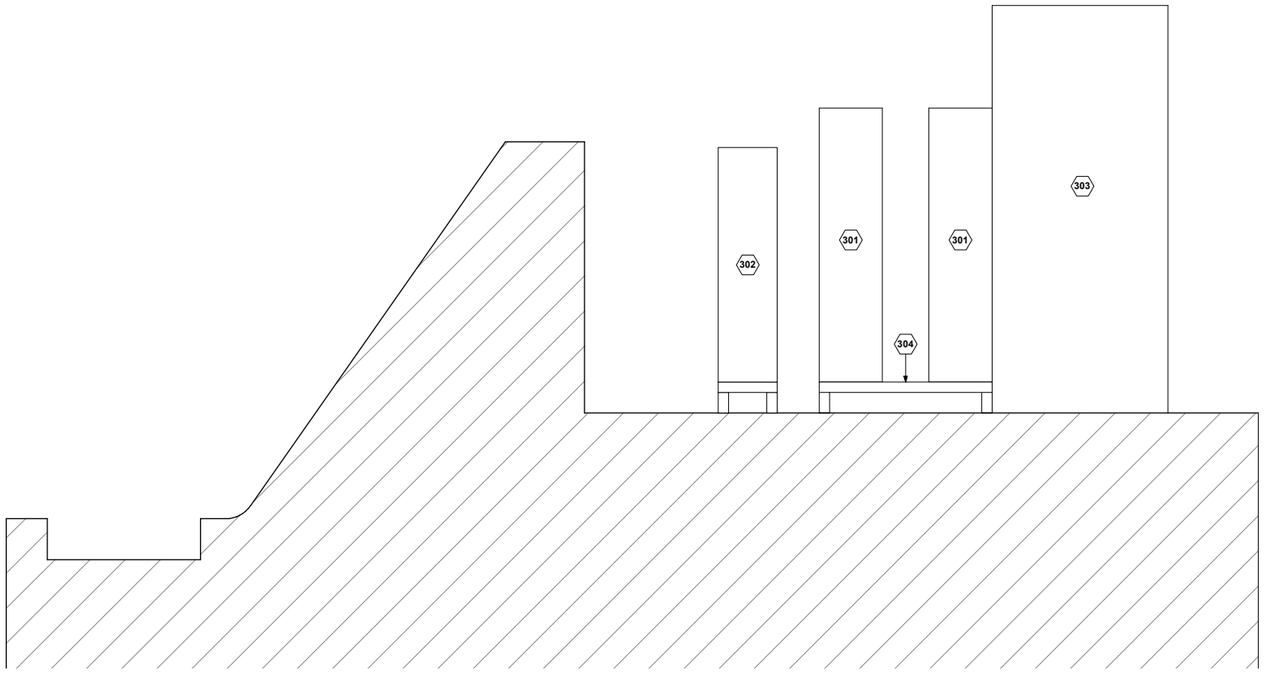


1 EXISTING ROOF TOP SECTION

PL400 SCALE 1:15 @ A1

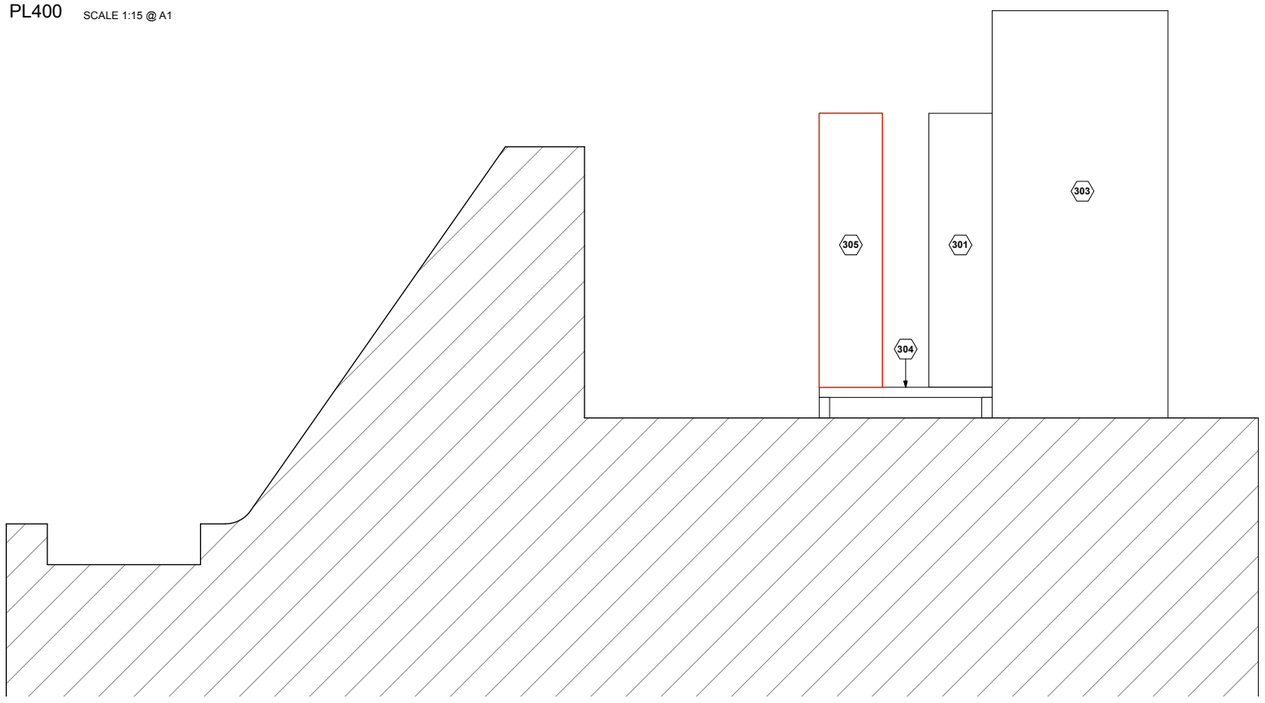

2 PROPSED ROOF TOP SECTION

PL400 SCALE 1:15 @ A1

KEY NOTES

KEY

301 EXISTING TOSHIBA RAV-SP1104AT-E1 EXTERNAL CONDENSER UNIT SERVING EXISTING CASSETTES WITHIN UNITS 1-5.

302 EXISTING ROOF MOUNTED AIR CONDITIONING CONDENSER SERVING UNIT.

303 SERVICE RISER FROM GROUND FLOOR.

304 EXISTING SUPPORT SYSTEM AND CONTAINMENT TRAY.

305 NEW TOSHIBA RAV-SP1604AT8-E SPLIT EXTERNAL CONDENSER UNIT (TO REPLACE EXISTING UNIT) SERVING BASEMENT, UTILISING EXISTING FREESTANDING MOUNTING SYSTEM, REFRIDGERANT PIPEWORK AND CONTAINMENT.

LEGEND

OUTSIDE OF DEMISE AREA.

0 0.5 1 1.5

Scale bar (metres) 1:15

apt.design

Studio 1
31 Main Street, Kilby
Leicestershire, UK, LE18 3TD

Studio 2
2nd Floor, 22 Conduit Street
London, UK, W1S 2XR

W www.apt-design.co.uk T +44 (0)1858 469420

For Office Use: A_12746

ANTHROPOLOGIE

1-5 ST. ANNS SQUARE
MANCHESTER
M2 7EF

CONSULTANT :

DRAWN BY:

OTB

ISSUE / DATE:

PLANNING/LBC	31.10.2025

REVISION :

SHEET TITLE :

PROPOSED
ROOFTOP SECTION

SHEET NO. :

PL400

Figured dimensions shall be taken in preference to scaled dimensions and any discrepancies or errors are to be referred to the Designer. Contractors, sub-contractors and suppliers must verify all dimensions on site before commencing work or making any fabrication drawings. © Copyright Reserved