
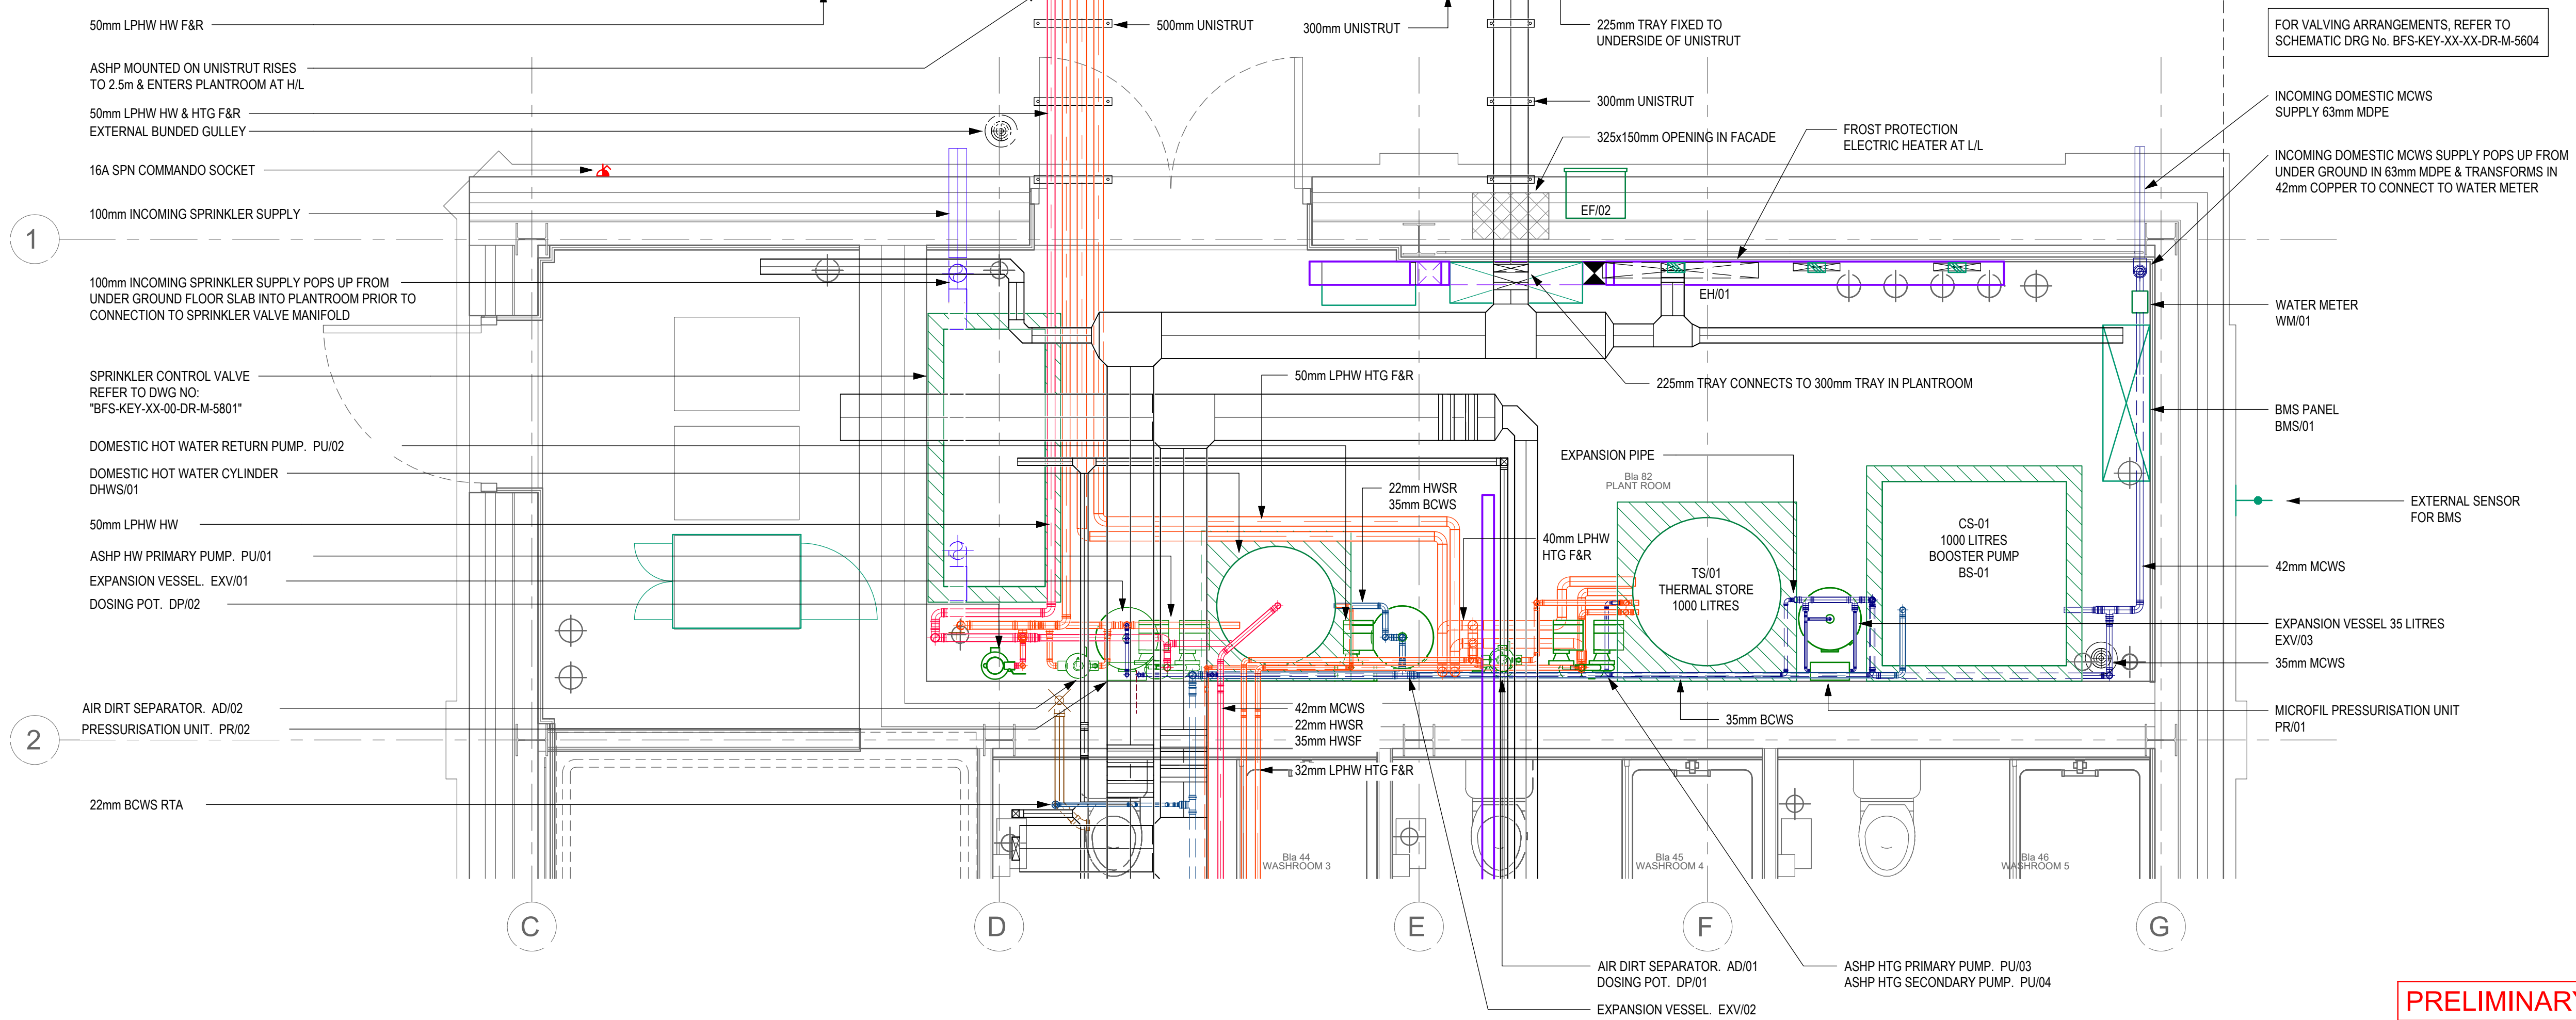


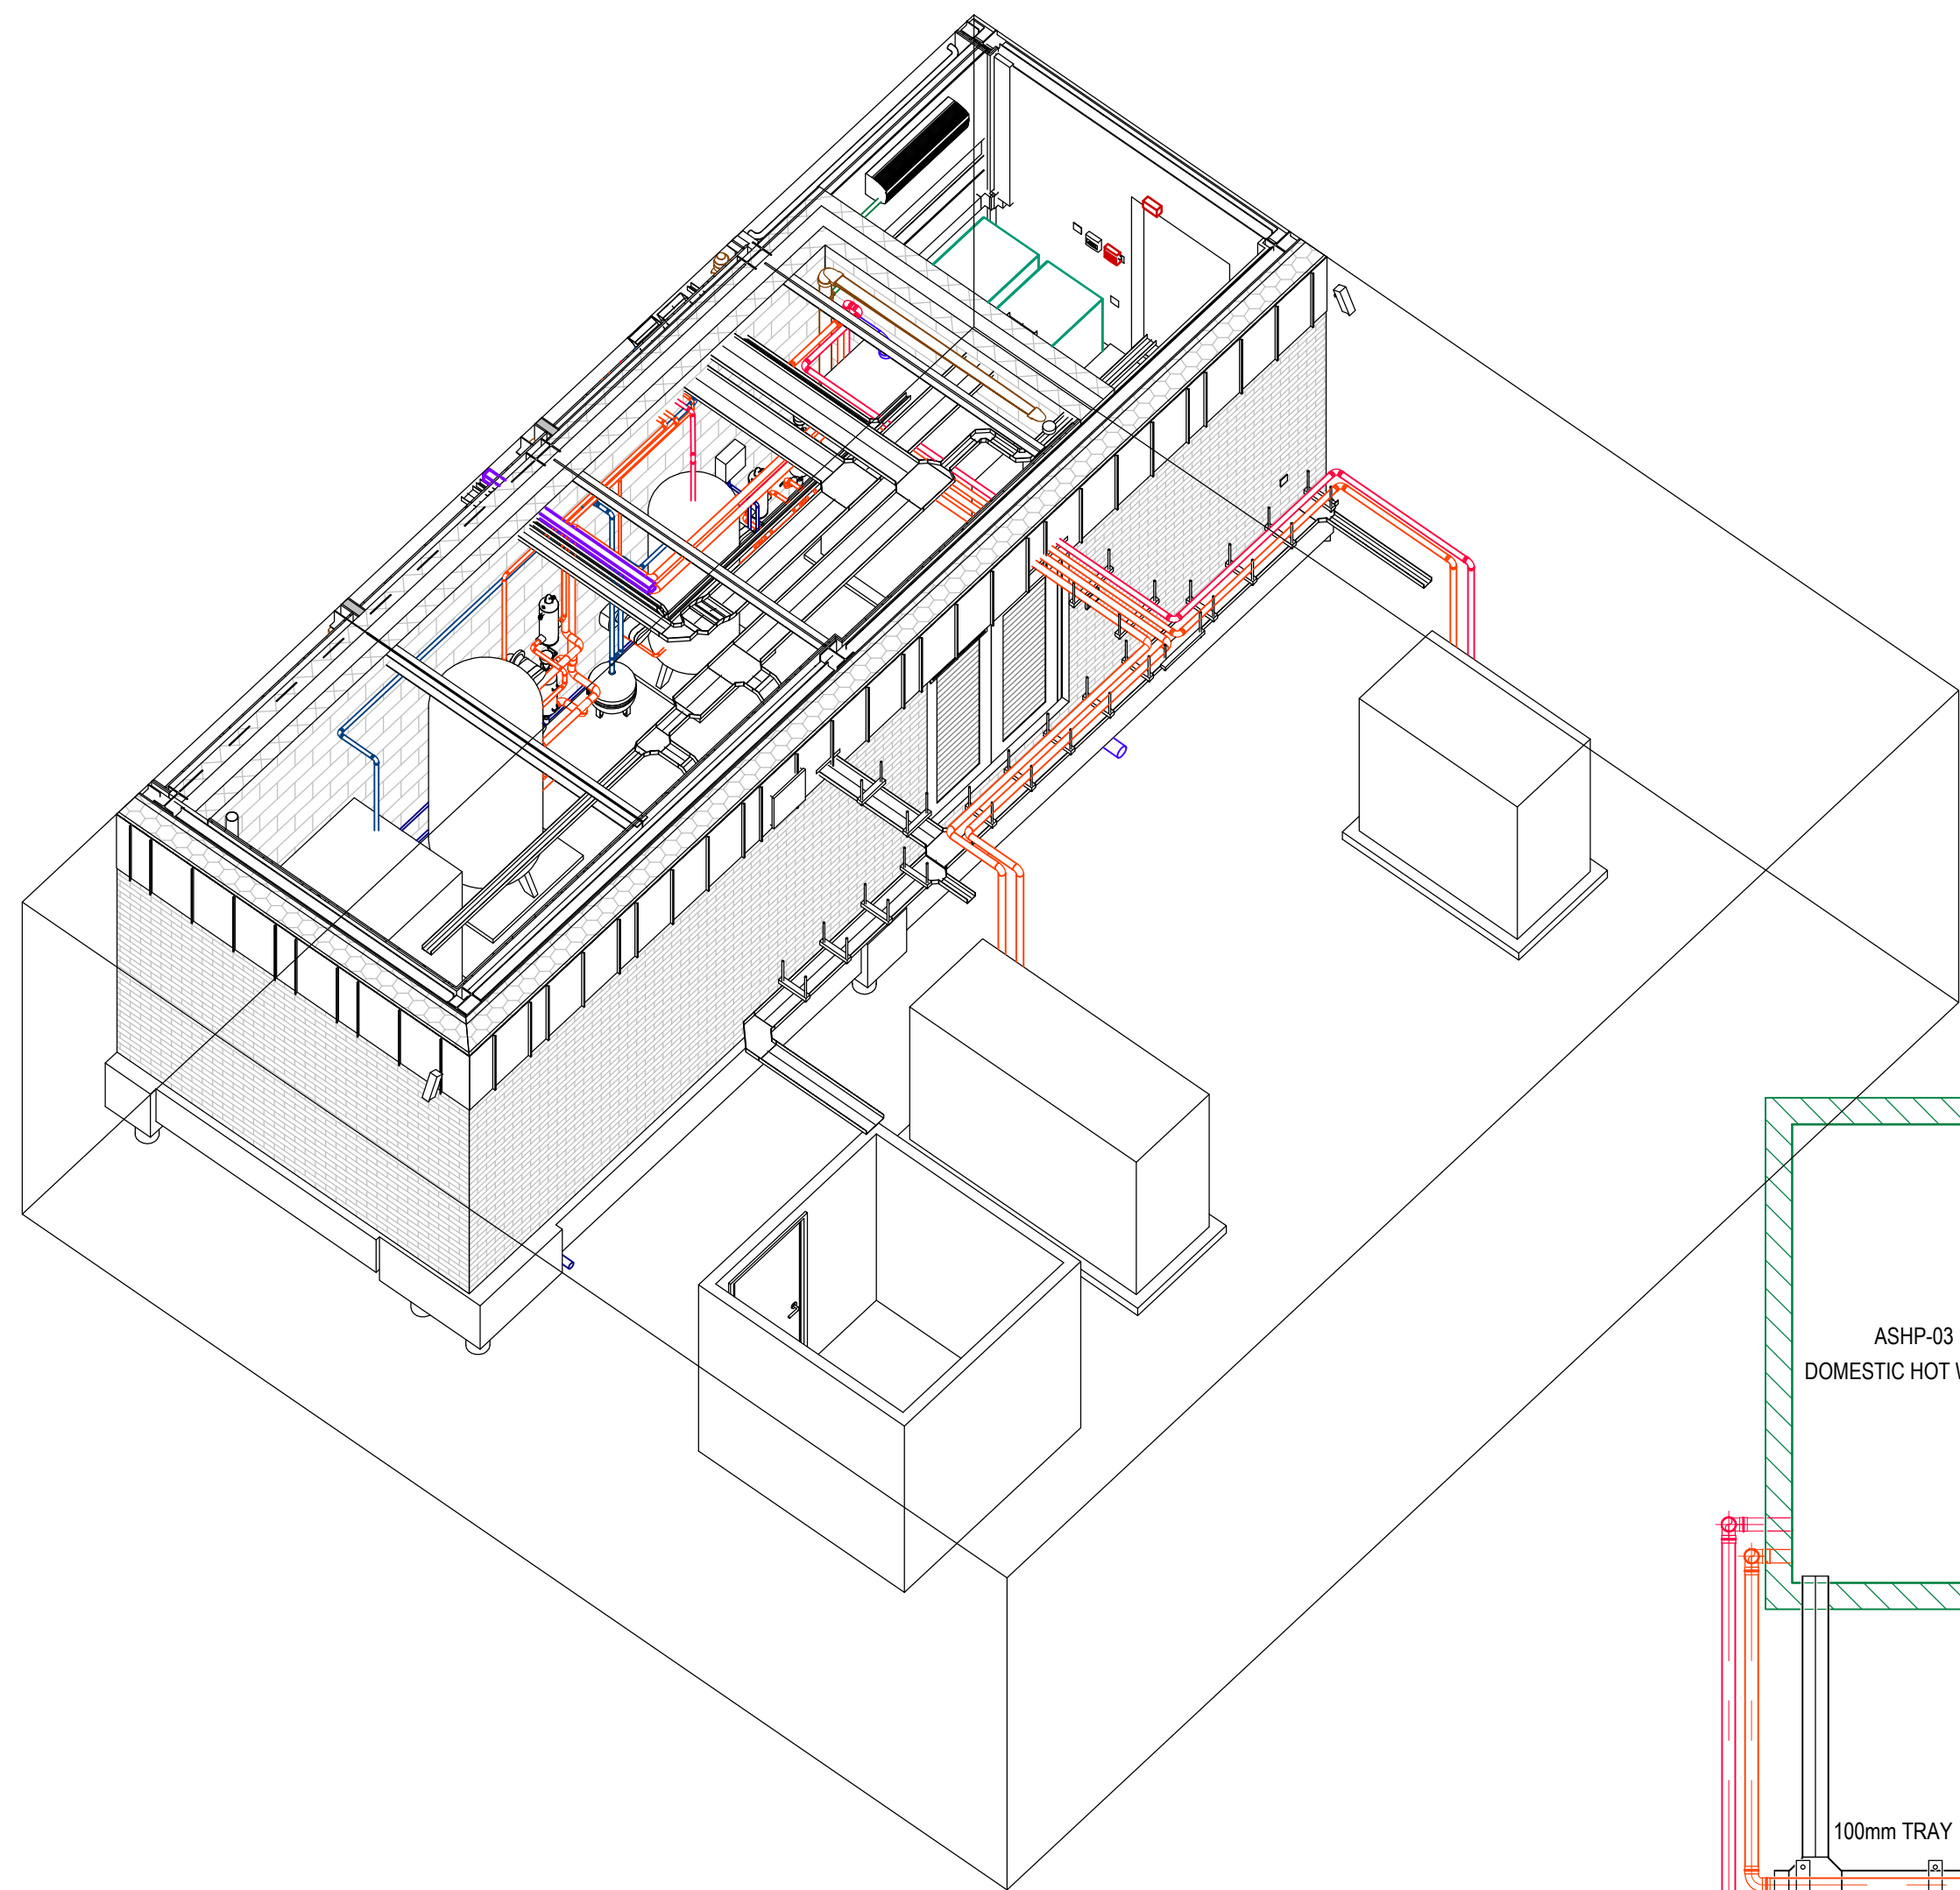

NOTES

- DO NOT SCALE FROM THIS DRAWING.
- THIS SECTION TO BE READ IN CONJUNCTION WITH THE SPECIFICATION, ARCHITECTS DIMENSIONED LAYOUTS AND ALL OTHER RELEVANT CONTRACT DRAWINGS.
- ALL INSTALLATIONS TO COMPLY FULLY WITH CURRENT WATER BYELAWS, REQUIREMENTS OF BS 6700, BS-EN-806 AND LOCAL WATER AUTHORITIES.
- ALL FITTINGS, PLANT AND EQUIPMENT TO BE INSTALLED, REGULATED AND TESTED IN ACCORDANCE WITH THE MANUFACTURERS PRINTED INSTRUCTIONS.
- ALL PIPEWORK, FITTINGS AND EQUIPMENT TO BE INSTALLED TO PROVIDE SYSTEMS FREE OF AIR LOCKS, WATER HAMMER OR LEAKS.
- ALL SERVICES IN COPPER PIPEWORK TO BS 2871 PART 1: TABLE X & BS-EN-1057.
- ALL FITTINGS TO BE NON-DEZINCIFIABLE AND COMPLY WITH BS 864 & BS-EN-1254.
- ALL CAPILLARY FITTINGS TO HAVE LEAD FREE SOLDER RINGS AS YORKSHIRE POTABLE RANGE.
- STOPCOCKS & GATE VALVES TO BS 5154, DOUBLE CHECK VALVES & NON RETURN VALVES TO BS 6282 : DRAIN VALVES TO BS-EN-1254.
- ALL TERMINAL CONNECTIONS TO APPLIANCES TO BE FITTED WITH INDEPENDENT BALLOFIX VALVES.
- ALL VALVES TO BE FULLY ACCESSIBLE AND BE PROVIDED WITH IDENTIFICATION LABELS.
- DRAIN VALVES TO BE PROVIDED AT ALL LOW POINTS IN ALL SYSTEMS.
- ALL PIPEWORK IN CEILING VOID DUCTS AND ENCLOSURES TO BE FULLY INSULATED. PIPEWORK WITHIN FLOOR VOIDS TO HAVE ARMOURFLEX INSULATION DUE TO SPACE RESTRICTIONS.

THIS DRAWING IS THE COPYRIGHT© OF KEY IS.
IT MUST NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT PRIOR CONSENT. DO NOT SCALE FROM THIS DRAWING. WORK TO FIGURED DIMENSIONS ONLY. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER MECHANICAL, ELECTRICAL & PUBLIC HEALTH DRAWING, SPECIFICATIONS AND SCHEDULES.

PRELIMINARY

P01 Issued for Stage Approval		02.05.25
Rev	Amendment	Date
KEYIS Engineered to deliver		
T: 01925 759948 F: 01925 758400 E: info@keyis.com W: www.keyis.com		
Client ROBERTSON		
Project Title Blackley Fire Station		
Drawing Title Proposed Plantroom Layout		
Drawn By CJG	Checked By RDI	Approved By GW
Scale @ A1 N.T.S		
Document Number BFS-KEY-XX-00-DR-M-6605	Status S4	Revision P01