



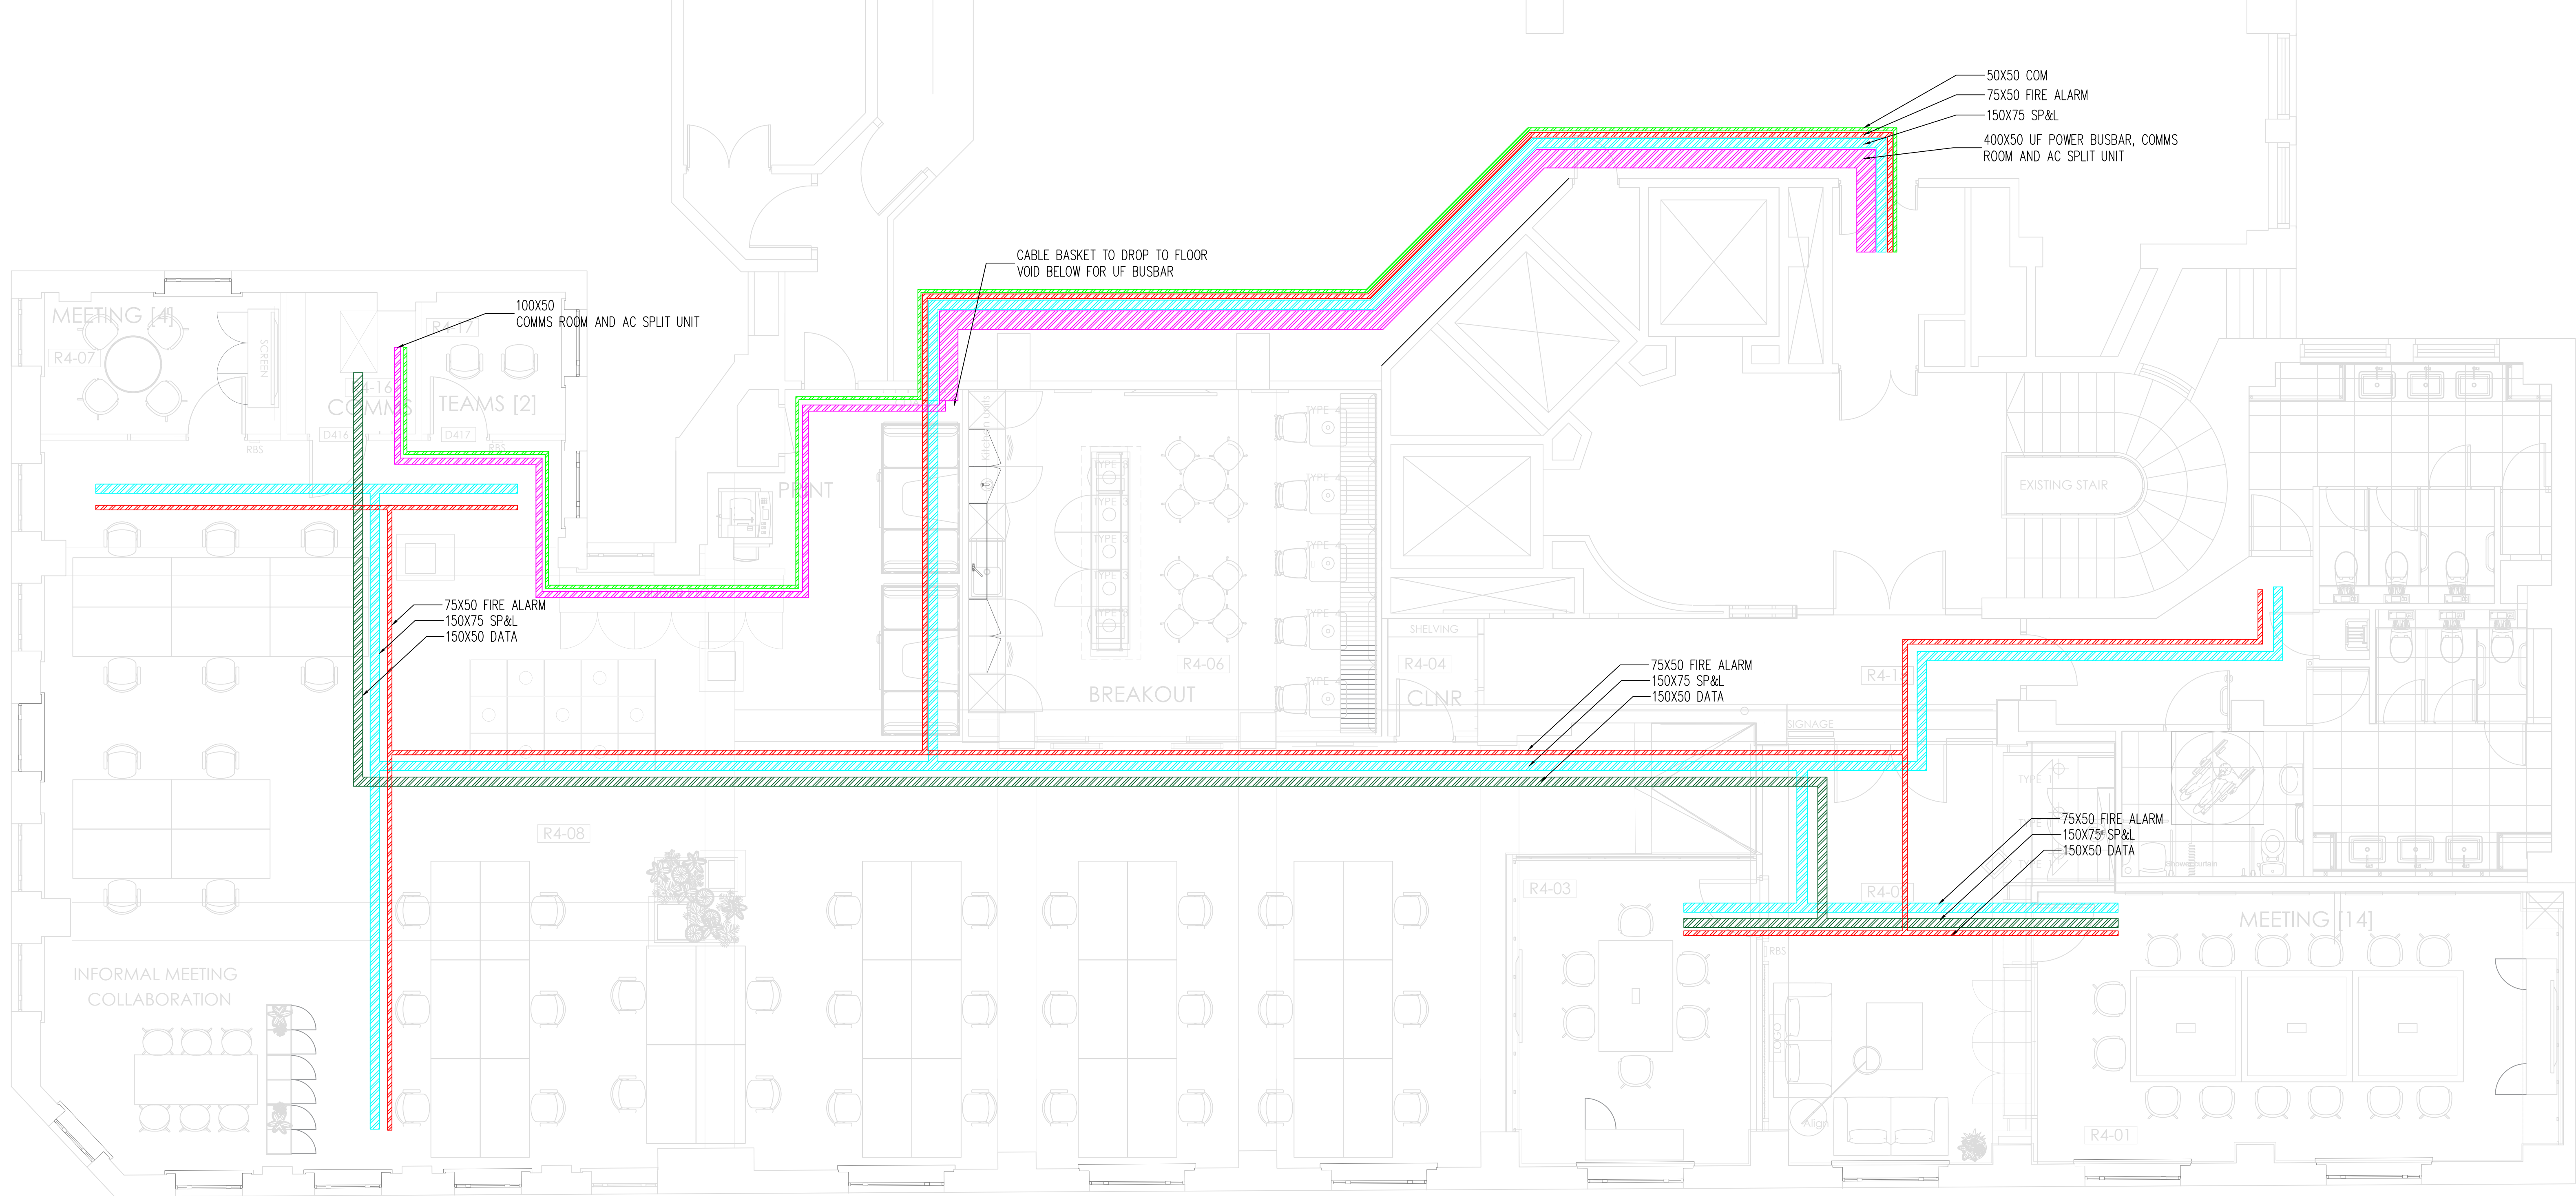

HIGH LEVEL CONTAINMENT

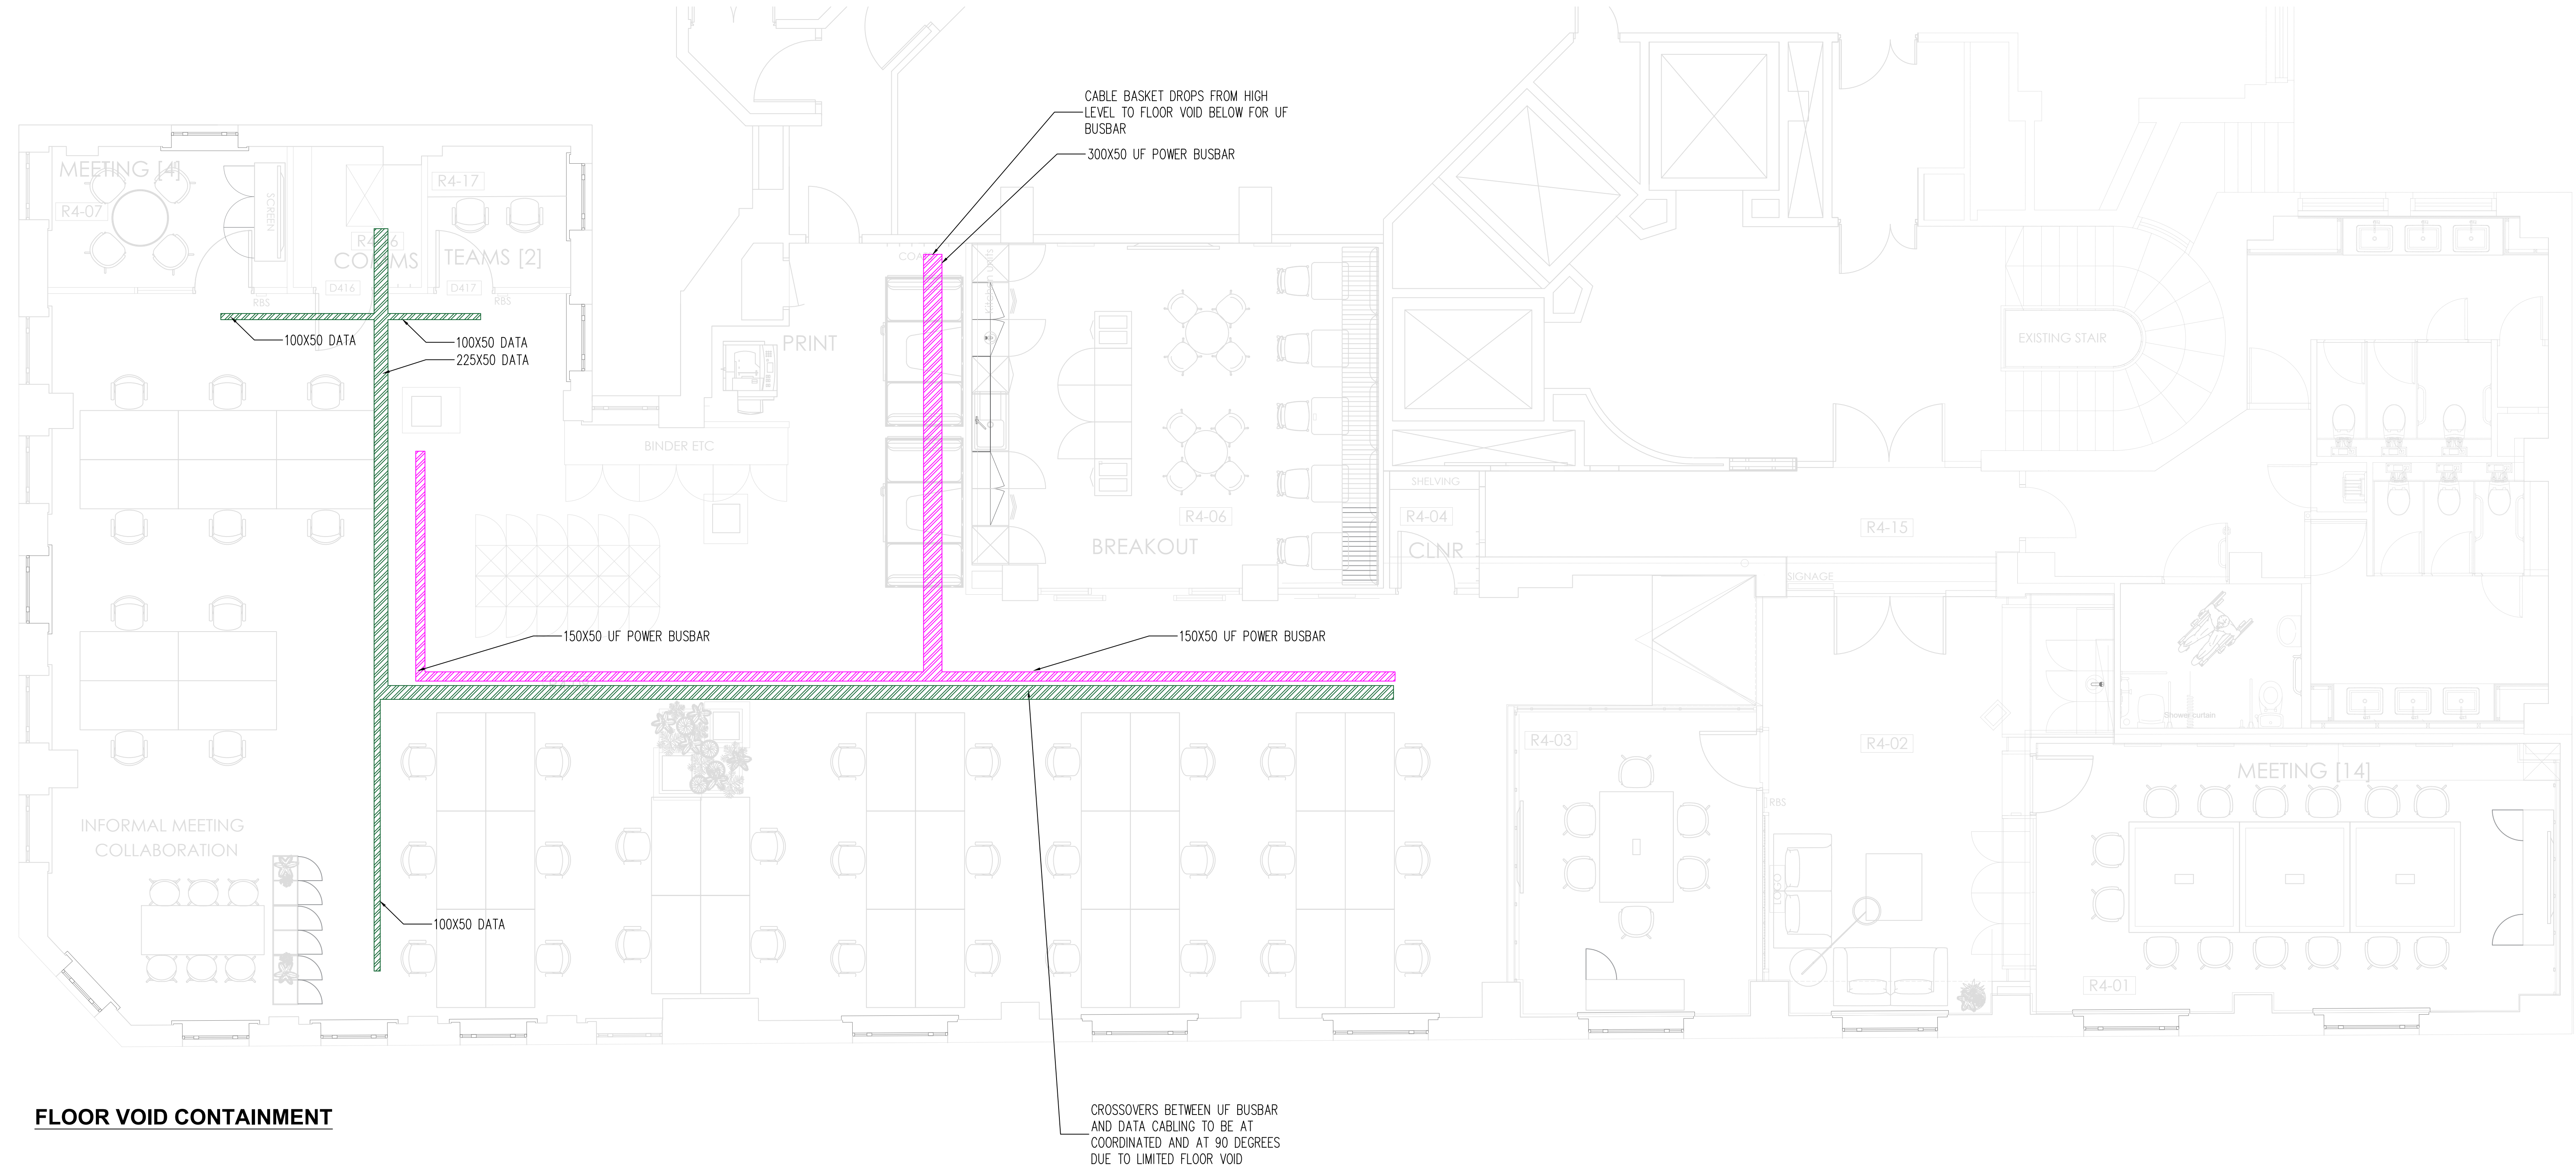

FLOOR VOID CONTAINMENT

LEGEND

CONTAINMENT TAGS: (SIZES AS NOTED)

COM/DATA CABLE BASKET FOR COMMS / DATA SERVICES

UF POWER BUSBAR CABLE BASKET RUNNING IN FLOOR VOID FOR UNDERFLOOR BUSBAR SUPPLIES

ELV CABLE BASKET FOR EXTRA LOW VOLTAGE SERVICES C/W SEGREGATION FILLETS FOR SECURITY, AV SERVICES & HIGH LEVEL COMMUNICATION SERVICES WHERE ONE BASKET IS USED MULTIPLE SERVICES

FIRE BASKET FOR FIRE ALARM SERVICES

SP&L TRUNKING FOR SMALL POWER & LIGHTING

- LOW VOLTAGE
- SMALL POWER AND LIGHTING
- FIRE
- COMMS CABLING
- CLIENT DATA CABLING

CDM Regulations:

In addition to any information included in this drawing or the model from which it is derived, refer also to the project CDM Risk Register for information on residual risks.

General Notes:

- The drawing does not necessarily show all the information needed to interpret the design intent or the construction details.
- The drawing contains information from more than one source and must be read in conjunction with all relevant specifications.
- Any apparent drafting errors and differences between other drawings and specifications shall be brought to our attention.

Project Notes:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH OTHER W&E SERVICES DRAWINGS AND SPECIFICATIONS.
- THE CONTRACTOR IS TO NOTE THAT THIS DRAWING SHOWS DESIGN INTENT WITH INDICATIVE SERVICES LAYOUT. DESIGN RESPONSIBILITY LIES WITH THE CONTRACTOR WHO SHALL BE RESPONSIBLE FOR ESTABLISHING EXACT QUANTITIES, SELECTIONS, DISTRIBUTION ROUTES OF THE EQUIPMENT AND THE SYSTEM TO MEET THE SPECIFICATION.
- CONTAINMENT SIZES TO BE FINALISED BY THE CONTRACTOR TO SUIT THEIR DESIGN.
- A SPARE ALLOWANCE OF 25% TO BE MAINTAINED FOR ALL CONTAINMENT.
- CONTAINMENT RUNS AT HIGH LEVEL TO BE WITHIN CEILING VOID WITH ALL CABLES SUPPORTED BY SUITABLY FIRE RATED STRAPS AS DECLARED BY BS7671.

Rev	Description	Design	Revised	Authorised	Date
P01	PRELIMINARY ISSUE	MT	BB	SM	07/11/25

REVISIONS:

HOARE LEA 		
ARCHITECT: Bluesky Design Interiors Ltd		
CLIENT: Grosvenor OEI Ltd		
PROJECT TITLE: Ship Canal House 4th Floor Refurbishment Works		
DRAWING TITLE: Containment Layout		
PRELIMINARY ISSUE		
PERSON RESPONSIBLE FOR:		
Design: MT	Review: BB	Authorising Issue: SM
Project No: 17/18784	Date: 07/11/2025	Scale @ A0: 1:100
DRAWING NUMBER: 791-E1718784-HLEA-XX-04-DR-E-703001		Status: Rev: S3 P01