GRADATION ANALYSIS TEST REPORT

Product: **10/20mm Single Size**

Material Code: **1020**

Supplied by: Dow low Quarry


Customer:

Site Address:

Material type: BS EN 12620 / Limestone

Test method: BS EN 933-1:2012

Sample number	34628
Ticket No	
Sampled by	Mellor
Date Sampled	18/12/2023
Sample location	Asphalt Bay
Weather Conditions	Cloudy

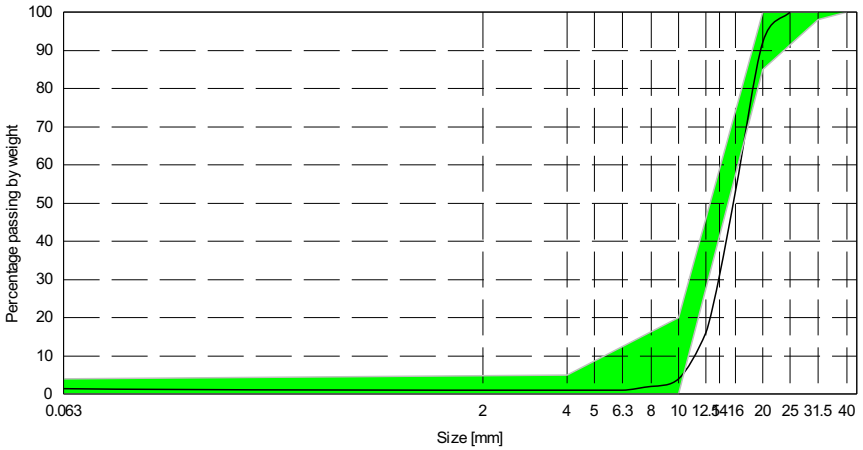

Sieve Size (mm)	Percent passing	Specification	Complies (Spec)
40	100	100	Yes
31.5	100	98 - 100	Yes
25	100	-	-
20	92	85 - 100	Yes
16	53	-	-
14	31	-	-
12.5	16	-	-
10	4	0 - 20	Yes
8	2	-	-
6.3	1	-	-
5	1	-	-
4	1	0 - 5	Yes
2	1	-	-
0.063	1.3	0 - 4.0	Yes
Moisture content (%)	0.5		
Uniformity Coefficient	1		

Sampled By: Mellor Tested By: Mellor Date Tested: 20/12/2023