


SECTION 'A' - 'A ON GRID LINE 7 Scale 1:50

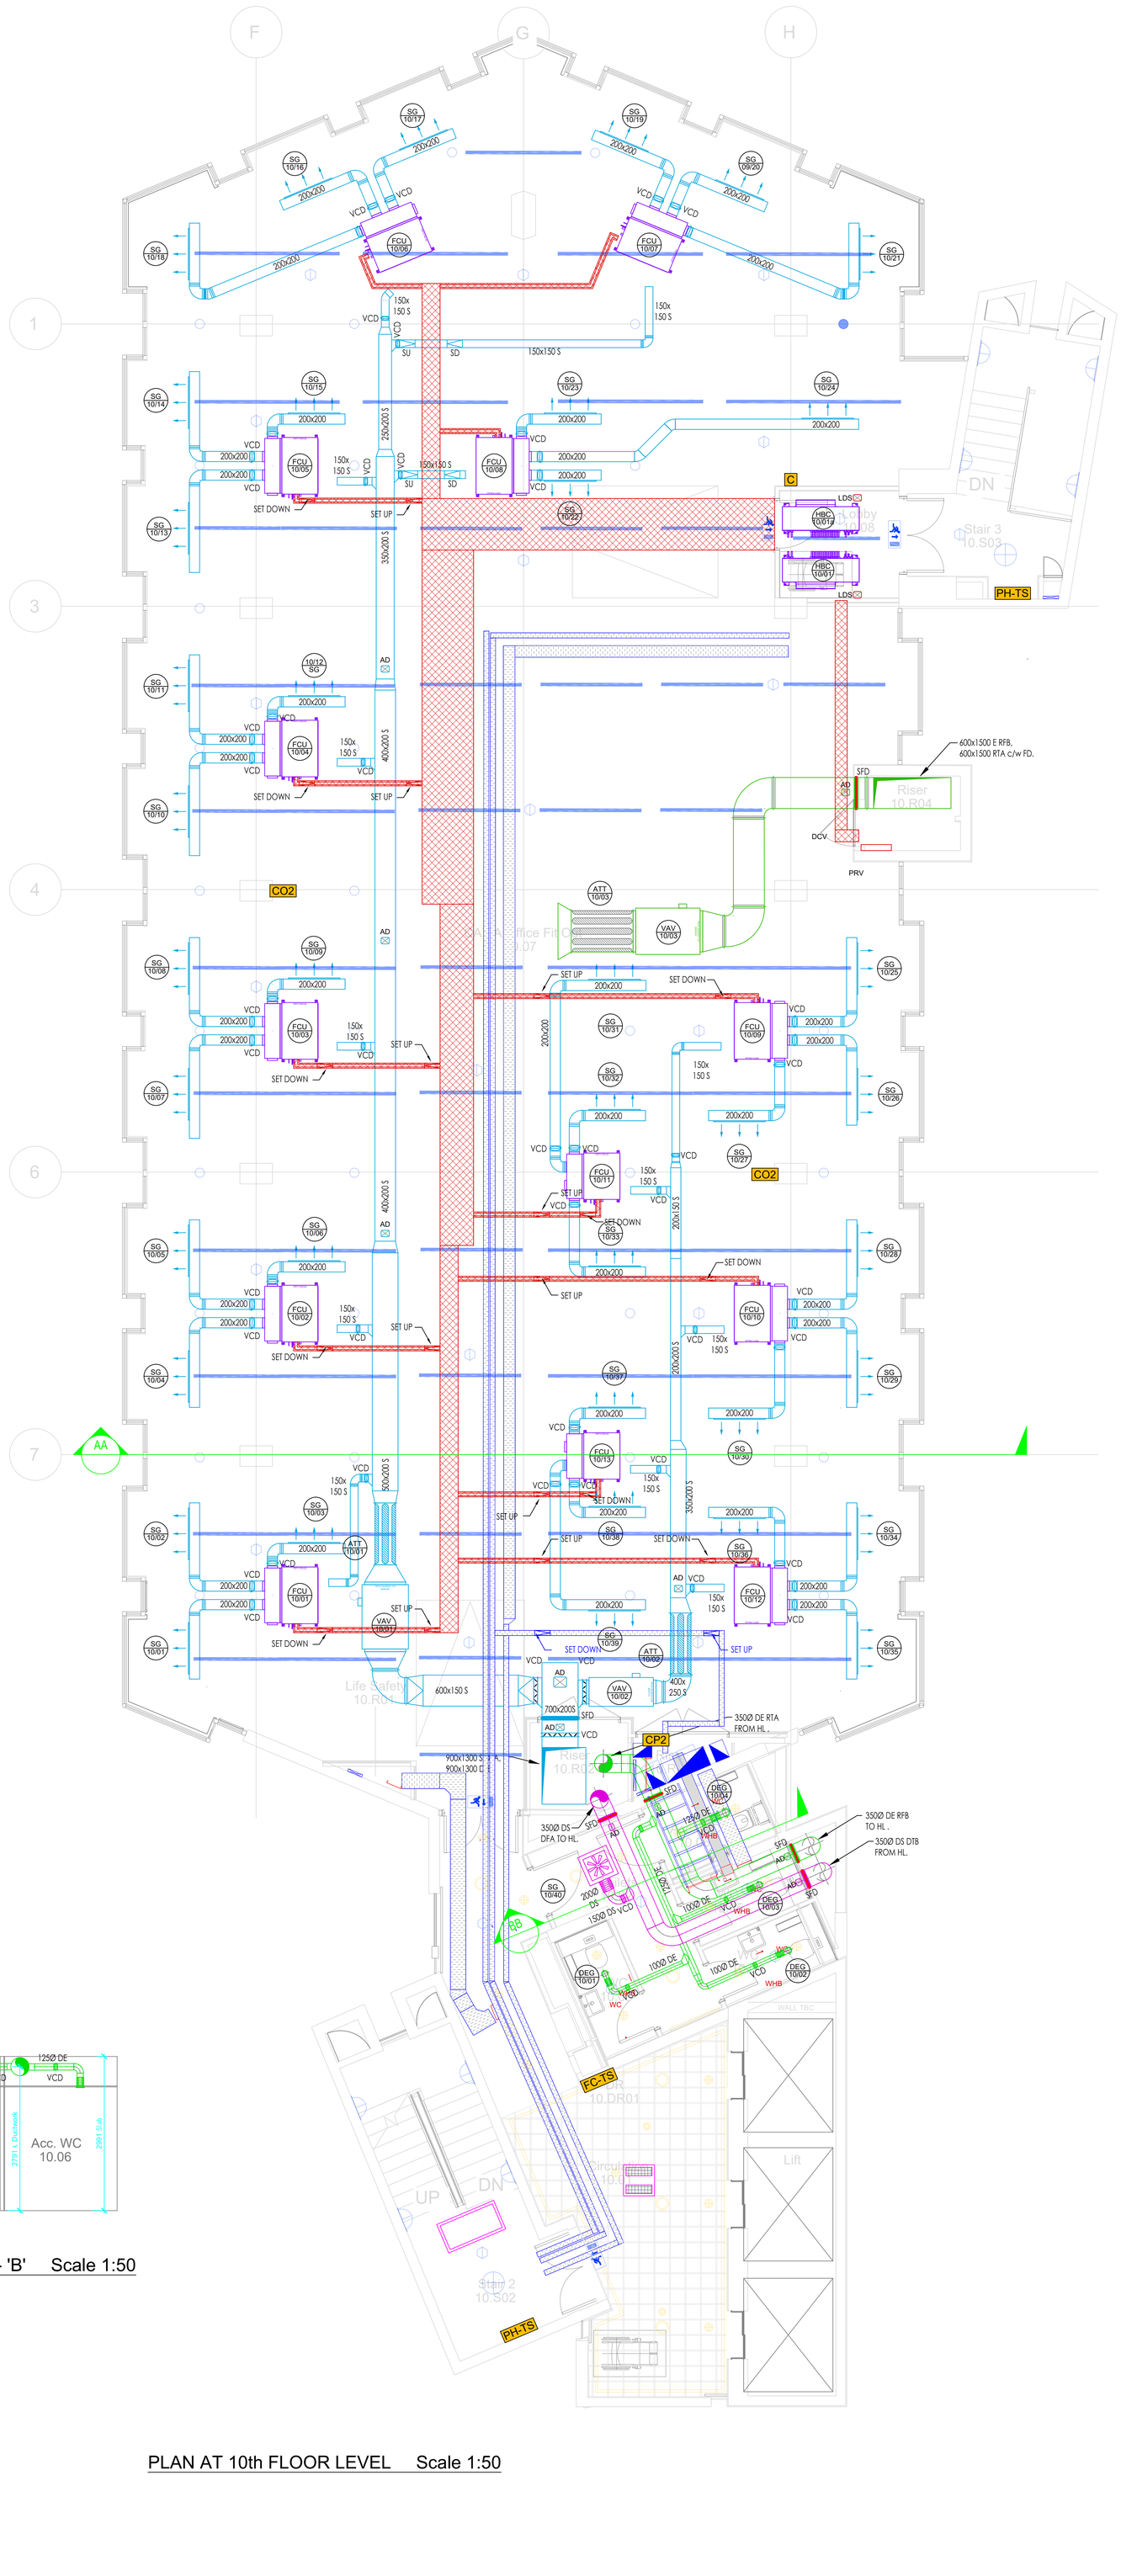

NOTES


- CONDENSATE DRAINS TO FOLLOW ROUTES OF REFRIGERATION PIPEWORK AND DISCHARGE INTO LOCAL WASTE STACK (LOCATION TO BE AGREED ON SITE TO SUIT FALL OF DRAIN PIPEWORK)
- FOR DETAILS OF LTHW PIPEWORK SEE DRG. CW1193-M-56-10-01

ELECTRICAL EQUIPMENT LEGEND

- FIRE ALARM BACKET
- POWER BASKET
- COMMS TRAY

MECHANICAL EQUIPMENT LEGEND

- MITSUBISHI HVRF DUCTED FAN COIL
- DUCT MOUNTED LINEAR GRILLE
- VCD VOLUME CONTROL DAMPER
- VCD VOLUME CONTROL DAMPER
- ATTENUATOR
- VAV - VARIABLE AIR VOLUME UNIT
- SFD SMOKE/FIRE DAMPER
- AD ACCESS DOOR
- AC PIPEWORK TRAY
- AC PIPEWORK
- LDS LEAK DETECTION SENSOR
- C AC CONTROLLER

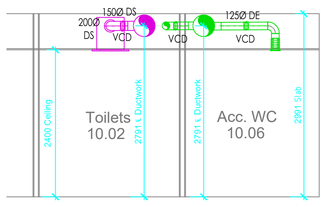

SECTION ON 'B' - 'B' Scale 1:50

PLAN AT 10th FLOOR LEVEL Scale 1:50

Revision

Revision	Description	Date	Drawn by	Checked by	Dwg. Status

Client: Bruntwood

Project: Pall Mall
Manchester

Title: Coordinated M+E Services Layout
10th Floor Level

Drawn by	P.S.
Checked by	D.I.
Approved by	S.K.
Scale	1:50
Sheet Size	A0
Issue Date	OCT25
Contract No.	CW1193
Drawing No.	ME-59-10-01
Revision	AF

AS FITTED

2nd Floor Spinnaker Court,
31 Broadway, Salford,
Manchester M50 2YR.

The contractor is to check all dimensions and conditions on site before commencing. DO NOT SCALE – USE FIGURED DIMENSIONS ONLY. This drawing is confidential & is the property of CubicWorks Ltd. It must not be copies, lent or disclosed to any third party without prior written consent.