

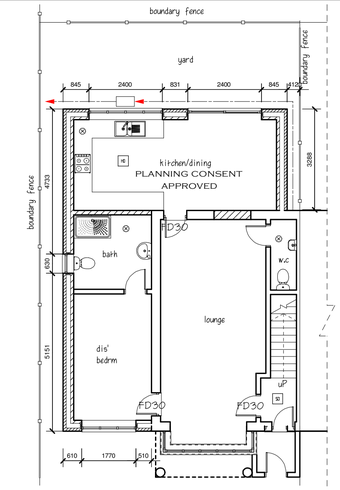



Proposed ground floor plan

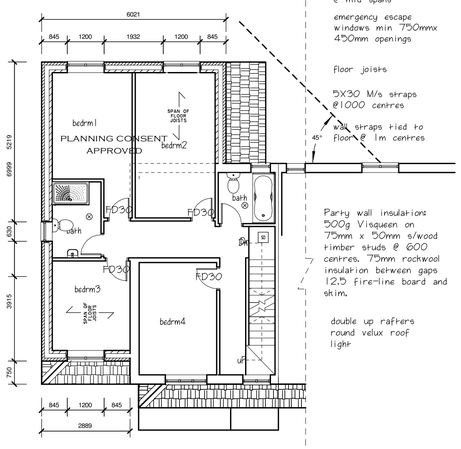

Proposed first floor plan

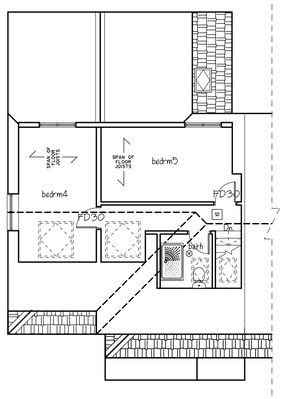

Proposed second floor plan

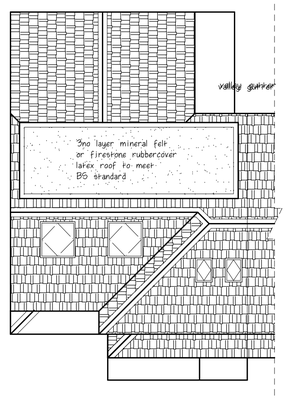

Proposed roof plan

herringbone struts @ mid spans

emergency escape windows min 750mmx 450mm openings

floor joists


5X30 M/s straps @1000 centres

wall straps tied to floors @ 1m centres


45°

Party wall insulation 300g Visqueen on 75mm x 50mm s/wood timber studs @ 600 centres. 75mm rockwool insulation between gaps 12.5 fire-line board and skim.

double up rafters round velux roof light

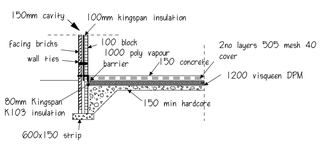

FOUNDATION DETAIL

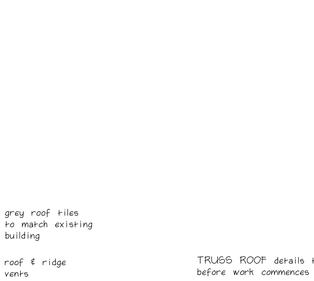

ALTERNATIVE CONSTRUCTION DETAIL

TRUSS ROOF details to be supplied by manufacturer before work commences designed and braced to BS 5268



Electrical:
All electrical taken of existing mains supply by qualified registered electrician to IEE regulations current edition & meets the requirements of part P electrical safety in buildings. Installed and tested by a person competent to do so IE NIC EIC or other approved institute, to BS standards, to clients request and LA satisfaction.

Heating:
Heating and hot water to be taken of existing system. Work to be carried out corgi registered engineer to client's request.

Plumbing:
Soil pipes and accessories to BS4514. 110mm diameter soil & vent pipe positioned externally with mesh cover outlet. Positioned 900mm above any window head. To discharge directly into existing system via 110mm diameter rest. 100mm diameter waste connected to sink. 76mm deep seal traps 38mm waste pipes LB 76mm deep seal traps 32 mm waste pipes provide any syphonic traps, where 50mm diameter common waste pipe is used for one or more appliance.
All pipe works in roof space to be insulated in accordance to BS. 5422:1977

Drains:
All new connections into the existing system via a new inspection chamber. Inspection chamber constructed using 225mm engineering bricks, built on a 100mm thick concrete base. Single seal galvanised mild steel cover and frame fix 100mm diameter vitrified clay channel or similar and bench in 1:3 cement mortar. Drain connections to be determined on site to the complete satisfaction of the building inspector to be self cleansing min 1:40 fall.

Disclaimer:
Syed Helal Uddin Architectural Services does not accept any liability of positions or depths of the drains. This is to be investigated by the contractor prior to commencing work.

All workmanship and materials used must comply with current regulations. All materials shall be fixed, applied or mixed in accordance manufacturer's specification.

The contractor must take into account everything necessary for proper execution of the works to the complete satisfaction of the building inspector whether or not indicated on the drawing.

Dormer Cheeks:
Dormer cheeks to be constructed of 100mm x100mm s/wood timber studs @ max 400mm vertical & horizontal centres. External side of cheeks to be lined with approved matching slates or marley concrete tiles nailed to horizontal 25mm x 50mm s/w battens @ required gauge. Battens nailed onto sarking felt fixed in turn onto 18mm plywood nailed on top of 6mm supalux board. Void spaces between timber to be filled with minimum 100mm kingspanUnterior surface of dormer walls to be lined with 500g visqueen vapour barrier and fire-line board to give minimum 1/2 hr fr.

Use 2 x 100mm x 200mm timber joists bolted together to give support to the dormer cheeks. Dormer walls & cheeks to be min100mm kingspan or similar insulation board to be fitted tightly between frame work to achieve the required 'u' value of 0.18w/m2k.

Dormer: Roof construction.
Flat roof constructed of 3no layers of mineral bitumen roofing felt hot bedded on12mm pre felted plywood on top 98mm kingspan decking vapour barrier on 75-25 x 50mm firings on 75x150 s/wood timber joists @400 centres. 100x75mm wall plate with catnic anchor straps. 12.5mm fire-line board and skim.Code 4 lead flashing and soakers with cavity tray at abutment.

Velux windows:
To be installed in positions shown on x section front side of the roof slope. Velux window (type GPLP06) to form part of the emergency escape window to be located max 1700mm away from eaves gutter and min 800mm above floor level. Exact position to be decided on site with approval from La building inspector.

Glazing:
Dormer windows to form emergency escape with min opening of 850mm x 500mm. Upvc double glazing ABD.

All side window and door glass to be safety glazing. Exterior Upvc frame with one part opening and Trickle vents with no less than 8000sq mm in area. Measures to be taken to deal with thermal bridging install draught seals to inspector's satisfaction. Note glazing to be 'k' Pilkington glass fitted with 22mm air gap filled with Argon gas and soft low e coating to achieve a U value of 1.4w/m2k.

Plumbing:
Soil pipes and accessories to BS4514. 110mm diameter soil & vent pipe positioned externally with mesh cover outlet. Positioned 900mm above any window head, to discharge directly into existing system via 110mm diameter rest bend.

New beams:
New ridge beam and beam to front of dormer see structural Engineers notes.

ROOF CONSTRUCTION:
Concrete interlocking tiles or Marley grey roof tiles on 37x25 s/w battens on un rearable sarking felt to BS 747 type on timber roof trusses by specialist manufacturer @ 30 degree pitch (check existing slope before manufacture to match existing) at 400mm centres. Trusses sat on 100x75mm wall plates at each end strapped to gabble with 30x5mm galvanised m/s straps @ 900mm centres to BS 5208 part2.
150mm fibre glass insulation between joists and a further 150mm laid across @ right angles to each other and 9.5mm fire line plaster board, skim and finish ceiling. 225mm x 75mm Upvc fascia board under gutter, leaving 50mm gap at eaves for ventilation. (U value of 0.15/m2) code 4 lead flashing and cavity tray at abutment.

GENERAL NOTES:
Building regulations notes to read in conjunction with drawings and structural engineers calculations & notes:
1. this drawing is only prepared for submission under building regulations and planning legislation and is not to be used as a working drawing.
2. asbestos, it is important that a check is madefor the presence of asbestos or materials containing asbestos and any necessary action taken before any work is begun. any action taken must comply with current relevant legislation.
3. all materials and workmanship to be to the appropriatestandard and/code of practice/ agrément certificate.
4. windows to be not less than 1/10th of the floor areato habitable rooms.
5. opening light to windows to be not less than 1/20th of the floor area.
6. trickle ventilations to heads of all windows to give not less than 8000mm2 of free air area.
7. no dimensions to be scaled off this drawing.
8. all drainage passing through the building must be encased in a minimum of 6" of concrete.
9. all figured dimensions to be checked on sight before any works are put on hand.
10. new walls either bonded into existing or mechanically connected.
11. cavities to be continued through.
12. vertical and horizontal damp proof membrane to all external openings.
13. all work drainage to the complete satisfaction of the local authority.
14.90mm minimum bearing to all structural timber.
15. 225mm minimum structural bearing to all structural steelwork.
16. universal beams to rest on 6" insitu concrete padstone.17. catnic or other approved lintels over new or altered openings.
18. mechanical ventilation to kitchen (250m3/h) and bathroom (170l/h).
19. permission required in writing from affected neighboursbefore plans are submitted or any work is put in-hand orundertaken which ever comes first.
20. it may be that covenants exist on all or part of the property/land - the applicant is advised to check before proceeding, there are also the requirements of the party wall act 1996, which the owner must take into account if the works are affected by this legislation.

BEAMS:
Blast clean, prime & paint all steelwork before fixing.
Builder to provide adequate support peirs below beams
Where parallel beams used use 100x5300 M.s restraint bars fixed to both flanges at each and mid-span by welding or bolting with M20 8.8 bolts.

Notes:

Foundations:
600mm x150mm concrete strip footings to project at either side, FDN6 taken minimum 750mm below ground level to suit conditions and below any adjacent drains to the complete satisfaction of the building inspector.

FLOOR:
65mm screed on 1000 grade poly vapour barrier on 80mm Kingspan Kooltherm K103 (U value of 0.18/m2k) with minimum 12mm floor edgeinsulation and opening closures. 1200 gauge visqueen gas/ Methane barrier taken to DPC across whole site. Joints to be taped and taken up inside face and linked into DPC, above 150mm above ground level over 150mm concrete slab with 1no A142 (BS 503) mesh 40 cover, 50mm sand blinding on 150 graded builders hardcore.

Wall constructions kitchen:
Block, sand & cement render to match existing house outer leaf with a 150mm minimum cavity with 100mm kingspan insulation block (U value of 0.18W/m2K. 100mm thick high strength 7N thermolite hurbo block or 100mm celcon block inner leaf and finish internally with 12.5mm plaster board and skim.

Cavity wall ties:
250mm stainless steel butterfly ties to BS1243 every 750mm horizontally and 450mm vertically. Cavity closers cut stone or block to eaves and verges reveal and cut block openings.

Lintels:
Suitable IG lintels over new window and door openings min 150mm end bearing with cavity tray over

Rain water:
110mm diameter half round gutter 68mm diameter rainwater pipe.

Walls:
All internal timber partition to be constructed of 50mm x 75mm s/w ood battens @ max 600mm centres vertical and horizontal. Void between frame-work to be filled in with 100mm fibre glass quilt insulation. Fire-line both side of partition to min 1/2 hr fr.

Ventilation:
Provide min 4no vent tiles with 2no @ high level near ridge & 2no low level to front side of sloping roof.

Staircase:
Max rise 210 min going 233 max angle 42 degrees with min head room 2000mm.
Hand-rails @ 900mm above pitch line.
1. is imperative new floor to floor height is confirmed prior to manufacture of new timber stairs.
Under draw and fire-line board to give min 1/2 hour fr.

Existing staircase:
Fire-line 12.5mm plasterboard under draw and skim.

First floor construction:
50mm x 150mm timber joists minimum 100mm into outside walls either side of window @ 400mm centres or 50mm x 150mm timber wall plates with proprietary bolts on shoe joist. 22mm TEG chipboards fixed down on top of Timber joists 50mm x 150mm @ 400 centres. Min 100m into wall or 100mm thick rockwool quilt insulation laid between timber floor joists supported by chicken wire draped around floor joists min 10kg /m3 density. 12.5mm fire-line board min 2no layers and skim to achieve 1/2 hour F.R.

Smoke detectors:
Install automatic smoke detectors to mains power and battery backup and interlinked where shown on plan.


Heat detector: HD
Fit one main's wired heat detector to kitchen to BS 5839 Part 1

Doors: FD6
All escape route passage doors to be fire doors with self closures and smoke sealed except W.C/bathroom.


Height of electrical sockets and switches from finished floor level.(with 450mm-1200mm)




Proposed front elevation



Proposed side elevation (East)

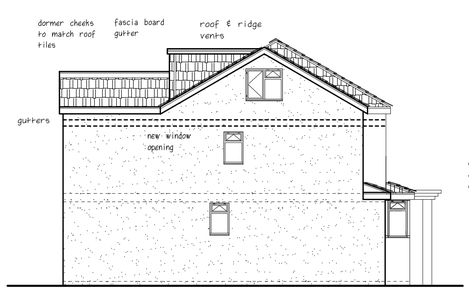


Proposed side elevation (West)

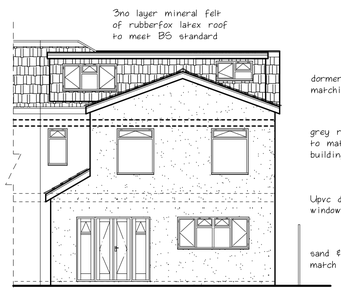


Proposed rear elevation

SECTION THRO TRUSSED ROOFING AREA

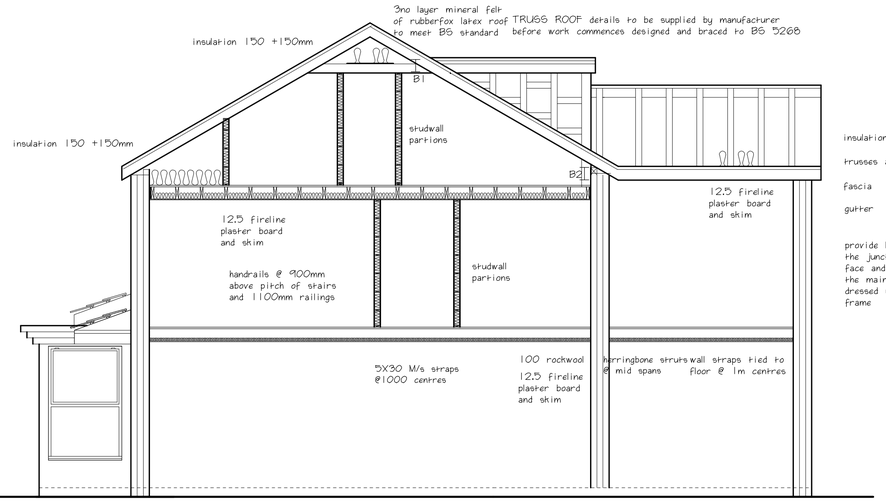

Proposed side elevation cross section scale:1:50



SVP THRU SEPERATING FLOOR DETAIL

DRAWING AMENDED FOR PLANNING 18/06/2026

0 1 2 3 4 5 6 7 8 9 10 1:100

0 1 2 3 4 5 1:50

SYED HELAL UDDIN ARCHITECTURAL SERVICES
58 SOUTHWOOD DRIVE, BAXENDEN, ACCRINGTON, LANCASHIRE. BB5 2PZ
TEL:01254 238202 FAX:0879 2352826
MOBILE: 07879 261142
EMAIL: SYEDHELALUDDIN@YAHOO.COM

SCALE:1:100 PAGE 2/2 (A1)

DRAWING NO: 2098 VER 2

PROPOSED LAYOUT

LOCATION: 16 SOLENT AVENUE, MANCHESTER, M8 4QA

PROP: TWO/SINGLE STOREY EXTENSION & ALTER ROOF INTO GABLE TO ACCOMMODATE REAR DORMER EXTENSION

CLIENT: MR. THAIR IQBAL

DATE: May 2026

PLEASE DO NOT SCALE DRAWING