
Lobby door partion fire rated lining to terminate under new fire rated bulkhead. Structure within the bulkhead to remain as exposed framing to allow MEP routes to pass through. Framing within the bulkhead to extend up to slab level and act as structural support only. Fire rating to continue uninterrupted through the full bulkhead zone. Sides of bulkhead to be fully lined with 60min fire rating (2x 15mm fire rated plasterboard)

Ensure fire-rated partitions extends fully to soffit level to maintain continuous fire protection to both sides of the partion inside the bulkhead. All penetrations through fire-rated construction to be sealed with approved 60min rated fire-stopping systems, including fire collars, wraps, sealants and associated components, as required to maintain the specified fire rating.

Ensure fire-rated partitions extends fully to soffit level to maintain continuous fire protection to both sides of the partion inside the bulkhead. All penetrations through fire-rated construction to be sealed with approved 60min rated fire-stopping systems, including fire collars, wraps, sealants and associated components, as required to maintain the specified fire rating.

Partions fire rated linings to terminate under new fire rated bulkhead. Structure within the bulkhead to remain as exposed framing to allow MEP routes to pass through. Framing within the bulkhead to extend up to slab level and act as structural support only. Fire rating to continue uninterrupted through the full bulkhead zone.

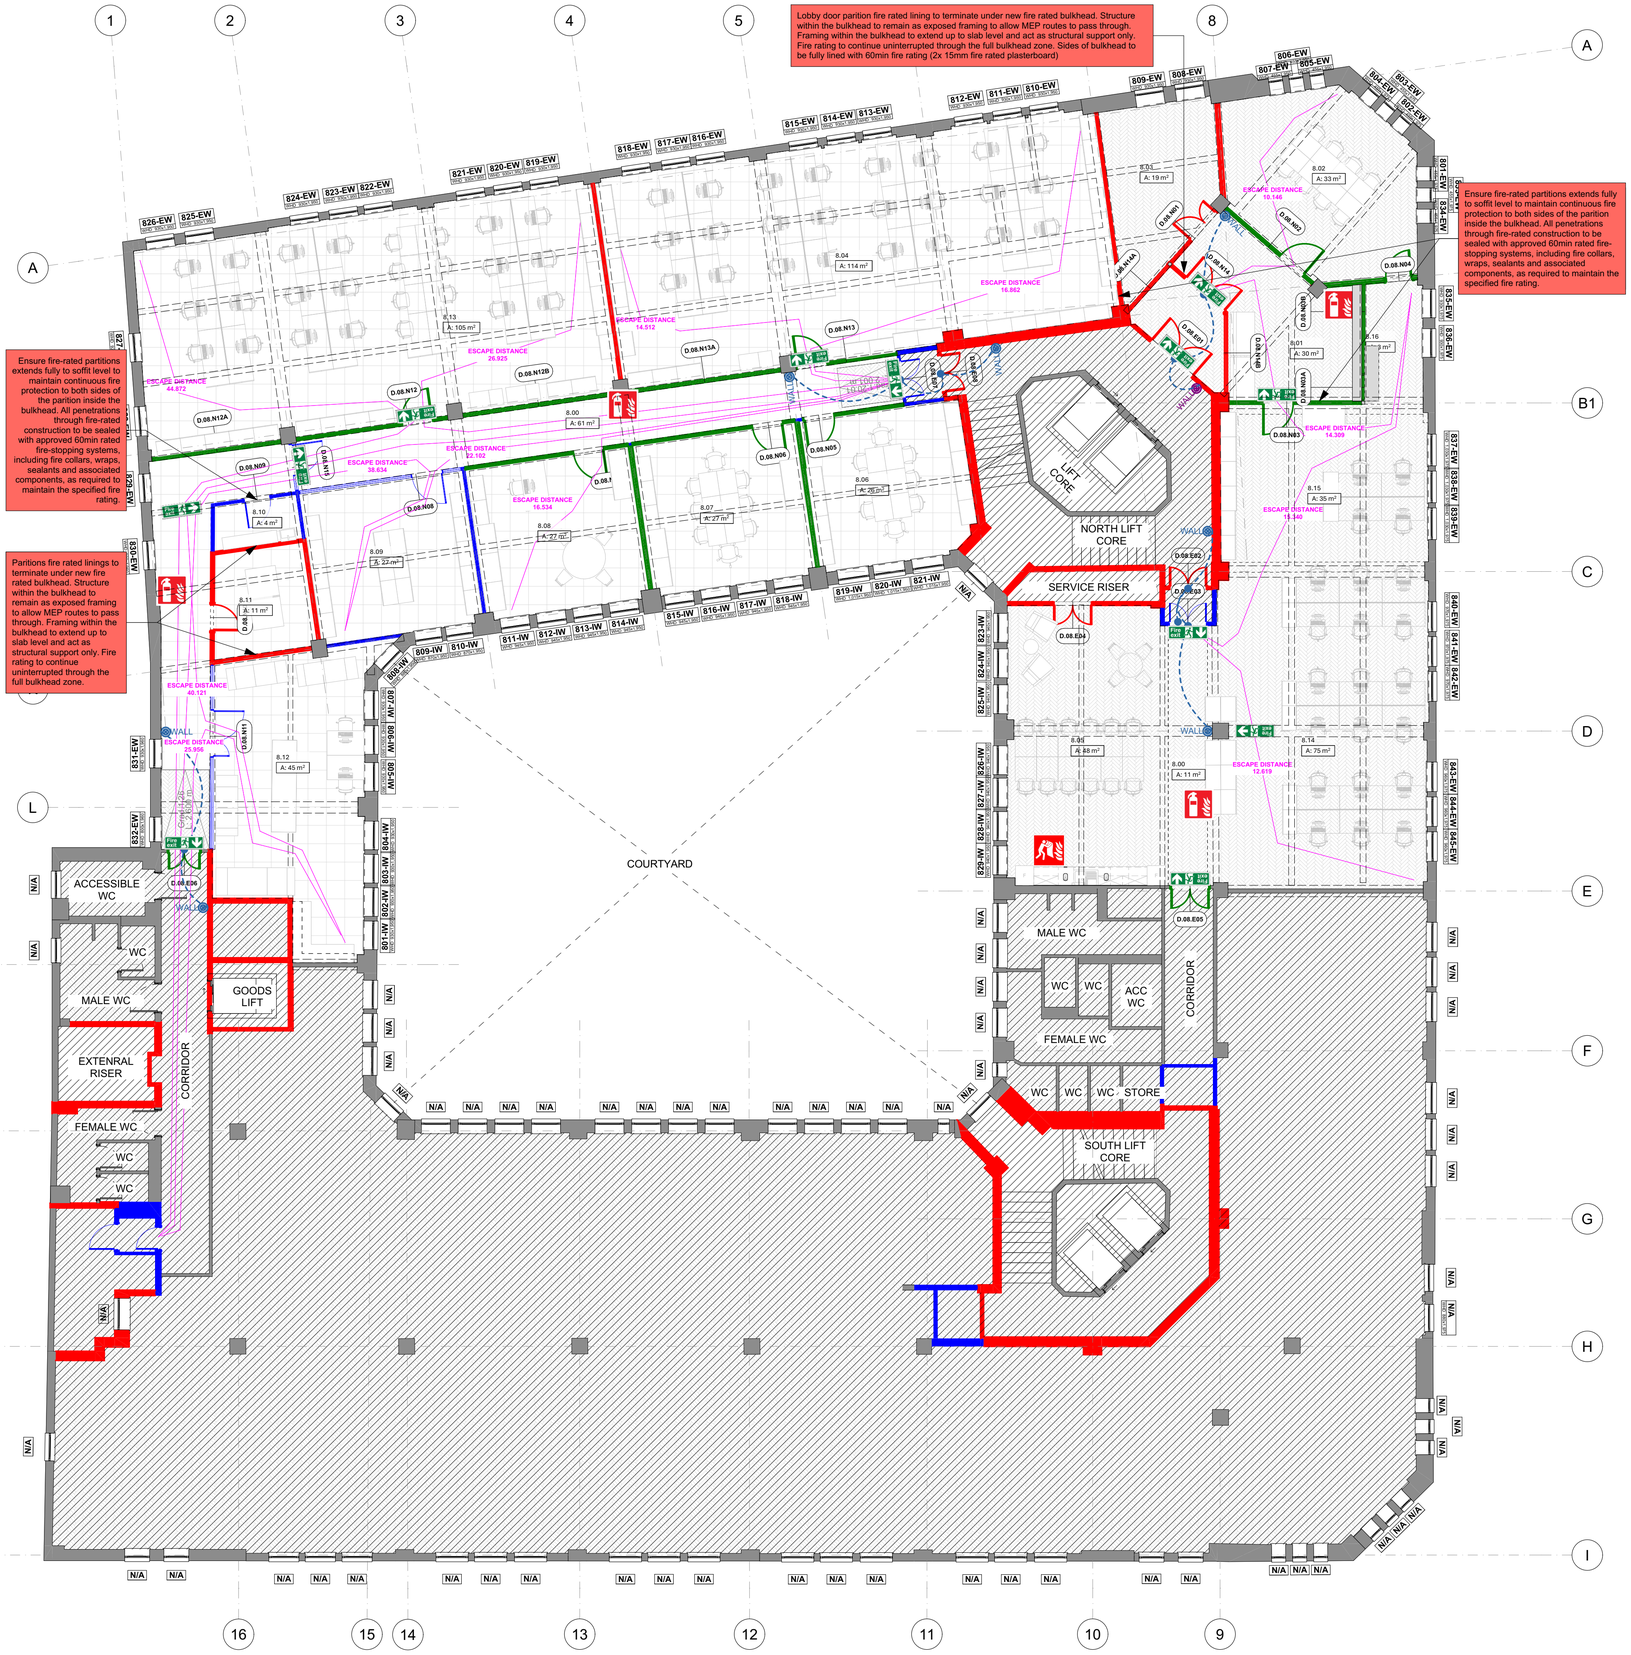

Key

- Scope of Works Boundary
- Out of Scope
- Existing Wall
- **60 Minute Fire Rating Required**
- **30 Minute Fire Rating Required**
- **No Fire Rating Required**
- **60 Minute Fire Rated Doorset**
- **30 Minute Fire Rated Doorset**
- **Illuminated Fire Exit Sign (Direction Shown)**
- **Fire Blanket**
- **Fire Extinguishers (H20 & C02) TBC BY CLIENT FMT**
- **No Fire Exit sign**

Access Tap to Open - Automatic door opening types
General Circulation shown only (refer to MEP drawings for each room access)

- WALL **Wall mounted access** — Fire Event: Stop powered opening and release door tension if fire alarm triggered.
- POLE **Floor mounted access on column** — Fire Event: Stop powered opening and release door tension if fire alarm triggered.
- **Door circuit route** — Fire Event: Stop powered opening and release door tension if fire alarm triggered.
- WALL **Wall mounted access - Public access button** — Fire Event: Stop powered opening and release door tension if fire alarm triggered.

THE FIRE STRATEGY SHALL BE READ IN CONJUNCTION WITH THE APPROVED FIRE STRATEGY REPORT AND BUILDING CONTROL COMMENTS.

ALL MEANS OF ESCAPE, TRAVEL DISTANCES, DOOR POSITIONS AND FIRE COMPARTMENTATION SHALL BE CONFIRMED AS PART OF THE CONTRACTOR'S DETAILED DESIGN AND SUBJECT TO BUILDING CONTROL APPROVAL.

ANY CHANGES TO LAYOUT THAT MAY IMPACT FIRE STRATEGY SHALL BE REFERRED TO THE FIRE CONSULTANT AND BUILDING CONTROL PRIOR TO IMPLEMENTATION.

ALL FIRE RATED CONSTRUCTION SHALL BE INSTALLED IN ACCORDANCE WITH TESTED SYSTEMS AND CERTIFICATION.

Level 08 **1:100**

Scale 1:100 — A1

Scale Bars

1:1000 · 1:500 · 1:200 · 1:100 · 1:50

Rev	Date	Description	Produced	Approved
L03	09/07/2026	Conditions Discharge Planning Application	SM	SM

Revision Status
STAGE 3 CONDITIONS

Notes:
Responsibility is not accepted for others scaling directly from this drawing. Do not scale from this drawing. Use written dimensions only. Where scaling is unavoidable, check the scale bar and confirm the drawing is printed to scale. Any errors, omissions, or discrepancies must be reported to Evoke Architecture prior to commencement of works. Work to figured dimensions only and verify all dimensions on site. This drawing is produced for use in this project only and for the purpose for which it was issued, as recorded in the title block under 'Project Stage'. It may not be used for any other purpose. Evoke Architecture accepts no liability for use of this drawing beyond its intended purpose. Copyright remains with Evoke Architecture. This drawing must not be copied, reproduced, or used by any third party without the express written permission of Evoke Architecture.

Stage
RIBA STAGE 3

Site Address
SUNLIGHT HOUSE
LITTLE QUAY STREET
MANCHESTER
M3 3HP

Project No.	Date
30279810	09/07/2026

Drawn By	Checked By
SM	SM

Drawing Name
Level 08 - Proposed Fire Compartmentation

Drawing No.
30279810-EVK-MAN-08-DR-AR-01502

Revision No.	Reference Code
L03	26-001

Evoke Architecture Limited
16 Bridge Street Row West
Chester | United Kingdom
CH1 1NN | 0151 315 1112
evokearchitecture.com

Level 08 - Proposed Fire Compartmentation

L03

30279810-EVK-MAN-08-DR-AR-01502-01