
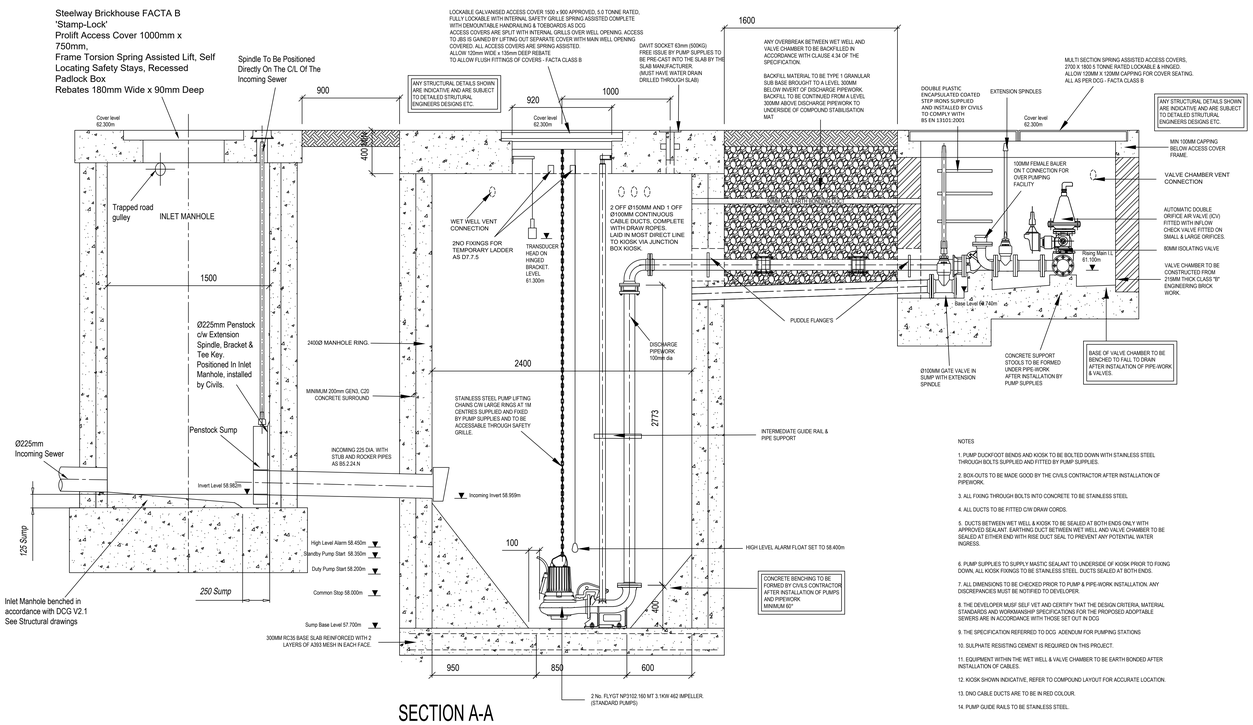



SECTION A-A

NOTES


1. PUMP DUCKFOOT BENDS AND KIOSK TO BE BOLTED DOWN WITH STAINLESS STEEL THROUGH BOLTS SUPPLIED AND FITTED BY PUMP SUPPLIES.
2. BOX-OUTS TO BE MADE GOOD BY THE CIVILS CONTRACTOR AFTER INSTALLATION OF PIPEWORK.
3. ALL FIXING THROUGH BOLTS INTO CONCRETE TO BE STAINLESS STEEL
4. ALL DUCTS TO BE FITTED C/W DRAW CORDS.
5. DUCTS BETWEEN WET WELL & KIOSK TO BE SEALED AT BOTH ENDS ONLY WITH APPROVED SEALANT. EARTHING DUCT BETWEEN WET WELL AND VALVE CHAMBER TO BE SEALED AT EITHER END WITH RISE DUCT SEAL TO PREVENT ANY POTENTIAL WATER INGRESS.
6. PUMP SUPPLIES TO SUPPLY MASTIC SEALANT TO UNDERSIDE OF KIOSK PRIOR TO FIXING DOWN. ALL KIOSK FIXINGS TO BE STAINLESS STEEL DUCTS SEALED AT BOTH ENDS.
7. ALL DIMENSIONS TO BE CHECKED PRIOR TO PUMP & PIPE-WORK INSTALLATION. ANY DISCREPANCIES MUST BE NOTIFIED TO DEVELOPER.
8. THE DEVELOPER MUSF SELF VET AND CERTIFY THAT THE DESIGN CRITERIA, MATERIAL STANDARDS AND WORKMANSHIP SPECIFICATIONS FOR THE PROPOSED ADOPTABLE SEWERS ARE IN ACCORDANCE WITH THOSE SET OUT IN DCG
9. THE SPECIFICATION REFERRED TO DCG ADENDUM FOR PUMPING STATIONS
10. SULPHATE RESISTING CEMENT IS REQUIRED ON THIS PROJECT.
11. EQUIPMENT WITHIN THE WET WELL & VALVE CHAMBER TO BE EARTH BONDED AFTER INSTALLATION OF CABLES.
12. KIOSK SHOWN INDICATIVE, REFER TO COMPOUND LAYOUT FOR ACCURATE LOCATION.
13. DNO CABLE DUCTS ARE TO BE IN RED COLOUR.
14. PUMP GUIDE RAILS TO BE STAINLESS STEEL.

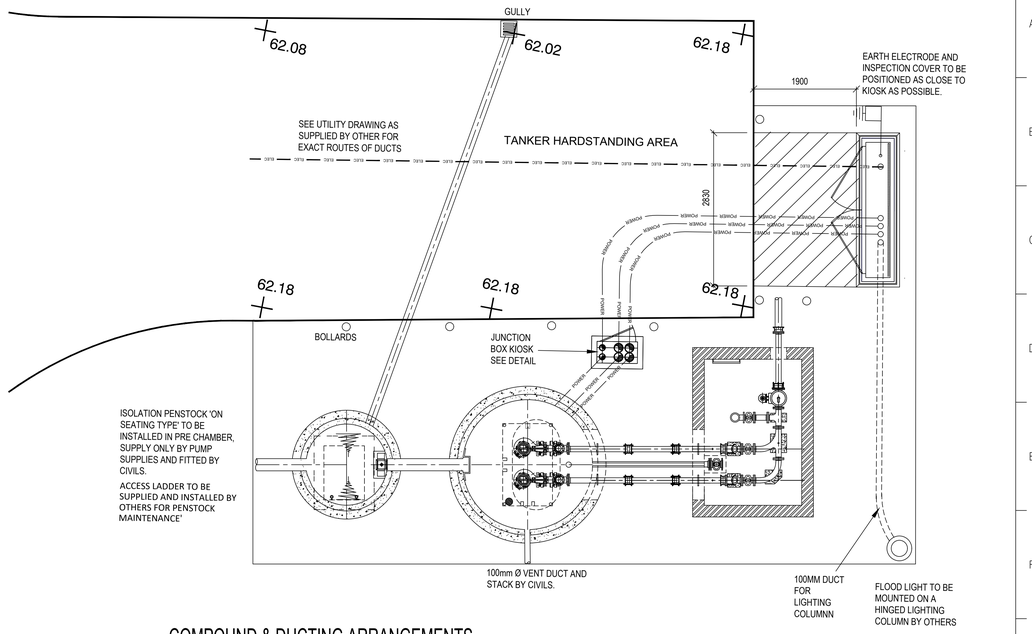

COMPOUND & DUCTING ARRANGEMENTS

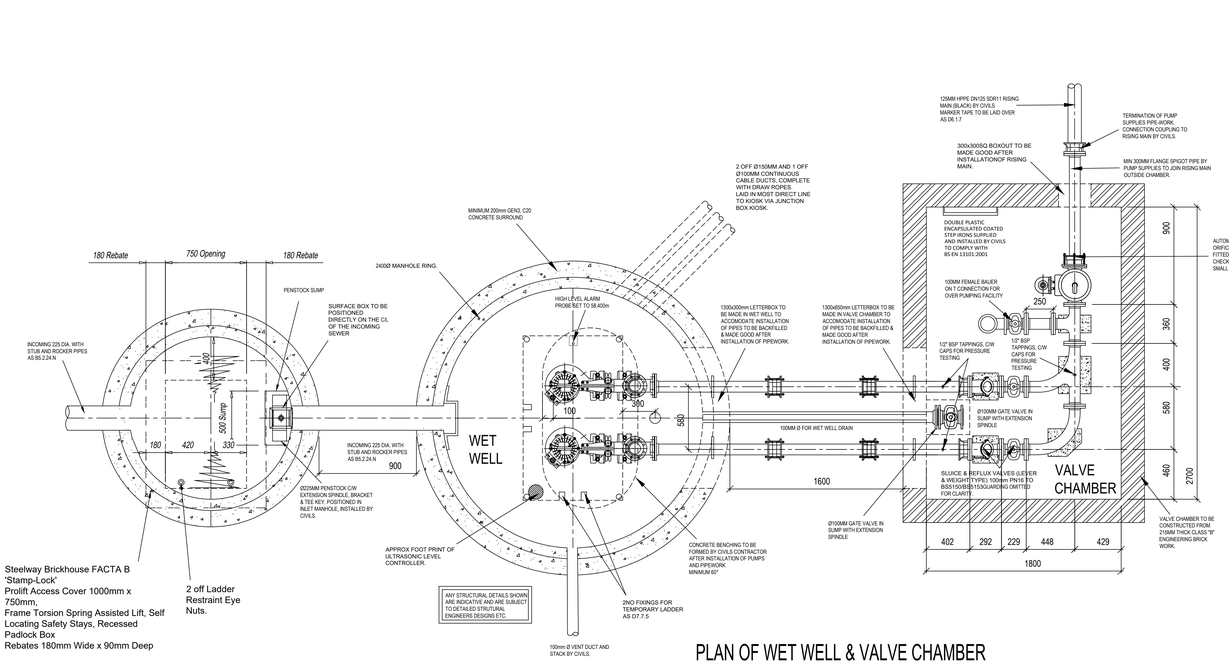


PLAN OF WET WELL & VALVE CHAMBER

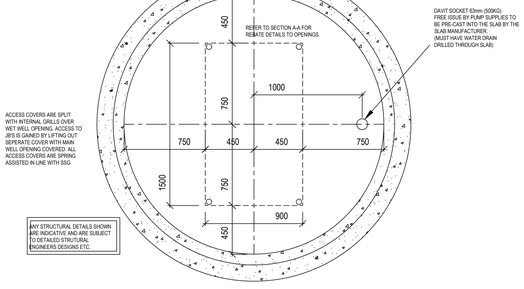



WET WELL ACCESS OPENING POSITION

VALVE CHAMBER ACCESS OPENING POSITION

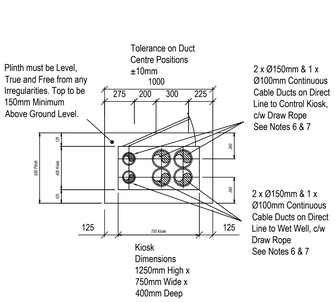

JUNCTION BOX KIOSK PLINTH DETAIL



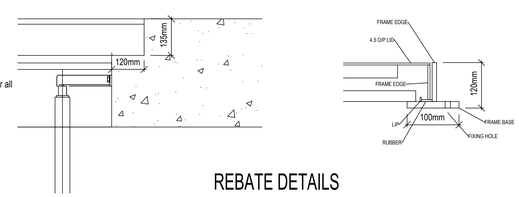

REBATE DETAILS

ISSUED FOR APPROVAL

REV	DATE	DESCRIPTION
F	14.09.25	REVISED IN ACCORDANCE WITH ESP COMMENTS
E	16.07.25	REVISED IN ACCORDANCE WITH ESP COMMENTS
D	27.03.25	REVISED IN ACCORDANCE WITH LATEST COMPOUND LAYOUT
C	04.03.25	INVERT LEVEL TO PENSTOCK MANHOLE AMENDED
B	28.01.25	COMPOUND GATES REMOVED
A	25.11.24	AMENDED TO NAV SPECIFICATIONS

CLIENT

KELLEN HOMES

PUMP & PUMPING STATION SPECIALISTS

BROWNING WAY, WOODFORD PARK INDUSTRIAL ESTATE
WINSFORD, CHESHIRE CW7 2JR
TEL :- 01606 863343
FAX:- 01606 863159

TITLE MOUNT ROAD, GORTON

TITLE GENERAL ARRANGEMENT OF 2 SUBMERSIBLE SURFACE WATER PUMPS

DRAWN	DATE	ORIGINAL SCALE	ORIGINAL SIZE
JL	26.06.24	1:20	A0

DRAWING NUMBER	SHEET	REV
24-073-1	001	F

DO NOT SCALE