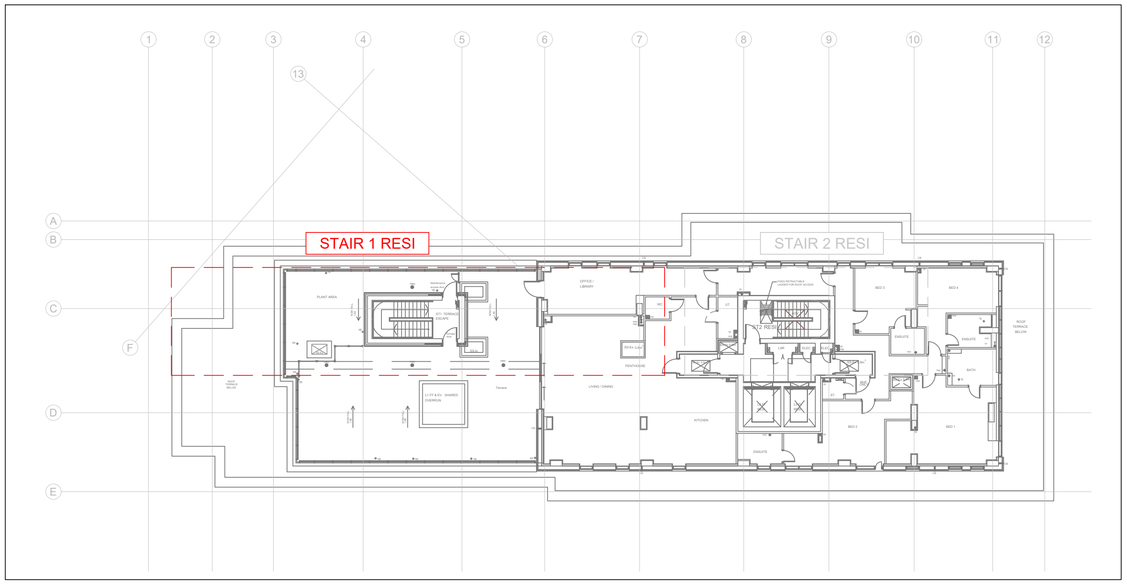


LEVEL 25 (TWENTY FIVE)
(SCALE 1:200)


VENTEC BLADE AOV (TYPE 1) ABOVE

AUTOMATIC TRANSFER SWITCH ATS
INDICATIVE SIZE SHOWN
(NOT WITHIN VENT SCOPE OF WORKS)

VENTEC ORANGE FIREFIGHTER'S SWITCH OFS OSS
(STAIR 1)

VENTEC FCP11 FAN CONTROL PANEL 11kW (23.5A)
1000 x 800 x 363
(TO BE MOUNTED ON UNISTRUT FRAME)

VENTEC SEF: 01 & 02 Ø800 - 6.90m³/s @ 525Pa
AXIAL EXTRACT FAN SET- DUTY / STANDBY
SEE DRAWING No: CBR-VE-XX-XX-DR-Z-205

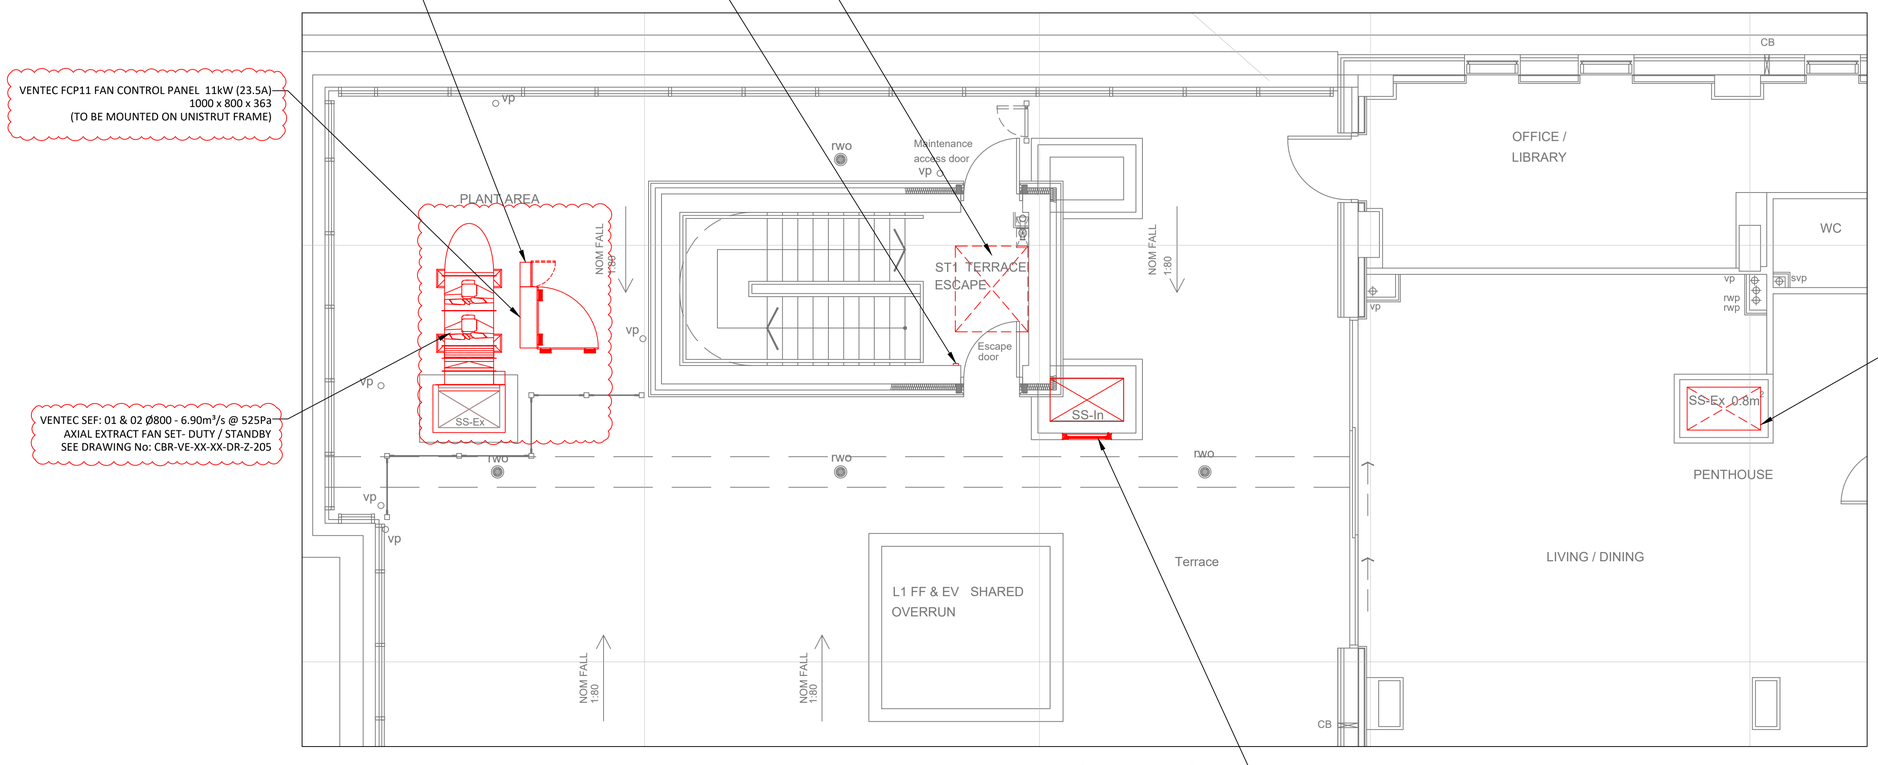

EXTRACT SHAFT 2 CONTINUES TO LEVEL 26 (ROOF) ABOVE
NOT IN USE AT THIS LEVEL

VENTEC VELO (TYPE 4) HEAD OF INLET SHAFT
SEE DRAWING No: CBR-VE-XX-XX-DR-Z-214

STAIR 1 LEVEL 25 (TWENTY FIVE)
(SCALE 1:50)

ALL DIMENSIONS ARE IN MILLIMETRES

IF IN DOUBT ASK

NOTE:

THE SMOKE SHAFT IS A BUILDERS WORK RISER (NOT IN VENT'S SCOPE OF WORKS). IT MUST BE TO THE AGREED DIMENSIONS, WITH A SMOOTH INTERNAL FINISH & SUFFICIENTLY SEALED TO LIMIT THE LEAKAGE RATE TO 3.8m³/h/m² AT 50 Pa. NO OTHER BUILDING SERVICES SHOULD BE CONTAINED WITHIN THE SMOKE SHAFT.

REV	DATE	DETAILS	DRW BY	CHK BY
CO1	07.08.25	FANSET UPDATE	HW	CJP
CO0	16.07.25	CONSTRUCTION ISSUE	HW	CJP
R04	04.07.25	GA UPDATED BLADE REPLACED FOR VELO CR07,CR08	MC	CJP
R03	02.06.25	DRAWING NUMBER UPDATED CR04	HW	CJP
R02	22.05.25	PANELS MOVED AND FAN ORIENTATION/DETAIL UPDATED	CJP	CJP
R01	25.03.25	DRAWING NUMBER CORRECTED CR01	HW	CJP
R00	21.03.25	FIRST ISSUE FOR APPROVAL	CIP	CJP

DRAWING REVISION DETAILS

VENTEC HOUSE
UNIT 16 CHALWYN INDUSTRIAL ESTATE
POOLE, DORSET. BH12 4PE
TEL. +44(0)1202 744958
www.vent.co.uk

©2025 Ventec 100 Ltd

CLIENT:
MATIC

PROJECT:
CORNBROOK
MANCHESTER

SALES ORDER No:
631531

DRAWING TITLE:
STAIR 1
LEVEL 25
(TWENTY FIVE)

DRAWING STATUS:
◯ APPROVAL
Ⓧ CONSTRUCTION
◯ AS BUILT

DRAWN:	DATE:	SCALE:	SHEET:
CIP	30.06.25	AS SHOWN	A1

DRAWING No.: CBR-VE-ZZ-25-DR-Z-106
REV: CO1

BACKGROUND DETAIL TAKEN FROM:
LEACH RHODES WALKER ARCHITECTS 8353-LRW-ZZ-22-DR-A-20-107 REV.P02